


- NOTES:
1. SEE ARCHITECTURAL DRAWINGS TO VERIFY LOCATION & DIMENSIONS OF OPENINGS.
 2. PROVIDE 8" OF BEARING AT EACH END (MIN.).
 3. REINFORCING SHALL PROJECT A MINIMUM OF 1'-4" BEYOND OPENING.
 4. LINTELS TO BE PROVIDED BY CASTCRETE OR EQUIVALENT SUPPLIER

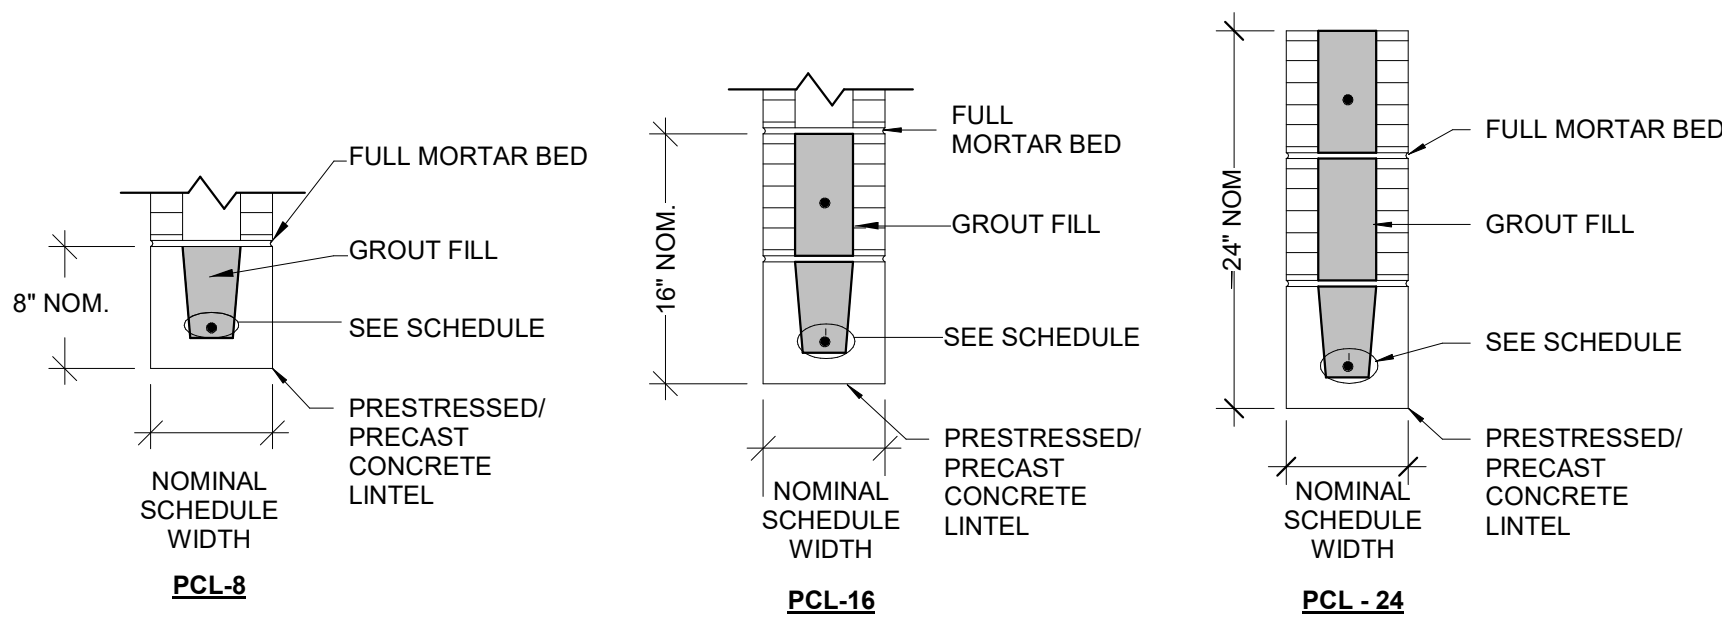


LINTEL SCHEDULE (PCL)					
TYPE	WALL SIZE NOMINAL WIDTH	LINTEL DEPTH	MAXIMUM CLEAR SPAN	REINFORCING	REMARKS
PCL - 8	8"	8"	4'-6"	1-#5	BOT
PCL - 16	8"	16"	10'-0"	1-#5	TOP & BOT
PCL - 24	8"	24"	14'-0"	1-#5	TOP & BOT

NOTES:


1. THE SIZES SHOWN ABOVE ARE THE MIN. REQUIRED UNLESS SIZE SHOWN ON PLAN
2. OPENINGS BEYOND 14'-0" REQUIRE A CONCRETE BEAM. CONSULT E.O.R. FOR GUIDANCE

1 LINTEL SCHEDULE
SCALE N.T.S.

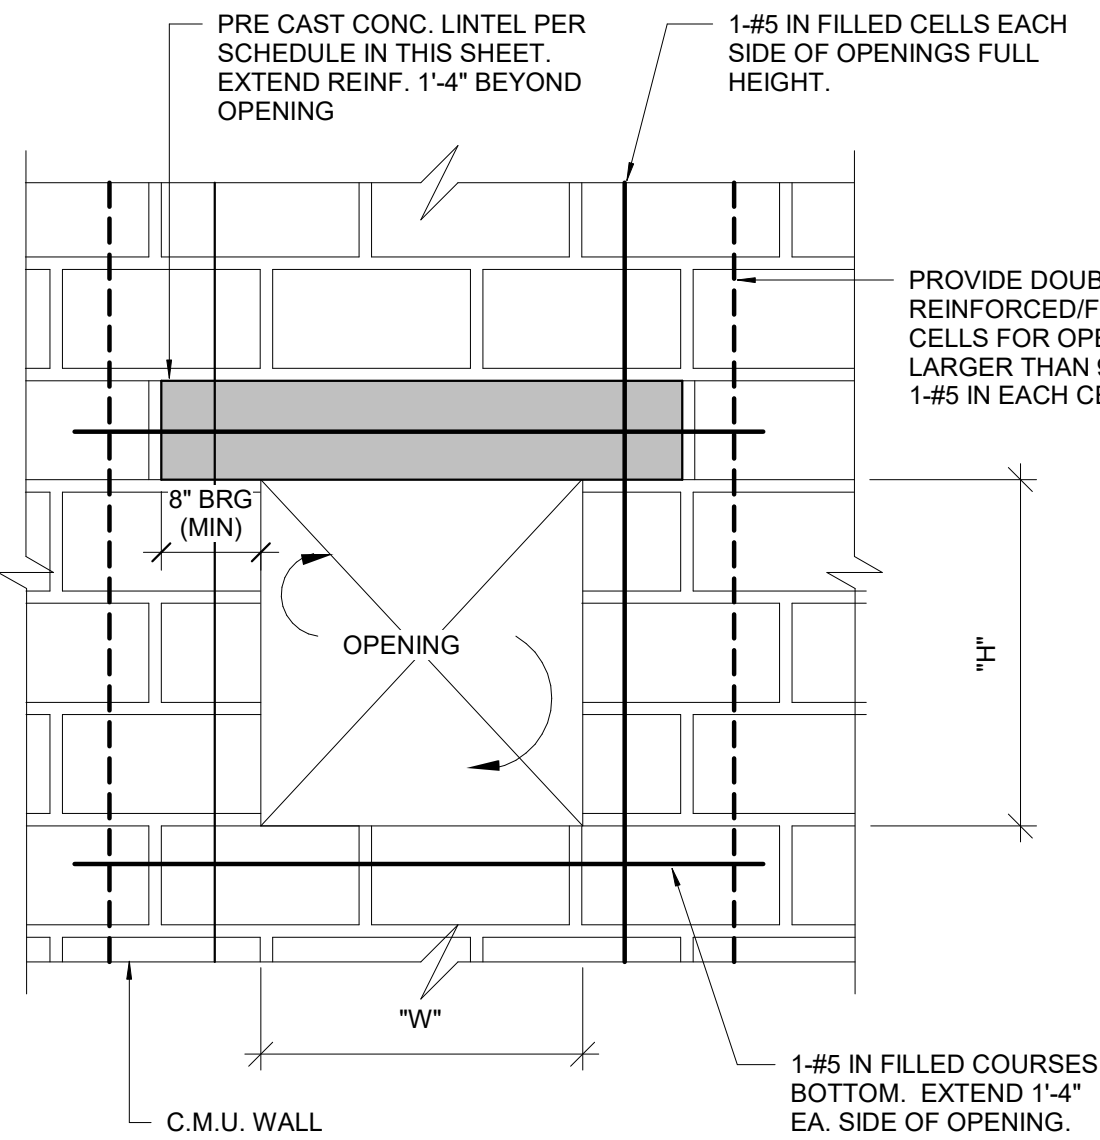


NOTE:
REFER TO ARCH. DWGS. FOR SIZES & LOCATIONS OF OPENINGS.

2 TYP. WALL OPENING
SCALE N.T.S.

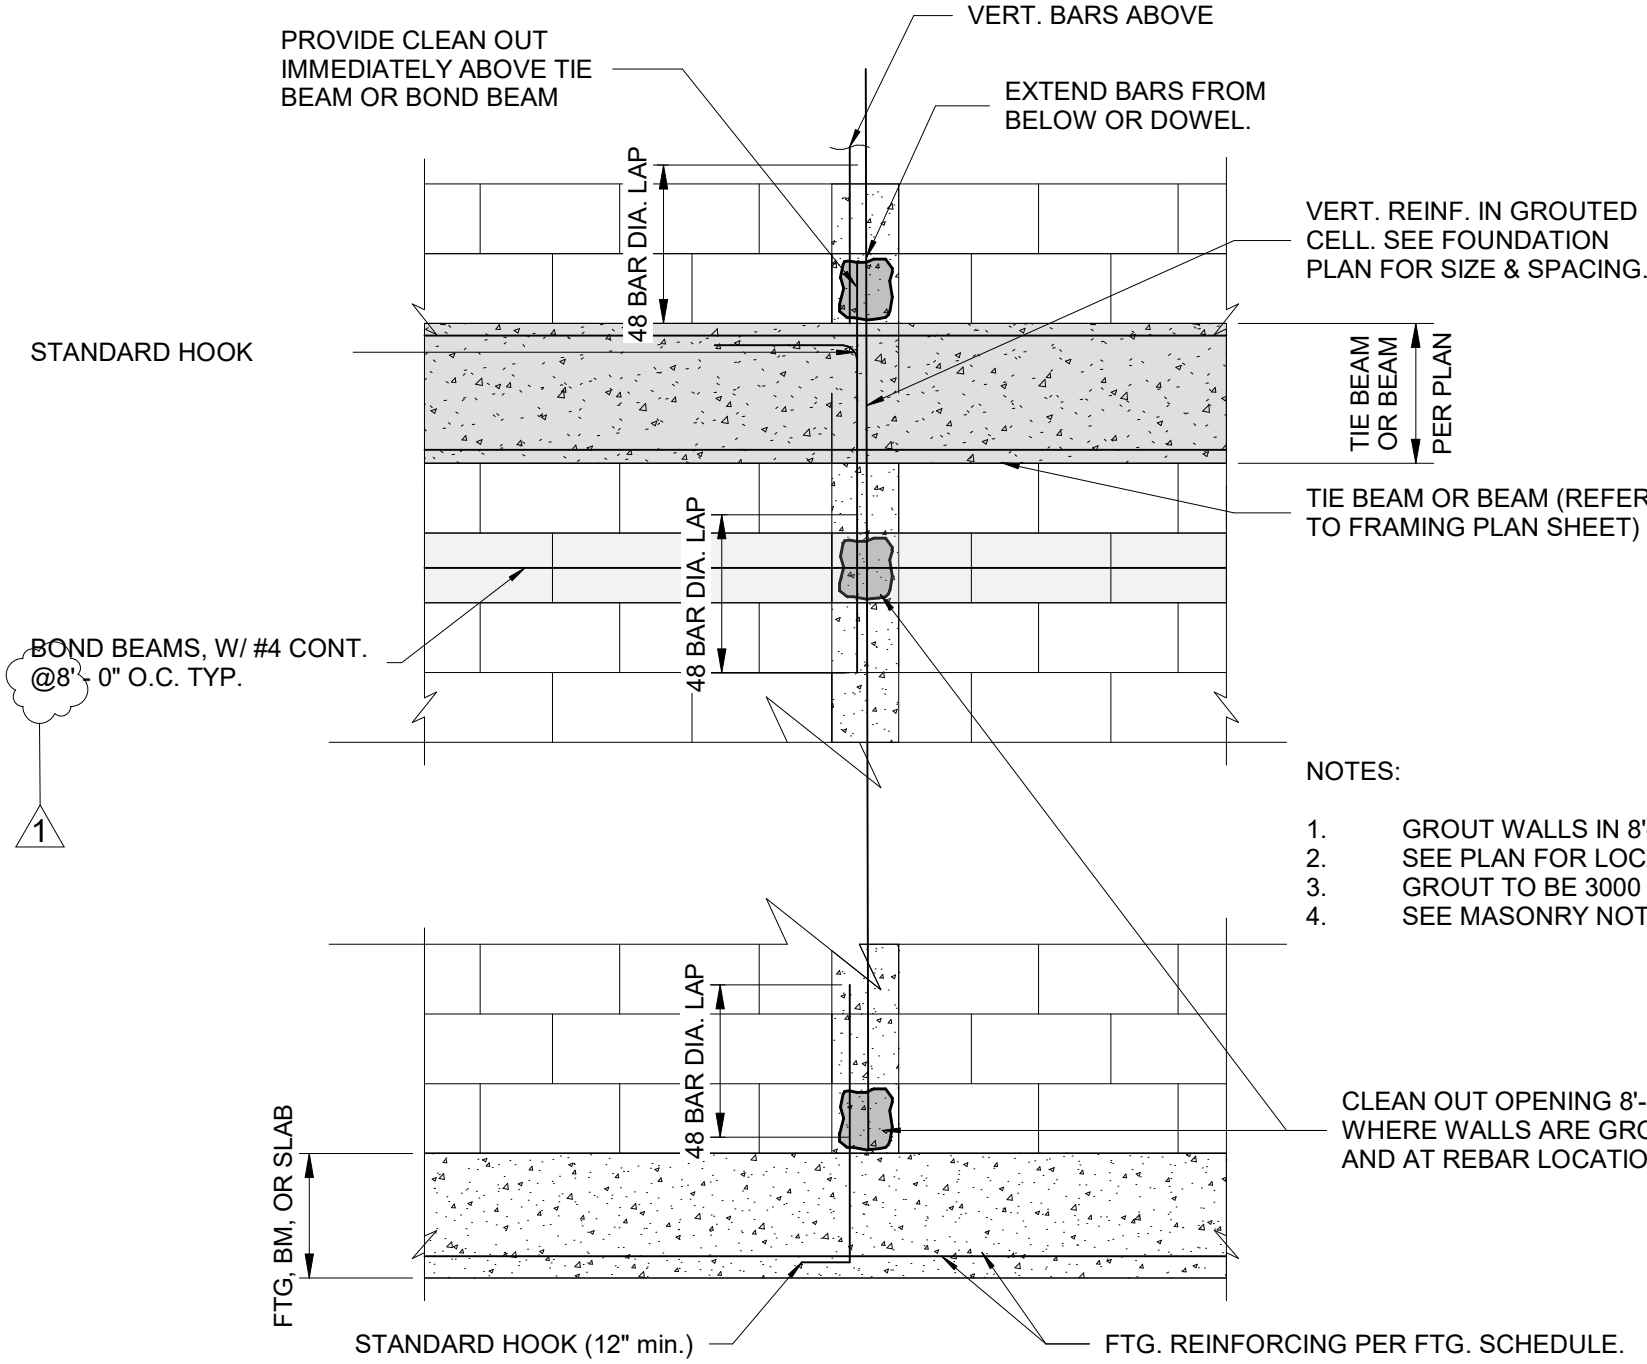

- NOTES:
1. GROUT WALLS IN 8'-0" LIFTS.
 2. SEE PLAN FOR LOCATION OF REINFORCEMENT.
 3. GROUT TO BE 3000 PSI
 4. SEE MASONRY NOTES, SHEET S-101

3 TYP. CMU WALL CONSTRUCTION
SCALE N.T.S.

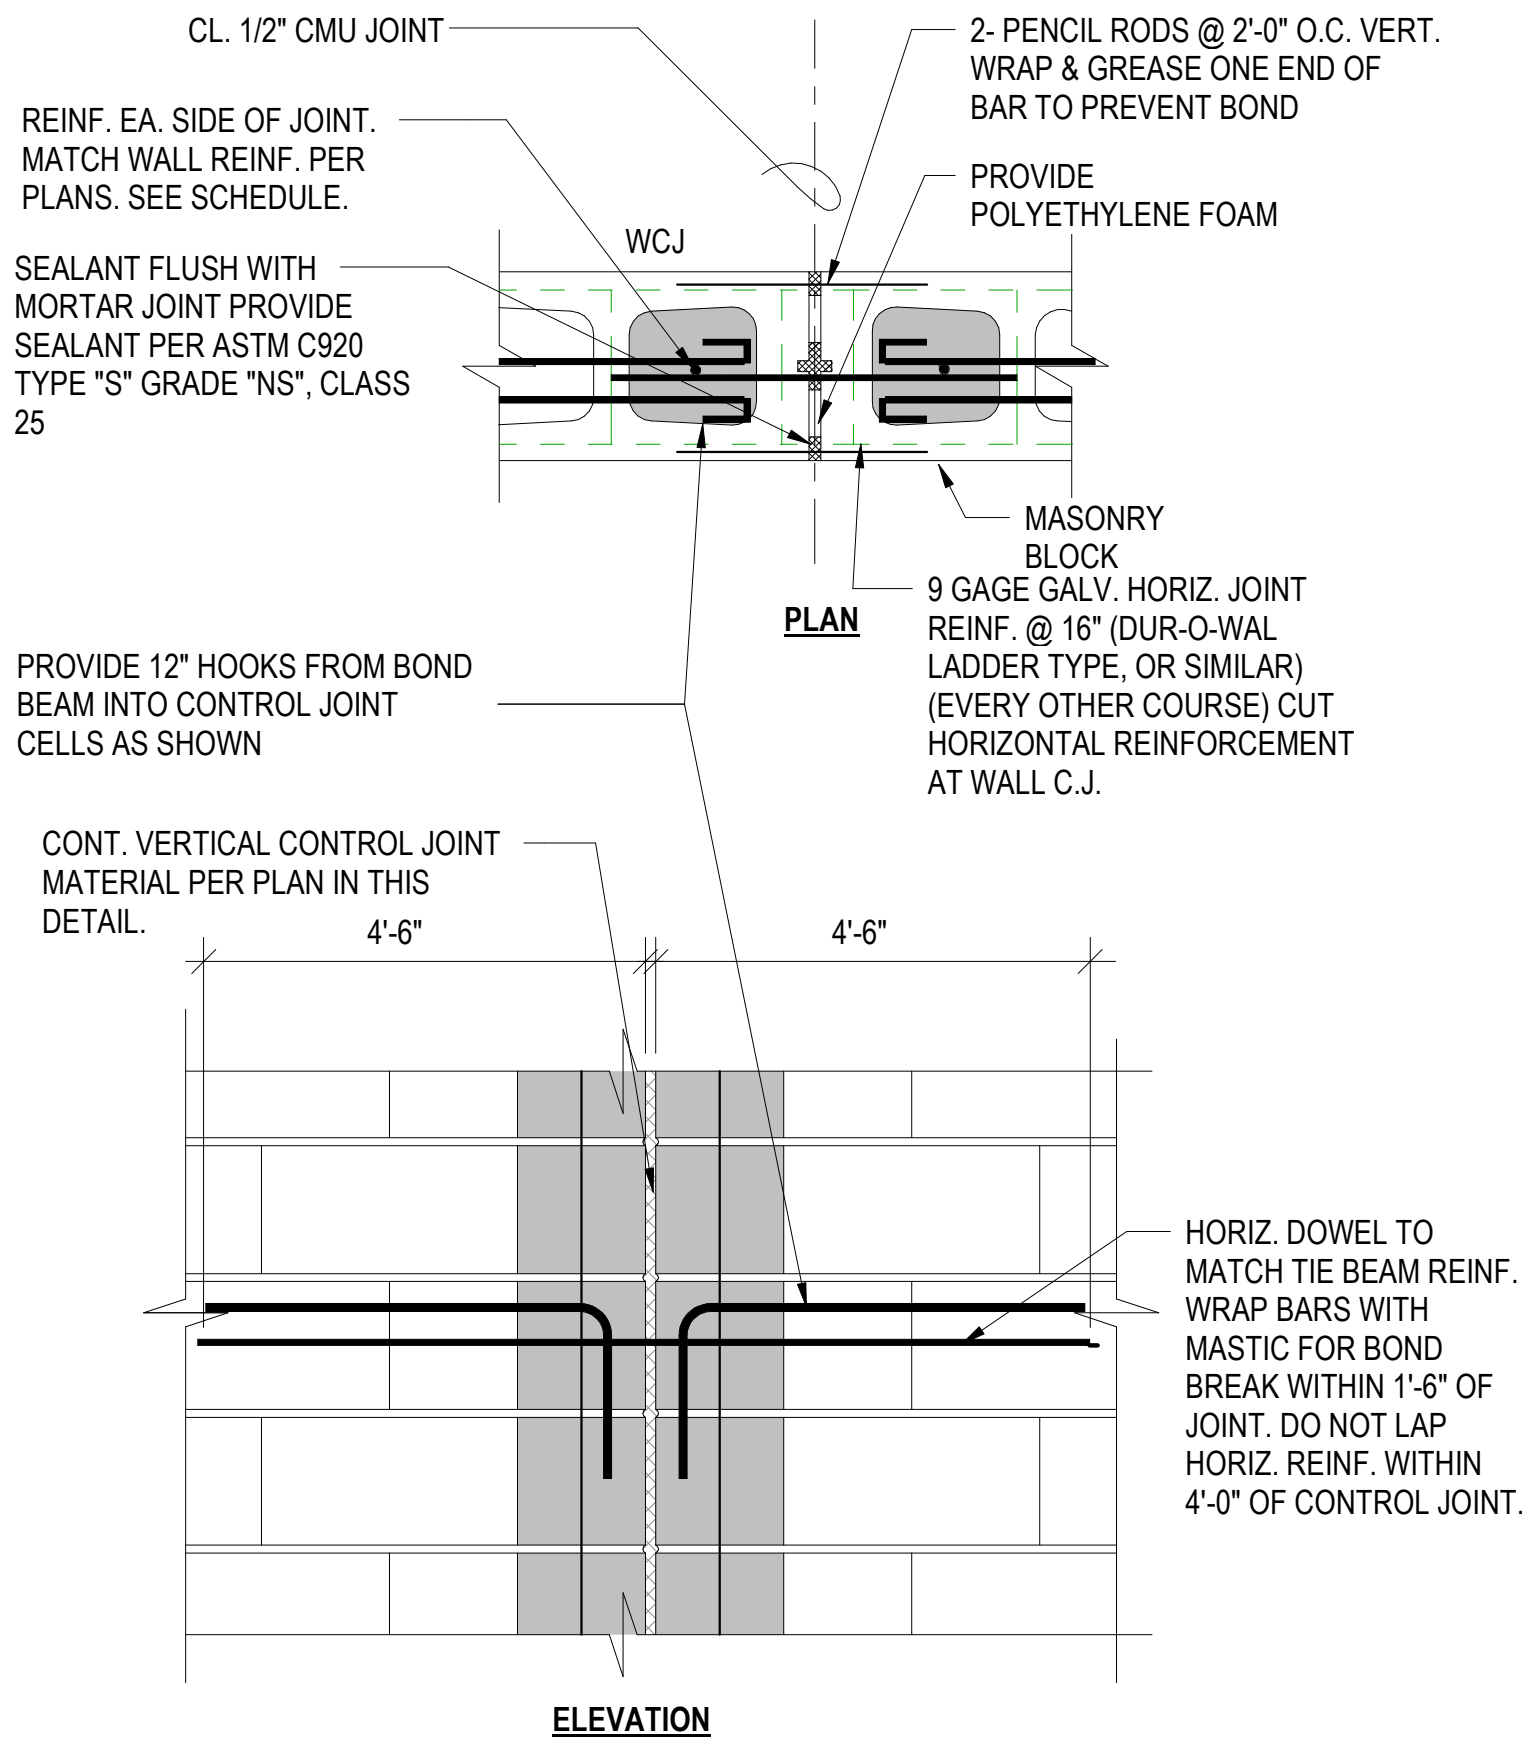


- NOTES:
1. MASONRY CONTROL JOINTS TO BE COORDINATED WITH ARCH ELEVATIONS, PLANS AND SPECIFICATIONS.
 2. WALL CONTROL JOINTS SHOULD MATCH LOCATION OF SLAB CONTROL JOINTS. ONLY AS NOTED IN PLAN.
 3. CONTROL JOINTS @ MASONRY WALLS SHOULD BE PLACED @ SPACING NOT EXCEEDING 25'-4" OR 3 TIMES THE WALL HEIGHT WHICHEVER IS LESS. MORE SPECIFICALLY WHEN SELECTING A LOCATION IT SHOULD INCLUDE

- A. CHANGES IN WALL HT. OR THICKNESS.
- B. AT LEAST 2'-0" OFFSET OVER DOOR & WINDOW OPENINGS.
- C. AT INTERSECTING WALLS.
- D. AT CONSTRUCTION JOINTS IN SLAB.
- E. NOT LESS THAN 2'-0" FROM A BEARING PLATE.


4. G. C. TO SUBMIT SHOP DWG. W/ LOCATIONS OF CONTROL JOINTS & ALL VERTICAL REINF. FOR APPROVAL BY ENGINEER OF RECORD.

4 MASONRY CONTROL JOINT (MCJ)
SCALE N.T.S.

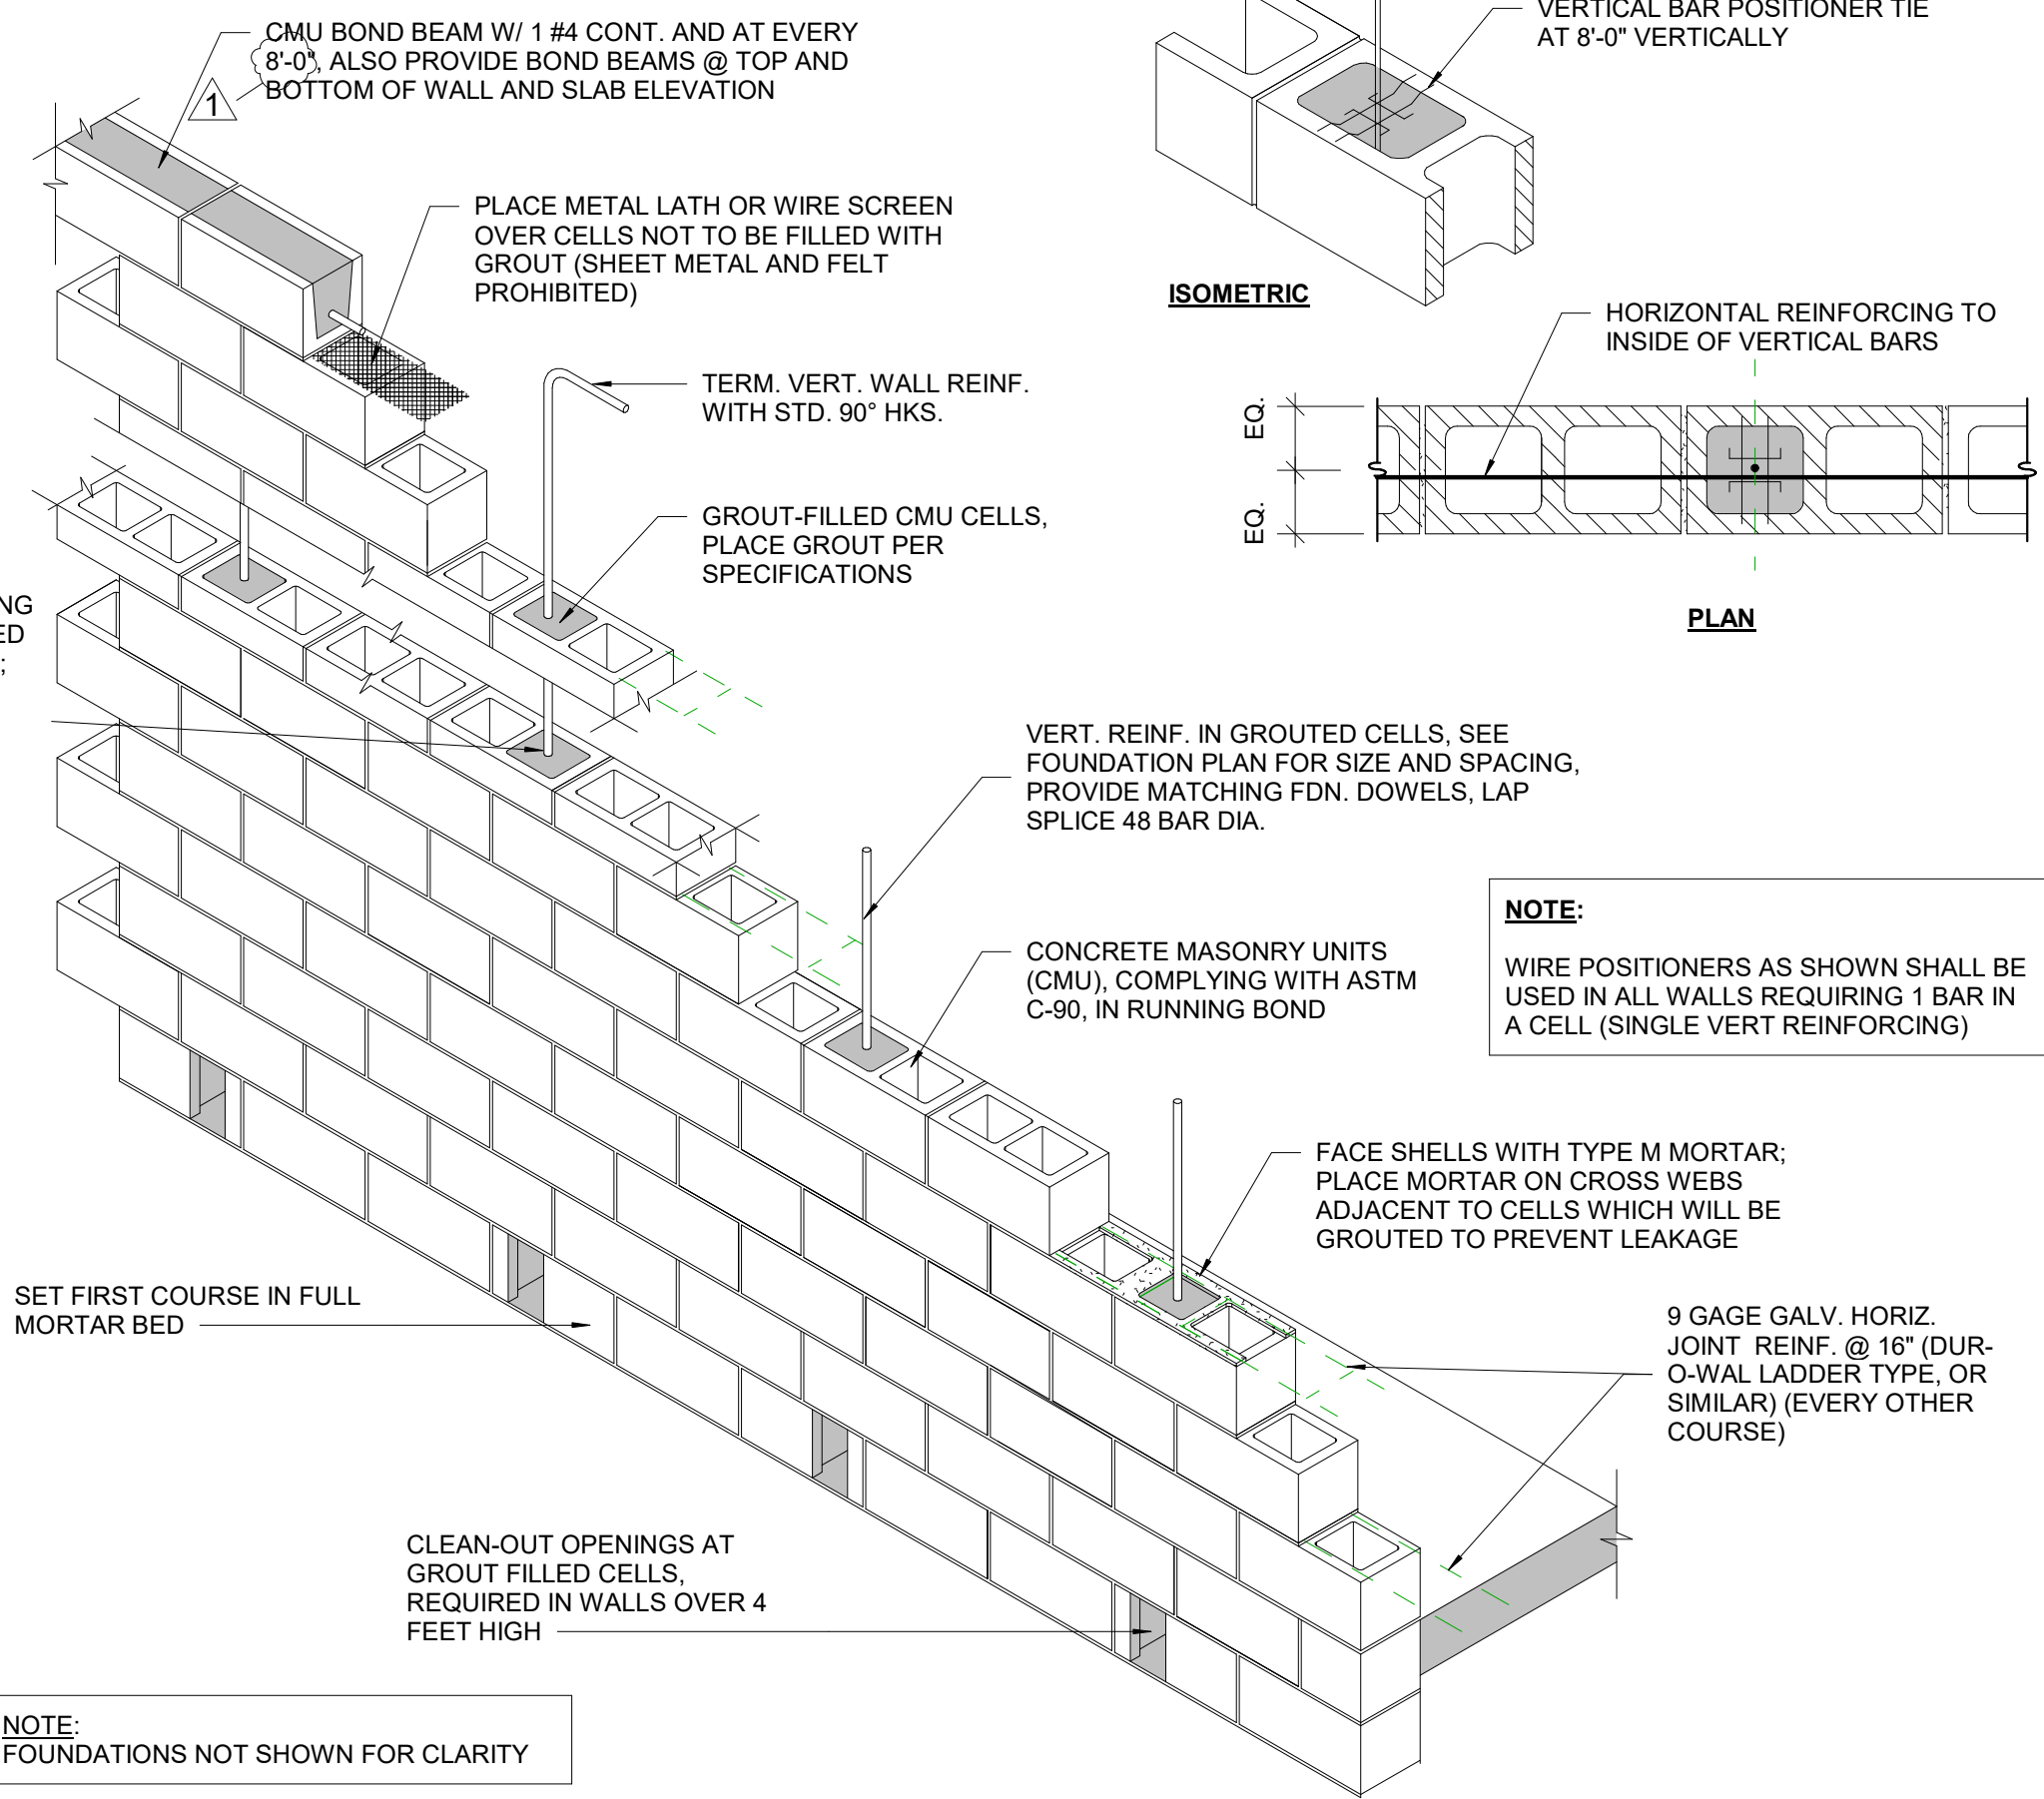

NOTE:
FOUNDATIONS NOT SHOWN FOR CLARITY

5 TYP. REINF MASONRY WALL CONSTRUCTION
SCALE N.T.S.

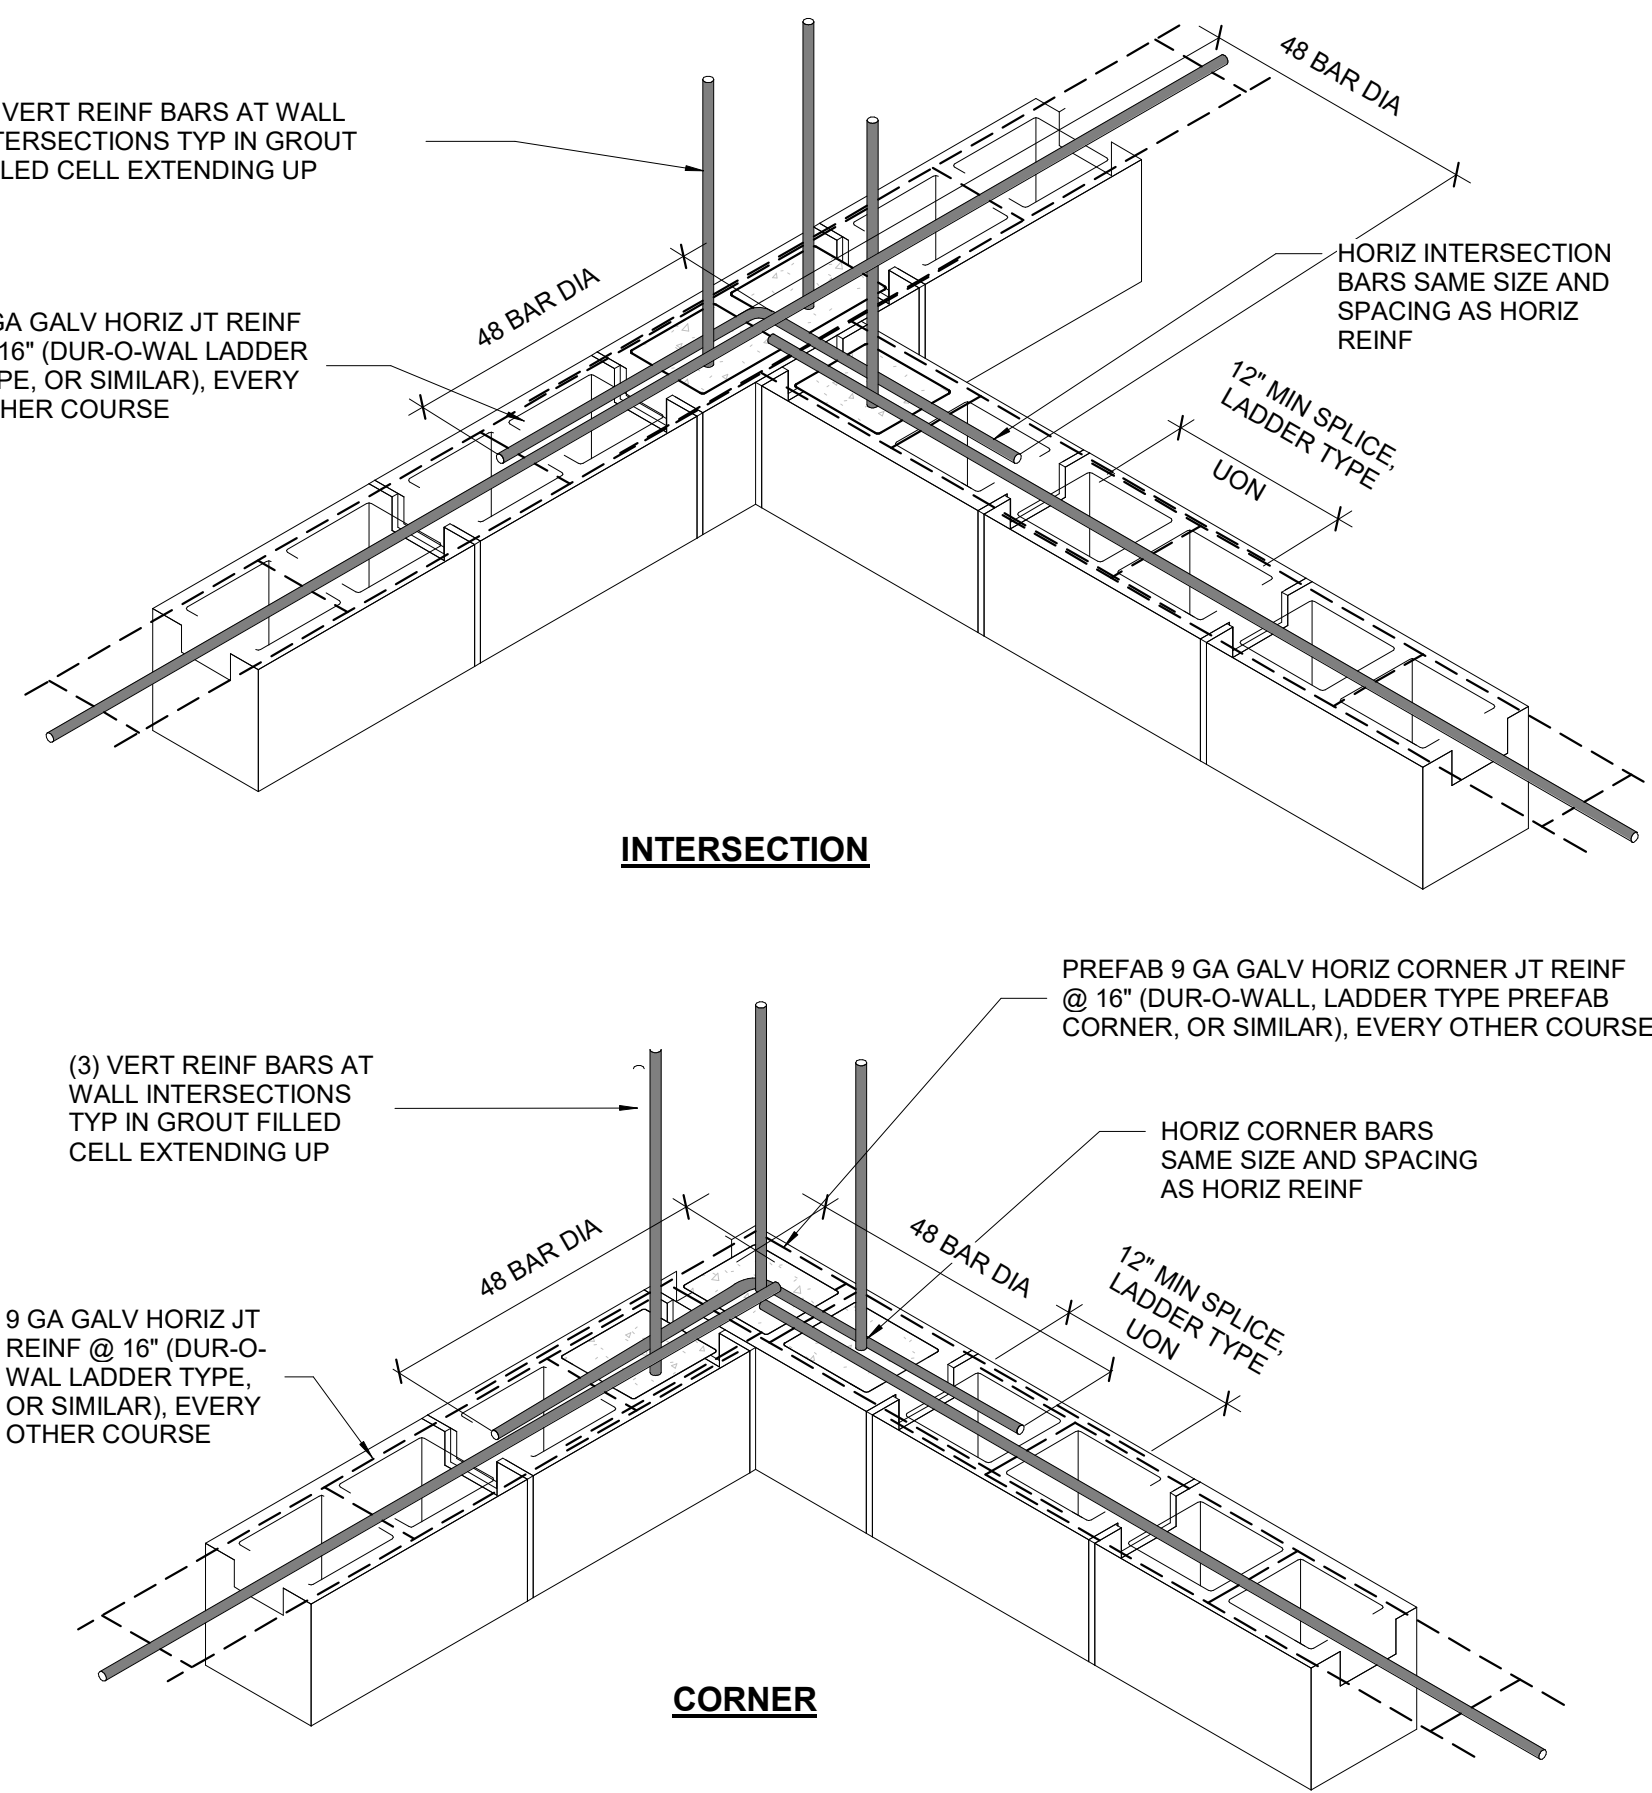

6 BOND BEAM REINF @ CORNER & INTERSECT. W/ CENTER BAR
SCALE N.T.S.

COPYRIGHT:
THIS DRAWING AND ALL
REPRODUCTIONS ARE
COPYRIGHTED AND THE
PROPERTY OF
VISIONEERING INC & MAY
NOT BE USED IN ANY
WAY WITHOUT THEIR
PERMISSION

PROJECT NAME:
TRIPLEX AT 1602 N RIVERSIDE DR.
PROJECT ADDRESS:
POMPAHO BEACH, BROWARD COUNTY, FLORIDA

SEAL:
ROBERTO ARCHILA, PE
DATE 04/08/25

REVISIONS:		
No.	DATE:	DESCRIPTION
1	04-08-2025	CITY COMMENTS

DRAWN: MG
CHECKED: RA
APPROVED: RA
ISSUE DATE: 11-26-24

SHEET NAME:
TYPICAL CMU DETAILS

PROJECT NUMBER:
24-925
VISIONEERING NUMBER:
VN24-165
SHEET NUMBER:

S-402

SHEET OF

This has been digitally signed and sealed by ROBERTO ARCHILA on the date adjacent to the seal. Proper copies of this document are not considered signed and sealed and the signature must be verified on any electronic copy in compliance with the latest State Statute requirements 471.1025 and FACS 6TG15-23.003