

### TREE RELOCATION PROCEDURAL SPECIFICATION






Tree, Palm, Shrub and other Plant Transplanting/Relocating Detail - Recommended Notes:

The American National Standard for Tree Care Operations - Tree, Shrub, and Other Woody Plant Maintenance - Standard Practices (Transplanting) ANSI A300(Part 6)-2005 must be adhered to in its entirety for all relocating/transplanting of trees and shrubs. ANSI A300 (Part 6)-2005 includes the following:

- 60- Transplanting Standards
- 61 - Normative References
- 62 - Definitions
- 63 - Transplanting Practices

The transplanting objectives shall be established prior to beginning the operation. These objectives may be presented in a report format for permitting purposes.

A feasibility and suitability assessment shall be conducted prior to recommending transplanting. Specifications for transplanting should be based on the assessment. See the Checklist in Annex A of ANSI A300 (Part6)-2005. This assessment may be presented in a report format for permitting purposes.

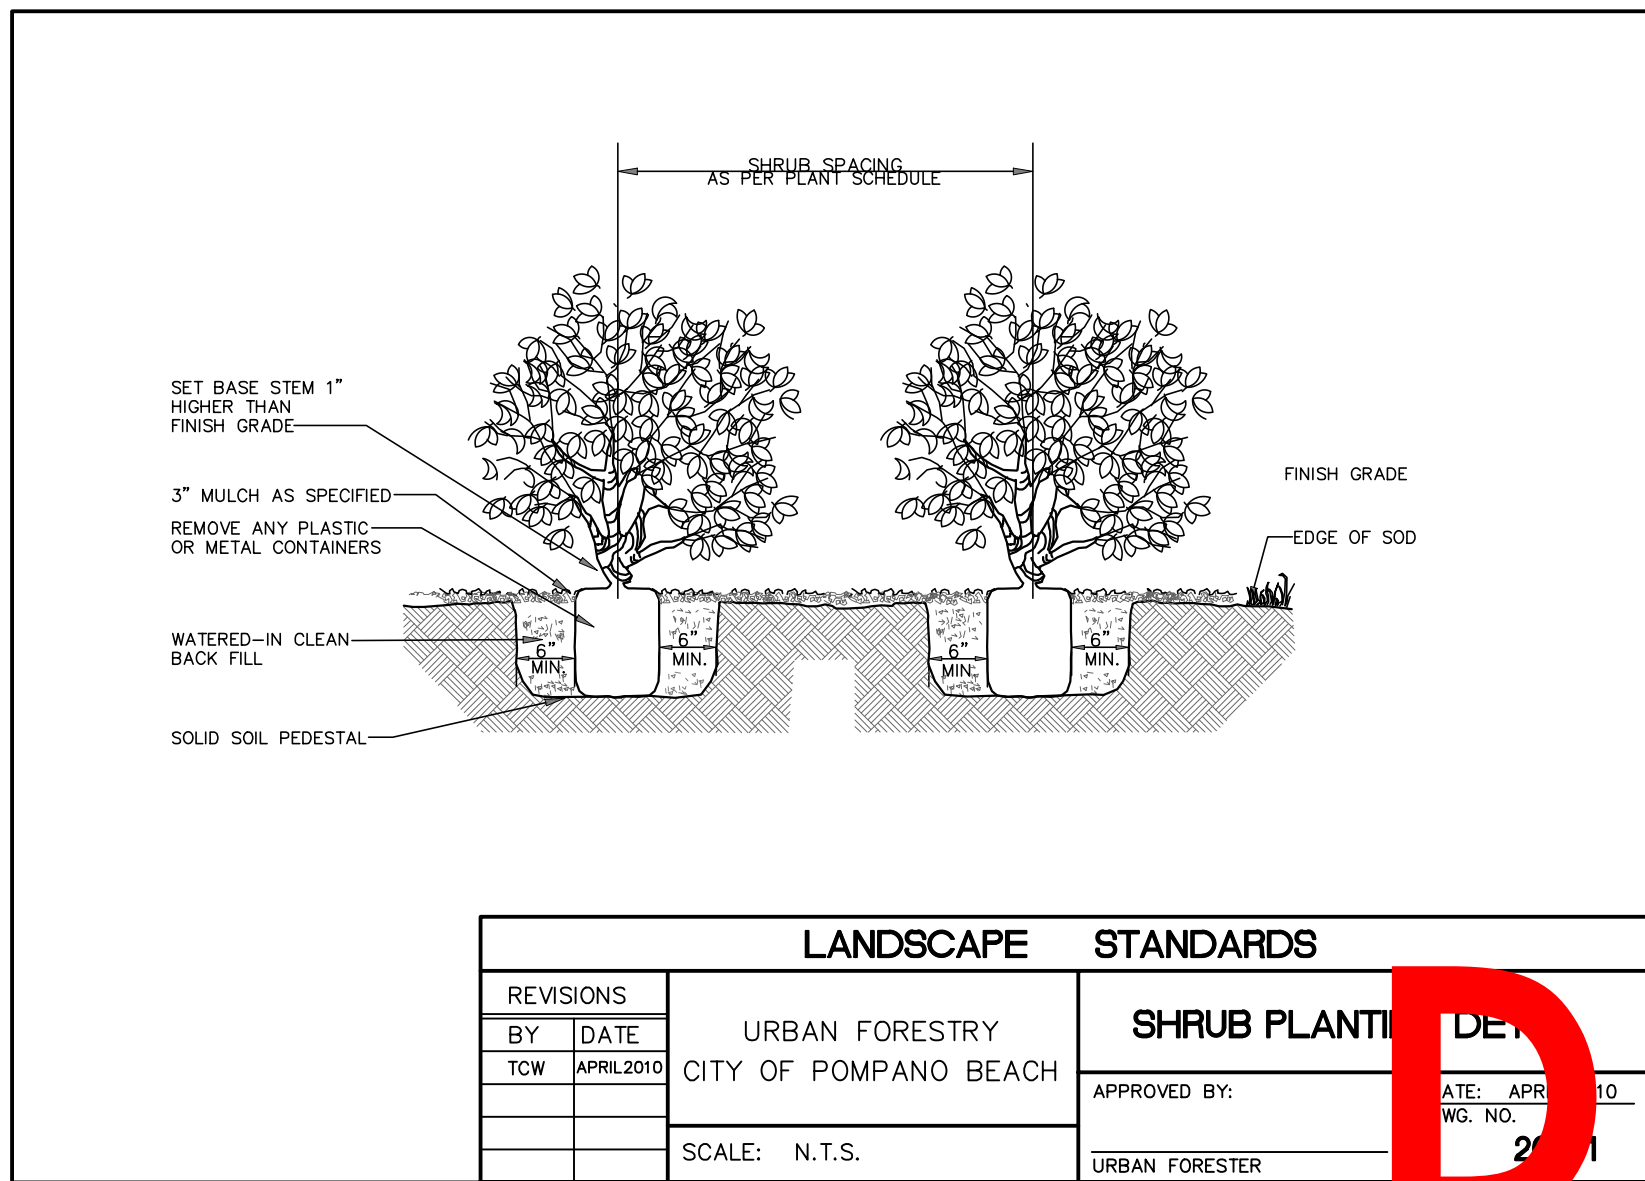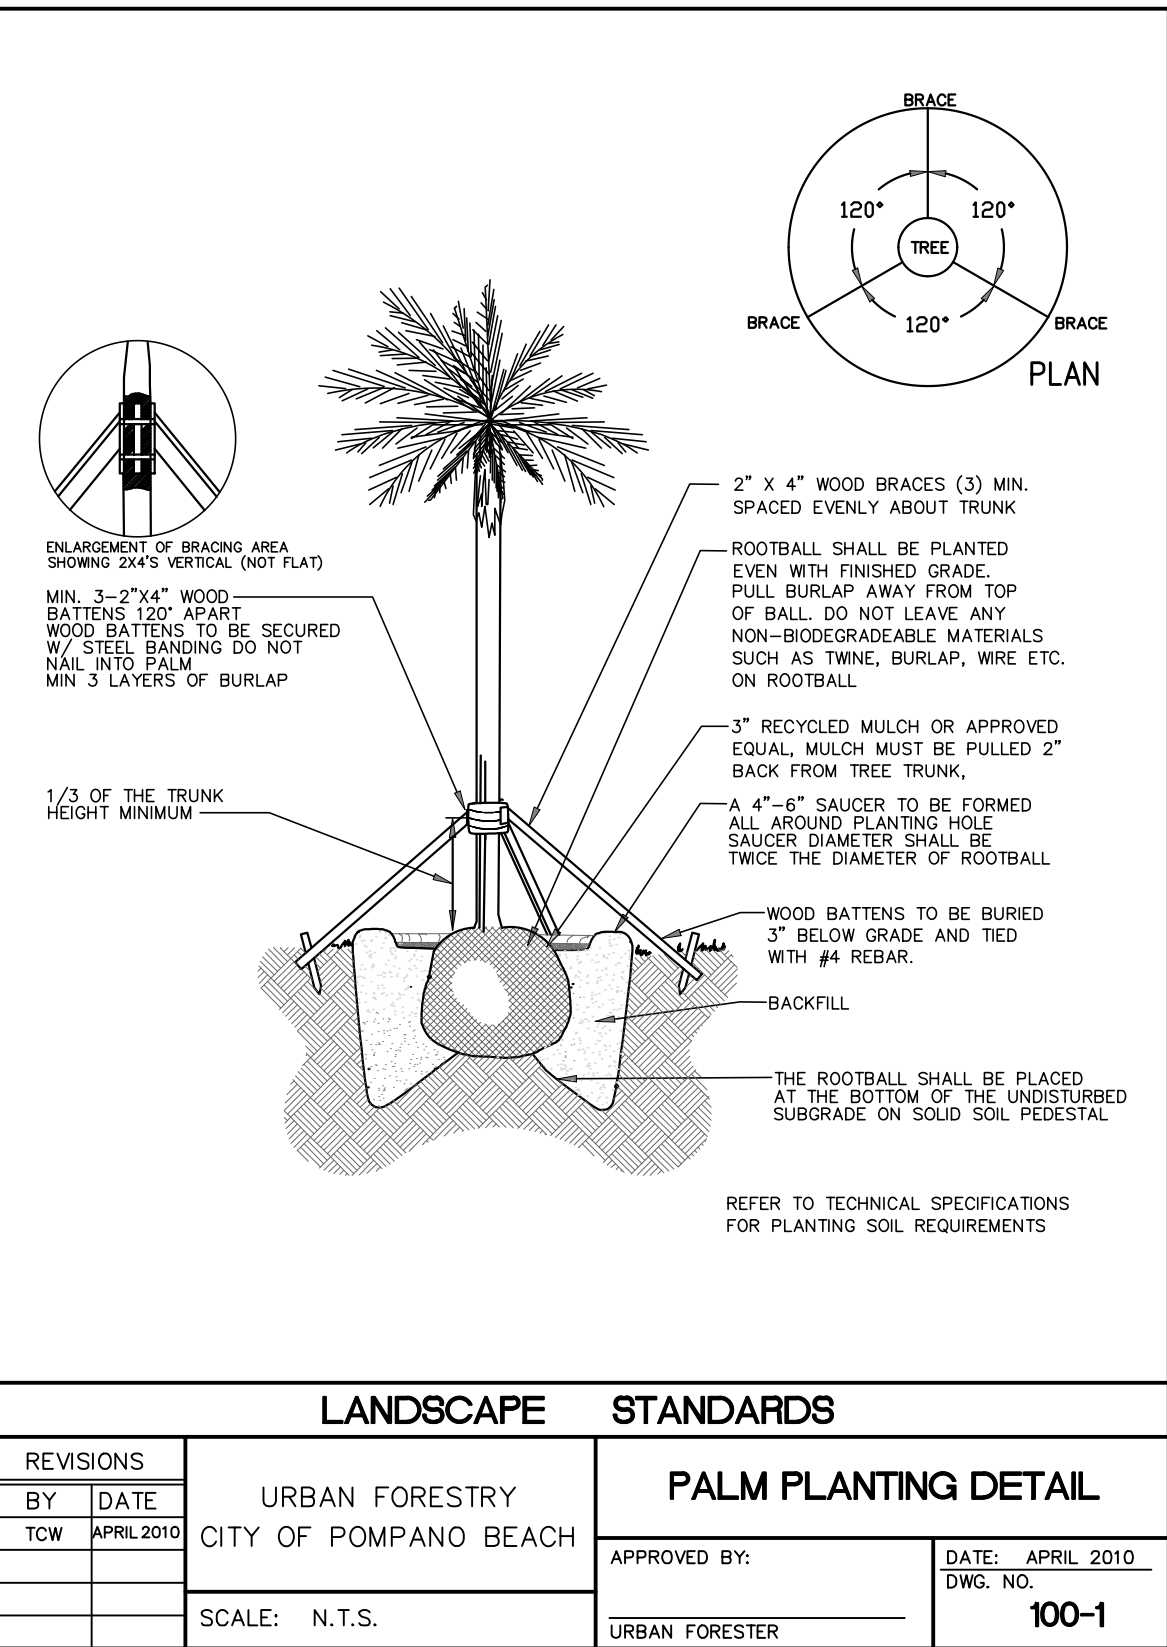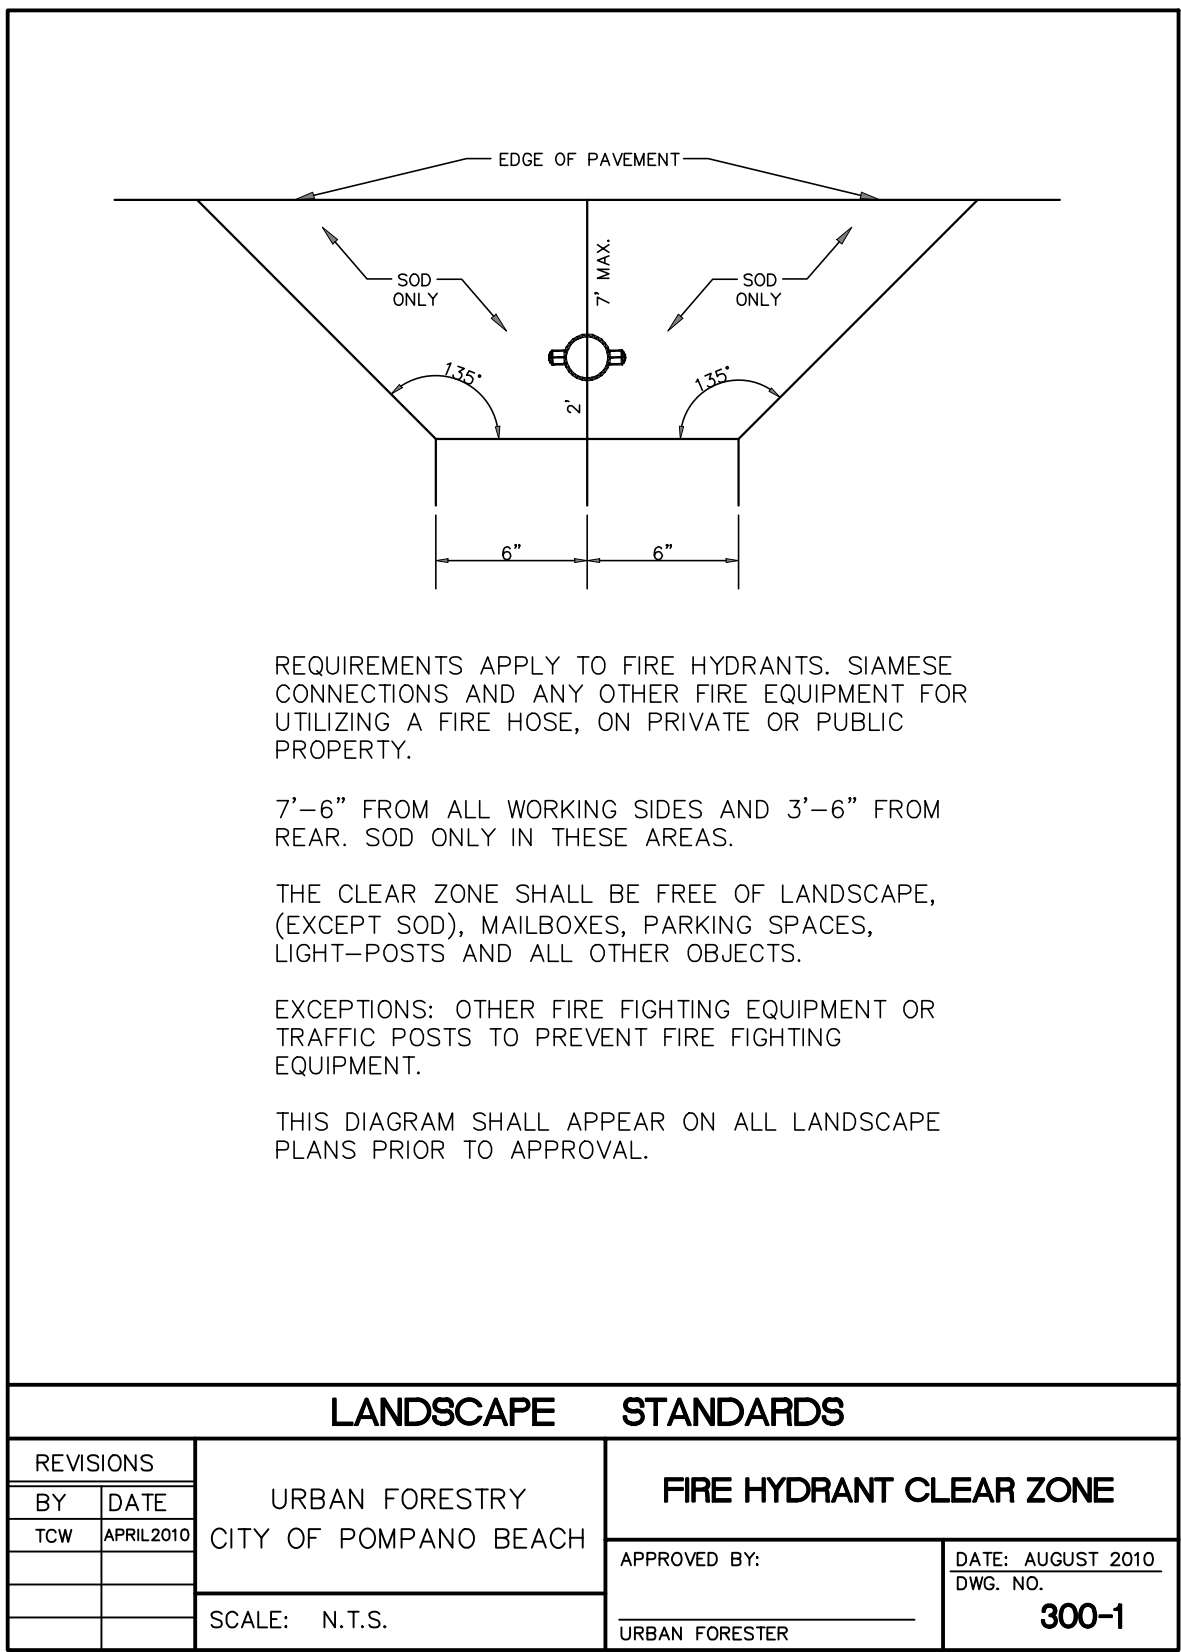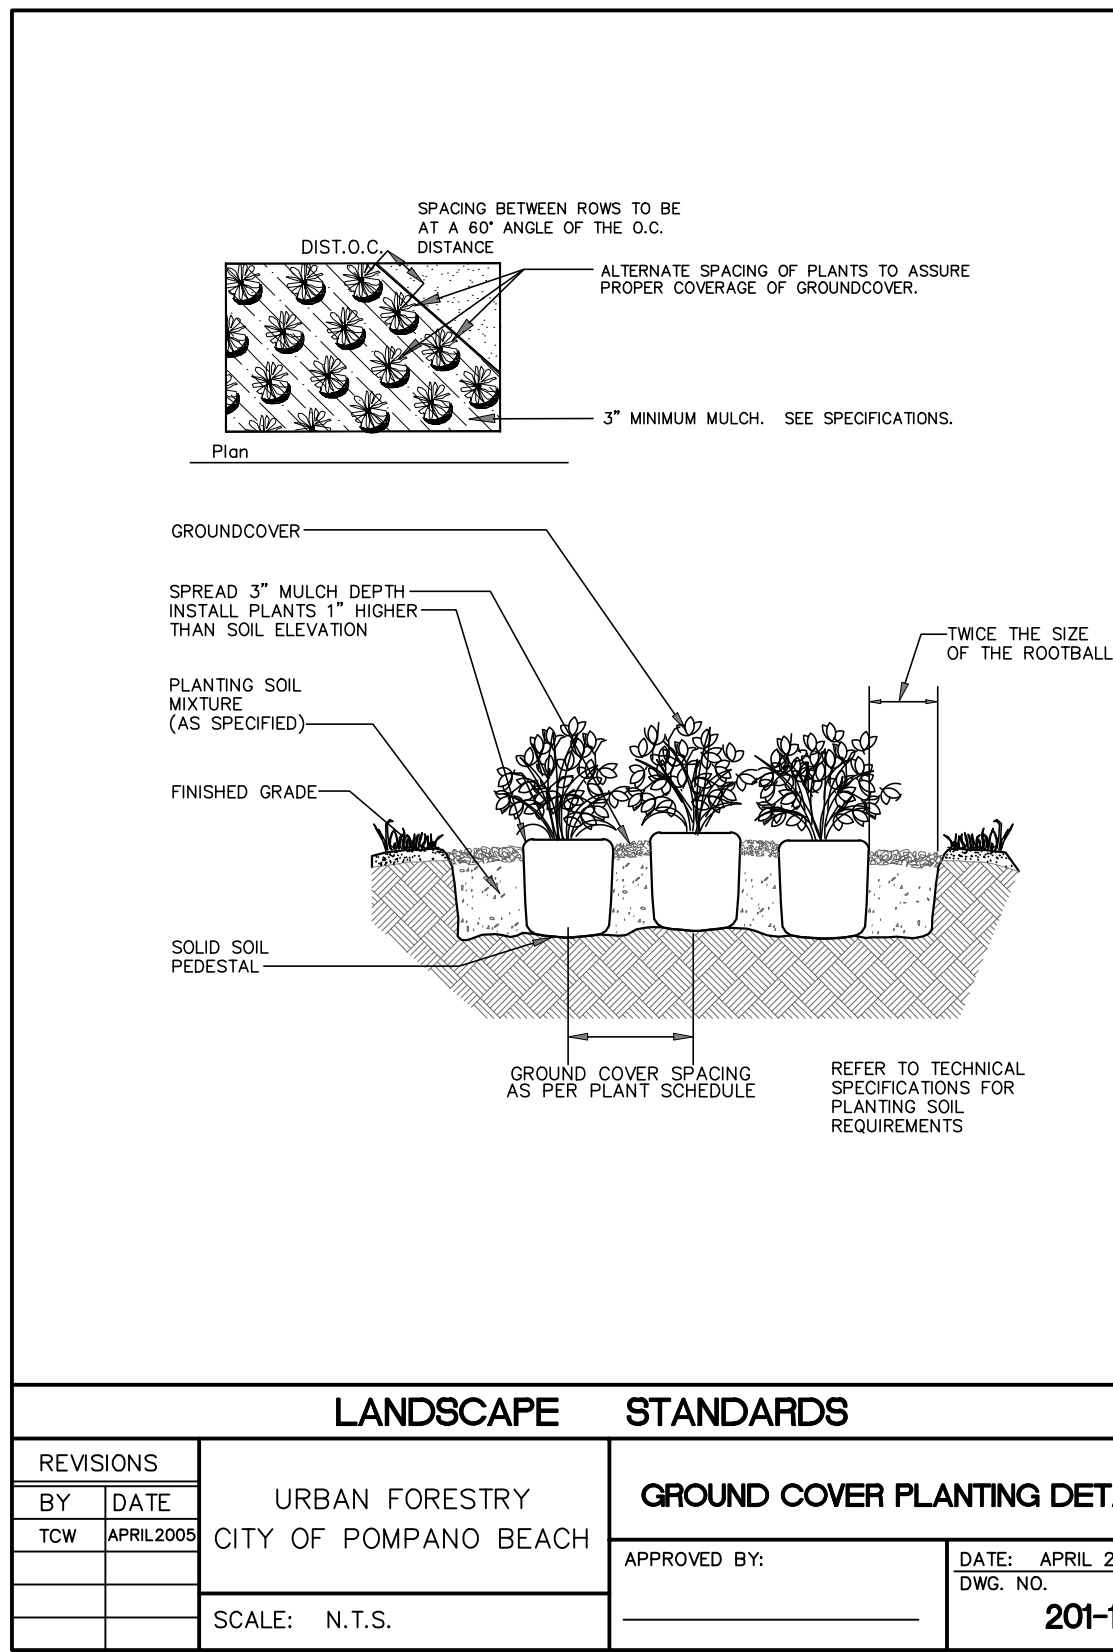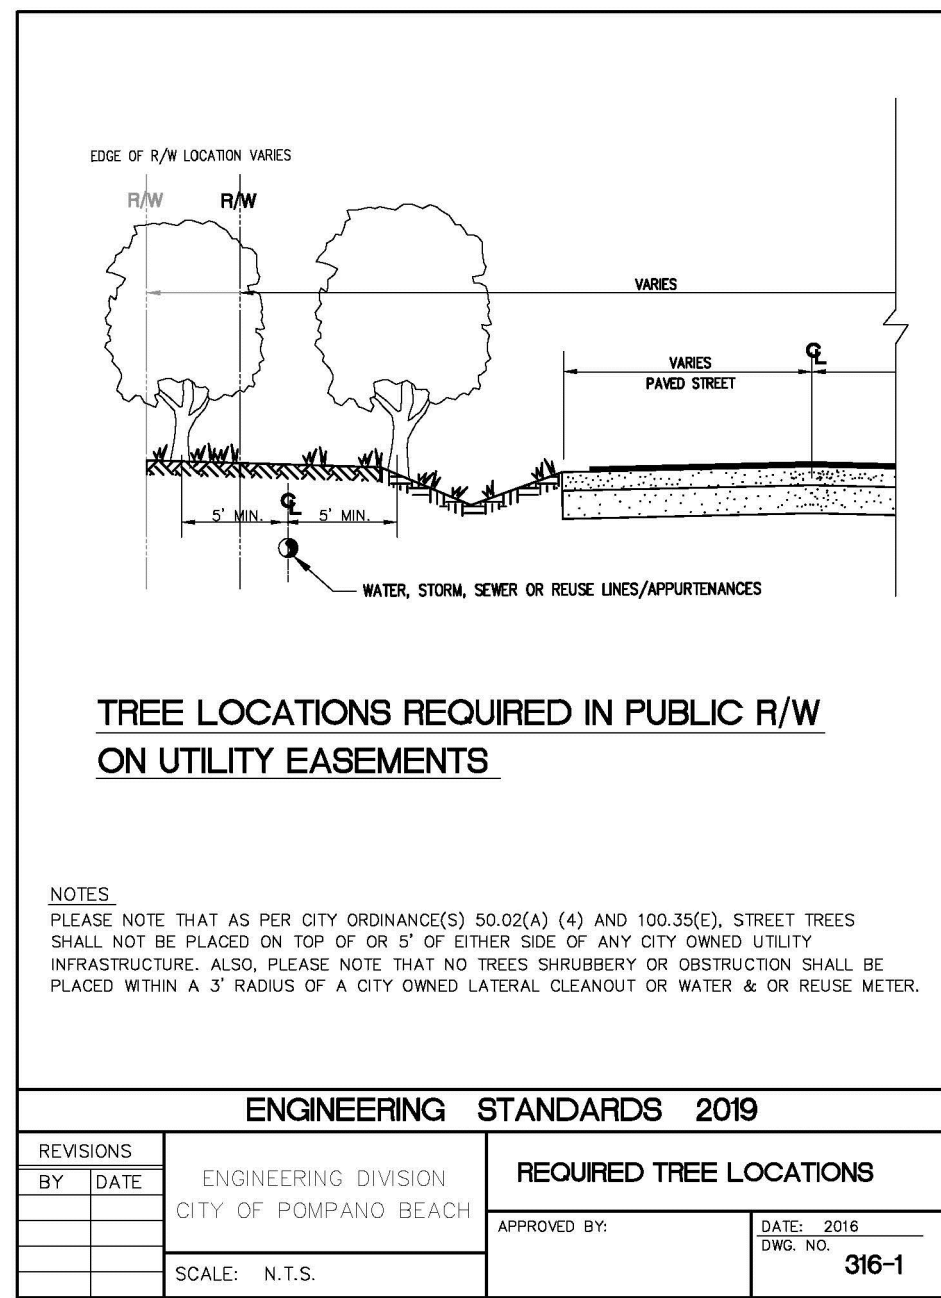


### CITY NOTES:

- Visibility and unobstructed working space must be maintained from fire apparatus access routes to fire protection and life safety appliances/equipment. these include but not limited to: fire hydrants, fire department connections (fdc), post indicating valves (piv), fire sprinkler risers, fire alarm control panels and electrical room locations require a minimum 36-inch clearance path to and on all sides. fire hydrants require 36-inch clear space each side and rear with a 60-inch wide clear access from the fire apparatus access to fire hydrant. (nfpa 1-2015 ch. 18 sec. 18.5.7.




PROPOSED SITE IMPROVEMENTS FOR:  
AHERN SHOP BUILDING

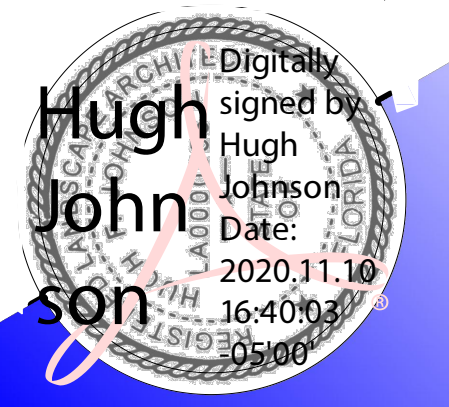

this document or parts thereof may not be reproduced in any form without permission copyrighted material ©

DESIGNED	DRAWN	CHECKED
JPB	GRC	JPB
DATE:	DATE:	DATE:
01/08/19	180720	
REVISIONS		
REVISION 2	06-05-20	

PLANTING DETAILS

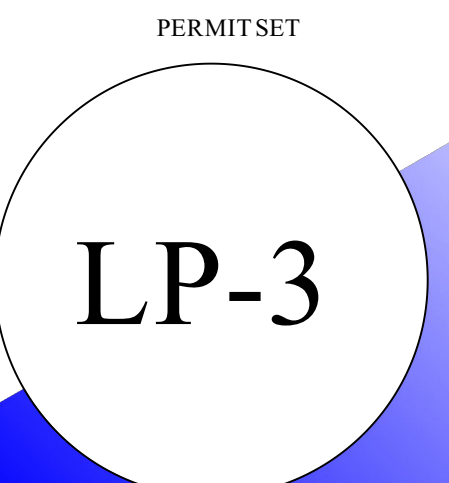

**DRC**  
PZ20-12000038  
12/16/2020