


- NOTES:
1. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO THE PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE TOP DRESSING, REPAIR AND/OR CLEANOUT OF ANY MEASURES TO SEDIMENT.
 2. WHEN NECESSARY, WHEELS SHALL BE CLEANED PRIOR TO ENTRANCE ONTO THE PUBLIC RIGHT-OF-WAY.
 3. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN.


TEMPORARY GRAVEL CONSTRUCTION ENTRANCE

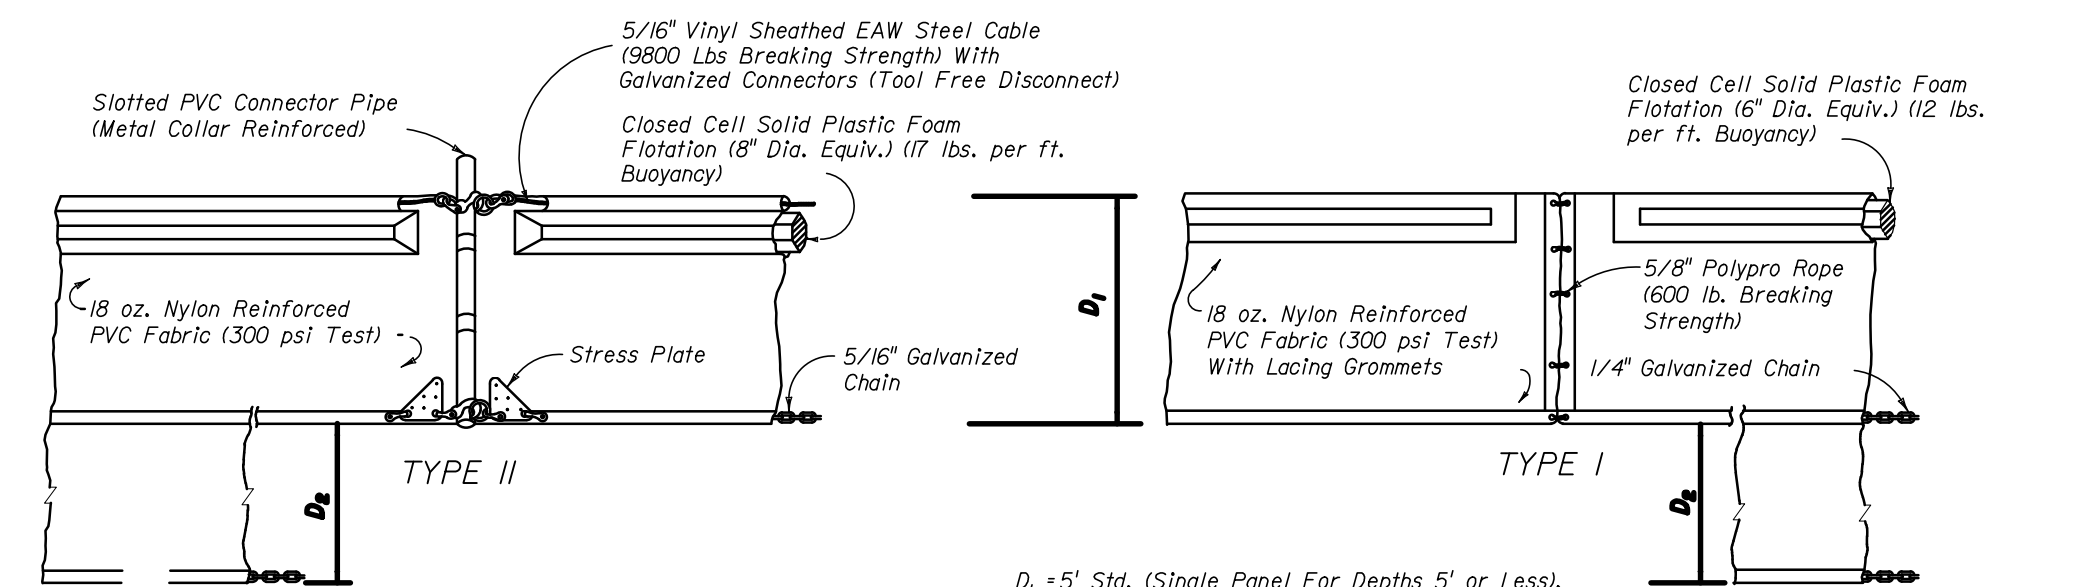

NOTICE: COMPONENTS OF TYPES I AND II MAY BE SIMILAR OR IDENTICAL TO PROPRIETARY DESIGNS. ANY INFRINGEMENT ON THE PROPRIETARY RIGHTS OF THE DESIGNER SHALL BE THE SOLE RESPONSIBILITY OF THE USER. SUBSTITUTIONS FOR TYPES I AND II SHALL BE AS APPROVED BY THE ENGINEER.

$D_1 = 5'$ Std. (Single Panel For Depths 5' or Less).
 $D_2 = 5'$ Std. (Additional Panel For Depths 5' to 10').
 Curtain To Reach Bottom Up To Depths Of 10 Feet.
 Two(2) Panels To Be Used For Depths Greater Than
 10 Feet Unless Special Depth Curtains Specifically Called
 For In The Plans Or As Determined By The Engineer.

FLOATING TURBIDITY BARRIERS

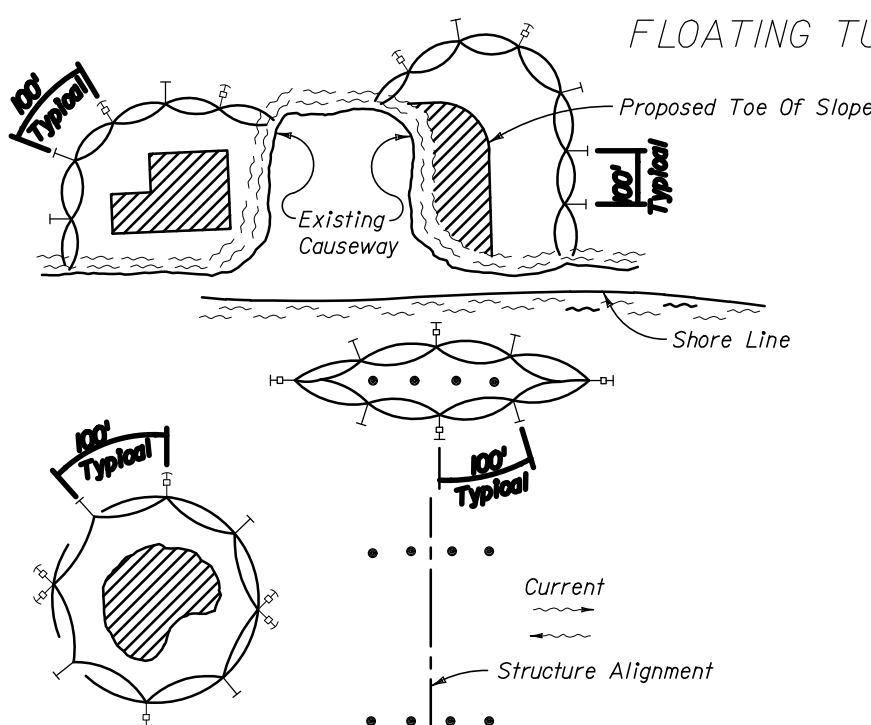

- NOTES:
1. Turbidity barriers are to be used in all permanent bodies of water regardless of water depth.
 2. Turbidity barriers shall be of sufficient length & depth & sufficiently stabilized in order to minimize turbidity.
 3. Number and spacing of anchors dependent on current velocities.
 4. Deployment of barrier around pile locations may vary to accommodate construction operations.
 5. Navigation may require segmenting barrier during construction operations.
 6. For additional information see Section 04.04 of the Standard Specifications.
- LEGEND**


TURBIDITY BARRIER APPLICATIONS

GENERAL NOTES

1. Floating turbidity barriers are to be paid for under the contract unit price for Floating Turbidity Barrier, LF.
2. Staked turbidity barriers are to be paid for under the contract unit price for Staked Turbidity Barrier, LF.

WATER QUALITY

1. Prior to construction and during all operations that may degrade water quality, the Contractor shall practise turbidity controls to prevent violations to the water quality standards as outlined in Chapter 62-302, F.A.C

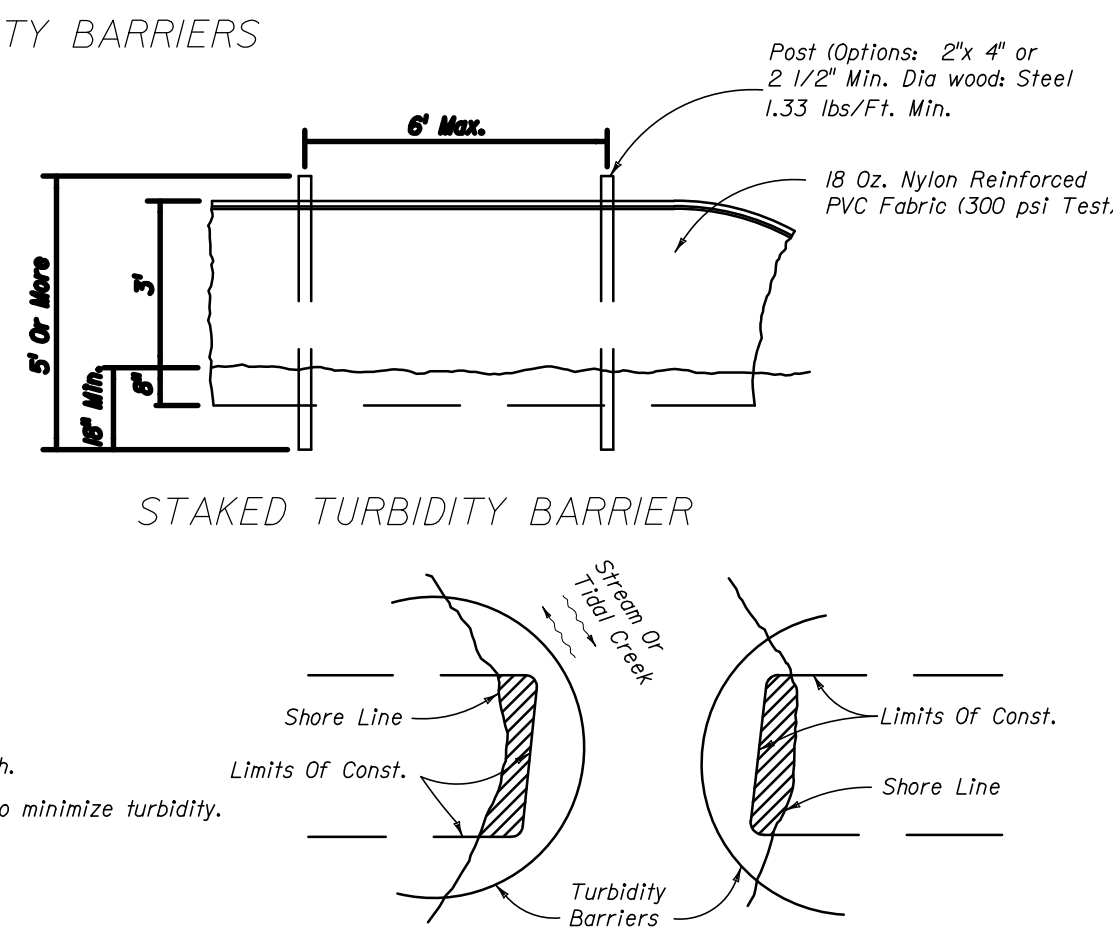


Note: Turbidity barriers for flowing streams and tidal creeks may be either floating, or staked types or any combinations of types that will suit site conditions and meet erosion control and water quality requirements. The barrier type(s) will be at the Contractors option unless otherwise specified in the plans. However, payment will be under the pay item(s) associated with the plans for Floating Turbidity Barriers and/or Staked Turbidity Barriers. Points in staked turbidity barriers may be installed in the position unless otherwise directed by the Engineer.

PZ24-12000017

07/02/2025

TURBIDITY BARRIER

N.T.S.

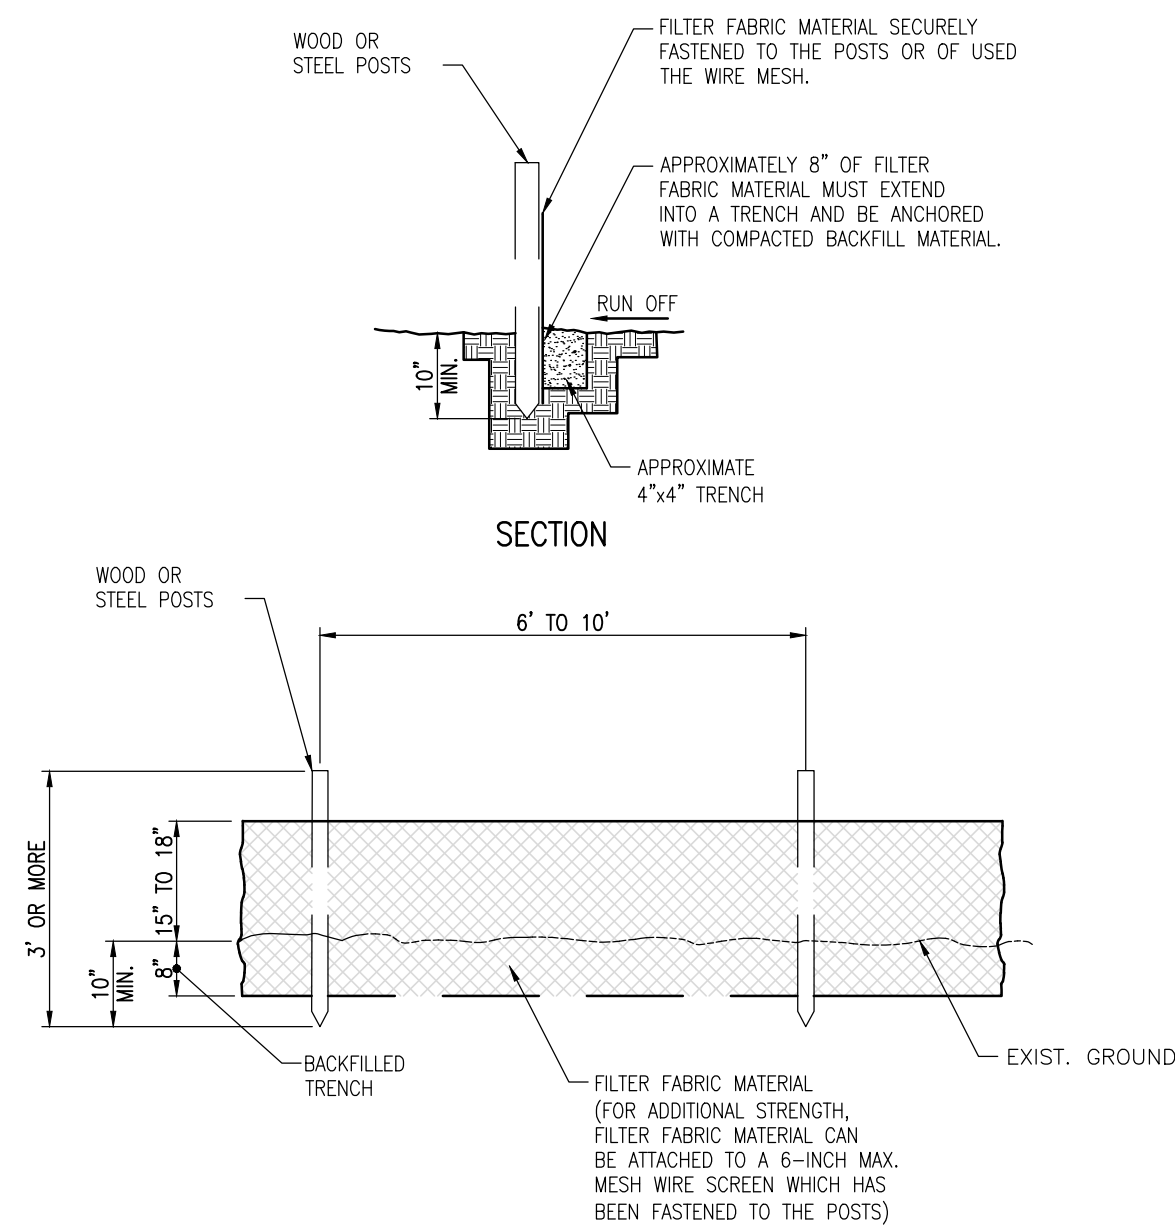

ELEVATION
SILT BARRIER FENCE

MINOR SITE PLAN SUBMITTAL
ELEVATIONS SHOWN ARE NAVD 88

-	-	.	-				
NO	DATE	REVISION	BY	NO	DATE	REVISION	BY



Calvin, Giordano & Associates, Inc.
A SAFEbuilt® COMPANY
1800 Eller Drive, Suite 600, Fort Lauderdale, FL 33316
Phone: 954.921.7781 • Fax: 954.921.8807

BLOSSMAN GAS COMPANY
261 S. ANDREWS AVENUE
POMPAÑO BEACH, FL 33069

STORMWATER POLLUTION PREVENTION DETAILS

JAMES D. MESSICK, STATE OF FLORIDA, PROFESSIONAL ENGINEER, LICENSE NO. 70870.
THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JAMES D. MESSICK DATE
INDICATED HERE.
PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND
THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.
DATE: 05/09/2025

SCALE AS SHOWN	SHEET C4
PROJECT No 23-7806	