

REVISIONS:

REV.	REV. ISSUE
1	05/10/2022

2203

**GALEWAY LUXURY
APARTMENTS**

LOCATED AT:
950 N POWERLINE ROAD,

950 N POWERLINE
POMPANO BEACH FL

1248 S ALHAMBRA CIRCLE
CORAL GABLES, FL 33146
(786) 554-9035
AIA 38052598
WWW.BURGOSLANZA.COM

**BURROPS
LANZA**
ARCHITECTS & PLANNERS
AA 26001519

ablo
urgos

ally signed by Pablo Burgos
n=Pablo Burgos, o=Burgos
a & Assoc., ou=AR95925,
l=pburgos@burgoslanza.co
=US
2022.05.11 15:49:46 -04'00

11/09/21
CR
2203
AS-SHOWN

SECOND FLOOR LIFE
SAFETY BUILDING # 2


SCALE: 1/8" = 1' - 0"

S1.22

LEGEND:

1. CONNECT ALL EXIT SIGNS AND BATTERY PACKS IN EMERGENCY LIGHT FIXTURES AHEAD OF ANY LIGHTING CONTROL DEVICE FOR CONTINUOUS OPERATION OF THE BATTERY CHARGER.
2. MEANS OF EGRESS ILLUMINATION LEVEL, INCLUDING STAIRWELLS, SHALL NOT BE LESS THAN 1 FOOTCANDLE AT THE WALKING SURFACE AS REQUIRED BY FBC.

FIRE ALARM SYMBOL
LEGEND:



HORN/STROBE WALL MOUNTED WEATHER PROOF,
AT 80" AFF TO BOTTOM




PULL STATION AT 48" AFF TO CENTER

SYMBOL KEY




B	OCCUPANCY
2,500	SQUARE FOOTAGE (SQUARE FEET)
1:100	OCCUPANT LOAD FACTOR
25	NUMBER OF OCCUPANTS


43	STAIR OPENING CLEAR WIDTH
44	MAXIMUM CAPACITY (0.3)
44	ACTUAL CAPACITY



DIRECTION OF EGRESS AND
OCCUPANT LOAD


WALL TYPES:

	CONC. BLOCK W/ STUCCO FINISH EXTERIOR AND 5/8" GYP. BD ON 2X2 P.T FURRING
	NON RATED MTL. STUD PARTITION
	1-HOUR RATED MTL PARTITION

 1-HOUR RATED MTL PARTITION WITH CONC. FILLED STEEL COLUMN (PROVIDE MASTIC COATING ON EXPOSED -NON PROTECTED STRUCTURAL STEEL PLATES & BASE. APPLICATION PER MANUFACTURER SPECIFICATIONS).


DOOR DESIGNATION
REFER TO DOOR SCHEDULE

WINDOW DESIGNATION
REFER TO WINDOW SCHEDULE

 DROP SOFFITS G.W.B. SOFFIT AT 8'-4" (U.O.N) A.F.F. WITHIN UNITS AND 8'-4" (U.O.N) A.F.F. BREEZEWAY CORRIDOR, METAL FRAME. REFER TO DETAIL 22/A7.03

F.E.	<p>PROVIDE FIRE EXT. 2A 40BC TYPE (FIRE EXTINGUISHER TO COMPLY W/F.B.C. CHAPTER 36 F.F.P.C. 7.6.3.1 & N.F.P.A 10) MAXIMUM TRAVEL DISTANCE TO A FIRE EXTINGUISHER – 75 FT FOR ORDINARY HAZARD AREAS. FIRE EXTINGUISHERS SHOULD BE MOUNTED MINIMUM 4 INCHES AND MAXIMUM 5FT FROM FLOOR, IF FIRE EXTINGUISHER IS LESS THAN 40LB IN WEIGHT.</p>
------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

ALL INSULATION MATERIALS TO HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 450. PER FBC 7th EDITION (2020), SECT 719.2

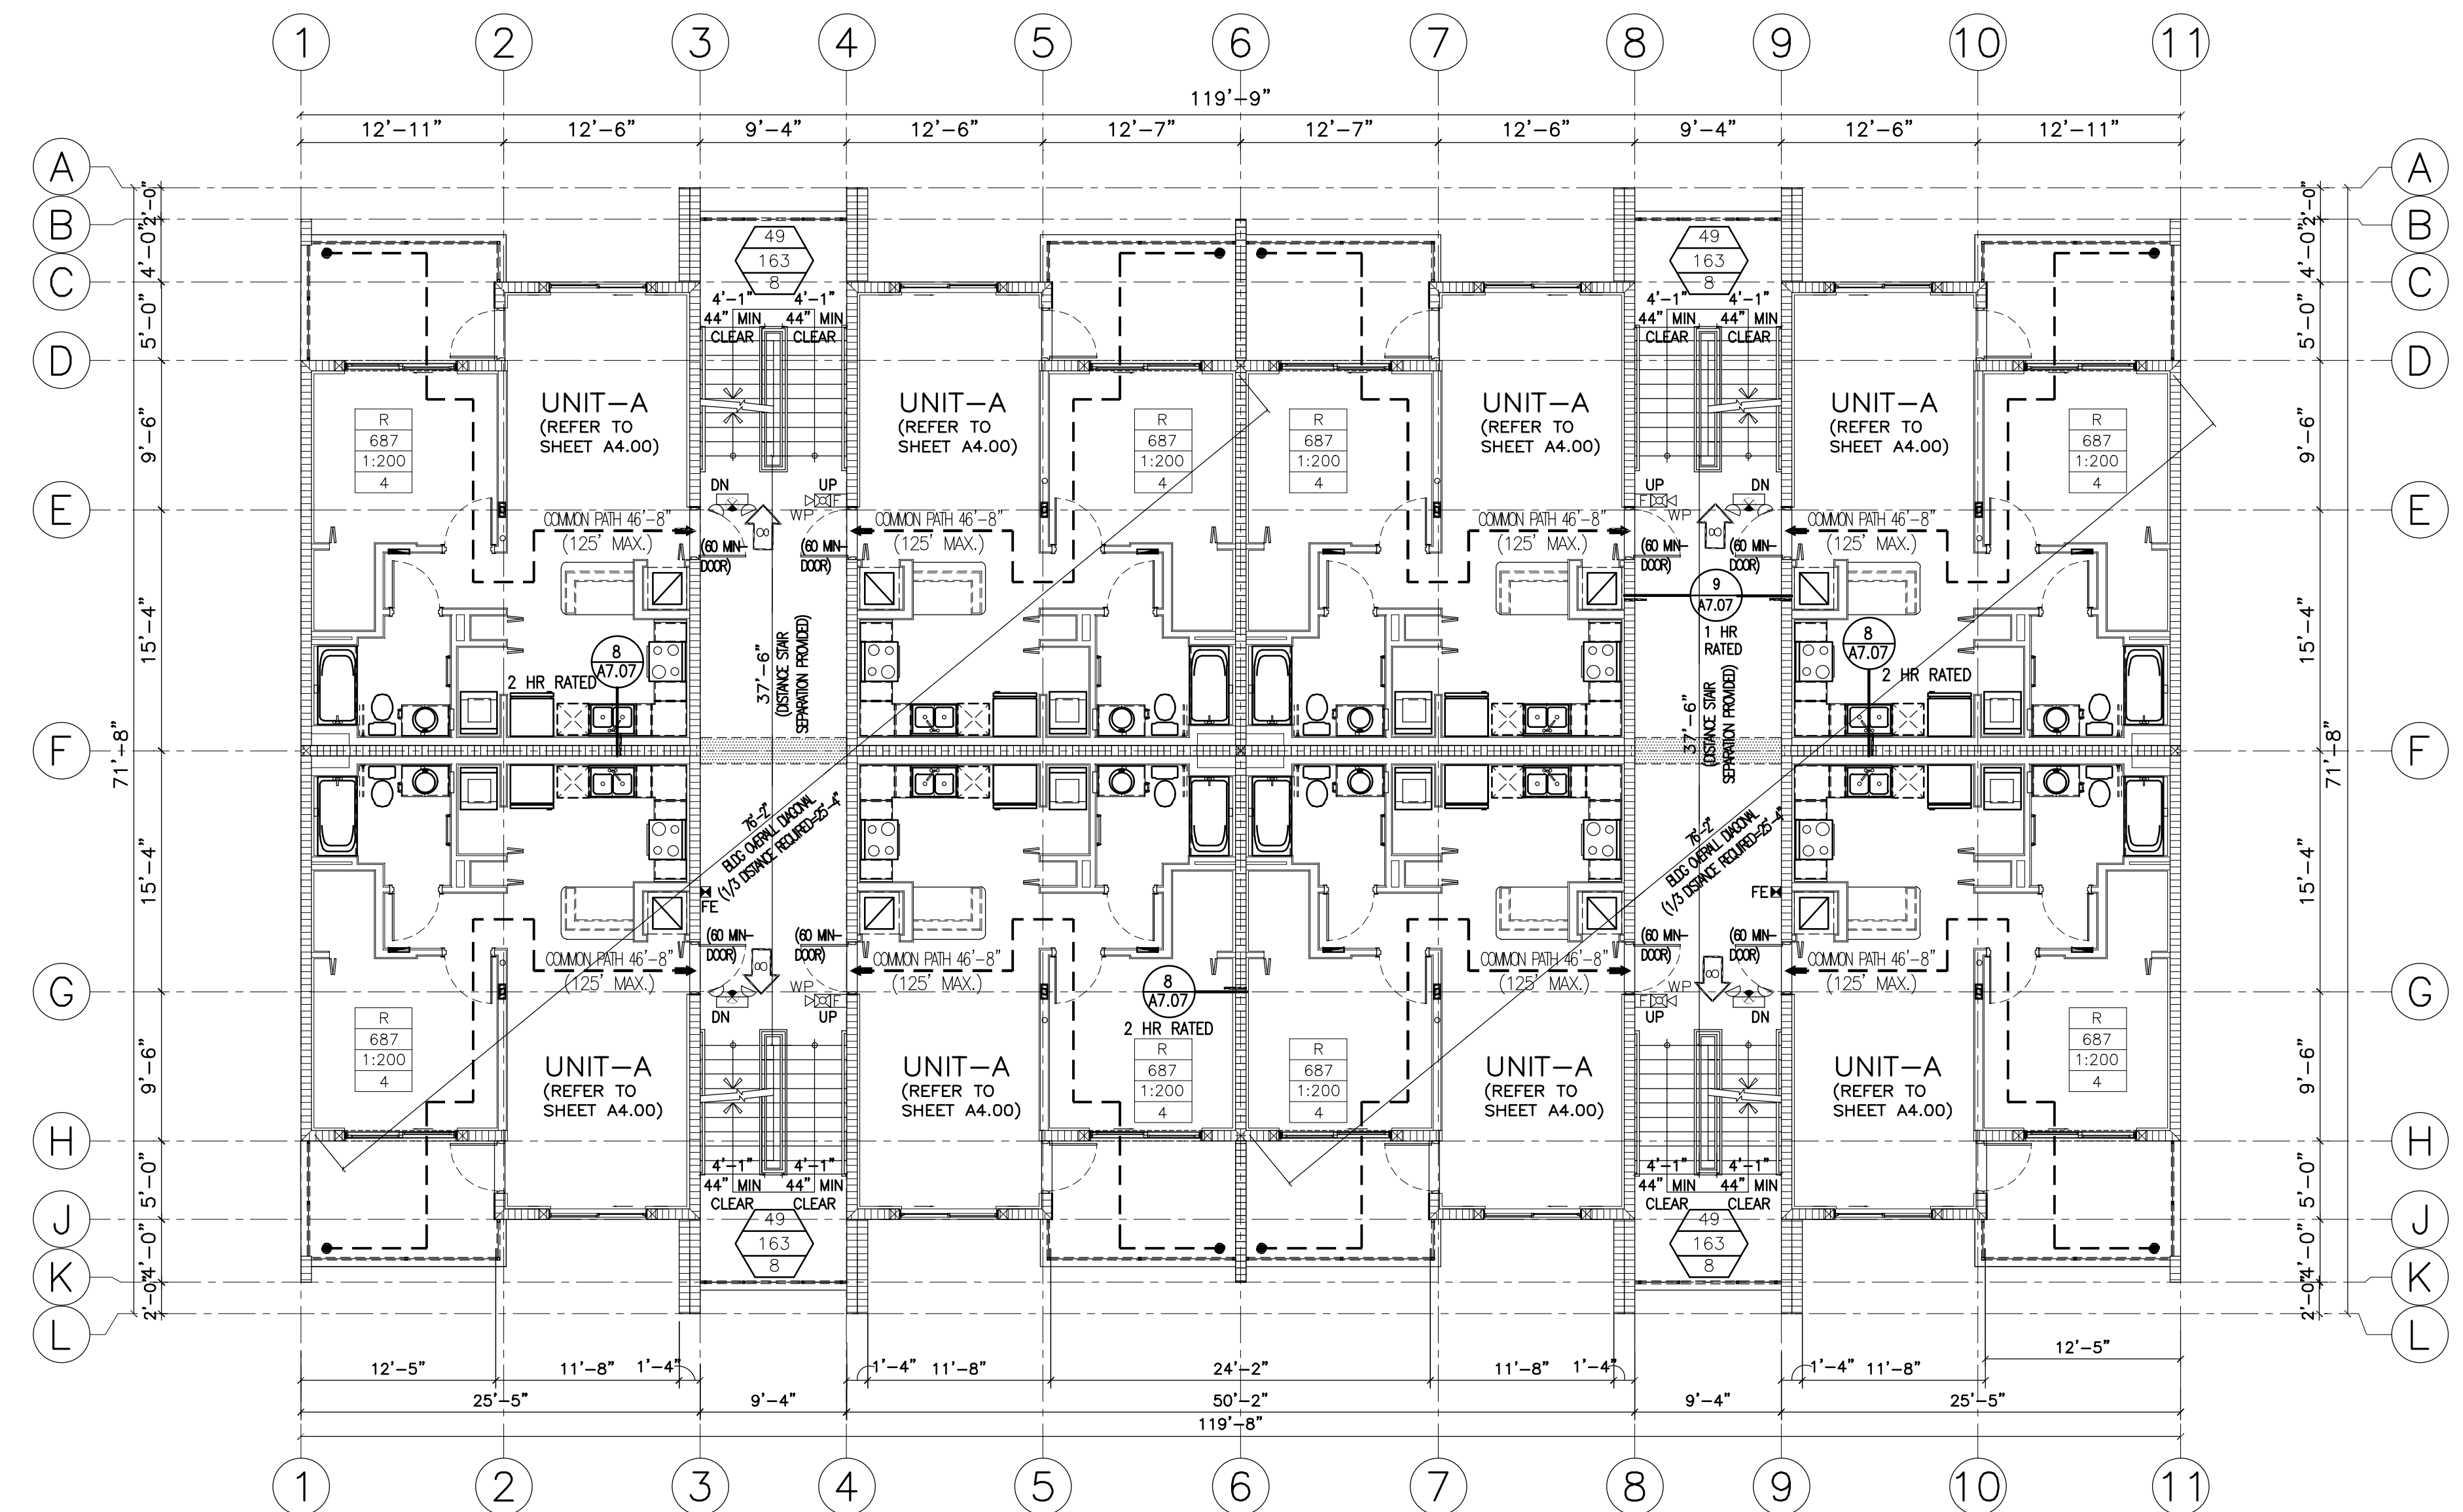

SECOND FLOOR PLAN - LIFE SAFETY - BUILDING #2

SCALE: 1/8" = 1'-0"

AAAC

PZ22-12000008

11/01/2022