




# See attached survey supplied by

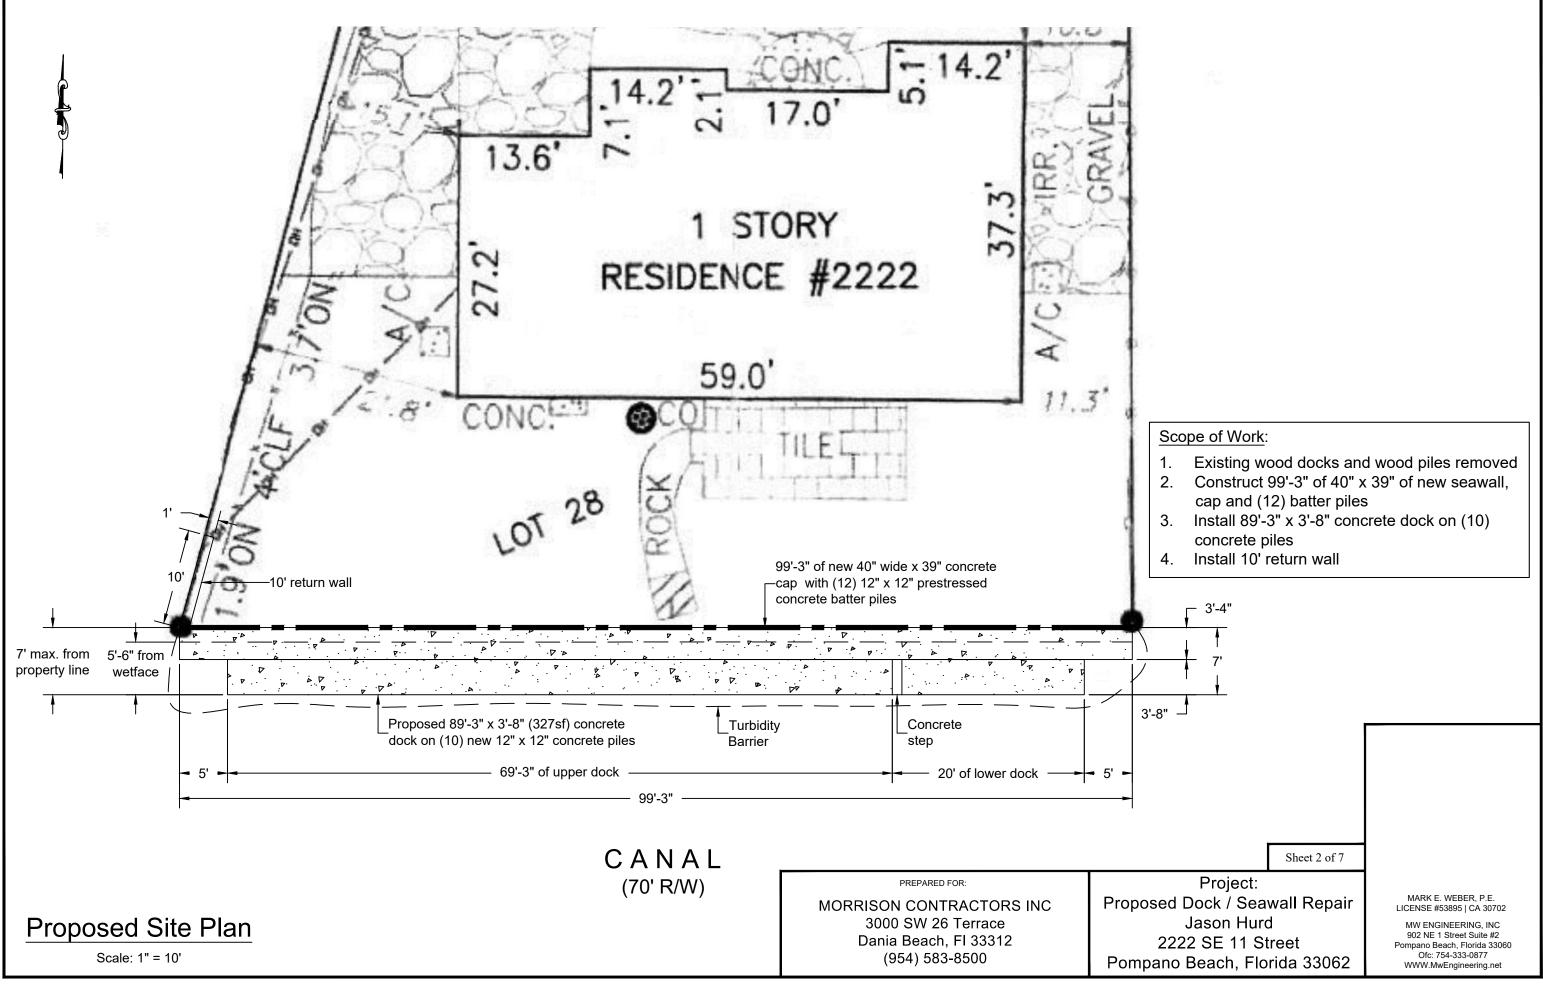

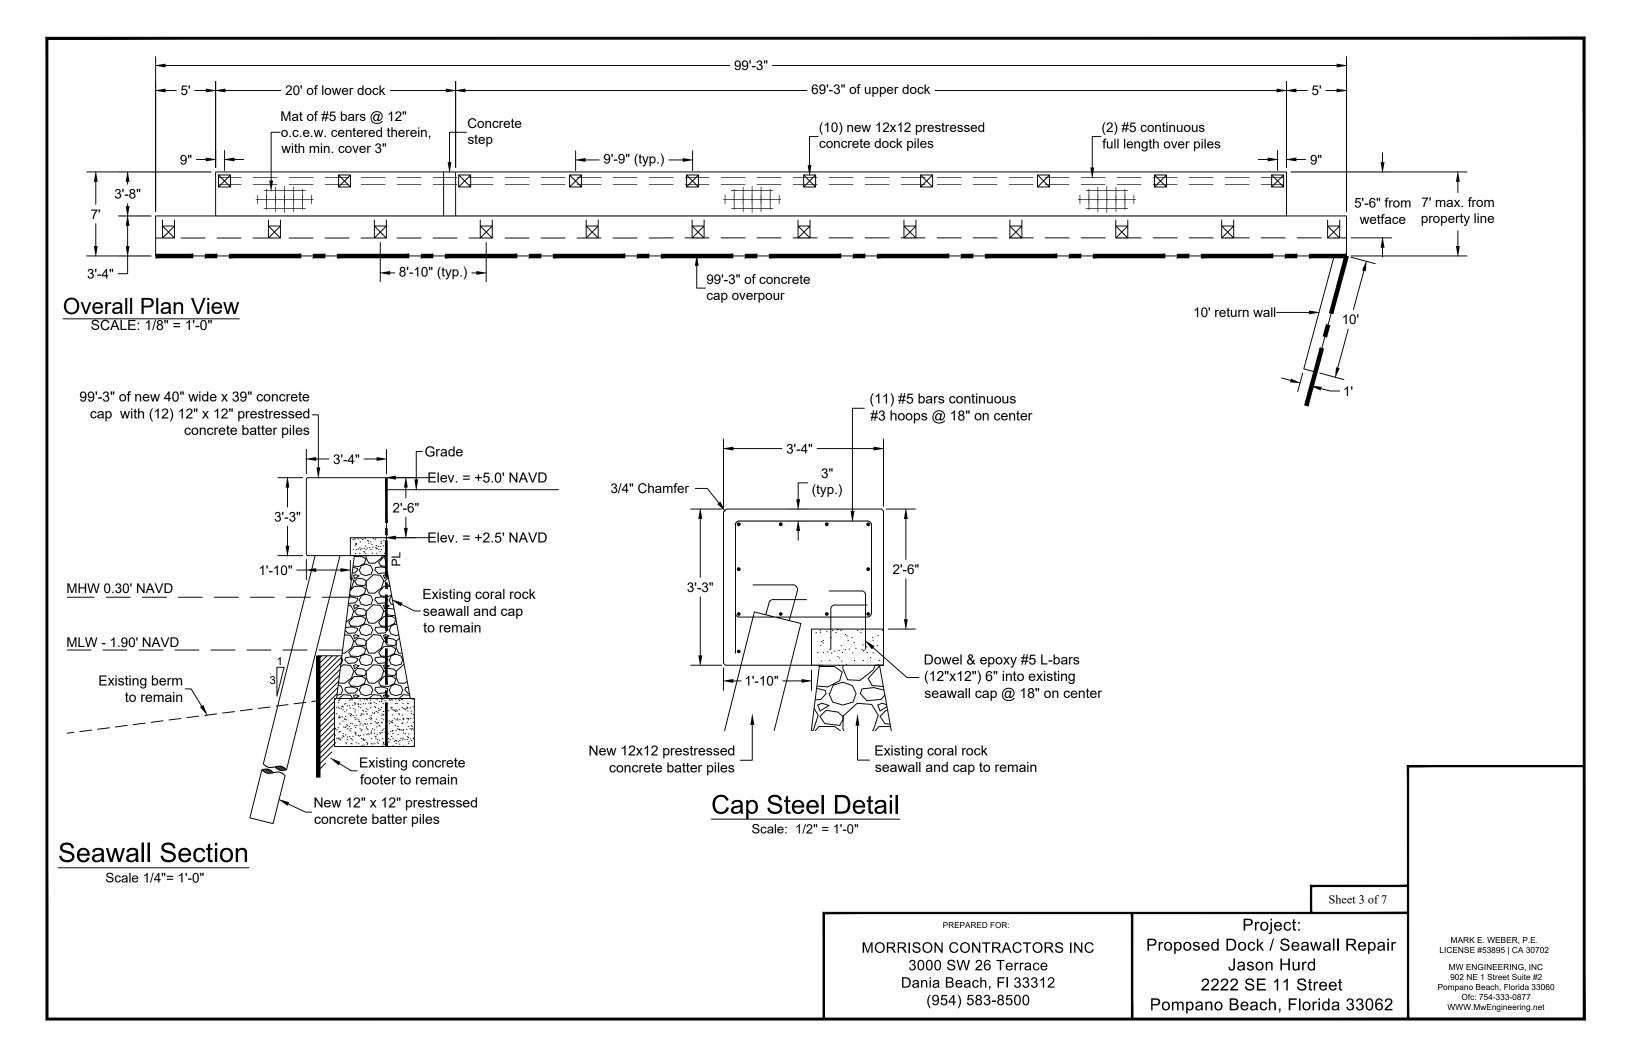

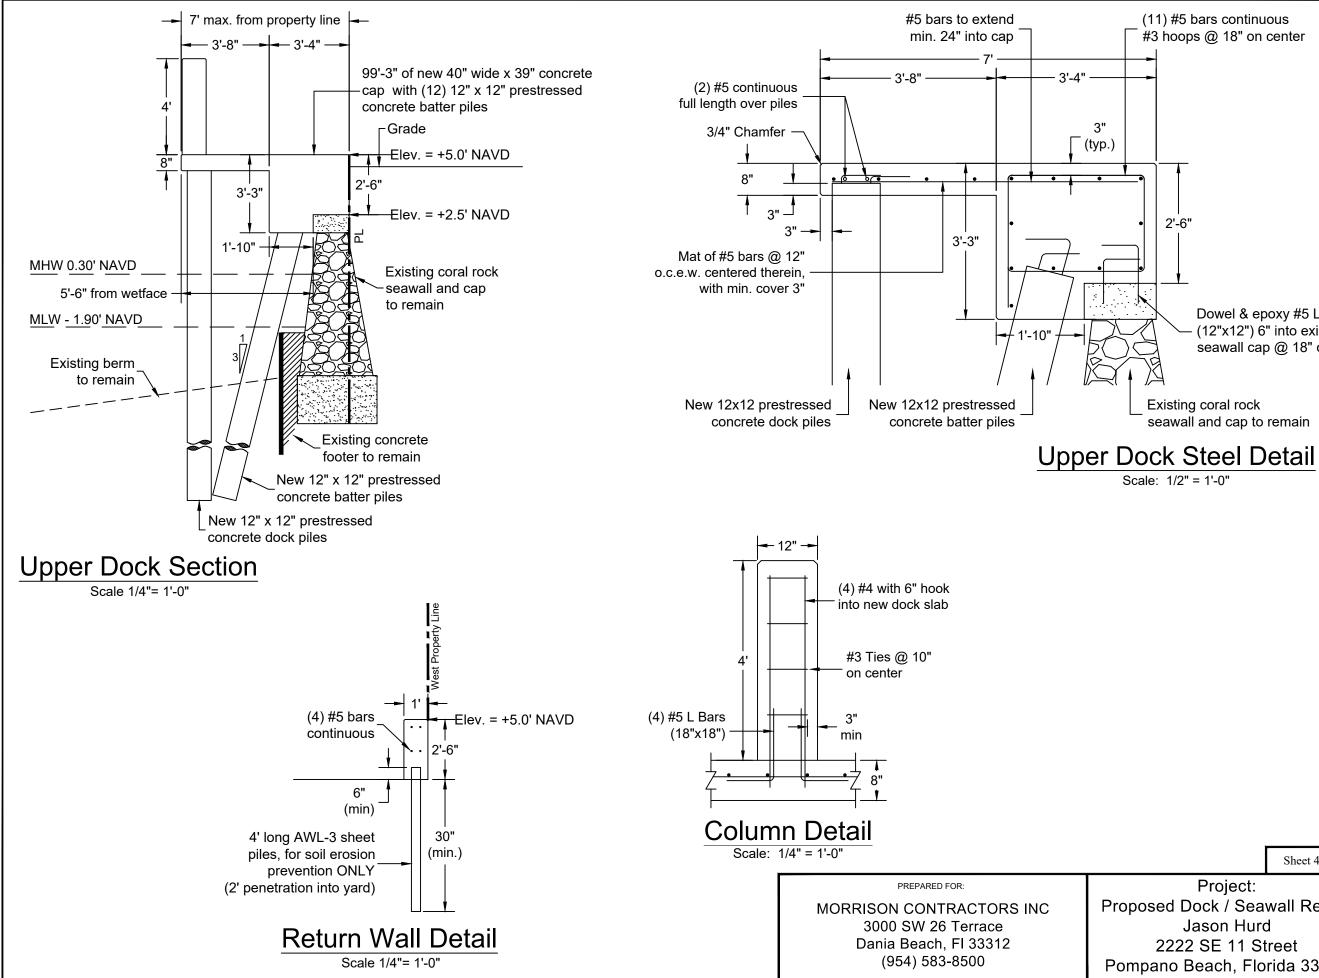


## (11) #5 bars continuous #3 hoops @ 18" on center 2'-6" Dowel & epoxy #5 L-bars (12"x12") 6" into existing seawall cap @ 18" on center

Existing coral rock seawall and cap to remain

	Sheet 4 of 7	
Project: sed Dock / Seawall Repair Jason Hurd 2222 SE 11 Street		MARK E. WEBER, P.E. LICENSE #53895   CA 30702 MW ENGINEERING, INC 902 NE 1 Street Suite #2 Pompano Beach, Florida 3306/
		Ofc: 754-333-0877


WWW.MwEngineering.net

Pompano Beach, Florida 33062

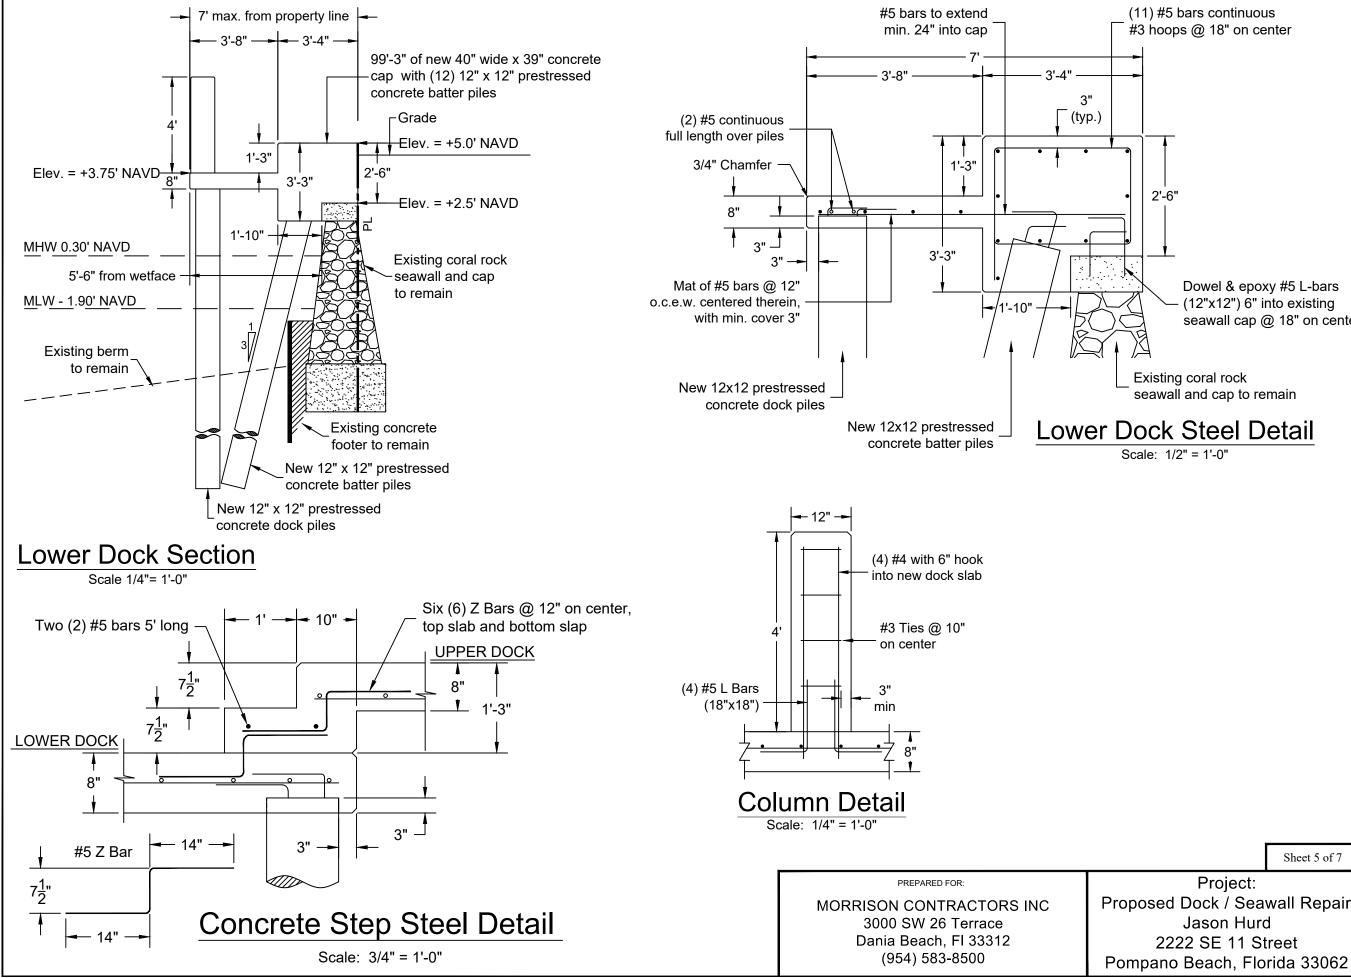

Dowel & epoxy #5 L-bars (12"x12") 6" into existing seawall cap @ 18" on center

Sheet 5 of 7 MARK E. WEBER, P.E. LICENSE #53895 | CA 30702 MW ENGINEERING, INC 902 NE 1 Street Suite #2 Pompano Beach, Florida 33060 Ofc: 754-333-0877 WWW.MwEngineering.net

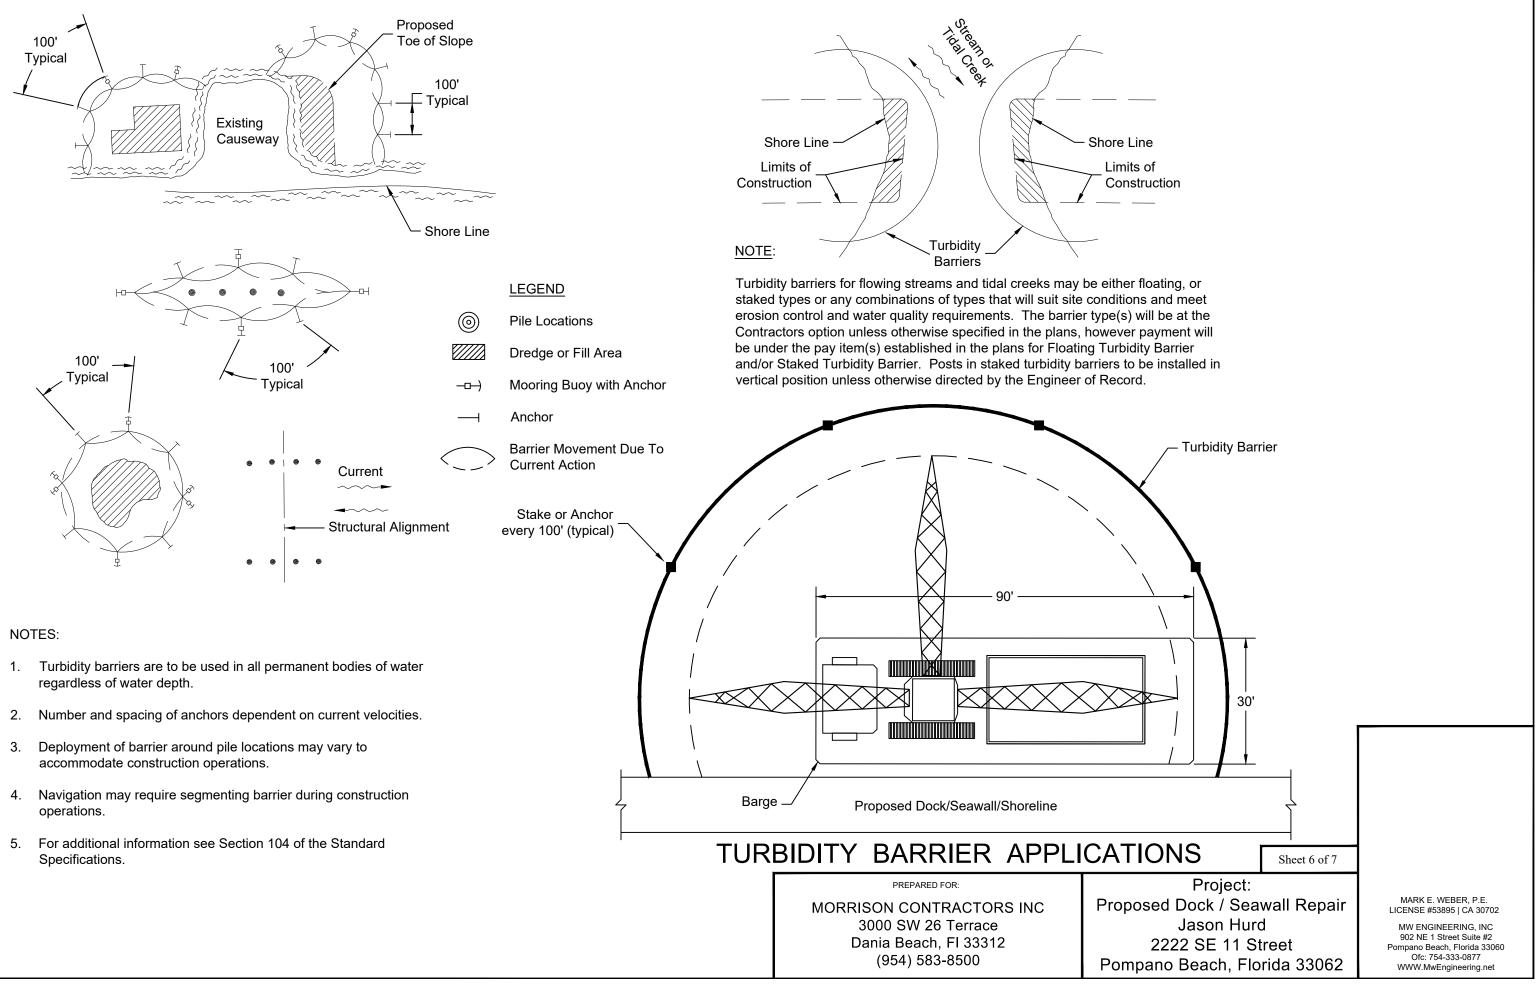

#### **GENERAL NOTES:**

- 1. Construction to follow the Florida Building Code 7th Edition (2020) and amendments as applicable and all Local, State and Federal Laws.
- 2. Licensed contractor shall verify the existing conditions prior to the commencement of the work. Any conflicts or omissions between existing conditions or the various elements of the working drawing shall be brought to the attention of the Engineer prior to the commencement of the work. The Licensed Contractor and all subcontractors are responsible for all lines, elevations, and measurements in connection with their work.
- Do not scale drawings for dimensions. 3.
- Any deviation and/or substitution from the information provided herein shall be submitted to the Engineer for 4. approval prior to commencement of work.
- All unanticipated or unforeseen demolition and/or new construction conditions which require deviation from 5. the plans and notes herein shall be reported to the Engineer prior to commencement of work.
- All new work and/or materials shall conform to all requirements of each administrative body having jurisdiction 6. in each appertaining circumstance.
- 7. All new materials and/or patchwork shall be provided to match existing materials and/or adjoining work where practical except as specifically noted herein.
- Licensed Contractor to shall use all possible care to protect all existing materials, surfaces, and furnishings 8. from damage during all phases of construction.
- Licensed Contractor to verify location of existing utilities prior to commencing work. 9.
- The Licensed contractor to install and remove all shoring and bracing as required for the proper execution of 10. the work.
- 11. Licensed Contractor to obtain all permits as necessary from all Local, State, and Federal agencies.
- 12. Turbidity barriers to be marked with site contractor's company name using permanent markings no smaller than 3 inches in height on the top of the barrier.

#### PILE DRIVING:

- 1. Piles shall be driven using an approved cushion block consisting of material so arranged so as to provide the transmission of hammer energy.
- 2. Piles shall be driven to a minimum allowable bearing capacity of 10 tons for wood, 25 tons for concrete, and 5 tons for pin piles, a minimum of 8' into berm or refusal.
- Piles shall be driven with a drop hammer or gravity hammer provided the hammer shall weight no less 3. than 3,000 pounds, and the fall of the hammer shall not exceed 6'.
- Piles shall be driven with a variation of not more than  $\frac{1}{4}$  inch per foot from the vertical, or from the batter 4. line indicated, with a maximum variation of the head of the pile from the position shown on the plans of not more than three inches.
- Where piling must penetrate strata offering high resistance to driving, the structural engineer of record 5. or special inspector may require that the piles be set in pre-drilled or punched holes. The piles shall reach their final penetration by driving.

## CONCRETE NOTES:

- 1. Concrete shall conform to ACI 318-14 and shall be regular weight, sulfate resistant, with a design strength of 5000 psi at 28 days with a maximum water-cementitious materials ratio, by weight aggregate concrete of 0.40.
- 2. Owner shall employ and pay for testing services from an independent testing laboratory for concrete sampling and testing in accordance with ASTM.
- Licensed contractor is responsible for the adequacy of forms and shoring and for safe practice in their use and removal. 3.
- 4. Concrete cover shall be 3" unless otherwise noted on the approved drawings.
- Reinforcing steel shall be in conformance with the latest version of ASTM A615 Grade 60 specifications. All 5. reinforcement shall be placed in accordance with ACI 315 and ACI Manual of Standard Practice.
- Splices in reinforcing bars shall be not be less than 48 bar diameters and reinforcing shall be continuous around all 6. corners and changes in direction. Continuity shall be provided at corners or changes in direction by bending the longitudinal steel around the corner 48 bar diameters.
- 7. Defective, cracked or loose concrete areas must be cut out, the rebar must be cleaned, coated with zinc and repaired with at least 3" of expoxy-concrete mix or gunnite concrete with sulfate-resistant cement.

## PILE NOTES:

- 1. Concrete piles shall attain 6000 psi compressive strength in 28 days.
- Concrete piles shall be reinforced with four  $\frac{7}{16}$  % lo-lax strands, 270 kips, and 5 ga. spiral ties. 2.
- 3. Concrete piles shall be 12"x12" square, minimum length of 20'.
- 4. Concrete piles shall be cut to leave strands exposed a min. of 18" and tied to dock or cap steel or drill and epoxy (2) #5 8"x12" hook bars 6" into pile.

PREPARED FOR:	
MORRISON CONTRACTORS INC	Propo
3000 SW 26 Terrace	
Dania Beach, FI 33312	
(954) 583-8500	Pomp

Sheet 7 of 7

Project: sed Dock / Seawall Repair Jason Hurd 2222 SE 11 Street ano Beach, Florida 33062

MARK E. WEBER, P.E. LICENSE #53895 | CA 30702 MW ENGINEERING. INC 902 NE 1 Street Suite #2 Pompano Beach, Florida 33060 Ofc: 754-333-0877 WWW.MwEngineering.net