


DESIGNED	DRAWN	CHECKED
NH	NH	JY

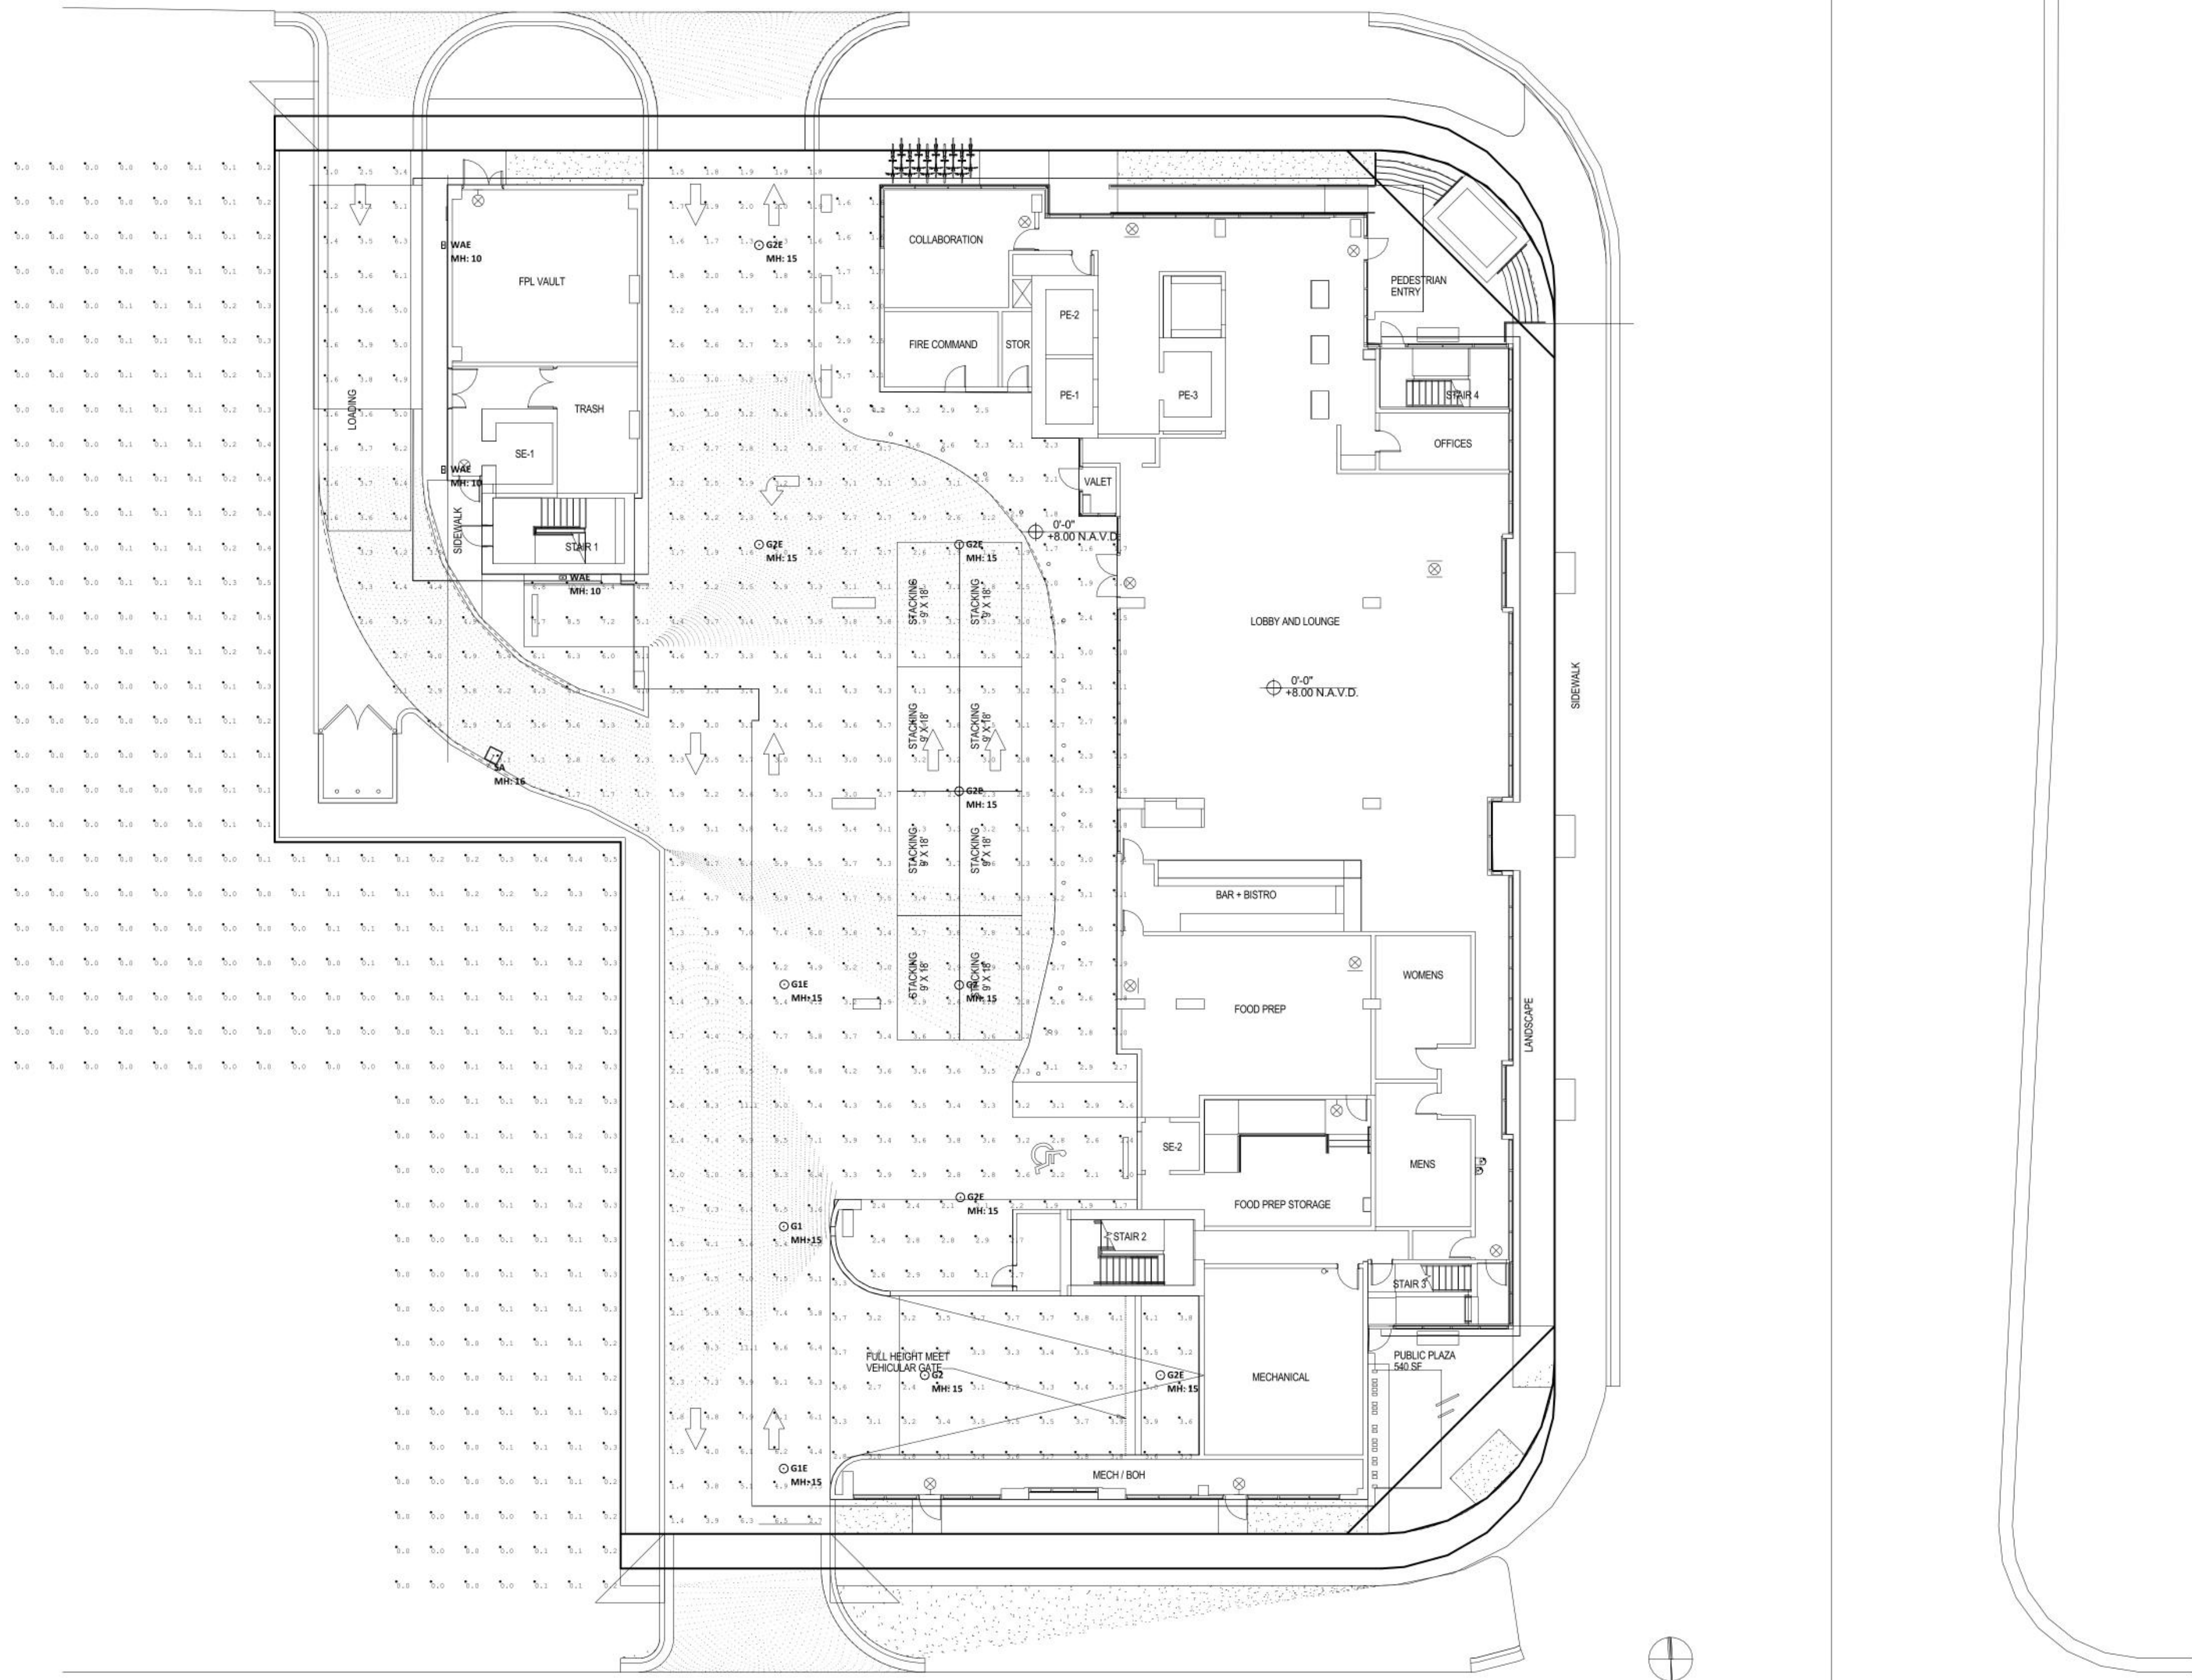


REVISIONS

DATE:	COMM:
02.28.2024	23008

POMPANO HOTEL

101 S. OCEAN BLVD
POMPANO BEACH, FL 33062



Digitally signed
by Jiro Yates
Date:
2024.02.28
09:58:02-05'00'

PHOTOMETRIC GROUND FLOOR
PLAN
DRC SET

AR-501

Luminaire Schedule							
Symbol	Qty	Label	Arrangement	Description	LLF	Luminaire Lumens	Total Watts
○	1	G1	Single	Endeavor Lighting ENAFR30QB1X3704KCXXXX	0.900	5469	42.2
○	2	G1E	Single	Endeavor Lighting ENAFR30QB1X3704KCXXXX (Connected to Generator)	0.900	5469	42.2
○	2	G2	Single	Endeavor Lighting ENAFR30QF1X3704KCXXXX	0.900	5494	42.2
○	6	G2E	Single	Endeavor Lighting ENAFR30QF1X3704KCXXXX (Connected to Generator)	0.900	5494	42.2
□	1	SA	Single	Cree Lighting OSQM-C-6L-40K7-3B-XX-NN-XX, Single Head	0.900	3920	37
□	3	WAE	Single	Cree Lighting OSQW-C-4L-40K7-3M-XX-NN-XX (Connected to Generator)	0.900	4071	26.8

Calculation Summary							
Label	CalcType	Units	A	Max	Min	Avg/Min	Max/Min
Parking and Drive Lanes	Illuminance	fc	3.0	11.1	1.0	3.72	11.10
Ramp	Illuminance	fc	3.0	4.1	2.4	1.40	1.71
Sidewalk	Illuminance	fc	2.0	4.0	1.6	1.62	2.63
Spill	Illuminance	fc	0.1	0.1	0.0	N.A.	N.A.

AAC
PZ23-1200042
05/07/2024