

# DRC

PZ22-12000052  
06/07/2023

**AMERICAN EAGLE FIRE PROTECTION, INC.**

4711 North Dixie Highway – Boca Raton, FL 33431

Telephone: 561-750-3698 – Fax: 561-750-8496

LIC # 33490800012003


## FLOW TEST

STATIC PRESSURE (psi)	RESIDUAL PRESSURE (psi)	PITOT PRESSURE (psi)	PITOT FLOW (gpm)	OUTLET SIZE
74	70	70	1402	2.5"

**Address:** 1801 N. Andrews Avenue, Pompano Beach

**Flow Test Date:** January 9, 2023 – January 10, 2023

### Sketch of Test Location

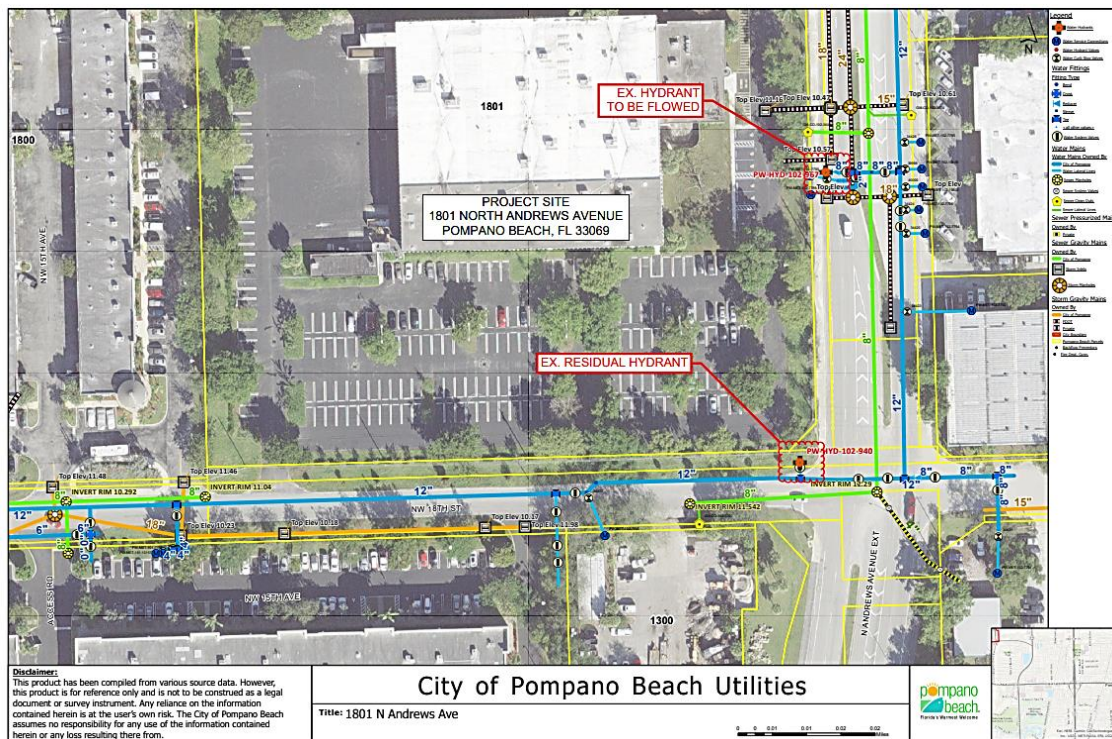

*X Adam Summers*

American Eagle Field Technician

*Date: 1/10/2023*

# DRC

PZ22-12000052  
04/19/2023

# DRC

PZ22-12000052  
03/01/2023