

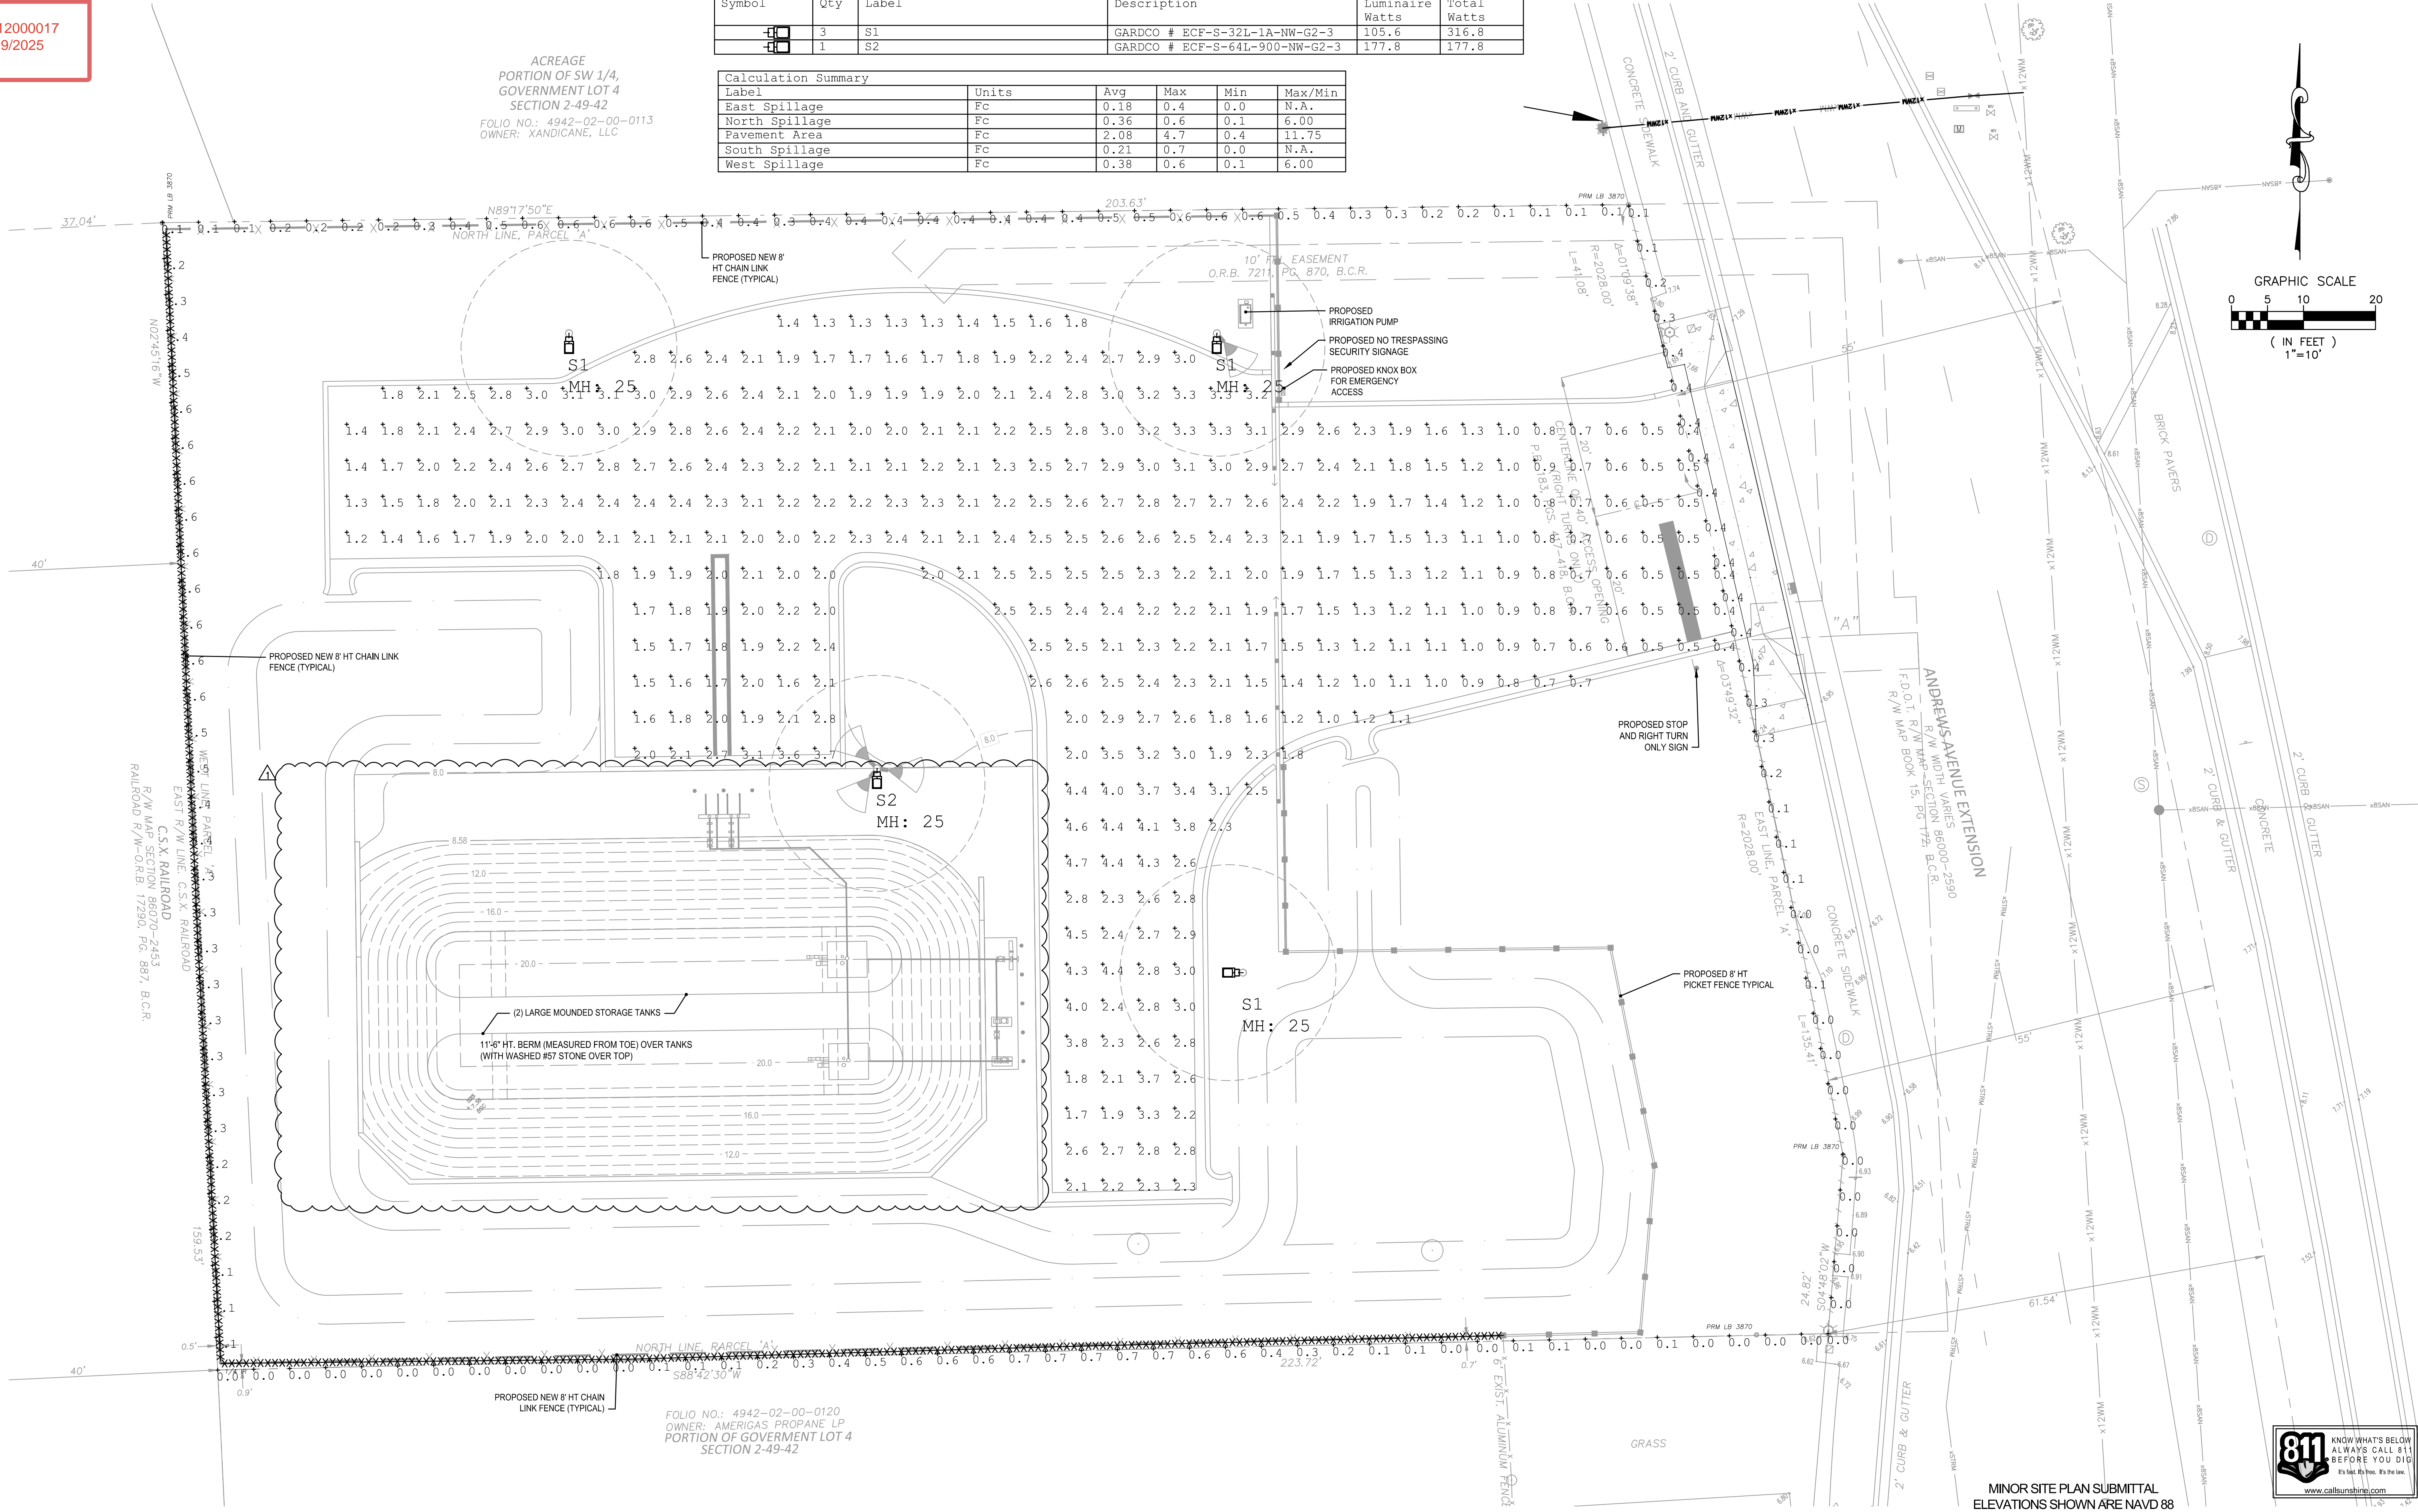


Luminaire Schedule					
Symbol	Qty	Label	Description	Luminaire Watts	Total Watts
	3	S1	GARDCO # ECF-S-32L-1A-NW-G2-3	105.6	316.8
	1	S2	GARDCO # ECF-S-64L-900-NW-G2-3	177.8	177.8

Calculation Summary					
Label	Units	Avg	Max	Min	Max/Min
East Spillage	Fc	0.18	0.4	0.0	N.A.
North Spillage	Fc	0.36	0.6	0.1	6.00
Pavement Area	Fc	2.08	4.7	0.4	11.75
South Spillage	Fc	0.21	0.7	0.0	N.A.
West Spillage	Fc	0.38	0.6	0.1	6.00



NO	DATE	REVISION	BY	NO	DATE	REVISION	BY
1	10/03/25	REVISED PLANS DUE TO CHANGES IN TANK ELEV.	M.D.C.				