
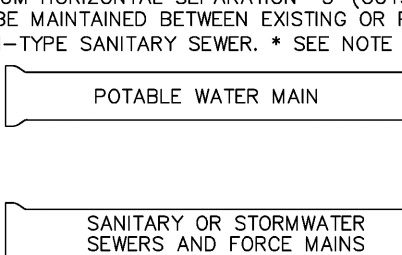
 <p style="text-align: center;">POTABLE WATER MAIN</p> <p style="text-align: center;">3'</p> <p style="text-align: center;">REUSE WATER MAIN OR STORMWATER SEWERS OR STORMWATER FORCE MAINS</p>	 <p style="text-align: center;">POTABLE WATER MAIN</p> <p style="text-align: center;">3'</p> <p style="text-align: center;">EXISTING OR PROPOSED VACUUM-TYPE SANITARY SEWER</p>												
	<p>A MINIMUM HORIZONTAL SEPARATION 3' (OUTSIDE TO OUTSIDE), SHALL BE MAINTAINED BETWEEN POTABLE WATER MAINS AND STORMWATER SEWERS, STORMWATER FORCE MAINS AND REGULATED REUSE WATER MAINS.</p>													
	 <p style="text-align: center;">POTABLE WATER MAIN</p> <p style="text-align: center;">6' MIN.</p> <p style="text-align: center;">SANITARY OR STORMWATER SEWERS AND FORCE MAINS</p>													
	<p>A MINIMUM HORIZONTAL SEPARATION OF 6' (OUTSIDE TO OUTSIDE), SHALL BE MAINTAINED BETWEEN POTABLE WATER MAINS AND EXISTING OR PROPOSED GRAVITY-OR PRESSURE TYPE SANITARY SEWER, WASTEWATER FORCE MAIN OR NOT REGULATED REUSE WATER MAIN. ** SEE NOTE D(1)(C).</p>													
<p><u>MINIMUM HORIZONTAL SEPARATION</u> <u>REQUIREMENTS FOR POTABLE WATER,</u> <u>REUSE, STORMWATER AND SEWER LINES</u></p>														
<p>ENGINEERING STANDARDS 2025</p>														
<p>REVISIONS</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 10%;">BY</td> <td style="width: 10%;">DATE</td> <td style="width: 80%;">ENGINEERING DIVISION</td> </tr> <tr> <td>S.S.</td> <td>01/12</td> <td>CITY OF POMPAÑO BEACH</td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </table>	BY	DATE	ENGINEERING DIVISION	S.S.	01/12	CITY OF POMPAÑO BEACH							<p>MIN. HORIZONTAL SEPARATION FOR POTABLE WATER</p>	<p>DATE: JAN. 2022 DWN. NO.</p>
BY	DATE	ENGINEERING DIVISION												
S.S.	01/12	CITY OF POMPAÑO BEACH												
<p>SCALE: N.T.S.</p>		<p>121-1</p>												