

**DRC**PZ25- 12000028  
01/07/2026**AMERICAN EAGLE FIRE PROTECTION, INC.**

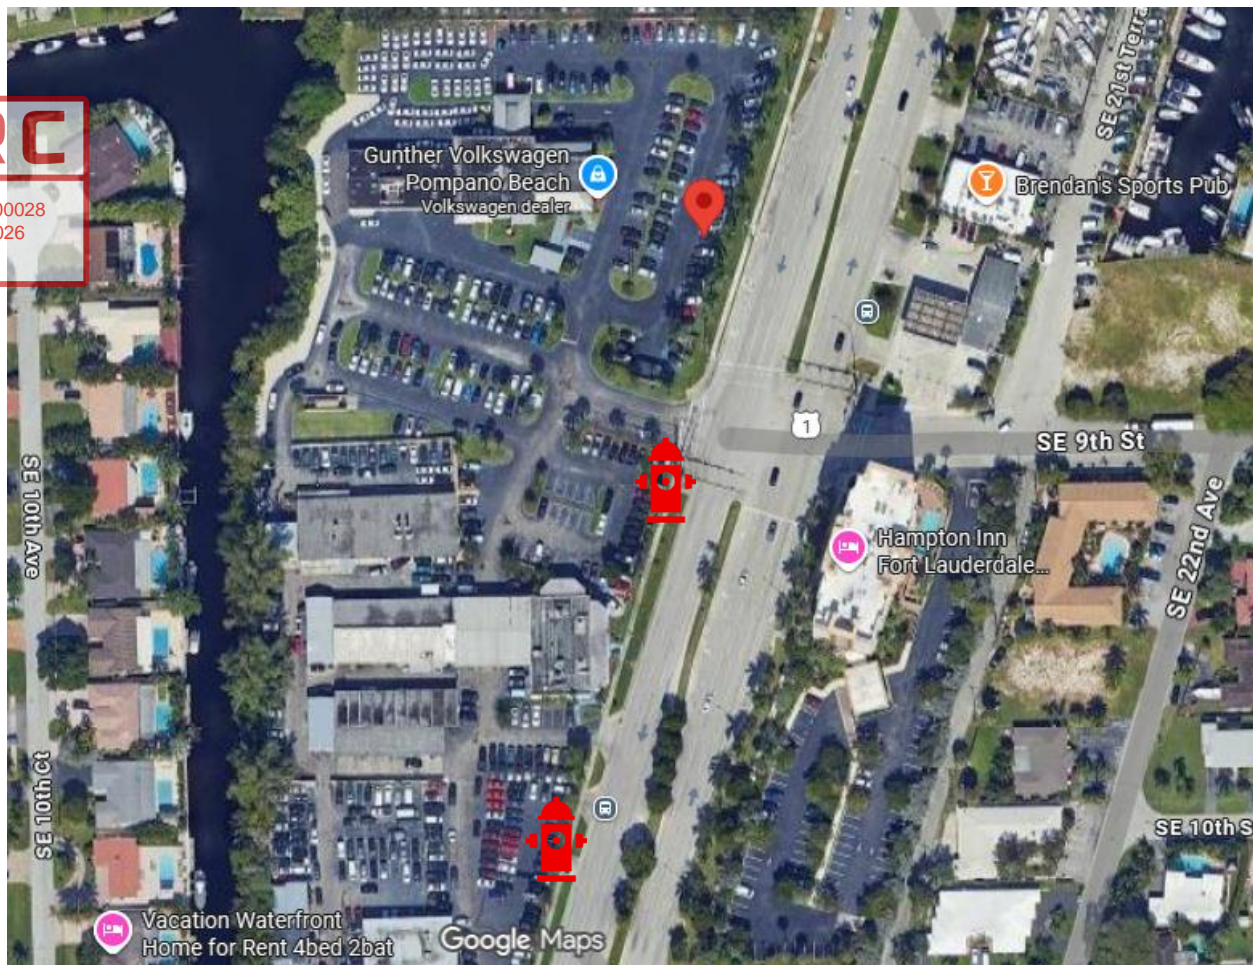
4711 North Dixie Highway – Boca Raton, FL 33431

Telephone: 561-750-3698 – Fax: 561-750-8496

LIC # 33490800012003

**FLOW TEST**

STATIC PRESSURE (psi)	RESIDUAL PRESSURE (psi)	PITOT PRESSURE (psi)	PITOT FLOW (gpm)	OUTLET SIZE
82	75	33	960	2"

**Address:** 855 S Federal Highway, Pompano Beach**Flow Test Date:** Monday, October 6, 2025 at 8:00 a.m. to Tuesday, October 7, 2025 at 8:00 a.m.**Sketch of Test Location**

Please note this test was performed using "The Little Hose Monster". The co-efficient and flow data are based on manufactures UL Listed specific specs designed for use of the 2 inch pitotless nozzle.

**DRC**PZ25- 12000028  
03/18/2026X *Barba Cinetta*

American Eagle Technician

Date: 10-08-2025