















LST RST SST




				Hunter PROS-00-PCN 10 Flood Bubbler, on a PROS - 04.	8	30
---	---	---	---	---	---	----


<u>SYMBOL</u>	<u>MANUFACTURER/MODEL/DESCRIPTION</u>	<u>QTY</u>
	Hunter ICZ-101-25 Drip Control Zone Kit. 1" ICV Globe Valve with 1" HY100 filter system. Pressure Regulation: 25psi. Flow Range: 2 GPM to 20 GPM. 150 mesh stainless steel screen.	1

	Area to Receive Dripline	
	Hunter HDL-06-18	
	On-Surface Pressure Compensating Landscape Dripline . 0.6 GPH	288.8 lf
	emitters at 18" O.C. Dripline laterals spaced at 18" apart, with	
	emitters offset for triangular pattern.	


SYMBOL	MANUFACTURER/MODEL/DESCRIPTION	QTY
	Hunter PGV-100G-S 1" Plastic Electric Remote Control Valve, for Residential/Light Commercial Use. Slip x Slip. Globe Configuration, No Flow Control.	2
	Gate Valve Aqualine Gate Valve or approved equal	1
	Febco 765 1" Pressure Vacuum Breaker, brass with ball valve SOV. Install 12" (305MM) above highest downstream outlet and the highest point in the downstream piping.	1
	Hunter PCC-600 Light Commercial & Residential Controller, 6-Station fixed controller, 120 VAC, Outdoor model	1
	Hunter RAIN-CLIK Rain Sensor, with conduit installation, mount as noted. Normally closed switch.	1
	Irrigation Meter 1" Irrigation Meter	1
— — —	Irrigation Lateral Line: PVC Class 200	790 lf
— — —	Irrigation Mainline: PVC Schedule 40	15 lf

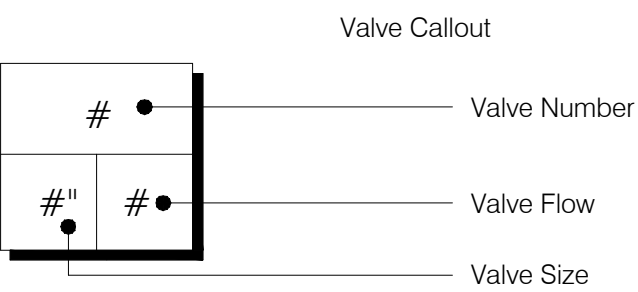

*Quantities to be field verified by contractor
 *All items listed may be substituted with LA/Owner approved equal
 *See sheet IR-02 for irrigation details & specifications

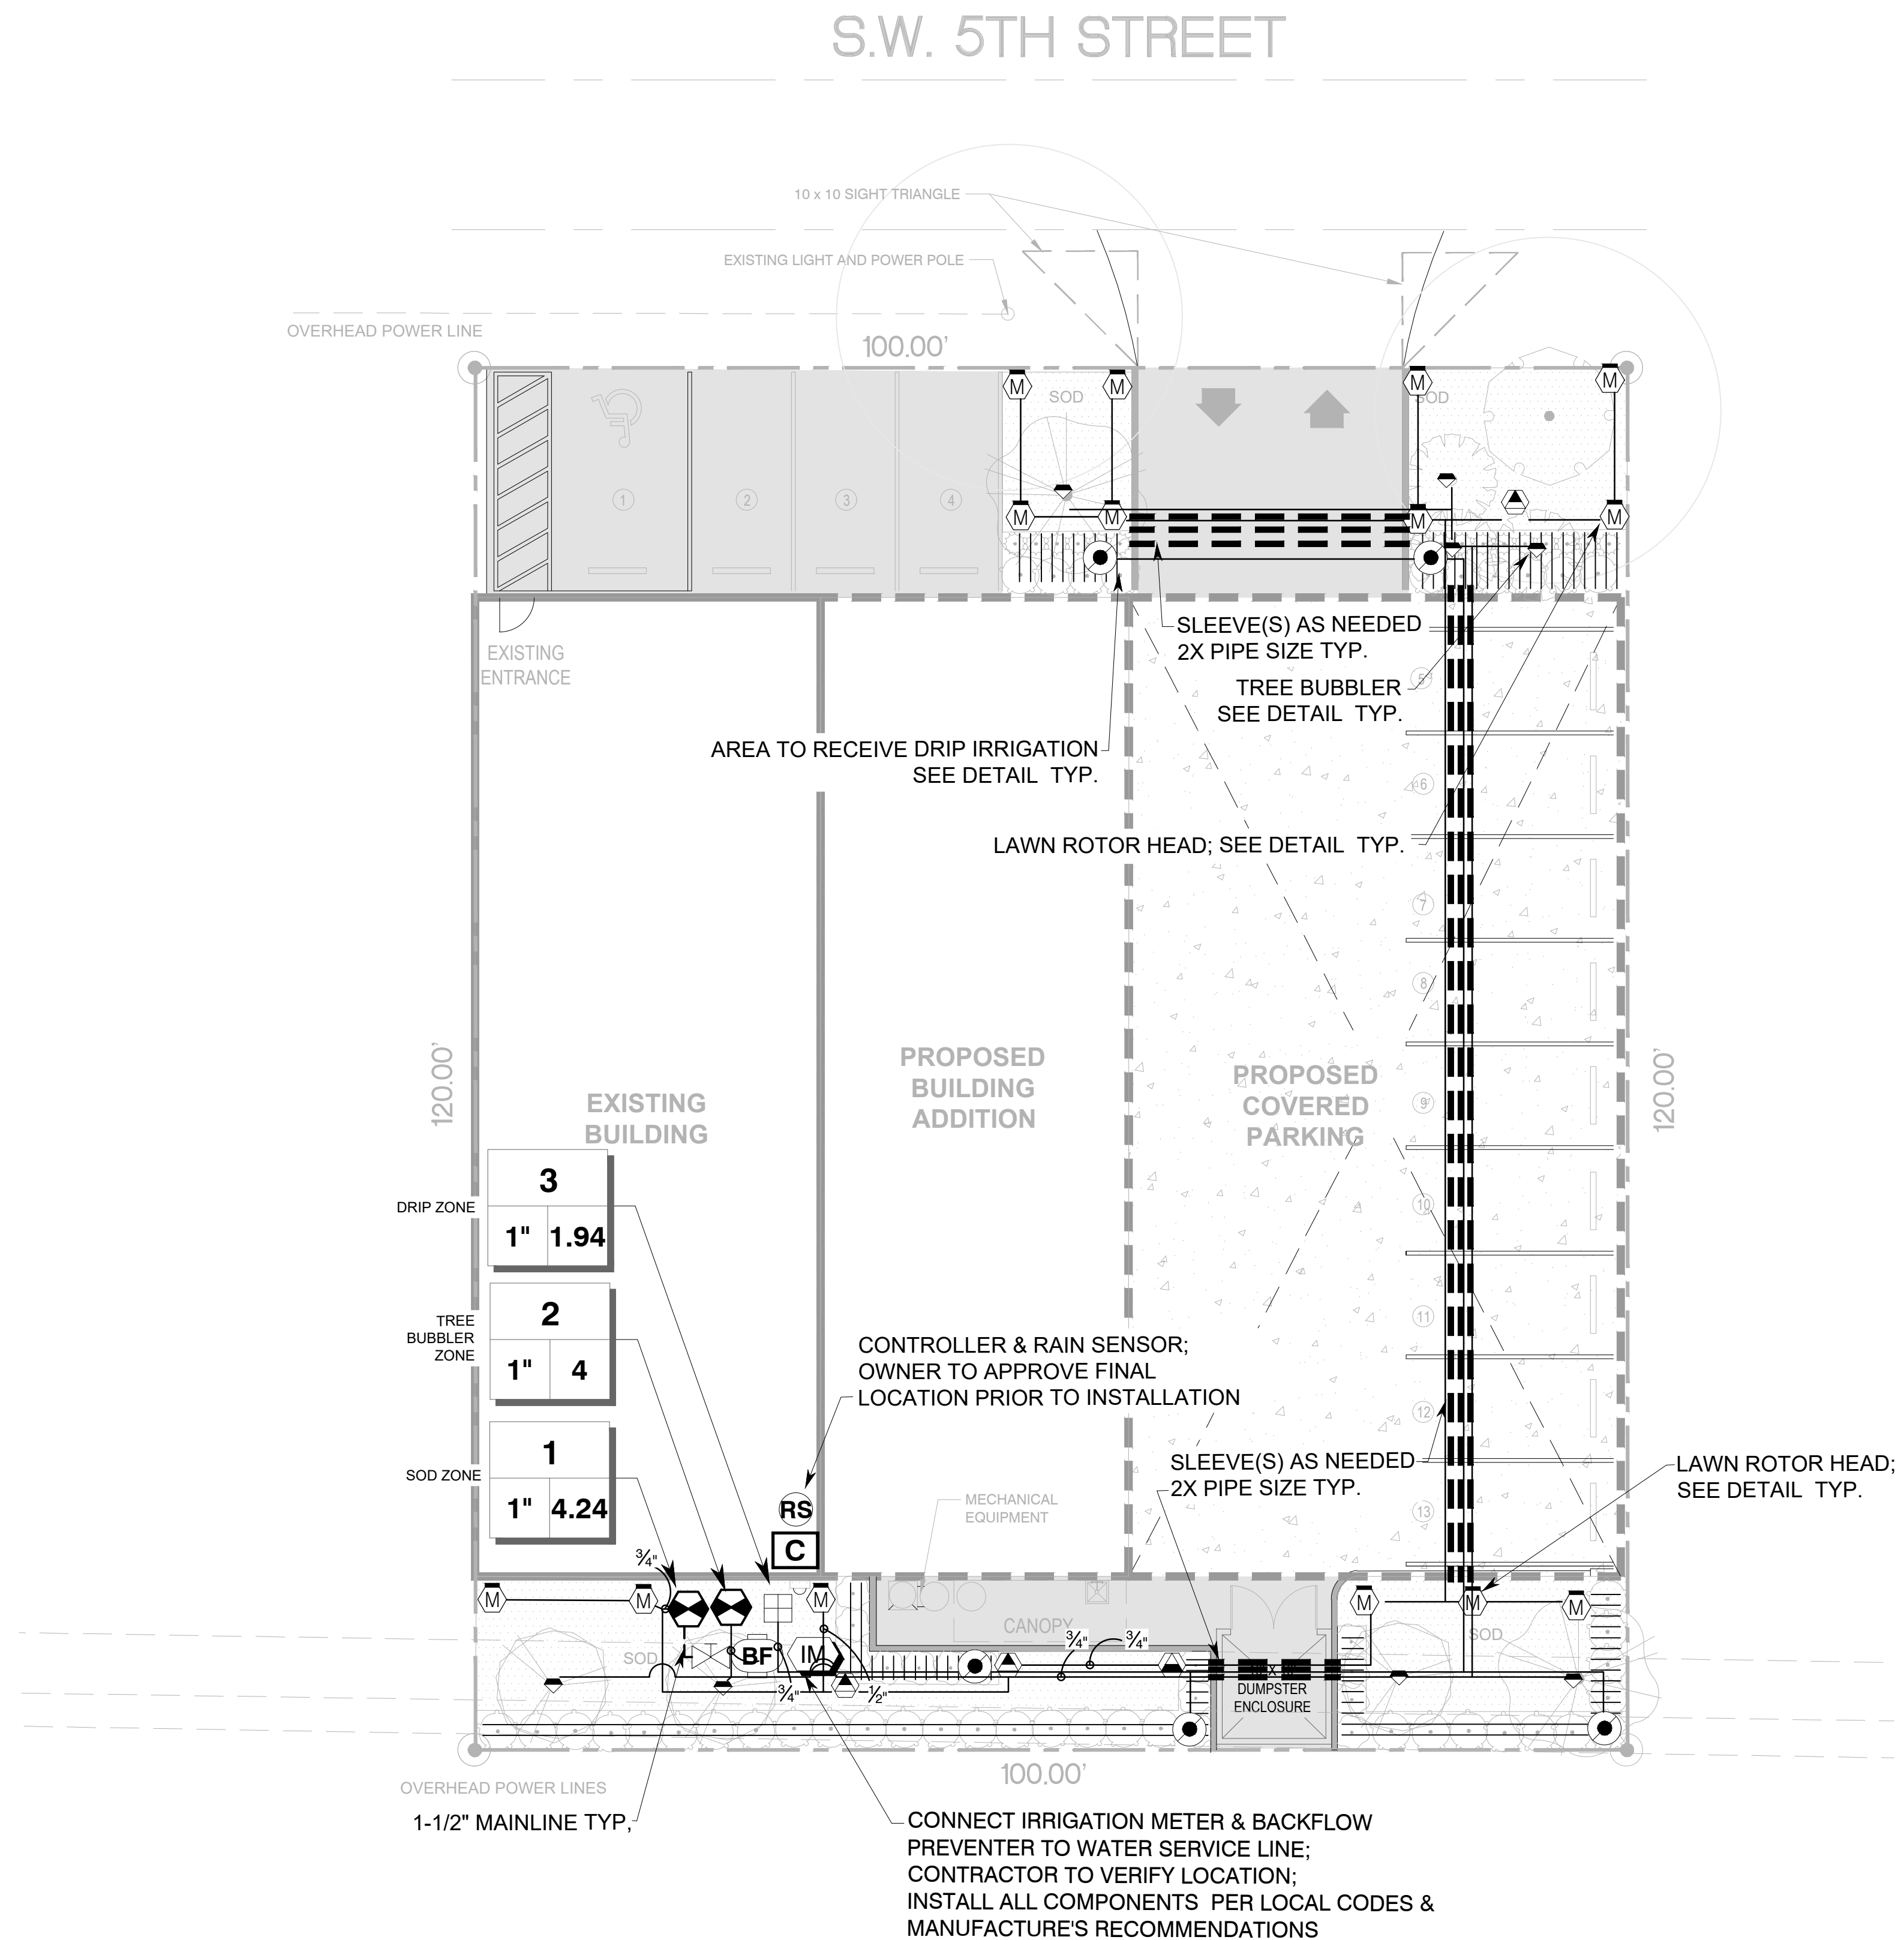


- The irrigation system shall be installed in accordance with requirements of the Building Code.
- The irrigation system rain-sensing cutoff device shall be located and installed so that building eaves, balconies, and similar overhangs do not interfere with effective operation of the device.
- The irrigation system shall be properly maintained in good working order and provide a minimum coverage of 100 percent with 50 percent overlap.
- Contractor to field locate mainline & laterals as needed to avoid conflicts with civil or landscape items.

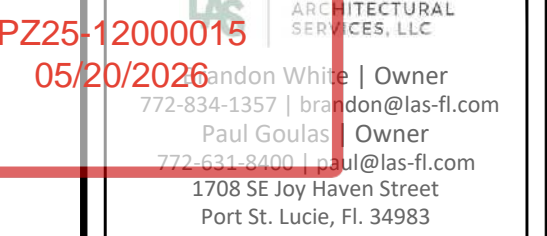


Architect:

RAMOS ARCHITECTS & ASSOC.
780 Tamiami Canal Road
Miami, FL 33144
(305) 506-7388


Proposed Building Addition & Parking For: 50 S.W. 5th Street Pompano Beach, FL 33060

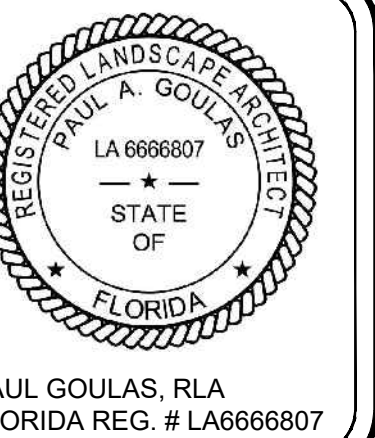[illegible]

Drawn By:	PG
Checked By:	PG
Municipal Project:	
Scale:	



SCALE: 1" = 10'



R-01

PZ25-12000015

08/06/2025

