

SYMMETRIK INC.

FIRE PROTECTION & SECURITY SYSTEMS

1052 NW 53rd STREET FORT LAUDERDALE FL 33309 - PH: 954-358-7696 - FAX: 954-358-5880 - EMAIL: INFO@SYMMETRIK.US

Date: 11/06/2019


FIRE FLOW TEST PICTURES

To: POMPANO BEACH FIRE
DEPARTMENT

Project: Festival Market – 2900 Sample Road

As per your request please see attached:

1. Key Plan:

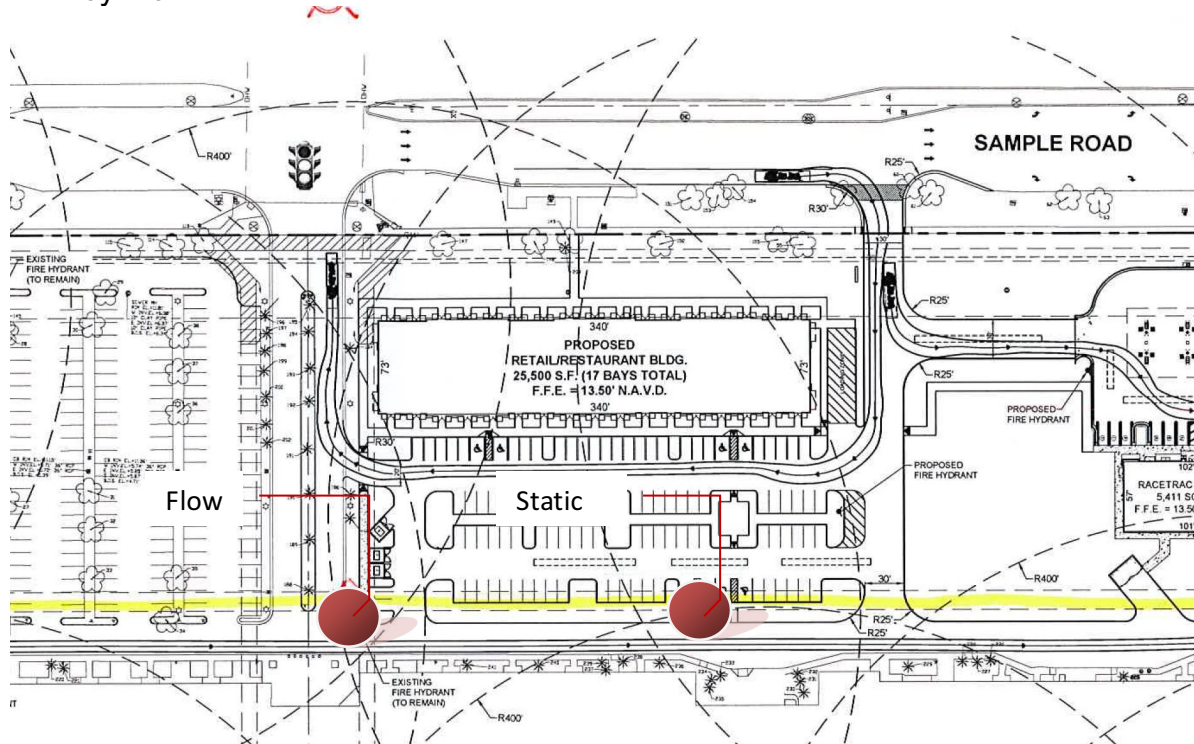

P&Z

Company of Trust and Integrity!

PZ19-12000016
10/28/2020

1. Hydrant Static: Pressure 71 psi and 65 average psi during Flow Test.





Company of Trust and Integrity !

P&Z
PZ19-12000016
10/28/2020



Company of Trust and Integrity !

P&Z
PZ19-12000016
10/28/2020

2. Hydrant Flow : 45 psi Average.



Print Name _____

Title _____ Date _____

Company of Trust and Integrity !

P&Z

PZ19-12000016
10/28/2020