


FOR:  
PORTMAN HOLDINGS

COPYRIGHT © 2024 MSA ARCHITECTS, INC.  
THE ARCHITECTURAL DESIGN AND DETAIL  
DRAWINGS FOR THIS BUILDING AND/OR  
OVERALL PROJECT ARE THE LEGAL  
PROPERTY OF AND ALL RIGHTS ARE  
RESERVED BY THE ARCHITECT, THEIR USE  
FOR REPRODUCTION, CONSTRUCTION, OR  
DISTRIBUTION IS PROHIBITED UNLESS  
AUTHORIZED IN WRITING BY THE ARCHITECT.




LS-0.6

LS-0.6

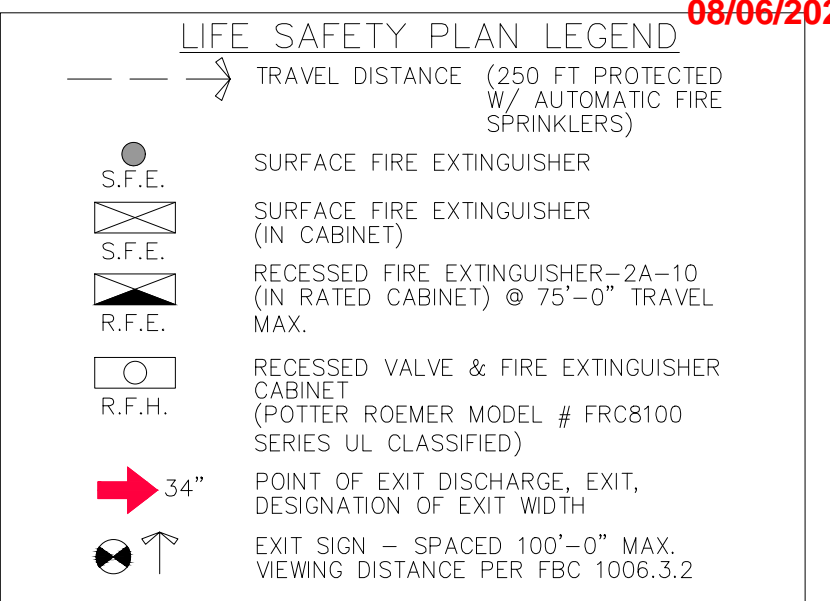

BUILDING (NORTH)			
OCCUPANT LOAD FACTOR, PER F.F.P.C 7.3.1.2 & PER F.B.C. 1004.1.2			
OCCUPANCY CALCULATION:			
SPACE	S.F.	S.F./PERSON	OCCUP. LOAD
A-3 OCCUPANCY GYM	1,875 SQ. FT.	50 S.F.	38 OCCUP.
A-3 OCCUPANCY AMENITY/CLUBROOM	4,743 SQ. FT.	15 S.F.	317 OCCUP.
A-3 OCCUPANCY POOL DECK	3,200 SQ. FT.	30 S.F.	107 OCCUP.
A-3 OCCUPANCY POOL	1,125 SQ. FT.	50 S.F.	23 OCCUP.
R-2 OCCUPANCY RESIDENTIAL AREA	37,932 SQ. FT.	200 S.F.	190 OCCUP.
S-2 OCCUPANCY PARKING GARAGE	8,615 SQ. FT.	200 S.F.	43 OCCUP.
S-2 OCCUPANCY BACK-OF-HOUSE	270 SQ. FT.	300 S.F.	1 OCCUP.
TOTAL			719 OCCUP.
EGRESS CAPACITY TABULATIONS			
GROUP R-2			
NEW APARTMENT -- FPPC-101, CHAPTER 30			
STORAGE -- FPPC-101, CHAPTER 42			
LEVEL EGRESS WIDTH REQUIRED	719 OCCUP.(0.2) =	143.8"	
LEVEL EGRESS WIDTH PROVIDED	6 @ 34" =	204"	
R-2 OCCUPANCY			
STAIR EGRESS WIDTH REQUIRED	676 OCCUP.(0.3) =	202.8"	
STAIR EGRESS WIDTH PROVIDED	6 @ 41" =	246"	
S-2 OCCUPANCY			
STAIR EGRESS WIDTH REQUIRED	43 OCCUP.(0.3) =	12.9"	
STAIR EGRESS WIDTH PROVIDED	1 @ 41" =	41"	

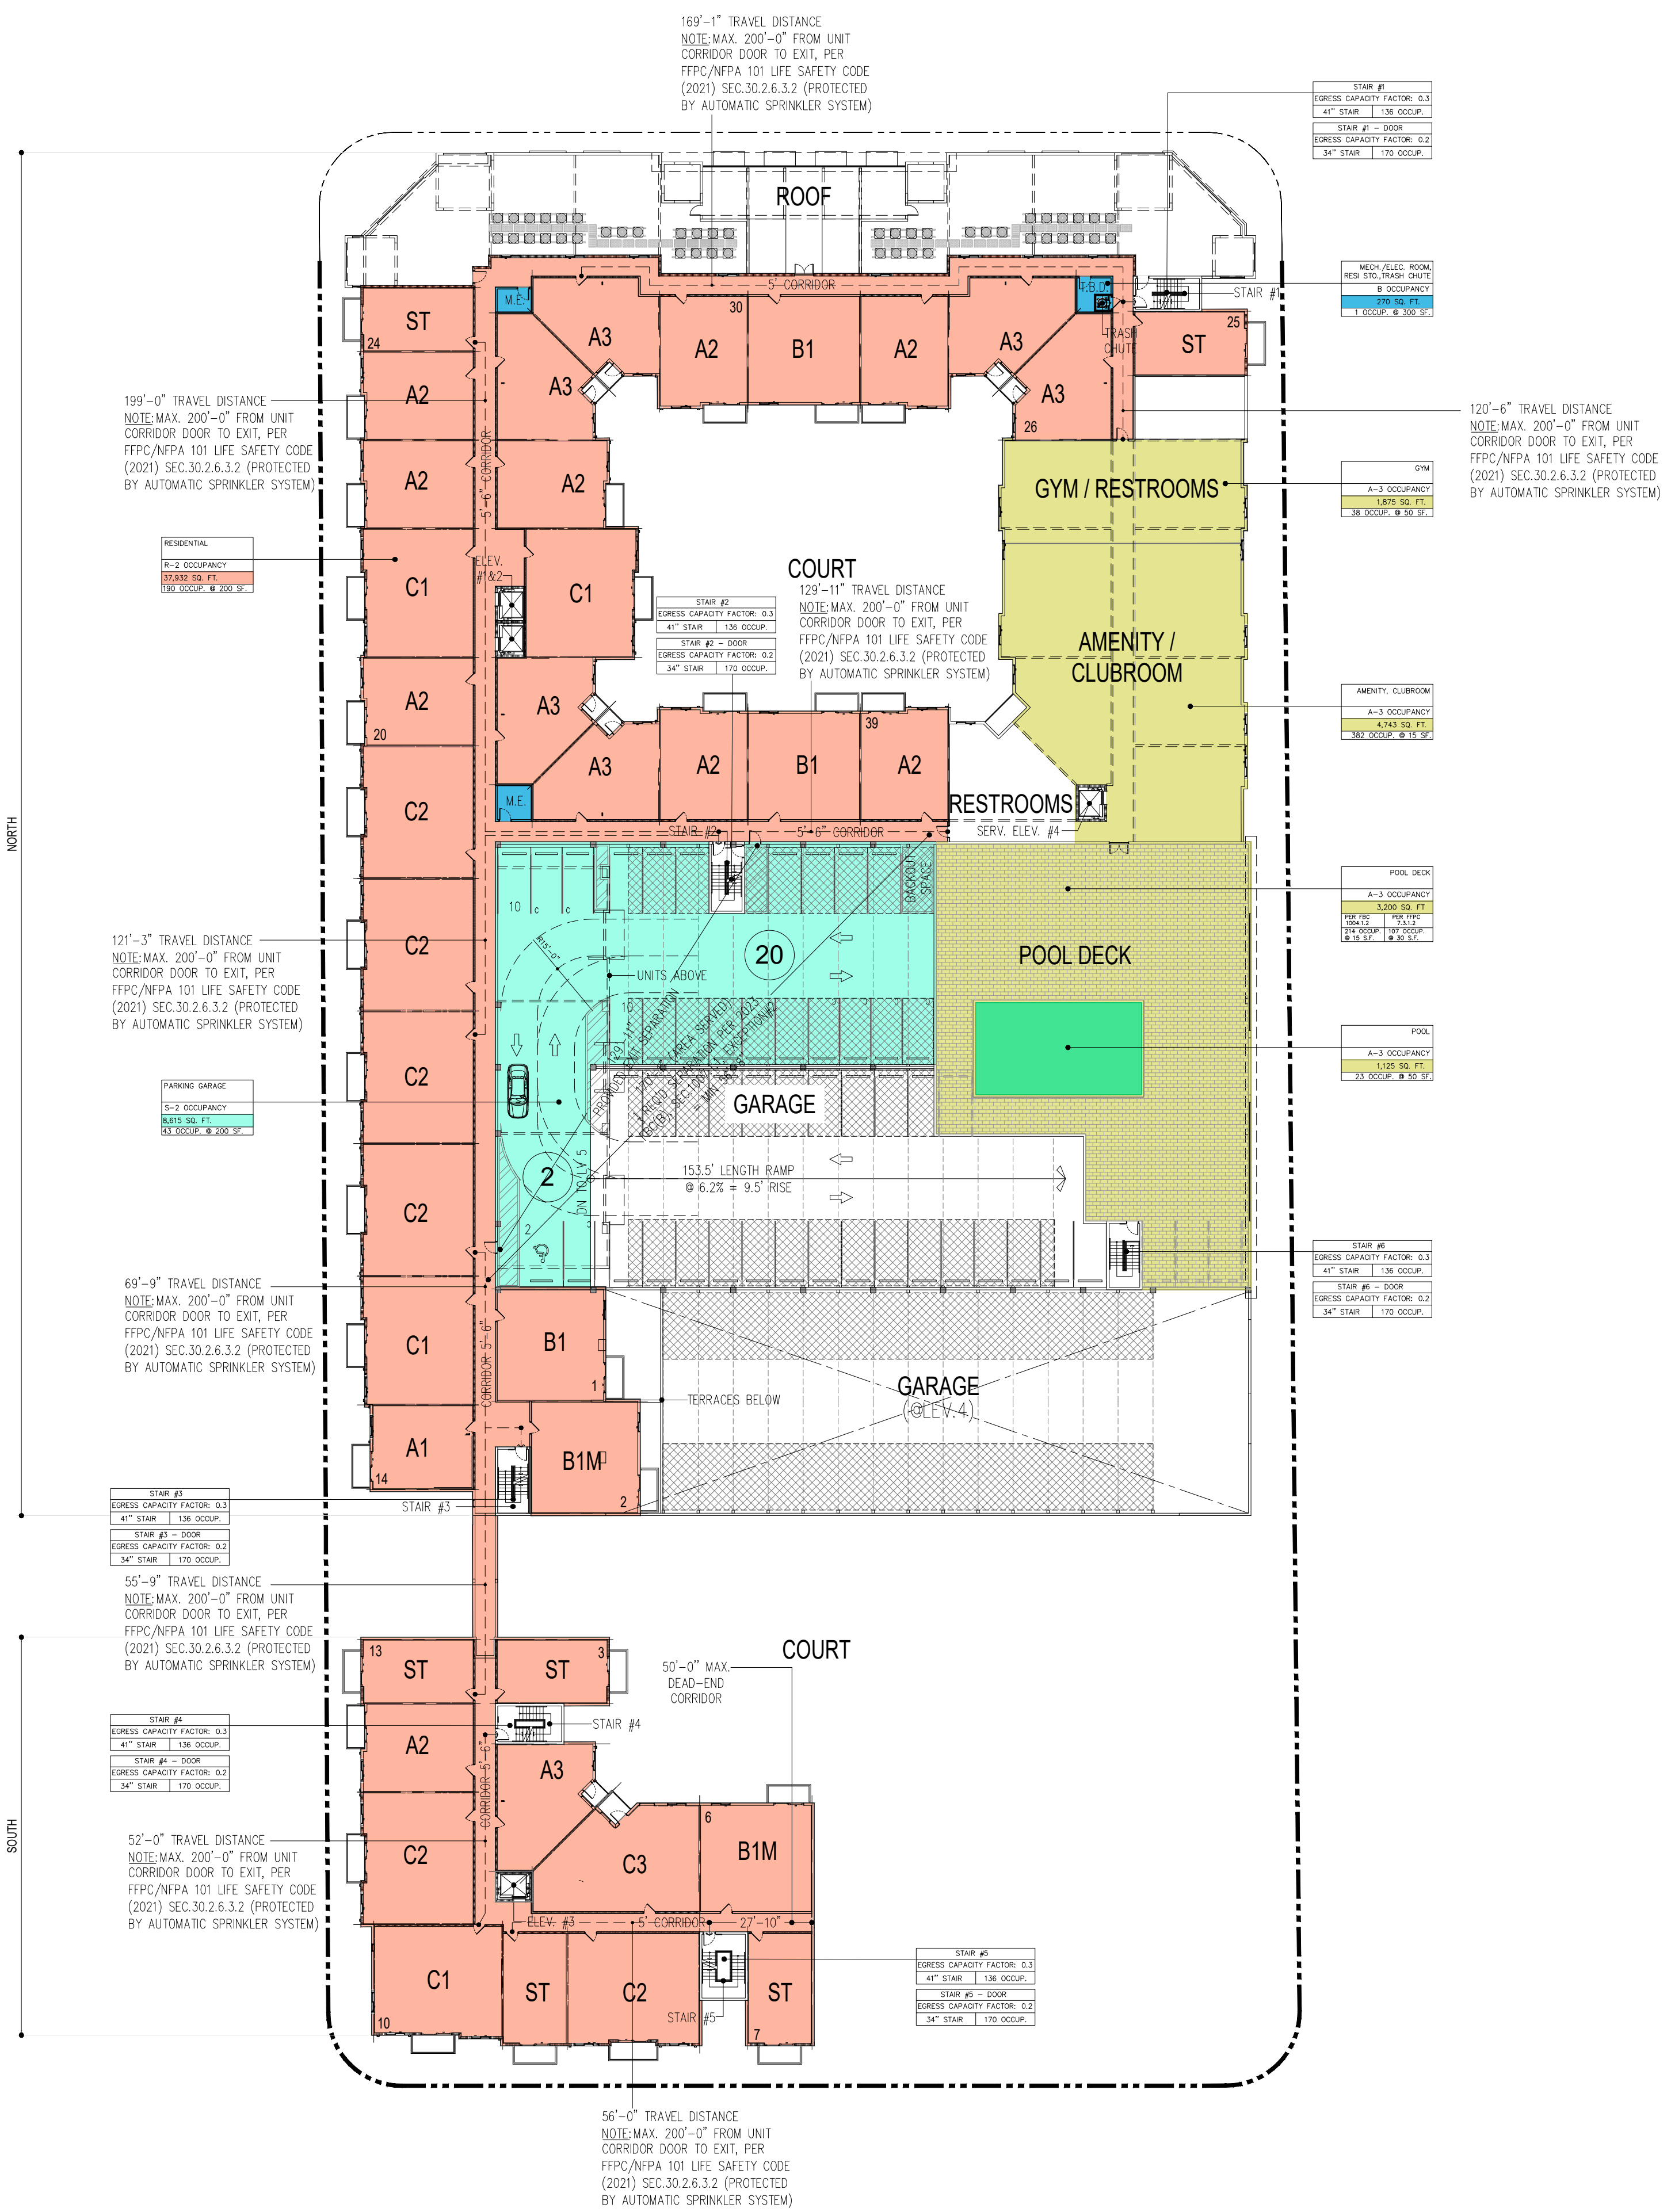

## LEVEL 6 - LIFE SAFETY PLAN

SCALE: 1" = 30'-0"