


PZ25-12000001

08/06/2025

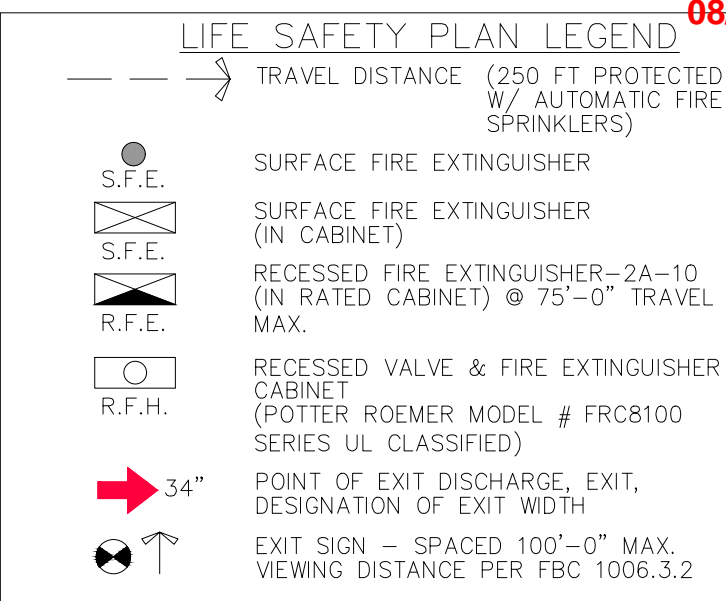


BUILDING (NORTH)			
OCCUPANT LOAD FACTOR, PER F.F.P.C 7.3.1.2 & PER F.B.C. 1004.1.2			
OCCUPANCY CALCULATION:			
SPACE	S.F	S.F/PERSON	OCCUP. LOAD
R-2 OCCUPANCY RESIDENTIAL AREA	39,256 SQ. FT.	200 S.F	196 OCCUP.
S-2 OCCUPANCY BACK-OFF-HOUSE	270 SQ. FT.	300 S.F	1 OCCUP.
		TOTAL	197 OCCUP.
EGRESS CAPACITY TABULATIONS			
GROUP R-2			
NEW APARTMENT - FFPC-101, CHAPTER 30			
STORAGE - FFPC-101, CHAPTER 42			
LEVEL EGRESS WIDTH REQUIRED	197	OCCUP.(0.2) = 39.4"	
LEVEL EGRESS WIDTH PROVIDED	3 @ 34" = 102"		
R-2 OCCUPANCY			
STAIR EGRESS WIDTH REQUIRED	197	OCCUP.(0.3) = 59.1"	
STAIR EGRESS WIDTH PROVIDED	3 @ 41" = 123"		

BUILDING (SOUTH)

OCCUPANT LOAD FACTOR, PER F.F.P.C 7.3.1.2 & PER F.B.C. 1004.1.2			
OCCUPANCY CALCULATION:			
SPACE	S.F	S.F./PERSON	OCCUP. LOAD
R-2 OCCUPANCY RESIDENTIAL AREA	10,000 SQ. FT.	200 S.F	50 OCCUP.
		TOTAL	50 OCCUP.

EGRESS CAPACITY TABULATIONS

GROUP R-2			
NEW APARTMENT – FFPC-101, CHAPTER 30			
STORAGE – FFPC-101, CHAPTER 42			
LEVEL EGRESS WIDTH REQUIRED	50 OCCUP.(0.2) = 10"		
LEVEL EGRESS WIDTH PROVIDED	2 @ 34" = 68"		
R-2 OCCUPANCY			
STAIR EGRESS WIDTH REQUIRED	50 OCCUP.(0.3) = 15"		
STAIR EGRESS WIDTH PROVIDED	2 @ 41" = 82"		

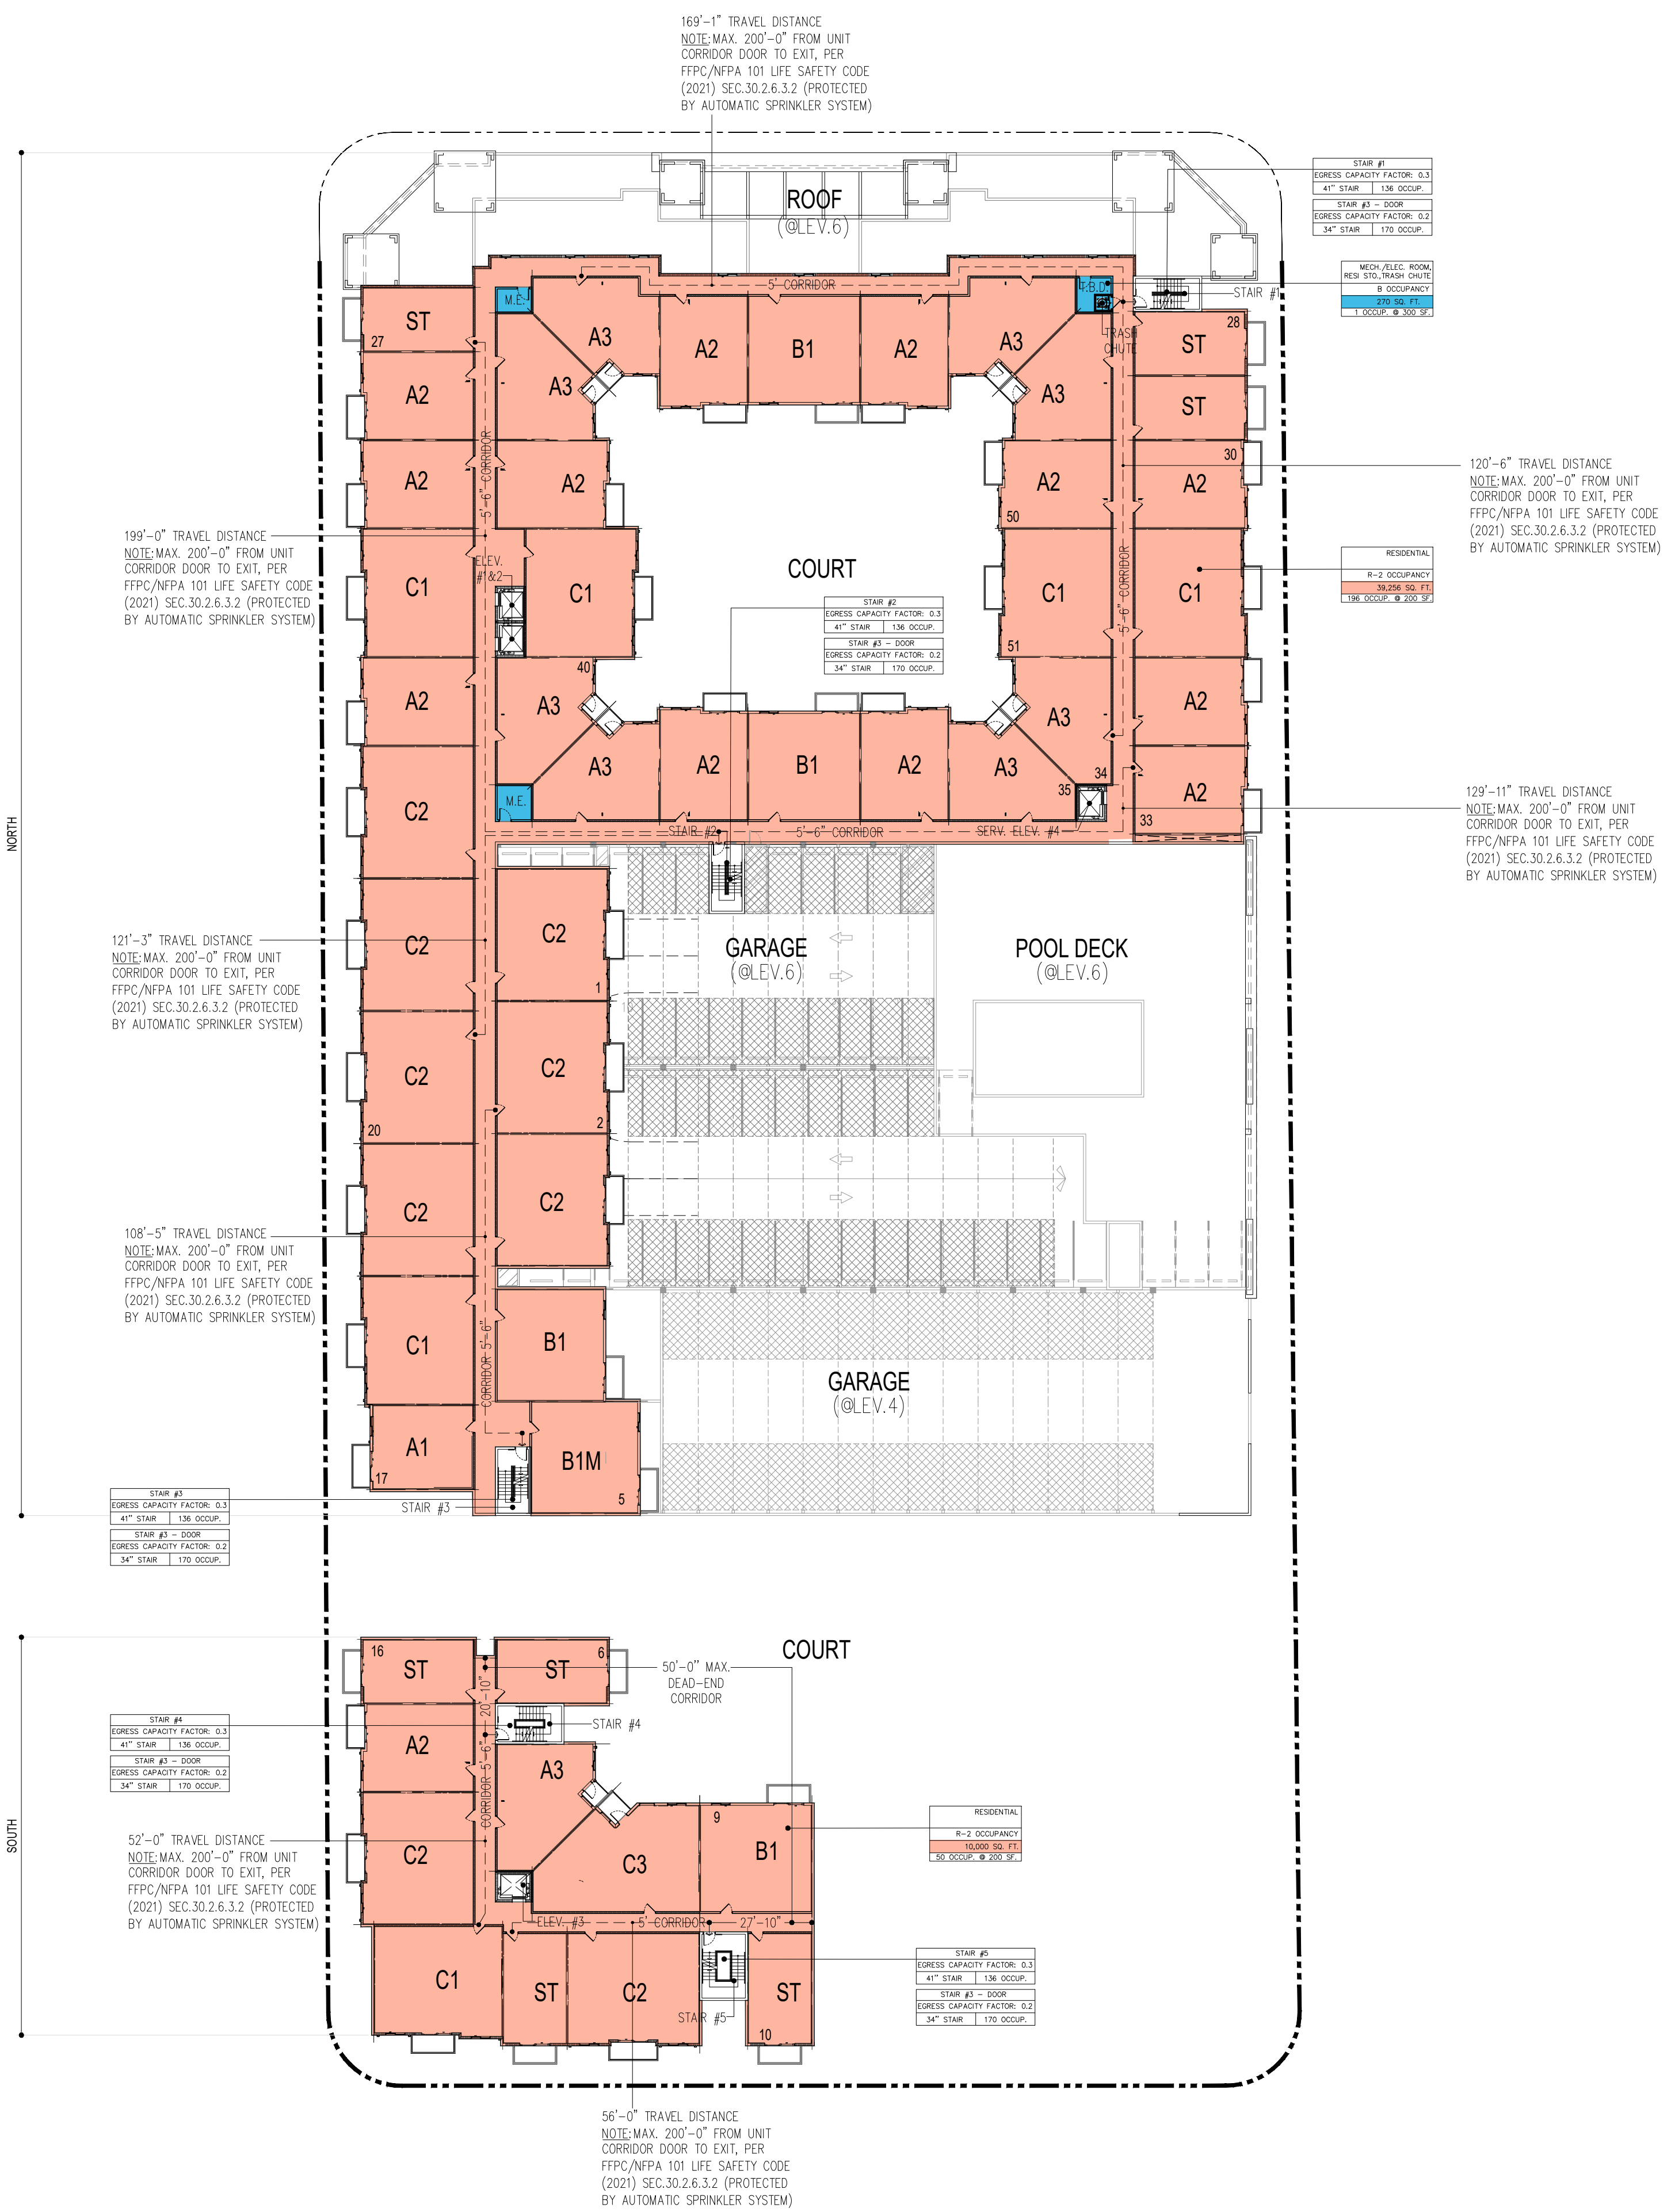

LEVEL 7 - LIFE SAFETY PLAN

51 DU'S

SCALE: 1" = 30'-0"