

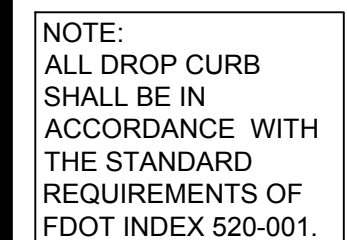


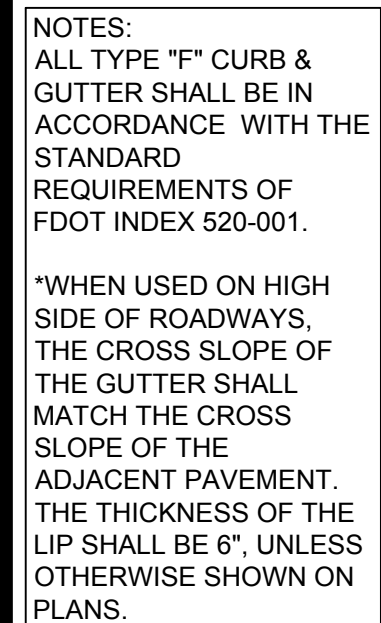

SUBGRADE:
12" STABILIZED SUBGRADE COMPACTED TO 98% OF MAXIMUM DENSITY (AASHTO T-180); MINIMUM LBR = 40.

○

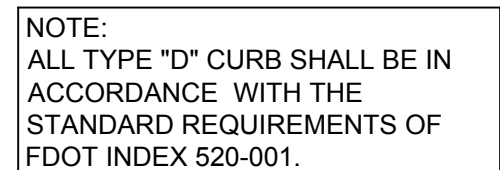


1000



1000

NOTES:

1. Sidewalk construction is to comply with the latest FDOT standards for sidewalks and ADA curb ramps, per FDOT index 522-001 and 522-002.
2. Provide either joint alternate 1 or 2. If using joint alternate 2: construct type "E" joints at not more than 30' intervals - within 12 hours after finishing, construct 1/2" expansion, provide joint type "A", with non-rising performed joint filler at not more than 120' intervals, construct remaining joints within 12 hours after finishing.
3. Provide 1/2" expansion joint type "A", with non-rising performed joint filler where concrete pavement abuts concrete curbs, driveways and other fixed objects.
4. Sidewalk thickness shall be 4" thick unless otherwise noted. Thickness shall be 6" through driveways and on all commercial sidewalk applications.
5. The use of steel reinforcement is not permitted.
6. Concrete to be 3,000 psi in 28 days.
7. Cure all concrete with approved method.
8. Sidewalk foundation shall be compacted to a firm, even surface, true to grade and cross section, and shall be moist at the time concrete is placed.
9. All construction shall conform to local construction codes and standards.
10. Sidewalk slopes shall meet the requirements of the Americans with Disabilities Act. Minimum transverse slope 0.01 ft/ft. And maximum transverse slope 0.02 ft/ft, toward swale or gutter. Longitudinal slope shall conform to ADA requirements.
11. The vertical deviation for a new sidewalk shall not be more than 1/4".
12. The vertical deviation for a new maintenance access structure cover shall not be more than 1/4".
13. Where truncated domes are used, stamped concrete is not permitted. Truncated domes to be cast with the concrete.
14. Sidewalk shall have a transverse hair broom finish.

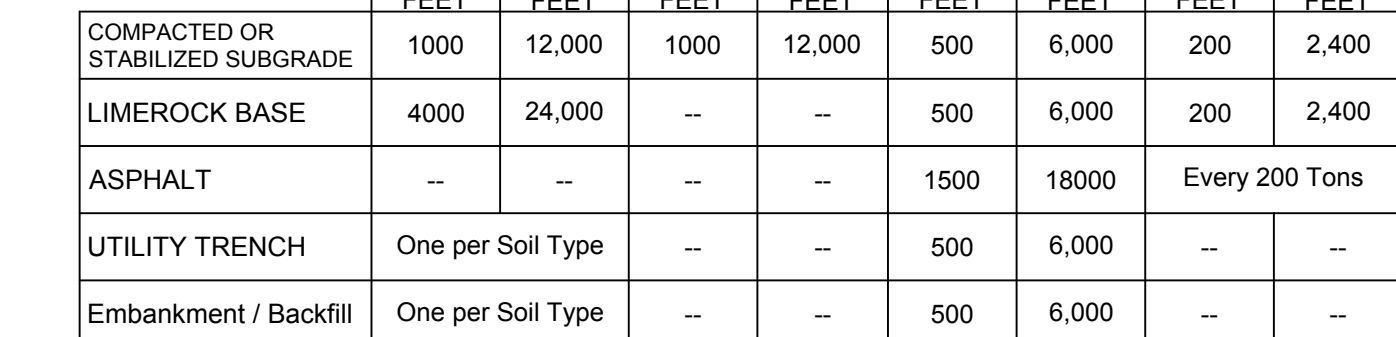

REVISIONS

REVISIONS		
NO	DESCRIPTION	DATE

RESPONSIBILITY FOR THE USE OF THESE
PLANS PRIOR TO OBTAINING PERMITS FROM
ALL AGENCIES HAVING JURISDICTION OVER
THE PROJECT WILL FALL SOLELY UPON THE
USER.

ISSUE DATE: 02/25/25

NILES T. WARRICK, P.E.
FLORIDA REG. NO. 94320
(FOR THE FIRM)

CLIENT

PORTMAN
HOLDINGS

PROJECT

2400 E ATLANTIC
2400 East Atlantic Blvd.
Pompano Beach, FL

SHEET TITLE

PAVING, GRADING, AND DRAINAGE DETAILS

SHEET
NUMBER **CP-501**

PROJECT NUMBER	14267.00
----------------	----------