

# AMERICAN EAGLE FIRE PROTECTION, INC.

4711 North Dixie Highway – Boca Raton, FL 33431

Telephone: 561-750-3698 – Fax: 561-750-8496

LIC # 33490800012003


## FLOW TEST

STATIC PRESSURE (psi)	RESIDUAL PRESSURE (psi)	PITOT PRESSURE (psi)	PITOT FLOW (gpm)	OUTLET SIZE
74	78	25	836	2"

**Address:** 1200 NW 12<sup>th</sup> Terrace, Pompano Beach, FL 33069

**Flow Test Date:** Wednesday, August 20, 2025 at 8:00 a.m. – Thursday, August 21, 2025 at 8:00 a.m.

### Sketch of Test Location

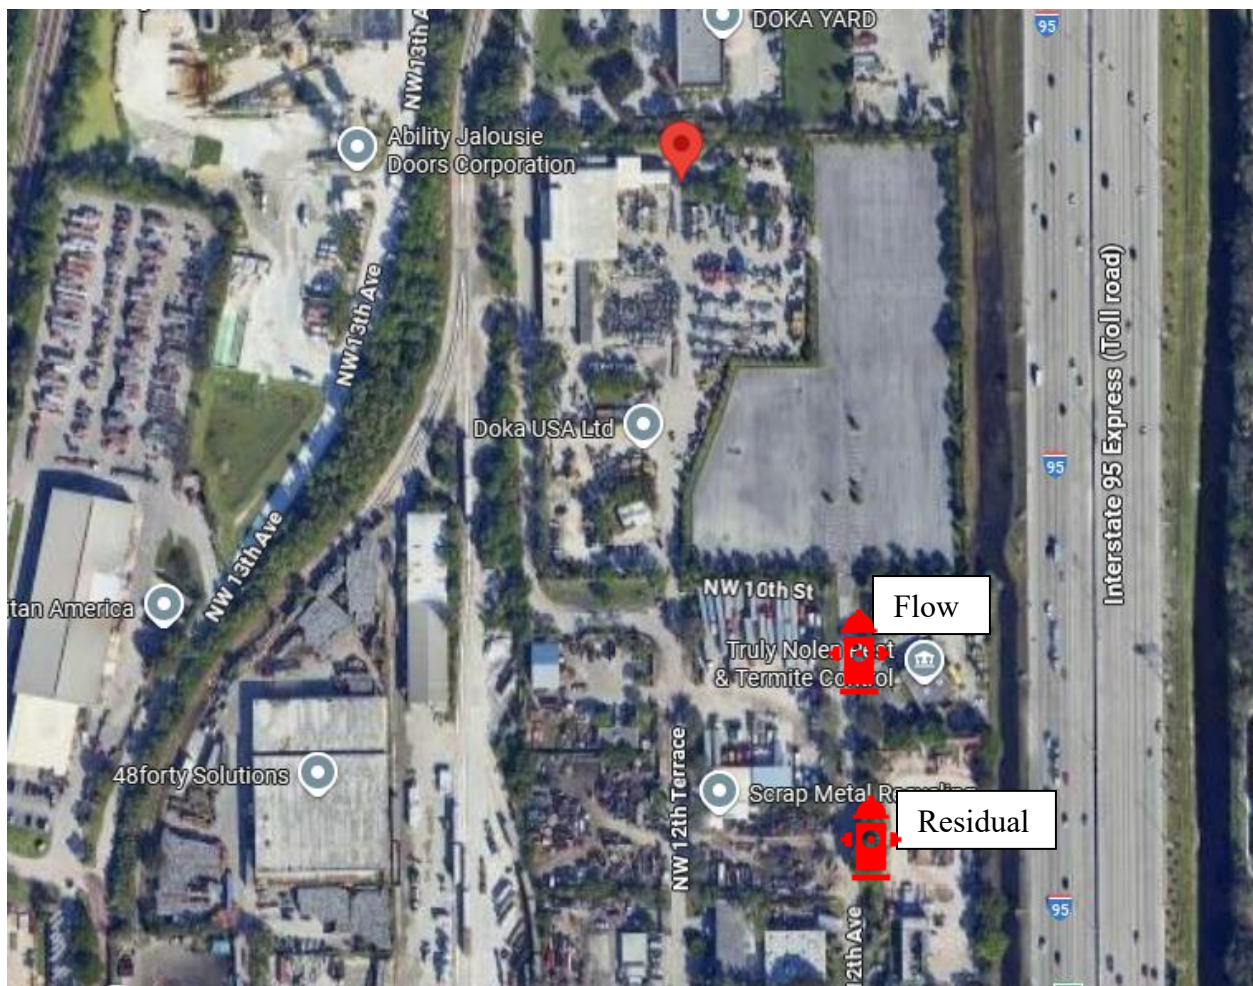

Please note this test was performed using "The Little Hose Monster". The co-efficient and flow data are based on manufactures UL Listed specific specs designed for use of the 2 inch pitotless nozzle.

X Dario Cimetta – AEFP Technician

**DRC**

Date: 08-21-25

PZ25-12000030

10/01/2025