


Channel Letters on Raceway

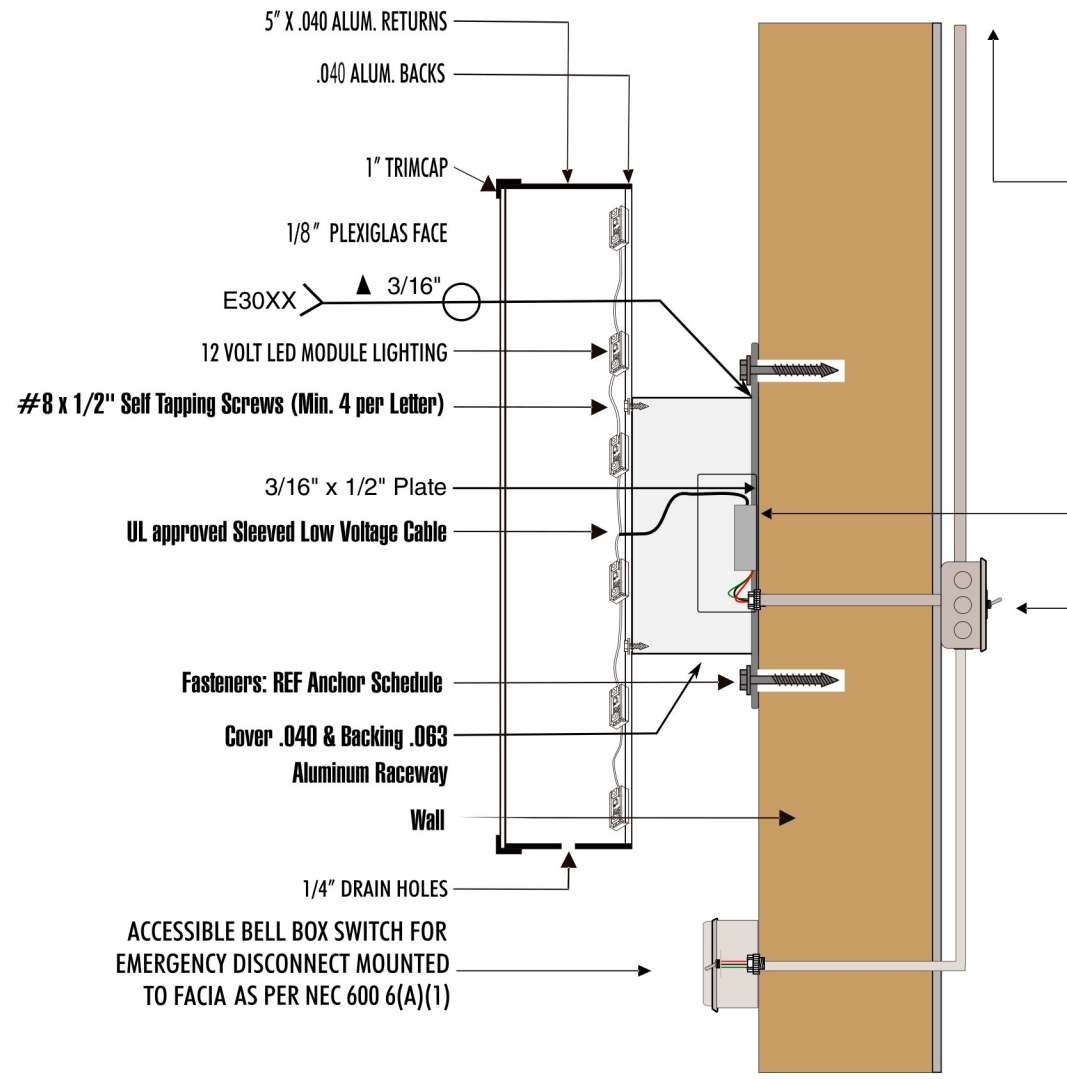

PRIMARY #12 MIN. THHN THWN ELECTRICAL SIGNAGE HOOKUP  
5' ELECTRICAL PIGTAIL; INSIDE 1/2" MIN. TYPE RW  
FLEXIBLE CONDUIT OR UL APPROVED EQUAL AS REQUIRED  
**110v 20AMP circuit Grounded as per 250.118. 3. C405.2.4**

**LED POWER SUPPLY**  
UL APPROVED WEATHER PROOF, 20 AMP ELECTRICAL SERVICE  
LOCKABLE DISCONNECT SWITCH (@ MAIN PANEL) AS PER NEC  
600.6(A)(1), CONNECTED TO TIME CLOCK OR PHOTOCELL AS  
PER SFBC 4503.5C REQUIREMENTS.  
**Astronomical timeclock with 10 hour**  
**Backup or photocell as per NEC 600.8(A), 600.5(C)(3),**  
**600.7(A). As Per 2023 FBC B Appendix H104 Specify Lable.**

| Anchor Schedule                  | Wall    |                     |       |          |      |
|----------------------------------|---------|---------------------|-------|----------|------|
|                                  | Masonry | Stucco<br>Over Wood | Metal | Concrete | Wood |
| @4' OC T&B                       |         |                     |       |          |      |
| 3/8" X 3" Sup-R-Sleeve           | ●       |                     |       | ●        |      |
| 1/4" Bolts Thru Wall             | ●       | ●                   | ●     | ●        | ●    |
| 1/4" x 2-3/4" Tap Cons           | ●       |                     |       | ●        |      |
| 3/8" x 3.5" Lag Bolts            |         |                     |       |          | ●    |
| 3/8" X 4" Toggle Bolts           |         |                     | ●     |          | ●    |
| 3/8" x 3.5" Exp. Anchors         | ●       |                     |       | ●        |      |
| #14 x 2-1/2" Self Tapping Screws |         |                     | ●     |          |      |
| # 8 x 3" Wood Screws             |         |                     |       |          | ●    |
| 1/4" x 4" Tapcons                |         | ●                   |       |          |      |
| # 8 x 4" Wood Screws             |         | ●                   |       |          |      |

Copies of this document are not considered signed & sealed and the signature must be verified on any electronic copies.

Customer:



AAC

PZ24-30000012  
02/03/2026

AAC

PZ24-30000012  
01/06/2026

754-300-9493