



SECTION A-A

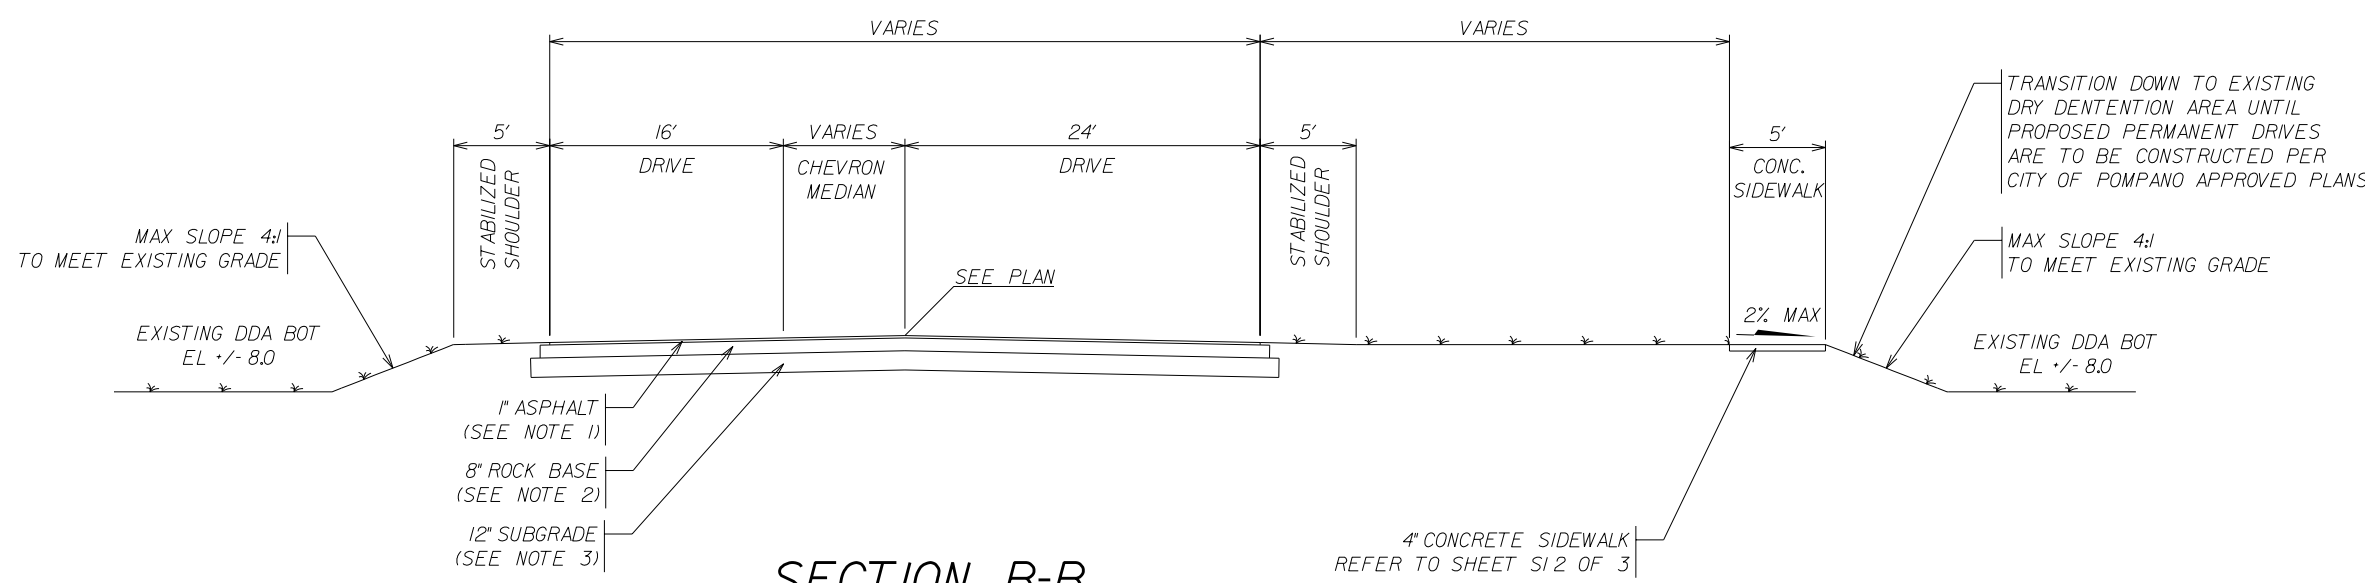


SECTION B-B

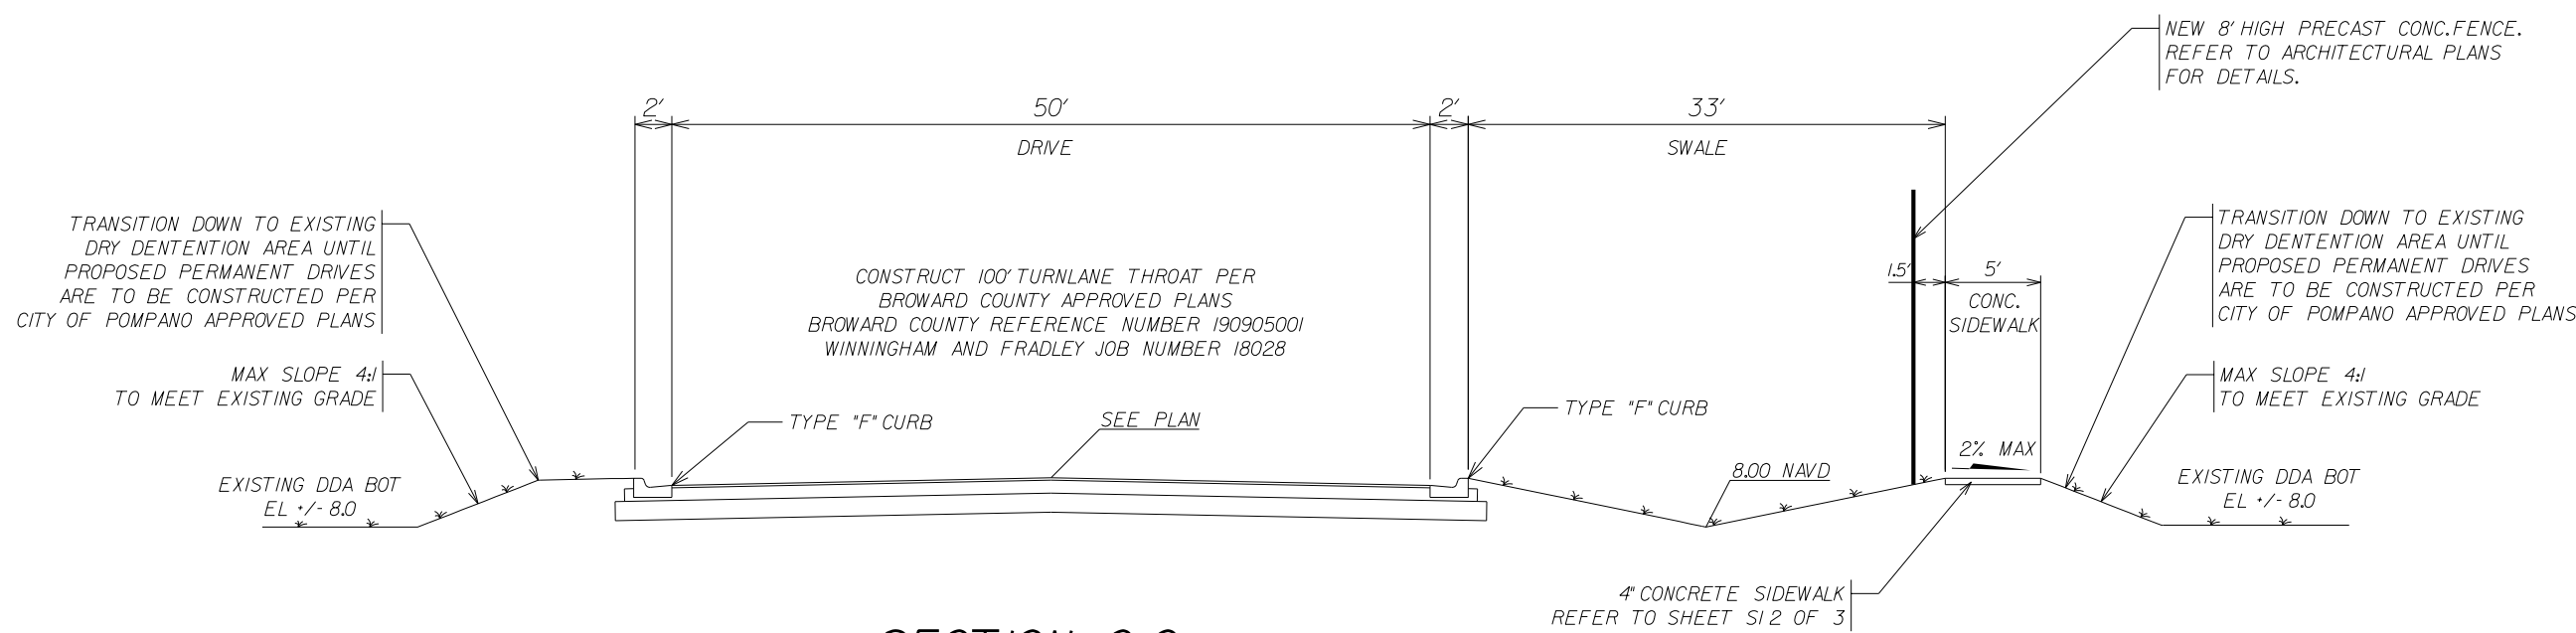


SECTION C-C

NOTES:

- PAVEMENT SHALL BE 1\"/>
- 8\"/>
- SUBGRADE MATERIAL SHALL BE IN ACCORDANCE WITH SECTION 160 OF THE F.D.O.T. STANDARD SPECIFICATIONS. ALL SUBGRADE SHALL HAVE A MINIMUM L.B.R. OF 40 AND SHALL BE COMPACTED TO NOT LESS THAN 100% MAXIMUM DRY DENSITY AS DETERMINED BY AASHTO T-99C.
- BASE AND SUBGRADE DENSITY TESTS SHALL BE CONDUCTED FOR A MAXIMUM 7000 SQUARE FEET OF FINISHED PAVEMENT OR @ 300' INTERVALS MAX.
- PRIME COAT SHALL BE APPLIED AT A RATE OF 0.25 GALLONS PER SQUARE YARD. PRIME AND TACK COAT FOR BASE SHALL CONFORM TO THE REQUIREMENTS AND SPECIFICATIONS OF SECTION 300.1 THROUGH 300.7 OF F.D.O.T. STANDARD SPECIFICATION.
- PROCTOR SHALL BE PERFORMED ON ALL MATERIAL SUBGRADE AND BASE AND SUBSEQUENT CHANGES IN MATERIAL. LIMEROCK BEARING RATIOS, SIEVE ANALYSIS AND DENSITIES REQUIRED BY THE CONTRACT DOCUMENTS SHALL BE SUBMITTED TO BROWARD COUNTY AND THE CITY OF POMPANO.
- ALL REPAIRS TO EXISTING PAVEMENT SHALL RECEIVE SAW-CUT EDGES PRIOR TO RELAYING ASPHALT.
- MINIMUM LONGITUDINAL SLOPE OF PAVEMENT SHALL BE 0.30%.
- DEMUCKING (IF ANY) SHALL BE IN ACCORDANCE WITH BROWARD COUNTY MINIMUM STANDARDS OR AS DIRECTED BY GEOTECHNICAL ENGINEER.
- EMBANKMENT MATERIAL (MINIMUM L.B.R. 40) COMPACTED IN 8\"/>

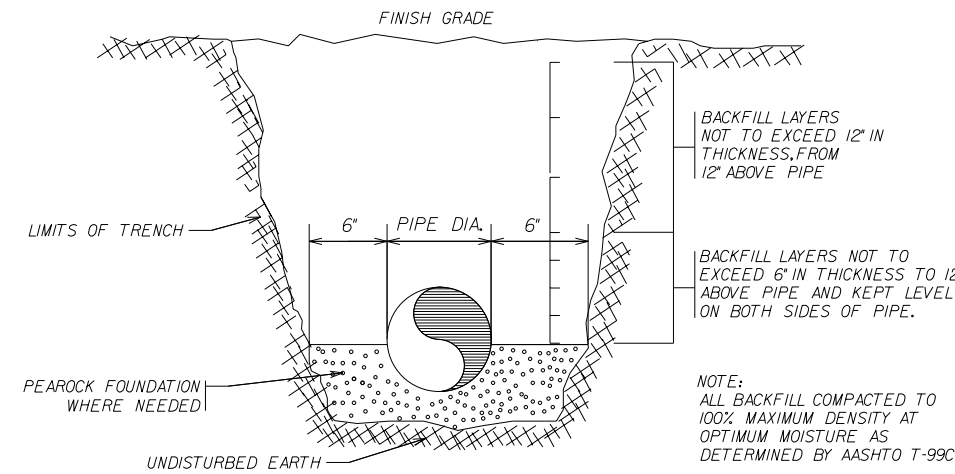

PIPE BEDDING DETAIL

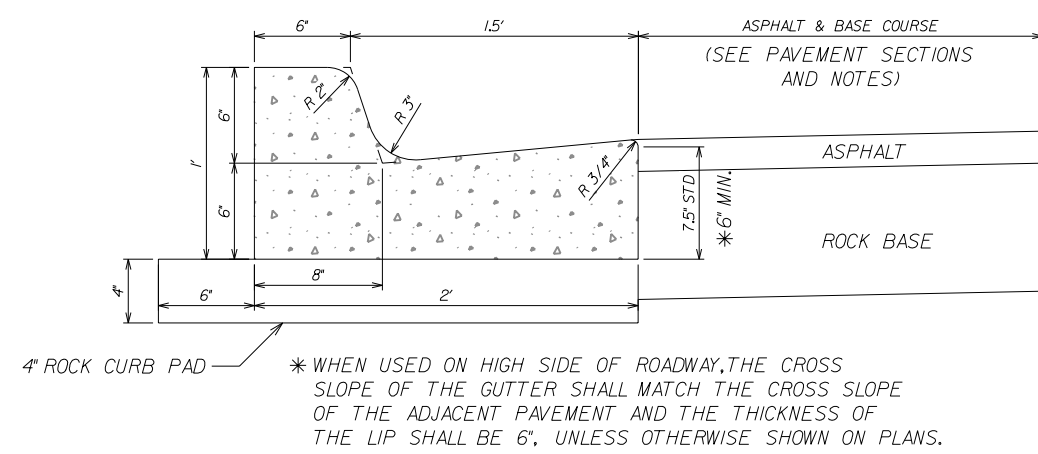

TYPE 'F' CURB & GUTTER

NOTE:
CONCRETE SHALL BE 3000 psi AT 28 DAYS

DRC
PZ23-12000032
12/04/2024

Digitally signed by
Bealinda M Pell
DN: c=US,
o=Unaffiliated,
dnQualifier=A0141
0C0000018E2E86C
2580002F48A,
cn=Bealinda M Pell
Date: 2024.06.19
12:20:05 -04'00'
Adobe Acrobat
version: 11.0.23

NOT FOR CONSTRUCTION

SITE IMPROVEMENTS
SECTIONS & DETAILS

BONSAL POMPANO
OLDCASTLE COASTAL

WINNINGHAM & FRADLEY
ENGINEERS • PLANNERS • SURVEYORS
111 N.E. 44th STREET, OAKLAND, FL 33334 • (904) 775-2400 • FAX: (904) 775-0208 • www.wf-engineers.com

DESIGNED: CJD/GSB DATE: 08/2018 APPROVED:
DRAWN: AMF DATE: 08/2018
CHECKED: WTV DATE: 12/2019
PROJECT NUMBER 18028 SHEET 51 OF 4

NO.	REVISIONS	DATE