BROWARD COUNTY
PUBLIC WORKS DEPARTMENT
PLOTTED: 10/2024

WATER & WASTEWATER SERVICES
ENGINEERING DIVISION
2555 WEST COPANS ROAD
POMPANO BEACH, FL 33069

PHONE NO. 954-831-0745
FAX: 954-831-0925

STANDARD DETAIL

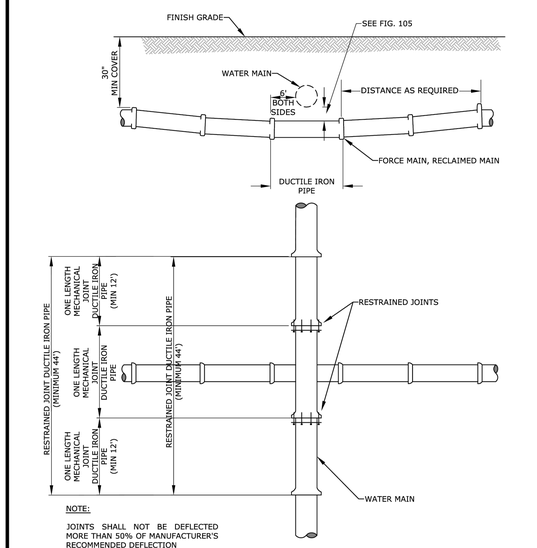

NOTE:

JOINTS SHALL NOT BE DEFLECTED MORE THAN 50% OF MANUFACTURER'S RECOMMENDED DEFLECTION

REVISED	STANDARD UTILITY CROSSING	FIGURE
7/7/2021		106

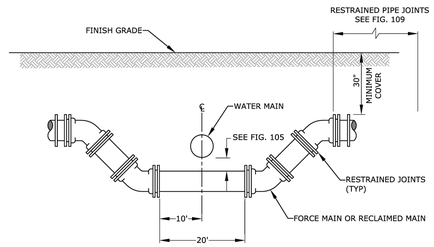

WHEREVER POSSIBLE DEFLECTION OF THE PIPE WILL BE USED TO AVOID EXISTING OBSTRUCTIONS. THIS CROSSING SHALL BE USED ONLY WHEN APPROVED BY WWS.

REVISED	SPECIAL UTILITY CROSSING	FIGURE
7/7/2021		107



STRAIGHT REDUCER

DUCTILE IRON PIPE				
DIAMETER	6"	8"	10"	12"
4"	15'	27'	36'	45'
6"		16'	27'	38'
8"			15'	28'
10"				16'
PVC PIPE				
	6"	8"	10"	12"
4"	24'	43'	58'	72'
6"		25'	44'	61'
8"			24'	44'
10"				25'

SMALL SIDE

TEE REDUCER

DUCTILE IRON PIPE				
DIAMETER	6"	8"	10"	12"
4"	1'	1'	1'	1'
6"		6'	1'	1'
8"			15'	10'
10"				23'
PVC PIPE				
	6"	8"	10"	12"
4"	1'	1'	1'	1'
6"		16'	8'	1'
8"			31'	25'
10"				44'

BRANCH SIZE

THE NOTED REQUIREMENTS WERE CALCULATED IN ACCORDANCE WITH THRUST RESTRAINT CALCULATOR V7.2 BY EBAA IRON WITH THE FOLLOWING ASSUMPTIONS:
SOIL CONDITIONS: SW OR GW; LENGTH ALONG RUN EQUALS 4 FEET
LAYING CONDITION: 4, SAND BEDDING, BACKFILL COMPACTED > 80%
MINIMUM COVER: 3.0 FT;SAFETY FACTOR: 1.5;BARE PIPE (NO POLY WRAP)
IF FIELD CONDITIONS DIFFER FROM THE ABOVE, CONTRACTOR SHALL NOTIFY WWS.
FOR PIPE LARGER THAN INCLUDED IN THE ABOVE TABLES, ENGINEER OF RECORD SHALL SUBMIT CALCULATIONS FOR EACH JOINT REQUIRING RESTRAINT.

RESTRAINED REDUCING FITTING
150 PSI TEST PRESSURE

REVISED	RESTRAINED JOINT REQUIREMENTS REDUCING FITTINGS	FIGURE
7/7/2021		112

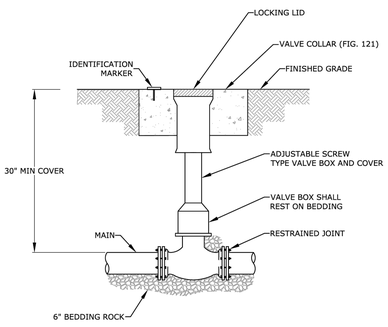

1. WHEN VALVE IS NOT LOCATED IN PAVEMENT, PLACE A WHITE REFLECTIVE RAISED PAVEMENT MARKER IN THE DRIVE LANE, ADJACENT TO THE VALVE.
2. OPERATOR EXTENSION SHAFT SHALL BE PROVIDED WHEN OPERATING NUT IS MORE THAN 24" BELOW TOP OF VALVE BOX.
3. PVC PIPE OR DUCTILE IRON PIPE IS NOT ACCEPTABLE FOR VALVE BOX RISER.

REVISED	VALVE BOX DETAIL	FIGURE
7/7/2021		123

REVISIONS	DATE	BY
REV PER CITY COMMENTS	01/28/26	DJP
REV PER CITY COMMENTS	12/16/25	DJP
REV PER CITY COMMENTS	10/27/25	DJP
REV PER CITY COMMENTS	08/25/25	DJP

FILE NAME: 11146ENG.dwg

CAULFIELD & WHEELER, INC.
CIVIL ENGINEERING
LANDSCAPE ARCHITECTURE - SURVEYING
7900 GLADES ROAD - SUITE 100
BOCA RATON, FLORIDA 33434
PHONE (561)-392-1991 / FAX (561)-750-1452

THE SATORI
4211 N FEDERAL HIGHWAY
WATER DISTRIBUTION &
SANITARY SEWER DETAILS
POMPANO BEACH, FL, 33064

DATE 05/28/25
DRAWN BY DJP
F.B./ PG. ----
SCALE N/A

Digitally signed by Matthew V Kahn
Date: 2026.01.29 11:19:18 -05'00'
Adobe Acrobat version: 2024.002.20687
MATTHEW V. KAHN
PROFESSIONAL ENGINEER
LICENSE NO. 82227
STATE OF FLORIDA
– FOR THE FIRM –
DATE

JOB # 11146
SHT NO.
WS-2
OF 16 SHEETS

BROWARD COUNTY
PUBLIC WORKS DEPARTMENT
PLOTTED: 10/2024

WATER & WASTEWATER SERVICES
ENGINEERING DIVISION
2555 WEST COPANS ROAD
POMPANO BEACH, FL 33069

PHONE NO. 954-831-0745
FAX: 954-831-0925

STANDARD DETAIL

WATER MAIN SEPARATION IN ACCORDANCE WITH F.A.C. RULE 62-555.314

	HORIZONTAL SEPARATION	CROSSINGS (1) (4)	JOINT SPACING @ CROSSINGS (FULL JOINT CENTERED)
OTHER PIPE	Water Main — 3 ft. minimum	Water Main — 12 inches is the minimum, 18 inches is preferred. Then 6 inches is the minimum and 12 inches is preferred	Alternate 3 ft. minimum — Water Main
STORM SEWER STORM WATER FORCE MAIN, RECLAIMED WATER (2)			
VACUUM SANITARY SEWER	Water Main — 10 ft. preferred 3 ft. minimum	Water Main — 12 inches preferred 6 inches min	Alternate 3 ft. minimum — Water Main
GRAVITY SANITARY SEWER,(3) SANITARY SEWER FORCE MAIN, RECLAIMED WATER	Water Main — 10 ft. preferred 6 ft. minimum	Water Main — 12 inches is the minimum, 18 inches is preferred. Then 6 inches is the minimum and 12 inches is preferred	Alternate 6 ft. minimum — Water Main
ON-SITE SEWAGE TREATMENT & DISPOSAL SYSTEM	10 ft. minimum	—	—

(1) WATER MAIN SHOULD CROSS ABOVE OTHER PIPE. WHEN WATER MAIN MUST BE BELOW OTHER PIPE, THE MINIMUM SEPARATION IS 12 INCHES.
(2) RECLAIMED WATER REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C.
(3) IF FORCE MAIN OR GRAVITY SANITARY SEWER WHERE THE BOTTOM OF THE WATER MAIN IS LAID AT LEAST 6 INCHES ABOVE THE TOP OF THE GRAVITY SANITARY SEWER.
(4) 18" VERTICAL MINIMUM SEPARATION REQUIRED BY WWS, UNLESS OTHERWISE APPROVED.

REVISED	WATER MAIN SEPARATION	FIGURE
7/7/2021		105

BROWARD COUNTY
PUBLIC WORKS DEPARTMENT
PLOTTED: 10/2024

WATER & WASTEWATER SERVICES
ENGINEERING DIVISION
2555 WEST COPANS ROAD
POMPANO BEACH, FL 33069

PHONE NO. 954-831-0745
FAX: 954-831-0925

STANDARD DETAIL



CROSSES SHALL BE RESTRAINED IN ALL DIRECTIONS. FITTINGS AND VALVES NEED TO BE RESTRAINED PER STANDARD DETAILS 109-112, EVEN WHEN THE FITTINGS OR VALVES ARE CUT IN AFTER THE INITIAL PIPE INSTALLATION. ASBESTOS CEMENT PIPE WILL BE REPLACED WITH DUCTILE IRON PIPE AT LEAST THROUGH THE RESTRAINING LENGTH.

DUCTILE IRON PIPE

HORIZONTAL, L (FEET)							45° VERTICAL OFFSET (FEET)	
Diameter	11 ¼°	22 ½°	45°	90°	Tee or Cross	Valves and Dead End	UPPER	LOWER
4	1	2	4	10	7	20	9	4
6	2	3	6	14	15	28	12	5
8	2	4	8	17	23	37	16	7
10	2	5	9	21	30	44	19	8
12	3	5	10	24	38	52	22	9

PVC PIPE

HORIZONTAL, L (FEET)							45° VERTICAL OFFSET (FEET)	
Diameter	11 ¼°	22 ½°	45°	90°	Tee or Cross	Valves and Dead End	UPPER	LOWER
4	2	3	5	12	11	32	14	5
6	2	4	7	16	23	45	19	6
8	3	5	9	21	37	59	25	8
10	3	5	11	25	48	71	30	9
12	3	6	12	29	61	83	35	11

THE NOTED REQUIREMENTS WERE CALCULATED IN ACCORDANCE WITH THRUST RESTRAINT CALCULATOR V7.2 BY EBAA IRON WITH THE FOLLOWING ASSUMPTIONS:
SOIL CONDITIONS: SW OR GW; NOMINAL SIZE EQUALS BRANCH SIZE; LENGTH ALONG RUN EQUALS 4 FEET
LAYING CONDITION: 4, SAND BEDDING, BACKFILL COMPACTED > 80%; VERTICAL LOW SIDE DEPTH EQUALS 3.5 FEET
MINIMUM COVER: 3.0 FT SAFETY FACTOR: 1.5 BARE PIPE (NO POLY WRAP)
IF FIELD CONDITIONS DIFFER FROM THE ABOVE, CONTRACTOR SHALL NOTIFY WWS.
FOR PIPE LARGER THAN INCLUDED IN THE ABOVE TABLES, ENGINEER OF RECORD SHALL SUBMIT CALCULATIONS FOR EACH JOINT REQUIRING RESTRAINT.

SINGLE FITTING RESTRAINED JOINT
150 PSI TEST PRESSURE

REVISED	RESTRAINED JOINT REQUIREMENTS SINGLE FITTING	FIGURE
7/7/2021		109

BROWARD COUNTY
PUBLIC WORKS DEPARTMENT
PLOTTED: 10/2024

WATER & WASTEWATER SERVICES
ENGINEERING DIVISION
2555 WEST COPANS ROAD
POMPANO BEACH, FL 33069

PHONE NO. 954-831-0745
FAX: 954-831-0925

STANDARD DETAIL

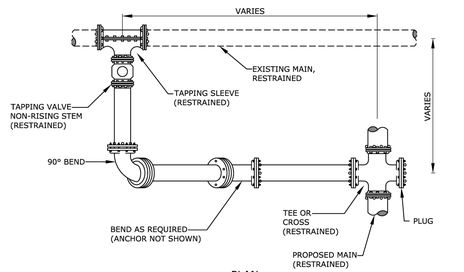

PLAN

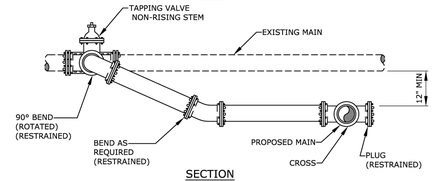

SECTION

NOTES:

1. ALL JOINTS TO BE RESTRAINED BY APPROVED METHODS.
2. IF CONNECTION IS PRIOR TO FDEP CLEARANCE THEN A SECOND VALVE WITH VENT IS REQUIRED.

REVISED	TYPICAL CONNECTION TO EXISTING MAIN	FIGURE
7/7/2021		131

BROWARD COUNTY
PUBLIC WORKS DEPARTMENT
PLOTTED: 10/2024

WATER & WASTEWATER SERVICES
ENGINEERING DIVISION
2555 WEST COPANS ROAD
POMPANO BEACH, FL 33069

PHONE NO. 954-831-0745
FAX: 954-831-0925

STANDARD DETAIL

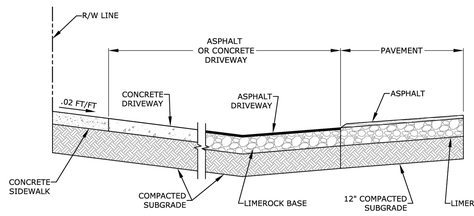

RESTORATION SPECIFICATION
SUMMARY TABLE

TYPE	MATERIAL	SPECIFICATION
TYPE I	SOD, SEED OR MULCH	COMPACTED SUBGRADE (100% PER AASHTO T-99C) BAHIA OR ST. AUGUSTINE SOD TO MATCH EXISTING
TYPE II-A	ASPHALT DRIVEWAY	1-1/2" ASPHALT, 6" LIMEROCK (98% PER AASHTO T-180), COMPACTED SUBGRADE (100% PER AASHTO T-99C)
TYPE III	CONCRETE DRIVEWAY	6" CONCRETE (NO WIRE MESH) COMPACTED SUBGRADE (100% PER AASHTO T-99C)

REVISED	TYPICAL SECTION THROUGH SWALE	FIGURE
7/7/2021		192

AAC
PZ25-12000016
03/03/2026

Drawing: P:\11146-00\-00\-00\Drawings\ws\Details\11146DETAILS-WS_BROWARD.dwg\13-WWS-DETAILS-WS-2