



SYMMETRIK INC.

FIRE PROTECTION AND SECURITY CONTRACTOR

- FIRE ALARM • FIRE SPRINKLER • CCTV
- BURGLAR ALARM • ACCESS CONTROL

1052 NW 53RD STREET FORT LAUDERDALE, FL 33309

PH1: (954)358-7696- PH:2 (954)306-3000

Fire Hydrant report:

Test Date: 3/18/2026 & 3/19/2026

Property Location: 3305 SE 5 ST POMPANO BEACH FL.

Customer name: Marsal Maintenance Corp

Tester technicians: Joe / ET

Inspectors Name: Alex Mascot

AHJ: City of Pompano Beach Fire Department

Number of hydrants tested: Two (2) Hydrants were tested

DRC

PZ25-12000046
06/03/2026



FIRE HYDRANT# 1 FLOW GPM: 1,255GPM




FIRE HYDRANT# 2 STATIC PREASSURE: 78.5 PSI



FIRE HYDRANT# 2 DURING FLOW RESIDUAL PREASSURE: 75 PSI

FIRE HYDRANT 24 HRS DATALOGF REPORT: 8 AM 3/18/2026 TO 3/19/2026-
AVERAGE PREASSURE: 71PSI -MAX PREASSURE: 94.9

Channel Summary										
Alarm Summary										
Chan	Chan Tag	Chan Type	Eng Units	Max	Min	Total Samples	Average	MKT	Start Time	Stop Time
Chan 1		Pressure	PSI	94.9	-0.1	48324	71.0		03/18/2026 08:08:24	03/19/2026 10:59:10

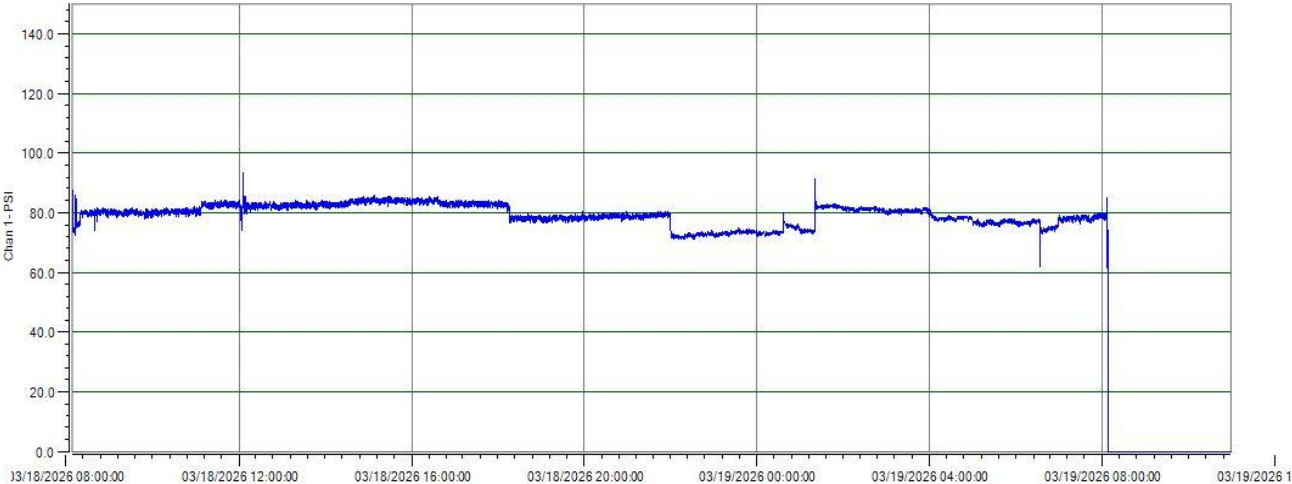

Data Date: 03/18/2026 08:08:24
Unit Tag:
File: 3305 SE 5 ST POMPANO.dat
Serial Number: 410289010

DRC

PZ25-12000046
06/03/2026

FIRE HYDRANTS TEST LOCATIONS:

