


## BACKFLOW PREVENTER

USE MEGALUGS AT ALL PIPE JOINTS 3" AND LARGER  
PLEASE SEE METER INSTALL DIMENSION LIST ON STANDARD NO. 106-4  
SMALL UNITS UNI-STRUT SUPPORT

ENGINEERING STANDARDS 2022			
REVISIONS	BY	DATE	DATE: MAY 2022 DWG. NO.
BY	DATE	ENGINEERING DIVISION CITY OF POMPAÑO BEACH	BACKFLOW PREVENTER
T.W.	04-2008		
S.S.	03-2009		
S.S.	11-2012		
S.S.	01-2013	SCALE: N.T.S.	106-1

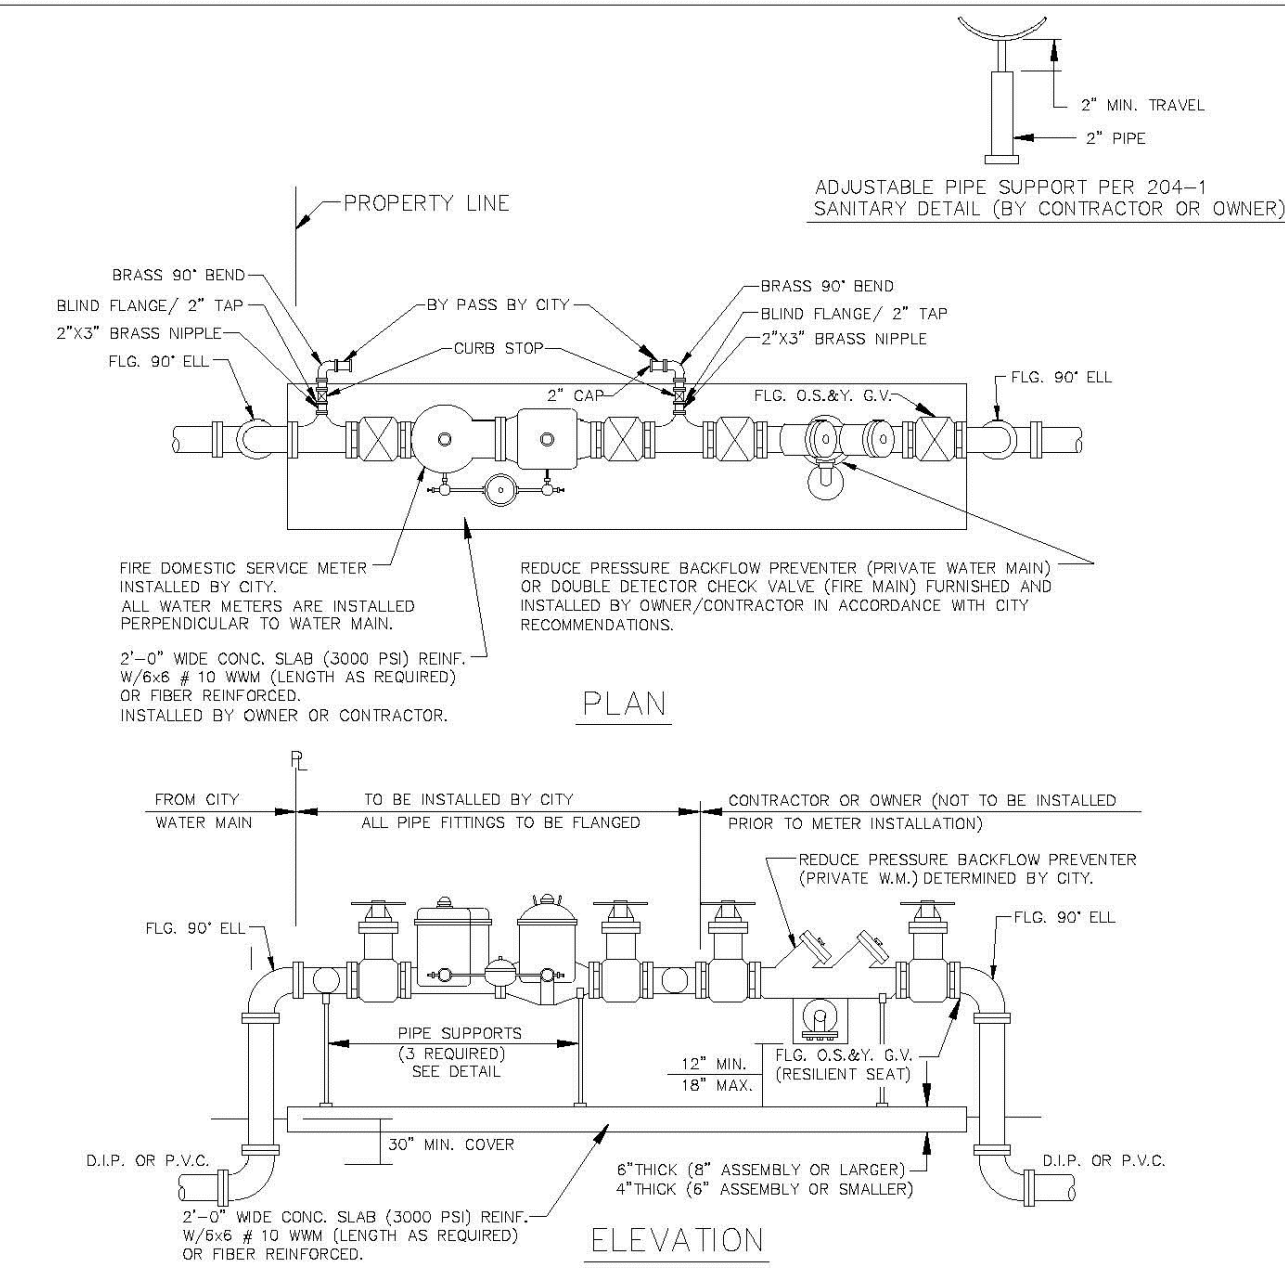

## MASTER METER AND BACKFLOW DEVICE DETAILS FIRE AND DOMESTIC COMBINED SOURCE

### NOTES

1. THE BACKFLOW PREVENTOR FOR THE BY-PASS SHALL BE DDGV OR RPZ.
2. PLEASE NOTE THAT WATER METERS 3" AND LARGER ARE SUBJECT TO AN APPROXIMATE ORDER LEAD TIME OF 60 TO 75 DAYS AFTER FULL PAYMENT. PLEASE CONTACT CUSTOMER SERVICE AT 954-786-4637 TO ARRANGE FOR METER PROCUREMENT AND INSTALLATION.
3. USE MEGALUGS AT ALL PIPE JOINTS
4. PLEASE SEE METER INSTALL DIMENSION LIST ON STANDARD NO. 106-4

ENGINEERING STANDARDS 2022			
REVISIONS	BY	DATE	DATE: MAY 2022 DWG. NO.
BY	DATE	ENGINEERING DIVISION CITY OF POMPAÑO BEACH	MASTER METER AND BACKFLOW DEVICE
S.S.	05-2011		
S.S.	11-2012		
S.S.	12-2013	SCALE: N.T.S.	106-2
S.S.	11-2016		

FIRE METERS - OS & Y VALVES, GASKETS & METER					
(NEPTUNE MACH 10 Ultrasonic Meter)					
				