

From: Nathaniel Watson
To: Carla Byrd; Greg Harrison
Cc: Randolph Brown; Bobby Clayton; Lorraine Frund; Jeffrey English; Tammy Thompkins; Allison Feurtado; Kelvin Stansberry
Subject: RE: (City Manager Approval Needed) Emergency Procurement: Wastewater Main Break at 1100 S Federal Hwy.
Date: Wednesday, March 22, 2023 9:53:05 AM

Thank you!

From: Carla Byrd <Carla.Byrd@copbfl.com>
Sent: Wednesday, March 22, 2023 9:52 AM
To: Greg Harrison <Greg.Harrison@copbfl.com>; Nathaniel Watson <Nathaniel.Watson@copbfl.com>
Cc: Randolph Brown <Randolph.Brown@copbfl.com>; Bobby Clayton <Bobby.Clayton@copbfl.com>; Lorraine Frund <Lorraine.Frund@copbfl.com>; Jeffrey English <Jeffrey.English@copbfl.com>; Tammy Thompkins <Tammy.Thompkins@copbfl.com>; Allison Feurtado <Allison.Feurtado@copbfl.com>; Kelvin Stansberry <Kelvin.Stansberry@copbfl.com>
Subject: RE: (City Manager Approval Needed) Emergency Procurement: Wastewater Main Break at 1100 S Federal Hwy.

Thank you, Sir.



From: Greg Harrison <Greg.Harrison@copbfl.com>
Sent: Wednesday, March 22, 2023 9:51 AM
To: Carla Byrd <Carla.Byrd@copbfl.com>; Nathaniel Watson <Nathaniel.Watson@copbfl.com>
Cc: Randolph Brown <Randolph.Brown@copbfl.com>; Bobby Clayton <Bobby.Clayton@copbfl.com>; Lorraine Frund <Lorraine.Frund@copbfl.com>; Jeffrey English <Jeffrey.English@copbfl.com>; Tammy Thompkins <Tammy.Thompkins@copbfl.com>; Allison Feurtado <Allison.Feurtado@copbfl.com>; Kelvin Stansberry <Kelvin.Stansberry@copbfl.com>
Subject: RE: (City Manager Approval Needed) Emergency Procurement: Wastewater Main Break at 1100 S Federal Hwy.

Approved.



From: Carla Byrd <Carla.Byrd@copbfl.com>
Sent: Wednesday, March 22, 2023 9:43 AM
To: Nathaniel Watson <Nathaniel.Watson@copbfl.com>; Greg Harrison <Greg.Harrison@copbfl.com>
Cc: Randolph Brown <Randolph.Brown@copbfl.com>; Bobby Clayton <Bobby.Clayton@copbfl.com>; Lorraine Frund <Lorraine.Frund@copbfl.com>; Jeffrey English <Jeffrey.English@copbfl.com>; Tammy Thompkins <Tammy.Thompkins@copbfl.com>; Allison Feurtado <Allison.Feurtado@copbfl.com>; Kelvin Stansberry <Kelvin.Stansberry@copbfl.com>
Subject: (City Manager Approval Needed) Emergency Procurement: Wastewater Main Break at 1100 S Federal Hwy.
Importance: High

Hi Nate,

Thank you for bringing this emergency procurement to my attention last night in your email below and including the attached invoice dated March 3. Based upon the facts, this is clearly an emergency procurement in accordance with City Ordinance 32.46 Emergency Procurement (attached). Thus, it is appropriate to forego the competitive procurement process in this instance. I have read the email trail below and I am including the City Manager, due to the dollar amount, as well as Finance, for the processing of payment.

In the future, when there are emergency procurements, please include me in the emails at the beginning or just let me know via phone so I can assist with expediting.

Hi Greg,

Please approve this emergency procurement in accordance with the City's Ordinance due to the dollar amount or authorize me to do so.

Purchasing has already begun its process for dispatching a PO, and upon Greg's approval, PO can be dispatched. Then, Purchasing will prepare the agenda item for Commission for ratification.

Thank you,



From: Nathaniel Watson <Nathaniel.Watson@copbfl.com>
Sent: Tuesday, March 21, 2023 10:51 PM
To: Carla Byrd <Carla.Byrd@copbfl.com>
Cc: Randolph Brown <Randolph.Brown@copbfl.com>; Bobby Clayton <Bobby.Clayton@copbfl.com>; Lorraine Frund <Lorraine.Frund@copbfl.com>; Jeffrey English <Jeffrey.English@copbfl.com>; Tammy Thompkins <Tammy.Thompkins@copbfl.com>
Subject: FW: Wastewater Main Break at 1100 S Federal Hwy.
Importance: High

Good Evening Carla,

I hope all is well. At approximately 4:16 PM on Tuesday, February 28, 2023, the Utilities Department responded to a report in which wastewater was discharging into the road and public swale right-of-way along S Federal Hwy. The City's sewer force main was in disrepair and located roughly 8 feet deep. City staff contacted Man Con, Inc. and Reynolds Construction, the two awarded vendors for RFP # P-27-19, Emergency and On Call Utility Repairs Services. Man Con, Inc. was not willing to respond to the repair in a timely manner. The means and method proposed for the work by Man Con would allow for a prolonged discharge of wastewater along the public right-of-way and into public water bodies. This response to the emergency solicitation to repair the City's utility was rejected.

As per Florida Administrative Code (F.A.C.) 62-604.500 Operation & Maintenance (5) The owner/operator of a collection/transmission system shall take corrective actions when infiltration, inflow, or leakage is excessive. (b) Leakage, or exfiltration, is considered excessive if it causes or contributes to a violation of surface water quality standards or ground water quality standards. Additionally, Reynolds Construction was neither willing, able nor ready to provide services for the emergency repair.

Given the imminent environmental and safety impacts to pedestrians and motorist alike, staff procured services from a local contractor who mobilized the site and completed the repair without delay. Please take note of the attached invoice which is pending review under requisition R1586.

Please let me know if you have any additional questions or concerns.

Thanks


From: Nathaniel Watson
Sent: Tuesday, February 28, 2023 5:58 PM
To: Randolph Brown <Randolph.Brown@copbfl.com>
Cc: Phil Hyer <Phil.Hyer@copbfl.com>; Richard Johnson <Richard.Johnson@copbfl.com>; Enrique Ochoa <Enrique.Ochoa@copbfl.com>; Whitney Walsh <Whitney.Walsh@copbfl.com>; Stacy Williams <Stacy.Williams@copbfl.com>; Fumiko Ojiro <Fumiko.Ojiro@copbfl.com>; Bobby Clayton <Bobby.Clayton@copbfl.com>; Steve Almyda <Steve.Almyda@copbfl.com>; Michael Taylor <Michael.Taylor@copbfl.com>; Aaron Lyons <Aaron.Lyons@copbfl.com>
Subject: Wastewater Main Break at 1100 S Federal Hwy.
Importance: High

Good Afternoon Randy-

The City was notified of a wastewater main break at approximately 4:16 PM at 1100 S Federal Hwy. We have dispatched the emergency on call contractor given the depth of the main. Staff has mobilized to the site and we are maintaining the spillage with Jet Vac trucks ensuring no wastewater enters into storm systems or waterways. We have also secured the area so as to prevent exposure to pedestrian and vehicular traffic. Once the contractor arrives on-site and work commences I'll provide detail as to causation and repair progress. We have Maintenance of Traffic (MOT) in place directing traffic accordingly. We are intermittently running and monitoring City Pump stations to help mitigate our the wastewater discharge.

The City lab is on standby. I will notify everyone once the repair is complete.

Thanks

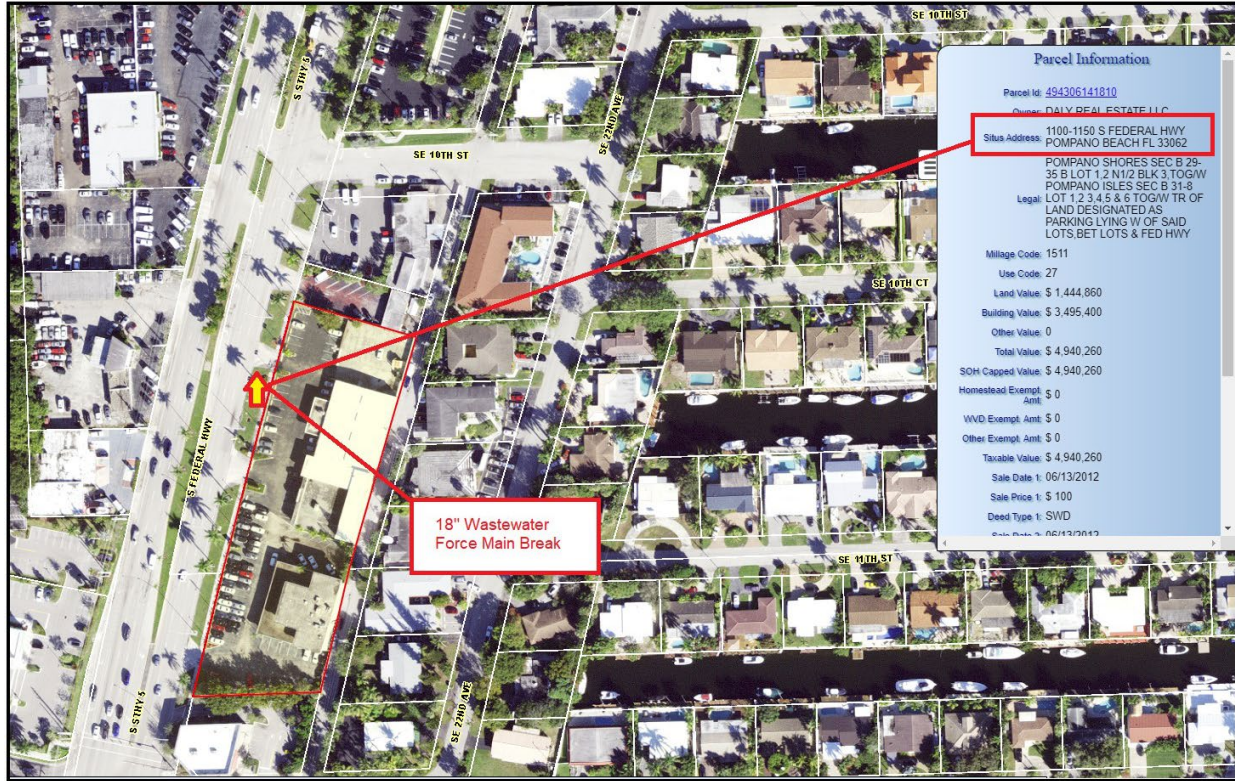

Utilities Hrs. of Operation: Mon-Thursday / 7AM – 5:30PM
After Hour & Weekend City Utility Emergency / 954-942-2202