DRC
PZ24-12000014
09/04/2024

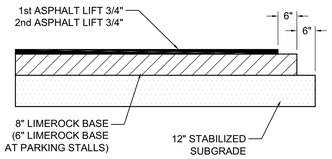

ASPHALTIC CONCRETE VEHICULAR:
FIRST LIFT - 3/4" FDOT - SP 9.5 (FINE MIX). SECOND (FINAL) LIFT - 3/4" FDOT - SP 9.5 (FINE MIX). ASPHALT SURFACE COURSE SHALL CONFORM TO THE REQUIREMENTS OF FDOT STANDARDS SPECIFICATIONS SECTIONS 330 AND 334. SECOND LIFT OF ASPHALT SHALL NOT BE PLACED UNTIL FINAL LANDSCAPE/HARDSCAPE HAS BEEN INSTALLED.

PRIME AND TACK COAT:
LIMEROCK BASE COURSE SHALL CONFORM TO THE REQUIREMENTS OF FDOT STANDARDS SPECIFICATIONS SECTION 300.
APPLICATION RATES:
PRIME COAT - 0.10 GALLONS PER SQ. YD.
TACK COAT - 0.08 GALLONS PER SQ. YD.

BASE:
8"/ 6" LIMEROCK BASE COMPACTED TO 98% OF MAXIMUM DENSITY (AASHTO T-180). LIMEROCK BASE TO CONFORM WITH THE REQUIREMENTS OF FDOT SPECIFICATIONS SECTIONS 200 AND 911.

SUBGRADE:
12" STABILIZED SUBGRADE COMPACTED TO 98% OF MAXIMUM DENSITY (AASHTO T-180); MINIMUM LBR = 40.

1 ASPHALT PAVEMENT DETAIL
NOT TO SCALE



1. CONCRETE VEHICULAR COURSE:
   8" - 3,000 PSI CONCRETE PER FDOT STANDARD SPECIFICATIONS SECTION 346 AND 350.
2. STABILIZED SUBGRADE:
   12" SUBGRADE COMPACTED TO 98% OF MAXIMUM DENSITY (AASHTO T-180). MINIMUM LBR = 40. GROUND ADJACENT TO PAVEMENT HAVING RUNOFF SHALL BE GRADED TWO INCHES LOWER THAN THE EDGE OF PAVEMENT TO ALLOW FOR THE PLACEMENT OF SOD.
3. SAWED JOINTS:
   3/16" SAW CUT, 1½" DEEP (WITHIN 12 HOURS), MAX. 15' O.C., AND MIN.3' PARALLEL TO THE EDGE OF PAVEMENT.

2 CONCRETE PAVEMENT DETAIL
NOT TO SCALE

NOTES:
ALL TYPE "F" CURB & GUTTER SHALL BE IN ACCORDANCE WITH THE STANDARD REQUIREMENTS OF FDOT INDEX 520-001.

"WHEN USED ON HIGH SIDE OF ROADWAYS, THE CROSS SLOPE OF THE GUTTER SHALL MATCH THE CROSS SLOPE OF THE ADJACENT PAVEMENT. THE THICKNESS OF THE LIP SHALL BE 6", UNLESS OTHERWISE SHOWN ON PLANS.

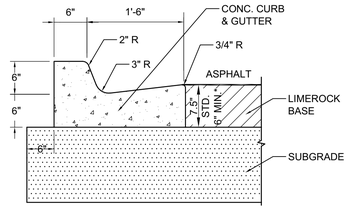

4 TYPE "F" CURB DETAIL PER FDOT INDEX No. 520-001
NOT TO SCALE

	SPACING OF REQUIRED ROADWAY, PARKING AREA, AND UTILITY TRENCH TESTS							
	Proctor Maximum Density		L.B.R.		DENSITY / Per Lift		THICKNESS	
	MAX. SPACING		MAX. SPACING		MAX. SPACING		MAX. SPACING	
	LIN. FEET	SQ. FEET	LIN. FEET	SQ. FEET	LIN. FEET	SQ. FEET	LIN. FEET	SQ. FEET
COMPACTED OR STABILIZED SUBGRADE	1000	12,000	1000	12,000	500	6,000	200	2,400
LIMEROCK BASE	4000	24,000	--	--	500	6,000	200	2,400
ASPHALT	--	--	--	--	1500	18000	Every 200 Tons	
UTILITY TRENCH	One per Soil Type		--	--	500	6,000	--	--
Embankment / Backfill	One per Soil Type		--	--	500	6,000	--	--

ALL TESTING SHALL BE TAKEN IN A STAGGERED SAMPLING PATTERN FROM A POINT 12" INSIDE THE LEFT EDGE OF THE ITEM TESTED TO THE CENTER, TO A POINT 12" INSIDE THE RIGHT EDGE. A MINIMUM OF 2 TESTS SHALL BE TAKEN INCLUDING UTILITY TRENCHES AND ROADWAY RESTORATION. SEE FDOT STANDARD SPECIFICATIONS FOR FURTHER DETAILS AND REQUIREMENTS.

6 COMPACTION TEST SCHEDULE
NOT TO SCALE

NOTE:
ALL TYPE "D" CURB SHALL BE IN ACCORDANCE WITH THE STANDARD REQUIREMENTS OF FDOT INDEX 520-001.

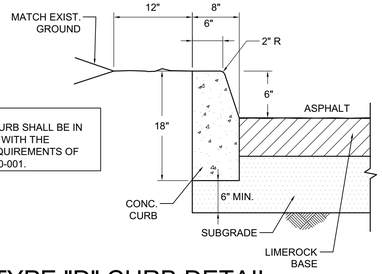

3 TYPE "D" CURB DETAIL PER FDOT INDEX No. 520-001
NOT TO SCALE

NOTE:
ALL DROP CURB SHALL BE IN ACCORDANCE WITH THE STANDARD REQUIREMENTS OF FDOT INDEX 520-001.

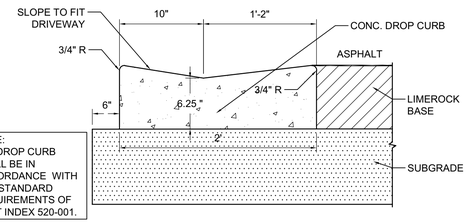

5 DROP CURB DETAIL PER FDOT INDEX No. 520-001
NOT TO SCALE

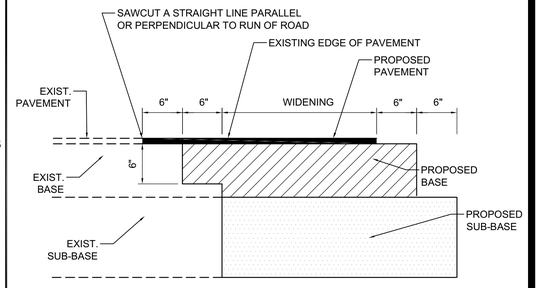

7 SAWCUT WIDENING DETAIL
NOT TO SCALE

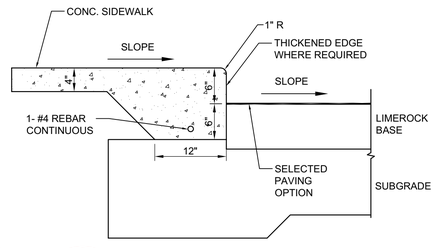

8 THICKENED EDGE SIDEWALK DETAIL
NOT TO SCALE

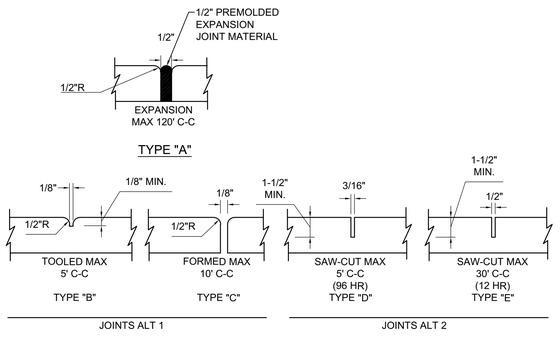

CONCRETE PAVEMENT & SIDEWALK JOINTS

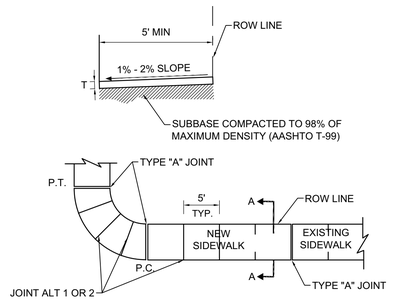

SIDEWALK PLAN

NOTES:
1. Sidewalk construction is to comply with the latest FDOT standards for sidewalks and ADA curb ramps, per FDOT index 522-001 and 522-002.
2. Provide either joint alternate 1 or 2. If using joint alternate 2: construct type "E" joints at not more than 30' intervals - within 12 hours after finishing, construct 1/2" expansion, provide joint type "A", with non-rising performed joint filler at not more than 120' intervals, construct remaining joints within 96 hours after finishing.
3. Provide 1/2" expansion joint type "A", with non-rising performed joint filler where concrete pavement abuts concrete curbs, driveways and other fixed objects.
4. Sidewalk thickness shall be 4" thick unless otherwise noted. Thickness shall be 6" through driveways and on all commercial sidewalk applications.
5. The use of steel reinforcement is not permitted.
6. Concrete to be 3,000 psi in 28 days.
7. Cure all concrete with approved method.
8. Sidewalk foundation shall be compacted to a firm, even surface, true to grade and cross section, and shall be moist at the time concrete is placed.
9. All construction shall conform to local construction codes and standards.
10. Sidewalk slopes shall meet the requirements of the Americans with Disabilities Act. Minimum transverse slope 0.01 ft./ft. And maximum transverse slope 0.02 ft./ft. toward swale or gutter. Longitudinal slope shall conform to ADA requirements.
11. The vertical deviation for a new sidewalk shall not be more than ½".
12. The vertical deviation for a new maintenance access structure cover shall not be more than ¼".
13. Where truncated domes are used, stamped concrete is not permitted. Truncated domes to be cast with the concrete.
14. Sidewalk shall have a transverse hair broom finish.

9 SIDEWALK DETAIL
NOT TO SCALE

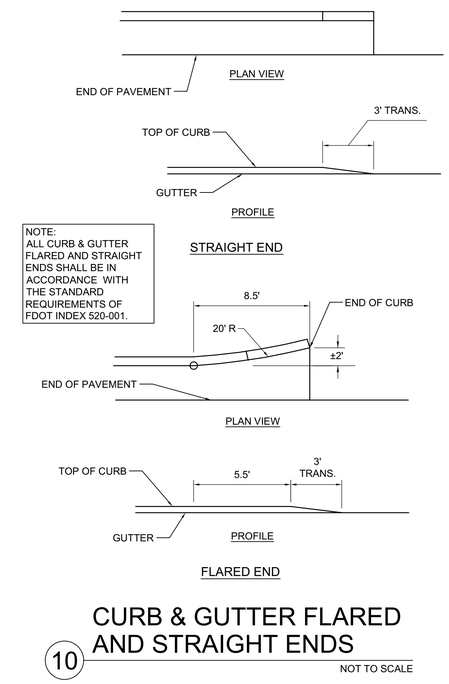

NOTE:
ALL CURB & GUTTER FLARED AND STRAIGHT ENDS SHALL BE IN ACCORDANCE WITH THE STANDARD REQUIREMENTS OF FDOT INDEX 520-001.

10 CURB & GUTTER FLARED AND STRAIGHT ENDS
NOT TO SCALE

KEITH
301 East Atlantic Blvd.
Pompano Beach, FL 33060
PH: (954) 788-3400
Florida Engineering Business License: CA7928
Florida Surveyor and Mapper Business License: LB6860
Florida Landscape Architecture Business License: LC26000457

REVISIONS

NO.	DESCRIPTION	DATE

Plotted by: cdelanoy On 7/30/2024 11:59 AM

RESPONSIBILITY FOR THE USE OF THESE PLANS PRIOR TO OBTAINING PERMITS FROM ALL AGENCIES HAVING JURISDICTION OVER THE PROJECT WILL FALL SOLELY UPON THE USER.

ISSUE DATE:	07/30/24
DESIGNED BY:	NW
DRAWN BY:	CD
CHECKED BY:	NW
BID-CONTRACT:	

This item has been digitally signed and sealed by NILES T. WARRICK, P.E. on the date adjacent to the seal.
NILES T. WARRICK LICENSE No. 94320 STATE OF FLORIDA PROFESSIONAL ENGINEER
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.
2024.07.30 12:15:50-04'00'
NILES T. WARRICK, P.E.
FLORIDA REG. NO. 94320
(FOR THE FIRM)

CLIENT
VINCENTO THROWER, THOMAS GRANER TRUSTEE

PROJECT
2851 DR. MLK JR. BLVD., POMPANO BEACH

SHEET TITLE
PAVING, GRADING, DRAINAGE, AND UTILITY DETAILS

SHEET NUMBER	CP-501
PROJECT NUMBER	14232.00

Drawing name: H:\14232.00 - 2851 Dr. MLK Jr. Blvd. - 2851 Dr. MLK Jr. Blvd. Trust\Engineering\Cad\14232.00-CP-SXX.dwg

STATUS: PRELIMINARY

DRC
PZ24-12000014
10/16/2024