


PROTECTIVE BARRIER AND PLANTING CLEARANCES  
FOR PADMOUNTED TRANSFORMERS  
NO SCALE (COORDINATE WITH FP & L)

ELECTRICAL SITE PLAN NOTES

1. PROPOSED LOCATION OF FLORIDA POWER AND LIGHT PAD MOUNTED TRANSFORMER. COORDINATE EXACT LOCATION WITH FP&L. COORDINATE ALL REQUIREMENTS WITH RON BURNISON PRIOR TO CONSTRUCTION AT (954) 781-1020.
  2. APPROXIMATE TELCO ROOM LOCATION, REFER TO ELECTRICAL PLAN, SHEET E-3.1.
  3. (2) 4" TELEPHONE CONDUITS WITH PULLWIRE. CAP EACH CONDUIT AT THE PROPERTY LINE. CONDUITS TO STUB UP 6" AFF AT TELEPHONE BOARD IN THE ELECTRICAL ROOM. COORDINATE WITH BILL SERPE AT BELL SOUTH PRIOR TO CONSTRUCTION AT (954) 423-6222.
  4. (2) 4" CONDUITS TO PAD MOUNTED XFMR AS SHOWN. CONDUIT IS FURNISHED BY FP&L FURNISHED 90 DEGREE TURNS AT THE PAD MOUNTED TRANSFORMER LOCATION. ELECTRICAL CONTRACTOR IS TO FURNISH AND INSTALL PULLWIRE IN CONDUIT. ELECTRICAL CONTRACTOR IS TO COORDINATE WITH FP&L THE EXACT ROUTE OF THE CONDUIT. DEPTH AND OTHER REQUIREMENTS PRIOR TO CONSTRUCTION.
  5. SATELLITE DISH.
- GENERAL NOTES
1. SPLICES IN GROUND JUNCTION BOXES SHALL BE THOROUGHLY COATED WITH AN APPROVED WATERPROOFING COMPOUND, SKOTCHKOTE OR EQUAL.

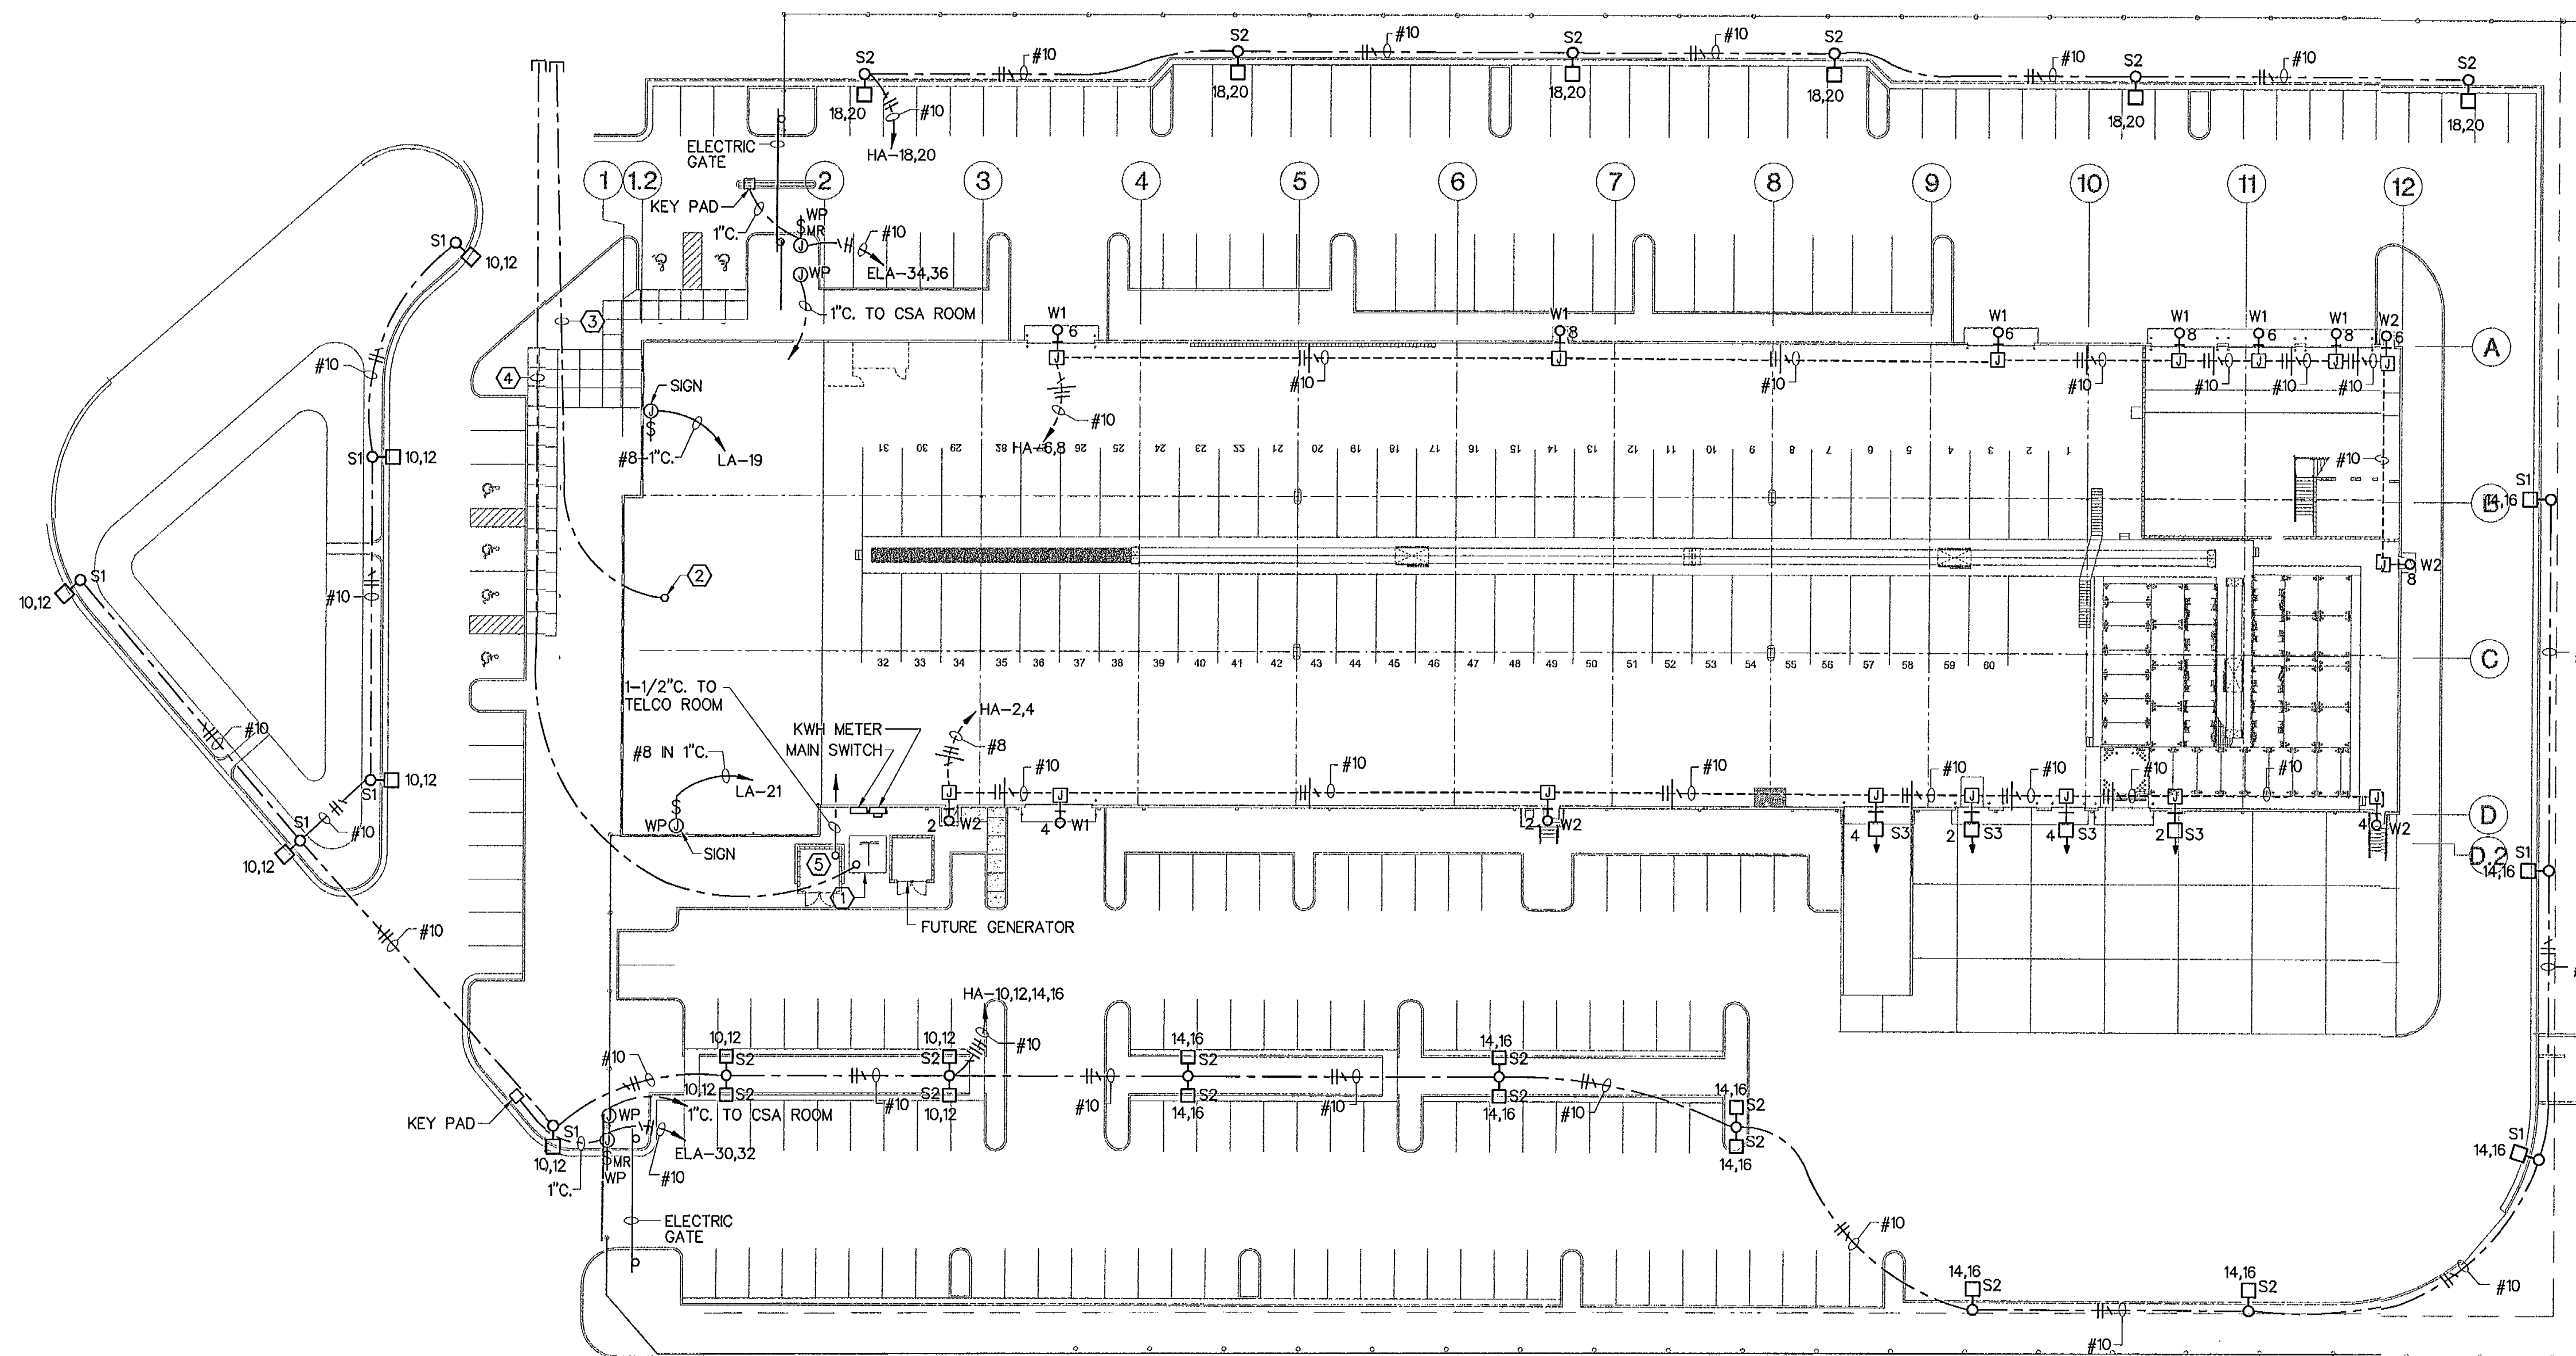

1 ELECTRICAL SITE PLAN  
SCALE: 1"=30'-0"