


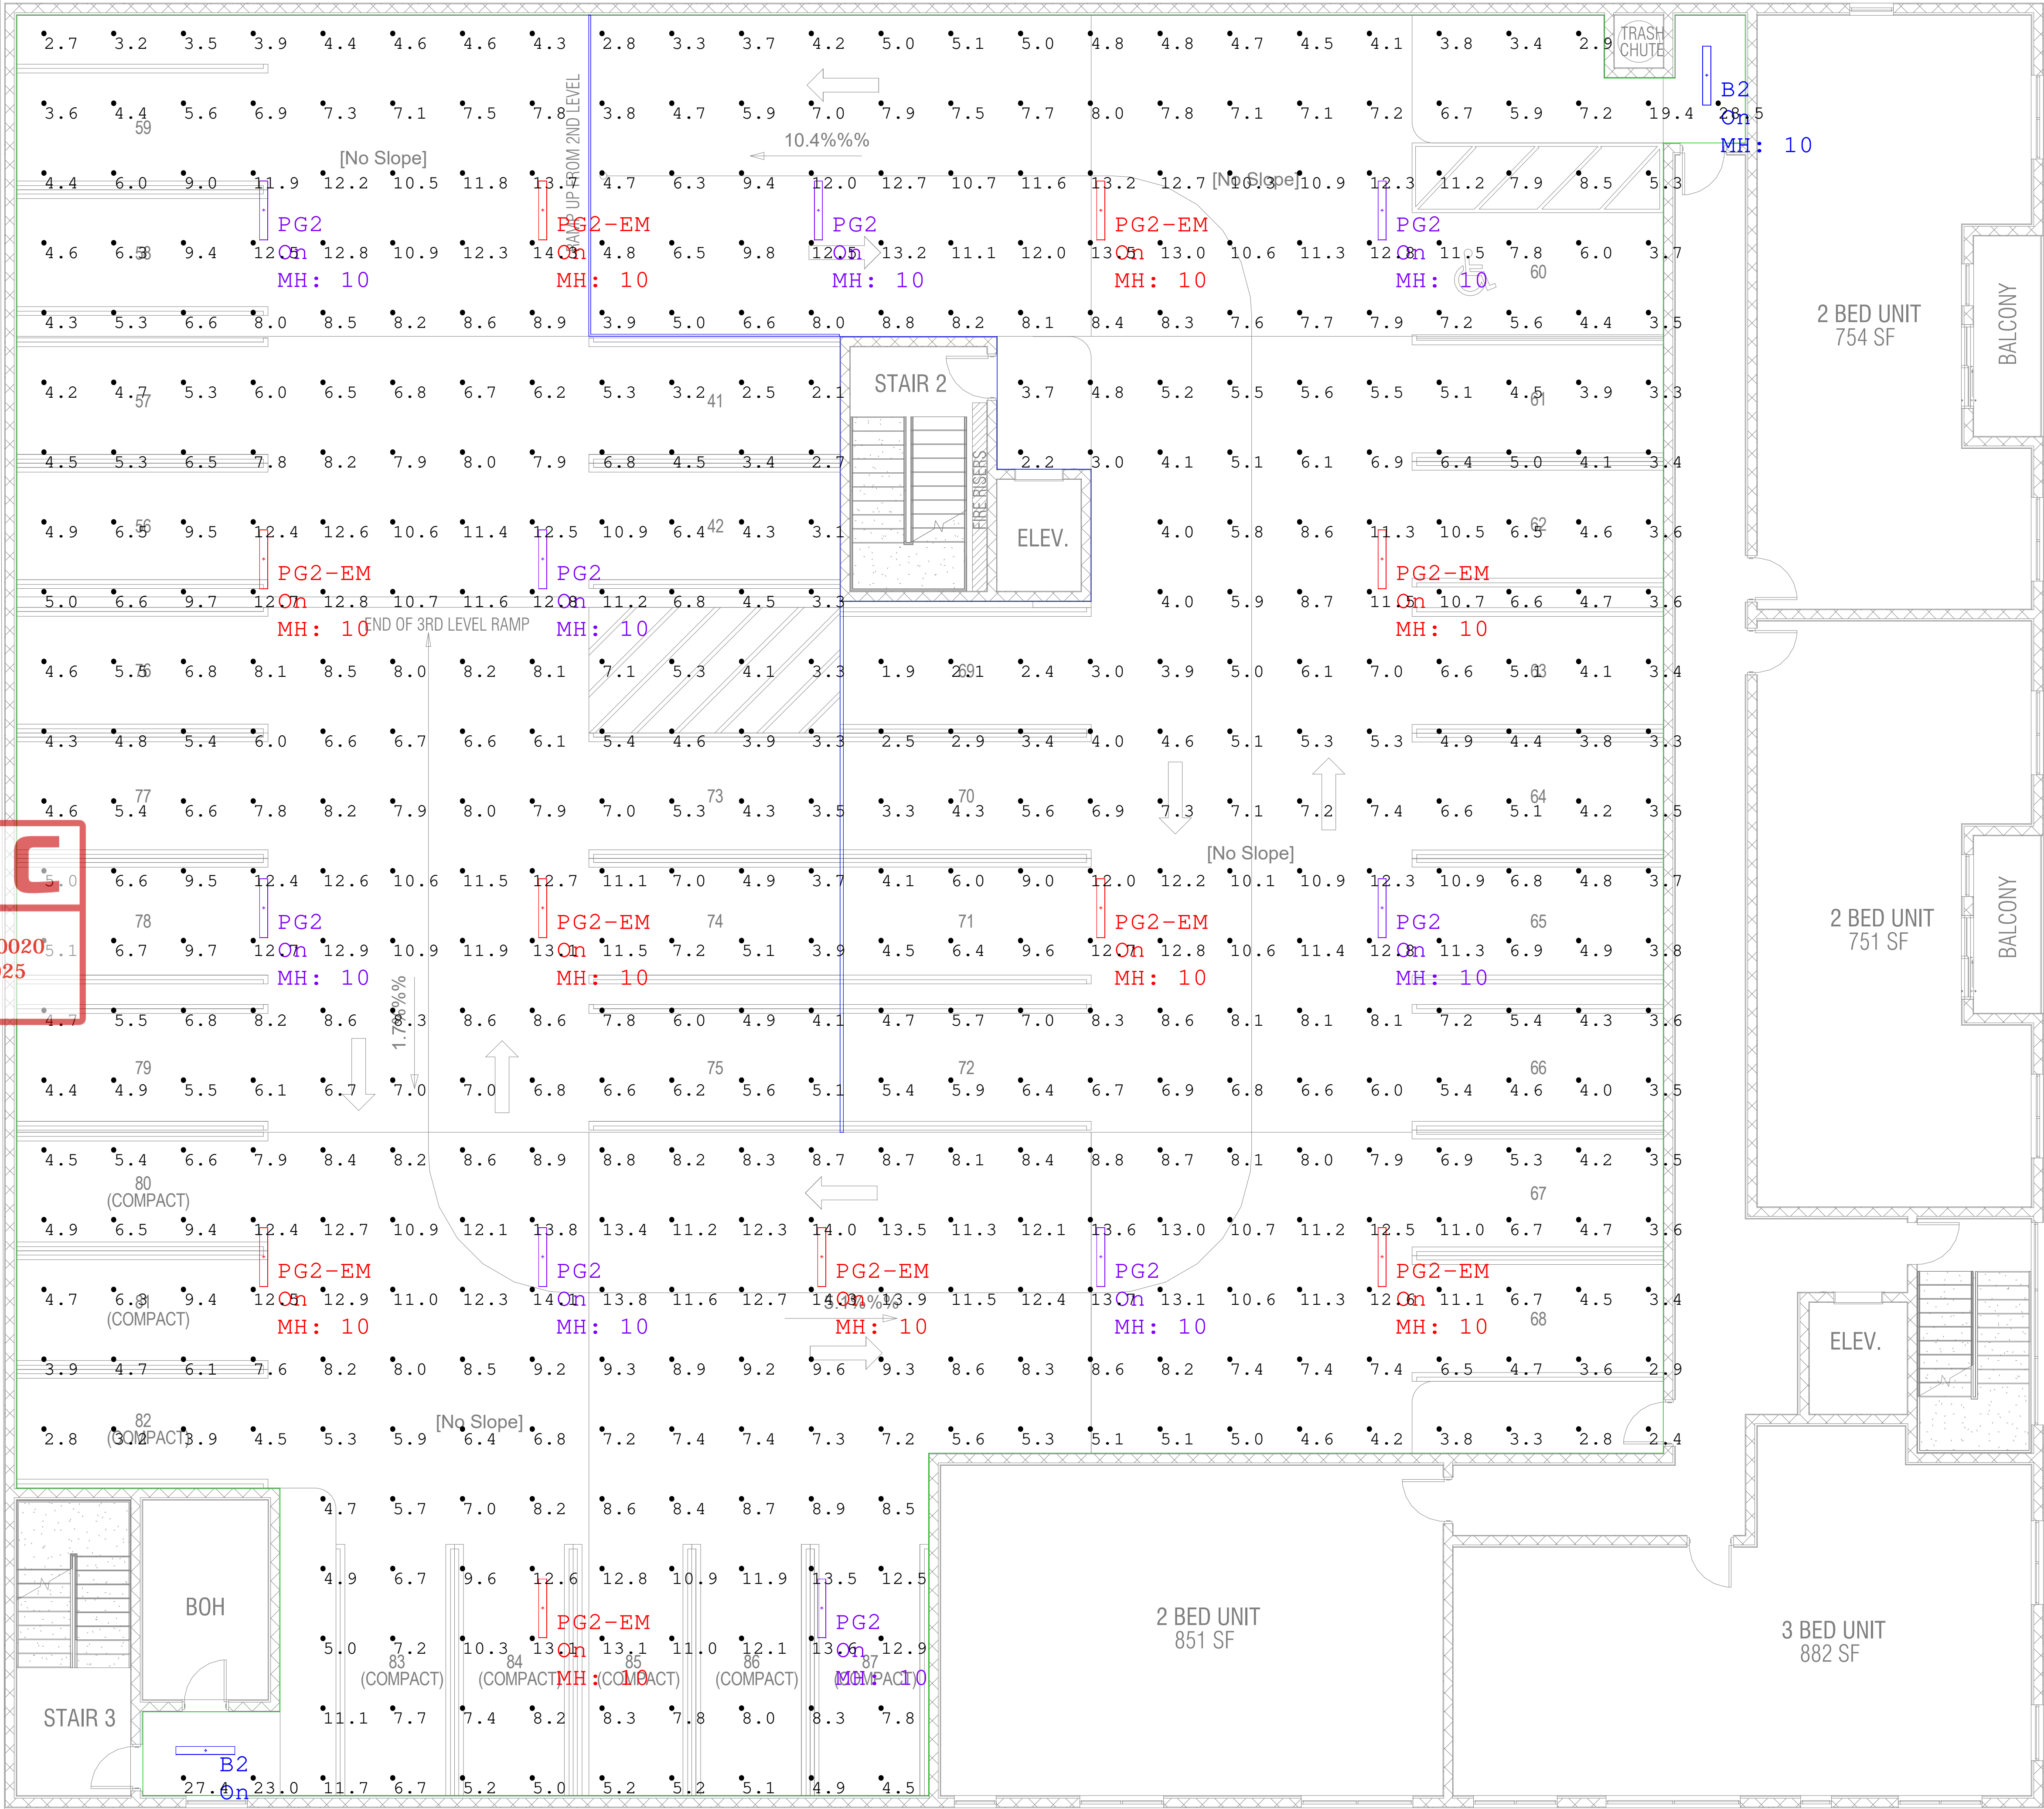


Luminaire Schedule									[MANUFAC]
Symbol	Qty	Label	Arrangement	Luminaire Lumens	LLF	Luminaire Watts	Total Watts	Description	
	10	PG2-EM	Single	5896	0.900	40	400	BS100LEDPG4HTLOWT40120-277V_S	
	9	PG2	Single	5896	0.900	40	360	BS100LEDPG4HTLOWT40120-277V_S	
	2	B2	Single	6265	0.900	40	80	BS100LED4HTLOWT40120-277V_S	

Calculation Summary									
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Point Spacing	Calc. Plane Height
Third Floor Parking_Floor	Iluminance	Fc	7.51	28.5	1.9	3.95	15.00	5	0

Room Summary		
Label	Type	Wall Height
Third Floor Parking	Polygon-Flat	10



Disclaimer:
SESCO Lighting provides this photometric report for purposes of comparison within the SESCO Lighting product line only. The information provided is based on standardized industry procedures.
This laboratory performance will always differ from that observed in the field due to a great number of variables, both known and unknown (installation methods, power quality, lamping, recoverable and non-recoverable light loss factors, etc.)
In general, SESCO Lighting considers numerical studies to be predictive in that they cannot characterize the visual performance of any luminaire, single or grouped. As such, specification decisions must be thoroughly based upon experience, consultation with the manufacturer, and, above all, common sense.

Sales Rep: Cory Lawson
Office: FT Lauderdale
Contact: (850) 572-2827
Processed By:
Filename: 09-05-2025 - Atlantico - Third Floor NORMAL.AGI

Atlantico Parking
Third Floor
NORMAL
Initial Layout