


Luminaire Schedule									Description	[MANUFAC]
Symbol	Qty	Label	Arrangement	Luminaire Lumens	LLF	Luminaire Watts	Total Watts			
SA	7	SA	Single	8730	0.900	54.129	378.903		OPF-S-A02-840-AFR	SIGNIFY CANADA LTD
B2	6	B2-EM	Single	6265	0.225	40	240		BS100LED4HTLOWT40120-277V_S-EM10W	BEGHELLI
PG2	10	PG2-EM	Single	5896	0.225	40	400		BS100LEDPG4HTLOWT40120-277V_S-EM10W	BEGHELLI
B2	7	B2	Single	5896	0.900	40	280		BS100LEDPG4HTLOWT40120-277V_S	BEGHELLI
B2	2	B2	Single	6265	0.900	40	80		BS100LED4HTLOWT40120-277V_S	BEGHELLI

Calculation Summary									
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Point Spacing	Calc. Plane Height
Bike Storage_Workplane	Fc		3.34	9.9	0.7	4.77	14.14	2	2.5
Elec_Workplane	Fc		6.51	10.0	3.9	1.67	2.56	2	2.5
Fire Pump_Workplane	Fc		9.71	11.8	7.8	1.24	1.51	2	2.5
First Floor Parking_Floor	Fc		1.10	3.3	0.1	11.00	33.00	5	0
FPL Vault_Workplane	Fc		6.58	10.5	3.5	1.88	3.00	2	2.5
Garage Entry	Fc		0.31	0.8	0.1	3.10	8.00	5	0
Loading Zone	Fc		0.00	0.0	0.0	N.A.	N.A.	5	0
Pump room_Workplane	Fc		9.67	11.7	7.8	1.24	1.50	2	2.5
Side Walk	Fc		0.01	0.2	0.0	N.A.	N.A.	5	0
Trash Room_Workplane	Fc		3.35	10.0	0.7	4.79	14.29	2	2.5

Room Summary		
Label	Type	Wall Height
Bike Storage	Polygon-Flat	10.5
Elec	Polygon-Flat	10.5
Fire Pump	Polygon-Flat	10.5
First Floor Parking	Polygon-Flat	10.5
FPL Vault	Polygon-Flat	10.5
Lobby	Polygon-Flat	10.5
Pump room	Polygon-Flat	10.5
Trash Room	Polygon-Flat	10.5

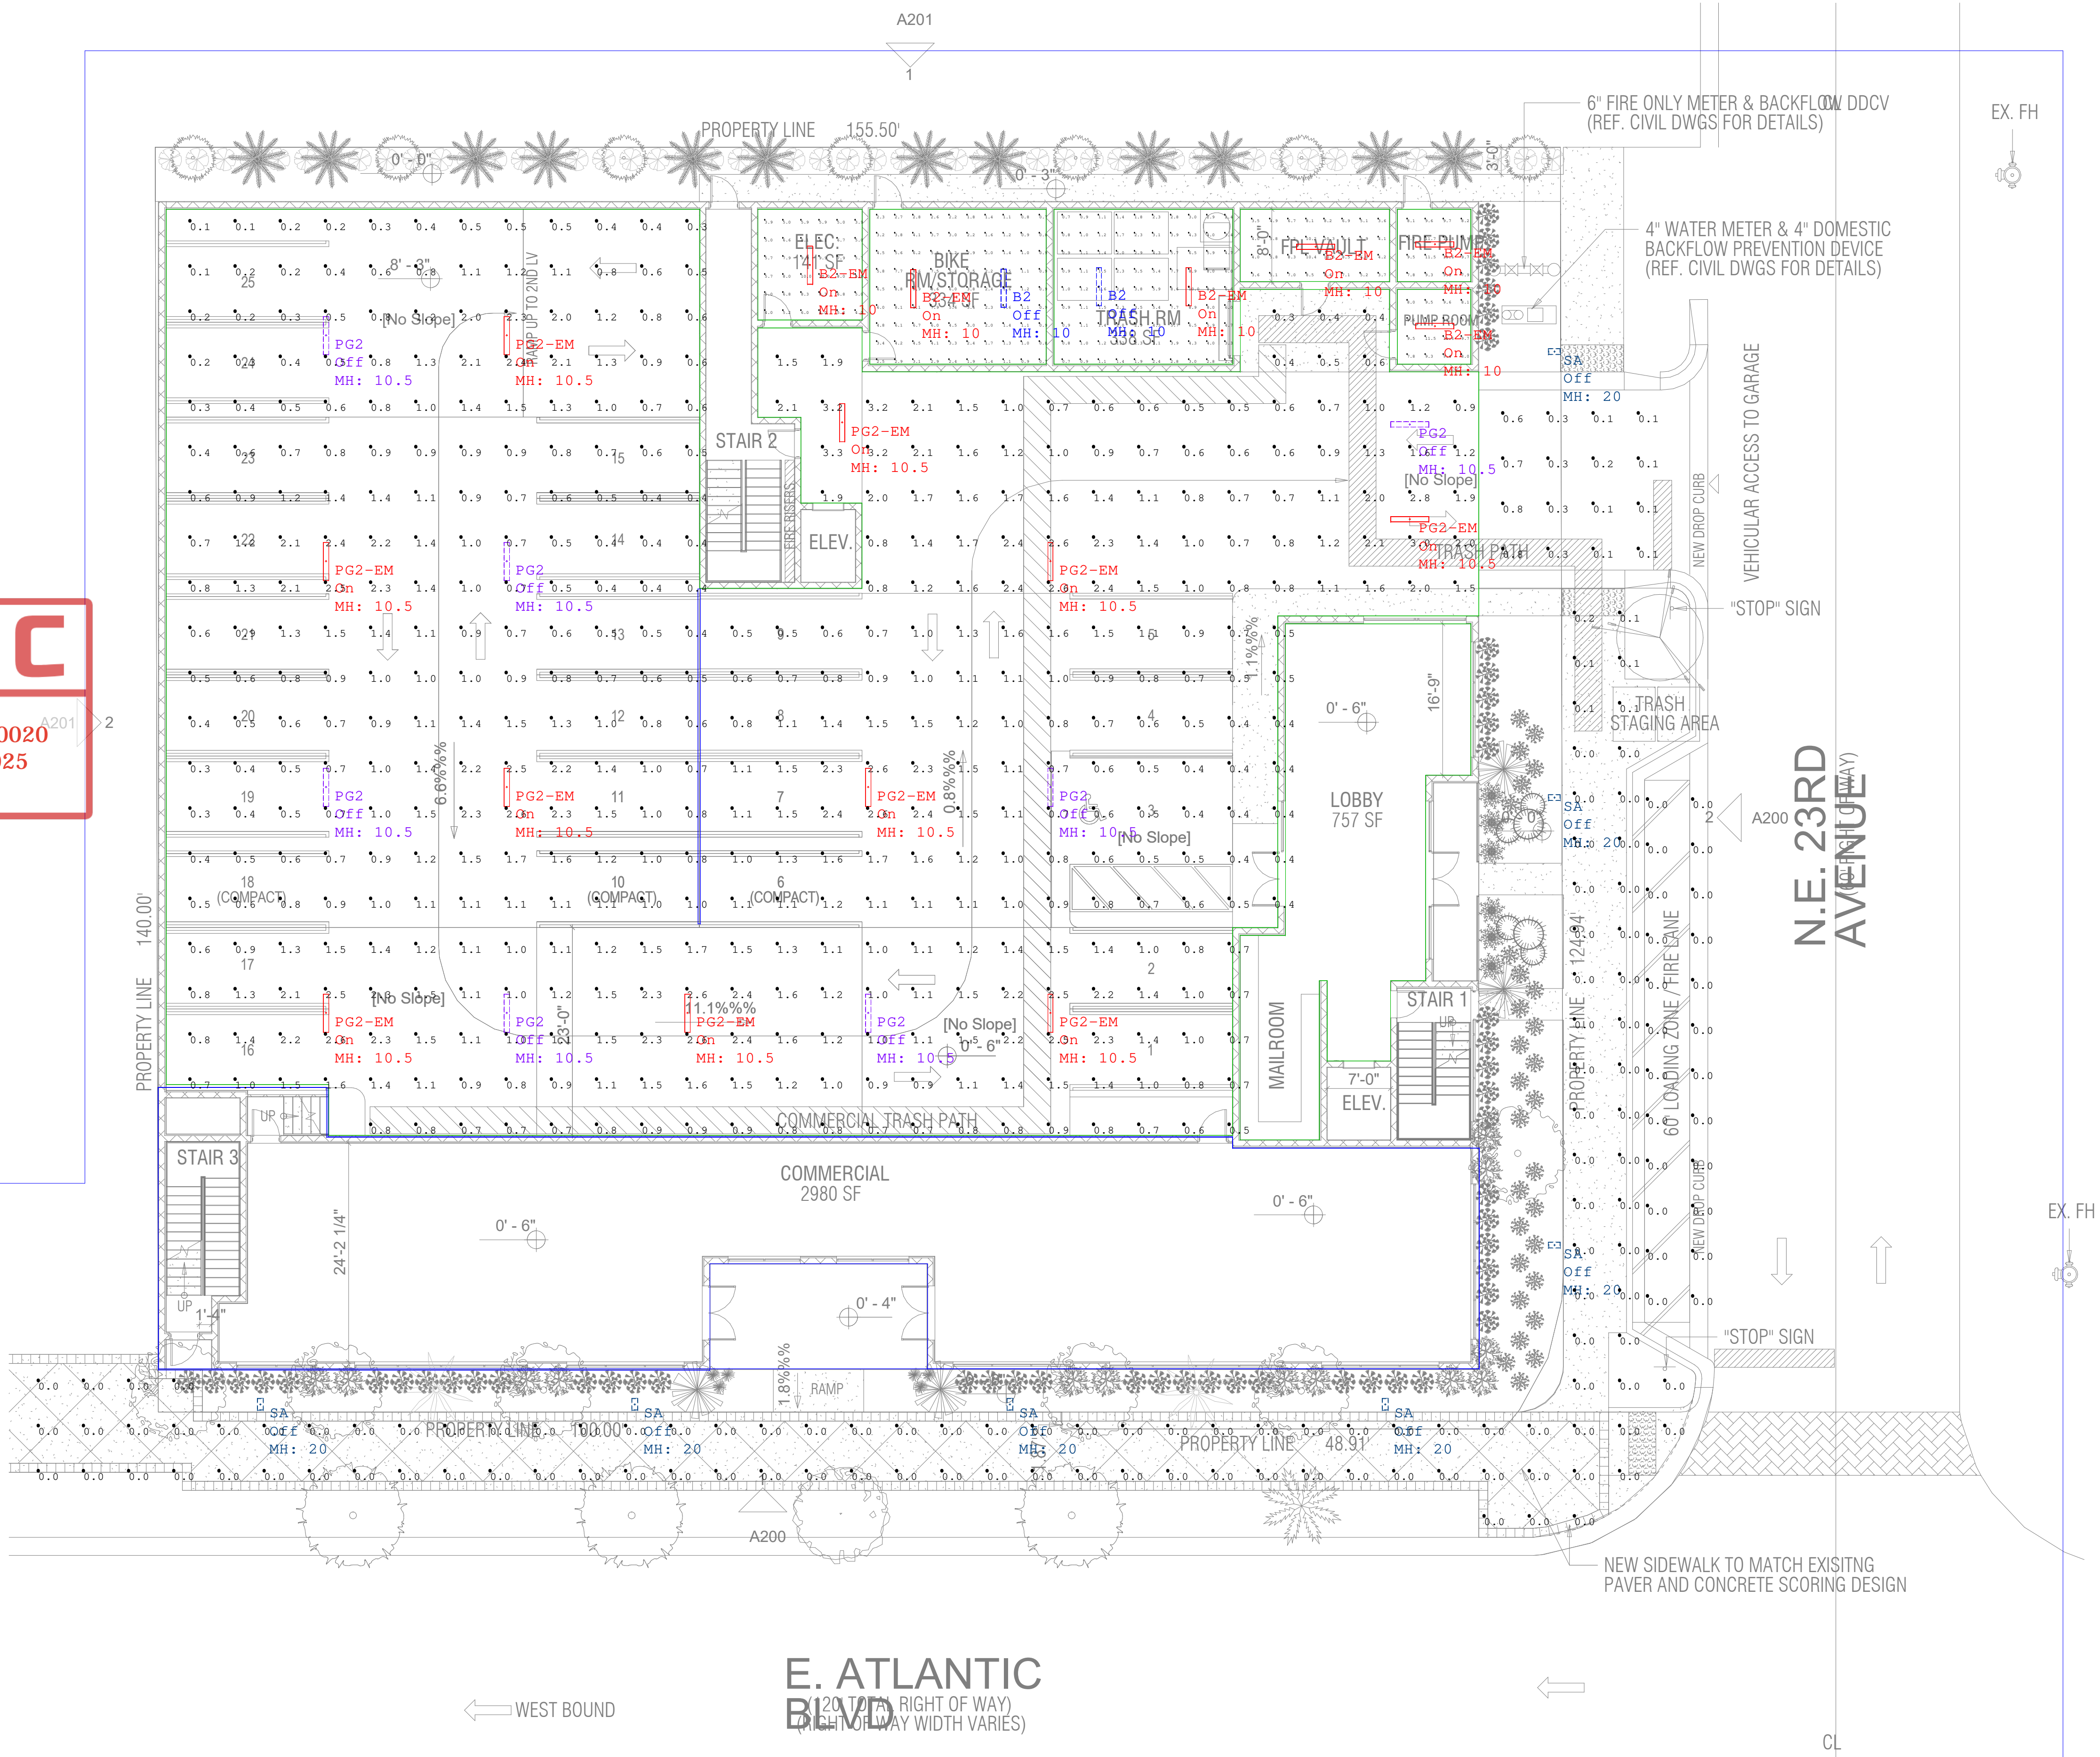

PHOTOMETRY
Scale: 1 inch= 10 Ft.

Disclaimer:
SESCO Lighting provides this photometric report for purposes of comparison within the SESCO Lighting product line only. The information provided is based on standardized industry procedures.
This laboratory performance will always differ from that observed in the field due to a great number of variables, both known and unknown (installation methods, power quality, lamping, recoverable and non-recoverable light loss factors, etc.)
In general, SESCO Lighting considers numerical studies to be predictive in that they cannot characterize the visual performance of any luminaire, single or grouped. As such, specification decisions must be thoroughly based upon experience, consultation with the manufacturer, and, above all, common sense.

Sales Rep: Cory Lawson
Office: FT Lauderdale
Contact: (850) 572-2827
Processed By:
Filename: 09-05-2025 - Atlantico - First Floor EMER-AGI

Atlantico Parking
EMERGENCY
Initial Layout

Date:9/9/2025

Page 1 of 1