


LEGEND
 * - Emergency escape

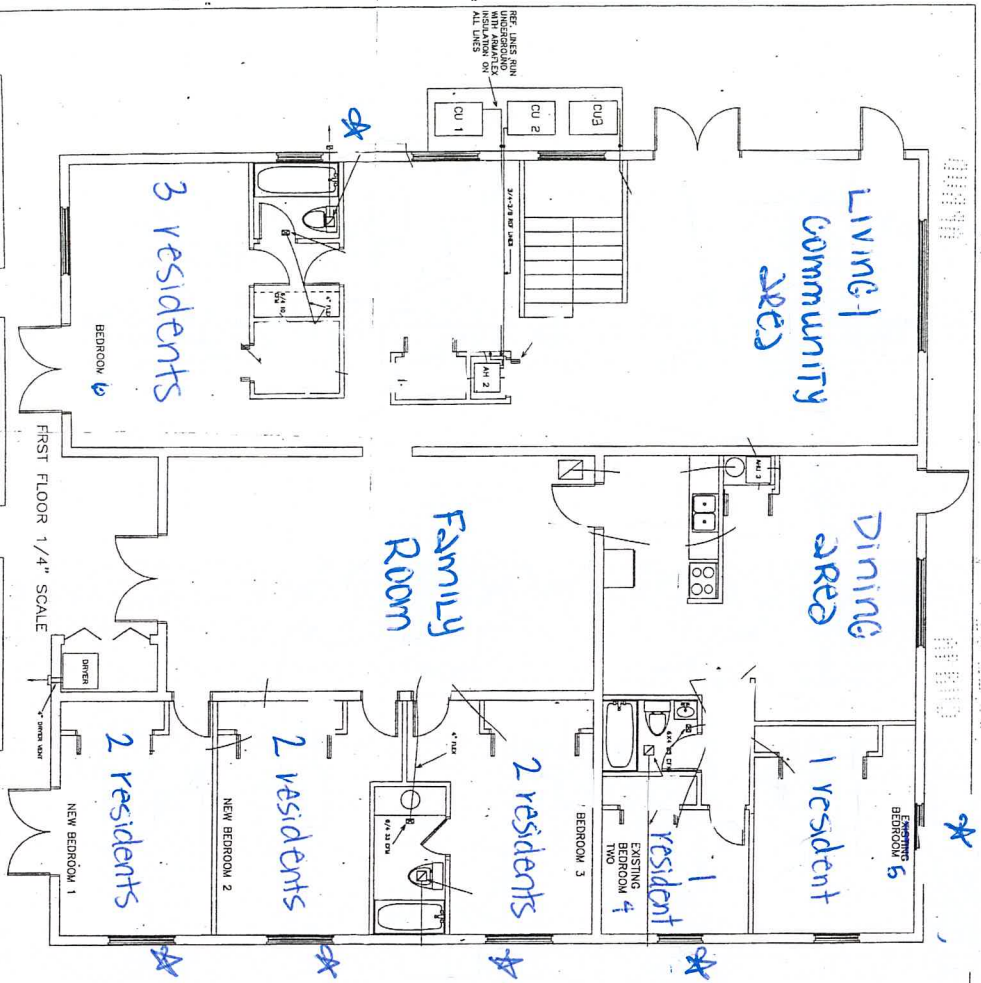

A/C SCHEDULE

CONDENSING UNIT	
MANUFACTURER	MODEL
RUUD	UHV-325
SEER	12.4
TOTAL HEAT	36,000
LATENT HEAT	10,400
SENSIBLE HEAT	25,560
AIR HANDLER	
MANUFACTURER	MODEL
RUUD	UHR-4-11
MODEL	1200
CFM	1200
HEAT	15 KW
TOTAL STATIC	50

A/C ONE

A/C SCHEDULE

CONDENSING UNIT	
MANUFACTURER	MODEL
RUUD	UHV-325
SEER	12.4
TOTAL HEAT	3000
LATENT HEAT	900
SENSIBLE HEAT	2300
AIR HANDLER	
MANUFACTURER	MODEL
RUUD	UHR-4-11
MODEL	1.0
CFM	1.0
HEAT	7 KW
TOTAL STATIC	3

A/C TWO





A/C SCHEDULE

CONDENSING UNIT	
MANUFACTURER	MODEL
RUUD	UHV-325
SEER	12.4
TOTAL HEAT	42,000
LATENT HEAT	12,100
SENSIBLE HEAT	29,900
AIR HANDLER	
MANUFACTURER	MODEL
RUUD	UHR-4-11
MODEL	1.400
CFM	1.400
HEAT	15 KW
TOTAL STATIC	60

A/C THREE

EXHAUST FANS

MANUFACTURER	MODEL	SIZE
GR	50	50 CFM
GR	50	50 CFM
GR	150	150 CFM

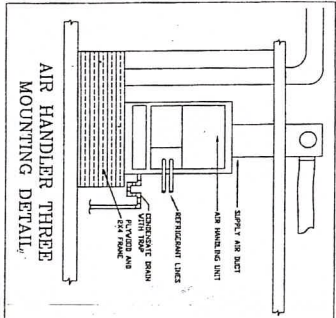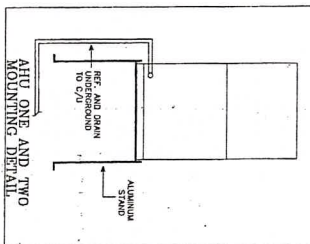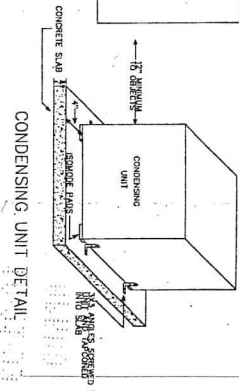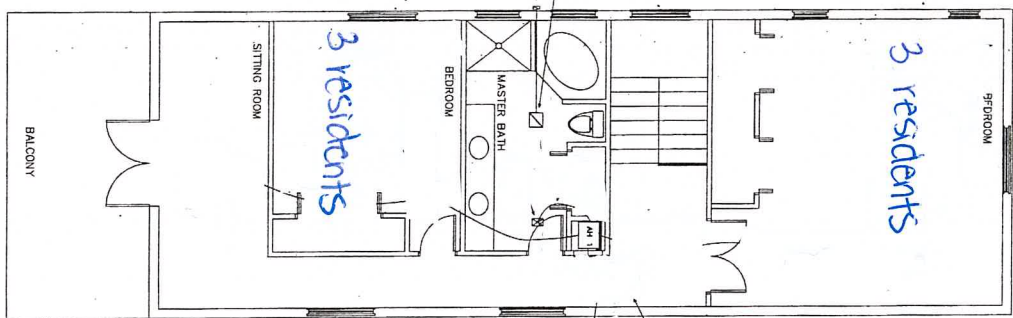


REMOVED
 APPROVED AS NOTED
 NOT APPROVED

Approval in accordance with...
 Special Conditions of the Contract for Construction...
 specifically define the limits of the Architect's responsibility.

Contractor shall not review and stamp Shop Drawings...
 without the Architect's approval.

To the Architect's approval of Shop Drawings as Sampled...
 shall not release the Contractor of responsibility for any...
 No liability shall be assumed by the Architect for any...
 of the Contract Documents.

DATE: 11/11/11
 ARCHITECTS



GOMEZ ASSOCIATES ARCHITECTS
 7334 NW 5TH STREET
 PLANTATION, FLORIDA 797-8220

**ADDITION AND REMODEL FOR
 MR. AND MRS. SOSA**
 1520 NE 43 CT.
 POMPANO BEACH, FLORIDA

NO.	DATE	REVISION
1		
2		
3		
4		