




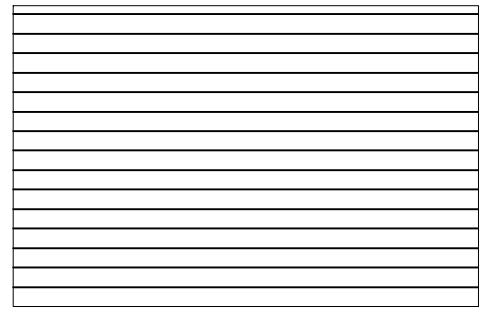
















IRRIGATION SCHEDULE 2.20

SYMBOL	MANUFACTURER/MODEL/DESCRIPTION	QTY	PSI
	Hunter MP Strip PROS-06-PRS40-CV-F Turf Rotator, 6" pop-up with factory installed check valve, floguard, pressure regulated to 40 psi, MP Rotator nozzle on PRS40 body. LST=Ivory left strip, SST=Brown side strip, RST=Copper right strip.	13	40
	Hunter MP2000 PROS-06-PRS40-CV-F Turf Rotator, 6" pop-up with factory installed check valve, floguard, pressure regulated to 40 psi, MP Rotator nozzle on PRS40 body. K=Black adj arc 90-210, G=Green adj arc 210-270, R=Red 360 arc.	24	40
	Hunter PROS-00-PCN 10 Flood Bubbler, on a PROS-04	26	30
SYMBOL	MANUFACTURER/MODEL/DESCRIPTION	QTY	
	Hunter ICZ-101-25 Drip Control Zone Kit. 1" ICV Globe Valve with 1" HY100 filter system. Pressure Regulation: 25psi. Flow Range: 2 GPM to 20 GPM. 150 mesh stainless steel screen.	1	
	Pipe Transition Point in Drip Box	16	
	Area to Receive Dripline Hunter HDL-06-18 On-Surface Pressure Compensating Landscape Dripline. 0.6 GPH emitters at 18" O.C. Dripline laterals spaced at 18" apart, with emitters offset for triangular pattern.	1,096 lf	
SYMBOL	MANUFACTURER/MODEL/DESCRIPTION	QTY	
	Hunter PGV-100G-S 1" Plastic Electric Remote Control Valve, for Residential/Light Commercial Use. Slip x Slip. Globe Configuration, No Flow Control.	3	
	Gate Valve Aqualine Gate Valve or approved equal	1	
	Hunter PCC-600 Light Commercial & Residential Controller, 6-Station fixed controller, 120 VAC, Outdoor model	1	
	Hunter RAIN-CLIK Rain Sensor, with conduit installation, mount as noted. Normally closed switch.	1	
	Goulds Centrifugal Pump 1.5 HP	1	
	Vu-Flow Filter Filter	1	
	2" PVC Well W	1	
	Pump Start Relay Hunter PSR	1	
	Irrigation Lateral Line: PVC Class 200	1,757 lf	
	Irrigation Mainline: PVC Schedule 40	25 lf	
	Valve Number Valve Flow Valve Size		
*Quantities to be field verified by contractor *All items listed may be substituted with LA/Owner approved equal *See sheet IRR-02 for irrigation details & specifications			

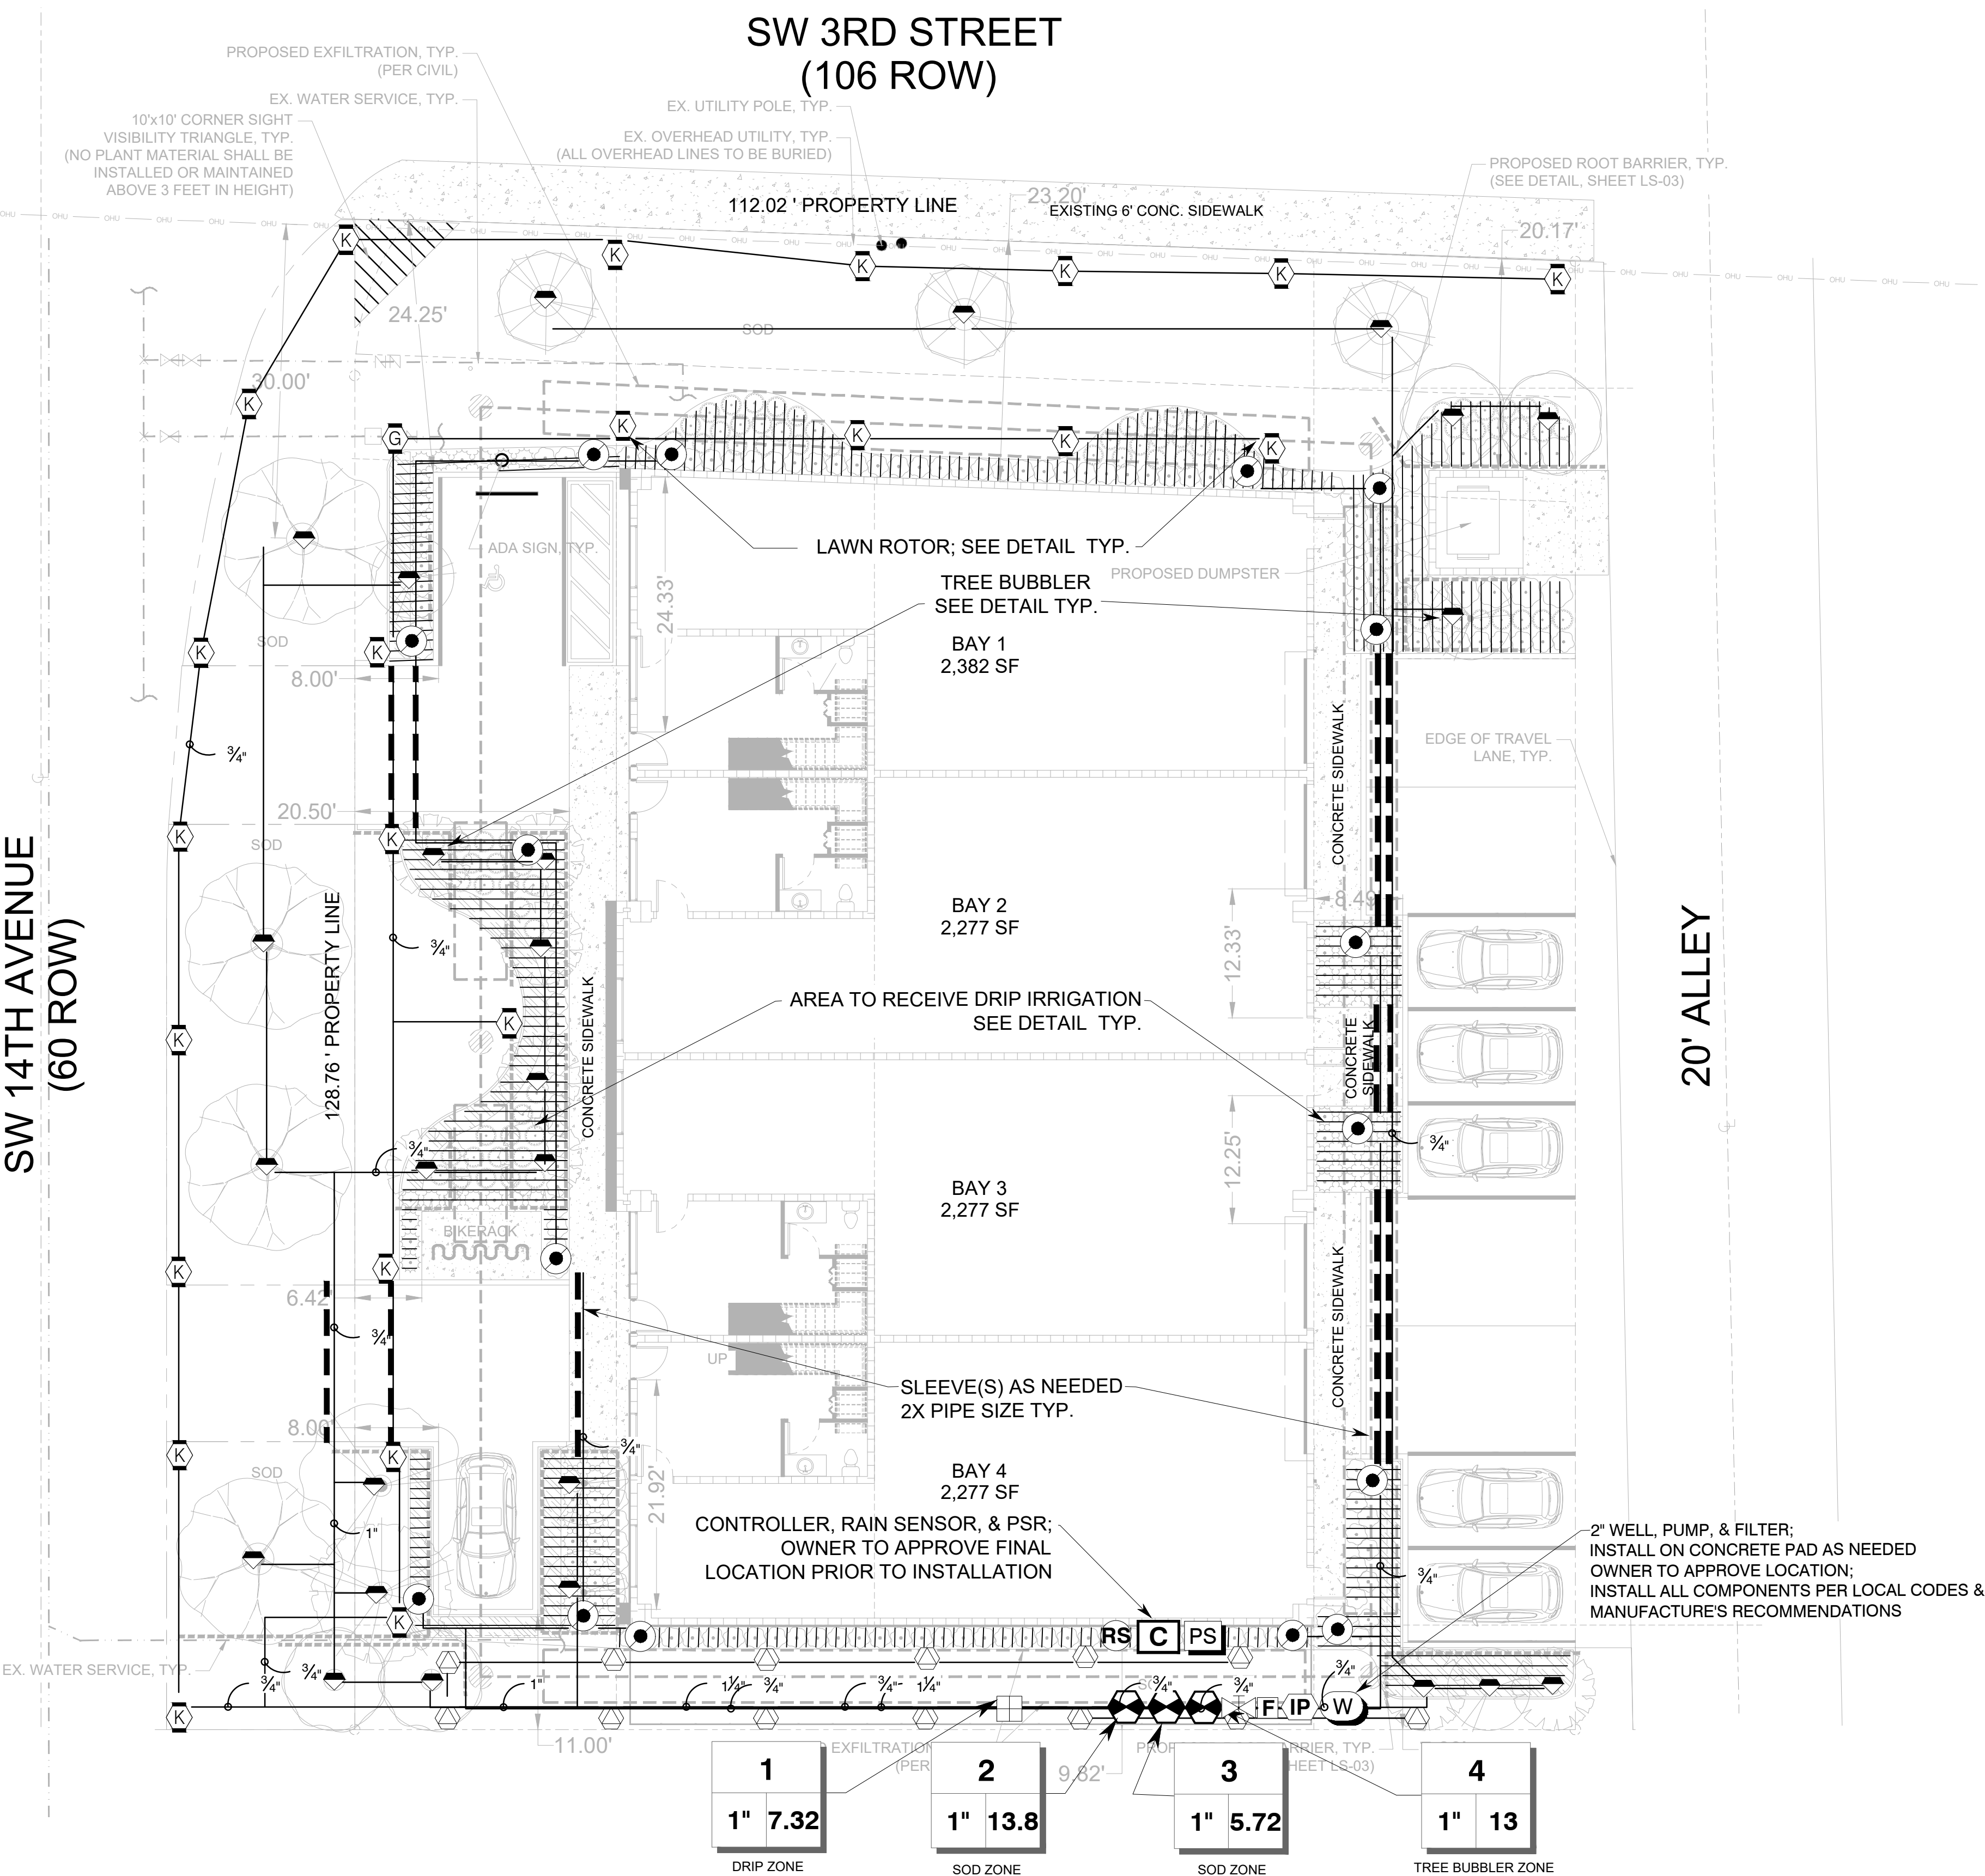

-The irrigation system shall be installed in accordance with requirements of the Building Code.
-The irrigation system rain-sensing cutoff device shall be located and installed so that building eaves, balconies, and similar overhangs do not interfere with effective operation of the device.
-The irrigation system shall be properly maintained in good working order and provide a minimum coverage of 100 percent with 50 percent overlap.
-Contractor to field locate mainline & laterals as needed to avoid conflicts with civil or landscape items.



Know what's below.
Call before you dig.


PZ23-12010055

10/22/2025

IRR-01

Project Team

Landscape Architect:



LANDSCAPE ARCHITECTURAL SERVICES, LLC

Brandon White | Owner
772-834-1357 | brandon@las-fl.com
Paul Goulas | Owner
772-631-8400 | paul@las-fl.com
1708 SE Joy Haven Street
Port St. Lucie, FL 34983

Architect / Applicant:

LLR Architects, Inc.
ARCHITECTURE & PLANNING
12980 S.W. 52 STREET
MIRAMAR, FLORIDA 33027


(OFF.) - 305-403-7926
(CELL) - 786-543-0851
E-MAIL: LLAR08@LLRARCHITECTS.COM

Proposed Warehouse

SW 3rd Street, Pompano Beach, FL 33069

Irrigation Plan

Revisions		
Date	Init.	Description
02.20.25	PG	Submittal




PAUL GOULAS, RLA
FLORIDA REG. # LA666807

Drawn By: DC

Checked By: PG

Municipal Project:

Scale:



NORTH

SCALE: 1" = 10'

0 5' 10' 20'