

I. GENERAL PROVISIONS:

1. THE CONTRACTOR SHALL OBTAIN FROM THE OWNER COPIES OF ALL AVAILABLE REGULATORY AGENCY PERMITS AND LOCAL AGENCY PERMITS.
2. ALL WORK AND MATERIALS SHALL CONFORM TO CURRENT POMPAÑO BEACH PUBLIC WORKS DEPARTMENT, MIAMI-DADE COUNTY PUBLIC WORKS DEPARTMENT (MDCPW), MIAMI-DADE COUNTY DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (DERE), MIAMI-DADE COUNTY WATER AND SEWER DEPARTMENT, MIAMI-DADE COUNTY WATER AND SEWER DEPARTMENT (MDWSD), FLORIDA DEPARTMENT OF TRANSPORTATION (FDOT) STANDARDS, FLORIDA DEPARTMENT OF HEALTH (FDH), AND SPECIFICATIONS AS WELL AS ALL LOCAL, STATE, AND NATIONAL CODES AND REGULATORY REQUIREMENTS, AS APPLICABLE.
3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING THAT ALL CONSTRUCTION SHALL BE DONE IN A SAFE MANNER AND IN STRICT COMPLIANCE WITH THE REQUIREMENTS OF FEDERAL OCCUPATIONAL SAFETY AND HEALTH ACT OF 1970, AND ALL STATE AND LOCAL HEALTH AND SAFETY REGULATIONS.
4. ALL CONSTRUCTION PROJECTS 1 OR MORE ACRES IN SIZE THAT DISCHARGE TO OFFSITE AREAS ARE REQUIRED TO COMPLY WITH THE REQUIREMENTS OF THE NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) GENERAL PERMIT FOR STORMWATER DISCHARGE FROM SMALL AND LARGE CONSTRUCTION ACTIVITIES. IN ORDER TO MEET NPDES REQUIREMENTS, THE CONTRACTOR IS RESPONSIBLE FOR PREPARING A STORMWATER POLLUTION PREVENTION PLAN (SWPPP), IMPLEMENTING, INSPECTING, MAINTAINING, AND REPORTING ON ALL ELEMENTS OF THE SWPPP, COMPLETING AND SUBMITTING THE REQUIRED NOTICE OF INTENT (NOI) AND NOTICE OF TERMINATION (NOT) FORMS AS THE OPERATOR, AND PAYING ALL ASSOCIATED FEES. FOR PROJECTS LESS THAN 1 ACRE IN SIZE THAT ARE NOT REQUIRED TO COMPLY WITH THE NPDES GENERAL PERMIT, THE CONTRACTOR IS STILL RESPONSIBLE FOR IMPLEMENTING AND MAINTAINING EROSION AND SEDIMENT CONTROL MEASURES PRIOR TO AND DURING CONSTRUCTION IN ACCORDANCE WITH THE DRAWINGS AND SPECIFICATIONS.
5. EXISTING UTILITIES SHOWN ARE LOCATED ACCORDING TO THE INFORMATION AVAILABLE TO THE ENGINEER AT THE TIME OF THE TOPOGRAPHIC SURVEY AND HAVE NOT BEEN INDEPENDENTLY VERIFIED BY THE OWNER OR THE ENGINEER. GUARANTEE IS NOT MADE THAT ALL EXISTING UNDERGROUND UTILITIES ARE SHOWN OR THAT THE LOCATION OF THOSE SHOWN ARE ENTIRELY ACCURATE. FINDING THE ACTUAL LOCATION OF ANY UNDERGROUND EXISTING UTILITIES IS THE CONTRACTOR'S RESPONSIBILITY AND SHALL BE DONE BEFORE COMMENCING ANY WORK IN THE VICINITY. FURTHERMORE, THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES DUE TO THE CONTRACTORS FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL UNDERGROUND UTILITIES. THE OWNER OR ENGINEER WILL ASSUME NO LIABILITY FOR ANY DAMAGES SUSTAINED OR COST INCURRED DUE TO THE OPERATIONS IN THE SAME. IT IS NECESSARY TO SHORE, BRACE, SWING, OR RELOCATE A UTILITY, THE UTILITY COMPANY OR DEPARTMENT AFFECTED SHALL BE CONTACTED AND THEIR PERMISSION OBTAINED REGARDING THE METHOD TO USE FOR SUCH WORK.
6. THE CONTRACTOR SHALL HAVE AVAILABLE AT THE JOB SITE AT ALL TIMES ONE COPY OF THE CONSTRUCTION DOCUMENTS INCLUDING THE PLANS, SPECIFICATIONS, GEOTECHNICAL REPORT AND SPECIAL CONDITIONS AND COPIES OF ANY REQUIRED CONSTRUCTION PERMITS.
7. UNLESS OTHERWISE NOTED ON THE PLANS, THE CONTRACTOR SHALL USE THE GEOMETRY PROVIDED ON THE CONSTRUCTION PLANS. BENCHMARK INFORMATION SHALL BE PROVIDED TO THE CONTRACTOR BY THE OWNER OR OWNERS SURVEYOR. ANY DISCREPANCIES BETWEEN FIELD MEASUREMENTS AND CONSTRUCTION PLAN INFORMATION SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER IMMEDIATELY.
8. BASE SURVEY INFORMATION INCLUDING BUT NOT LIMITED TO ELEVATIONS, EASEMENTS, RIGHTS OF WAY, AND OTHER TOPOGRAPHIC INFORMATION SHOWN ON THE DRAWINGS HAVE BEEN PREPARED BY MILLER LEGG. URBAN DESIGN ASSUMES NO RESPONSIBILITY FOR THE ACCURACY OF THIS INFORMATION.
9. THIS SET OF PLANS MAY CONTAIN DRAWINGS PREPARED BY OTHER PROFESSIONALS, WHICH CONTAIN THE NAME, ADDRESS, AND LOGO OF THE PROFESSIONAL. URBAN DESIGN IS NOT RESPONSIBLE FOR DRAWINGS PREPARED BY OTHER PROFESSIONALS.
10. THE CONTRACTOR SHALL SUBMIT COPIES OF SHOP DRAWINGS TO THE ENGINEER FOR APPROVAL PRIOR TO ORDERING THE MATERIALS REQUIRED FOR CONSTRUCTION. PRIOR TO SUBMISSION, THE CONTRACTOR SHALL THOROUGHLY CHECK SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES FOR COMPLETENESS AND FOR COMPLIANCE WITH THE CONSTRUCTION PLANS AND SHALL VERIFY ALL DIMENSIONS AND FIELD CONDITIONS AND SHALL COORDINATE THE SHOP DRAWINGS FOR THE REQUIREMENTS FOR OTHER RELATED WORK. THE CONTRACTOR'S RESPONSIBILITY FOR ERRORS AND OMISSIONS IN SUBMITTALS IS NOT RELIEVED BY THE ENGINEER'S REVIEW OF SUBMITTALS. THE CONTRACTOR SHALL NOTIFY THE ENGINEER, IN WRITING AT THE TIME OF SUBMISSION, OF DEVIATIONS IN SUBMITTALS FROM THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.
11. PROTECT BENCHMARKS, PROPERTY CORNERS, AND OTHER SURVEY MONUMENTS FROM DAMAGE OR DISPLACEMENT. IF MARKER NEEDS TO BE REMOVED IT SHALL BE REFERENCED BY LICENSED LAND SURVEYOR AND REPLACED, AS NECESSARY, BY SAME.
12. THE CONTRACTOR IS RESPONSIBLE FOR ALL QUALITY CONTROL TESTING. AS A MINIMUM, TESTING SHALL INCLUDE A) PIPING AND STRUCTURAL EXCAVATION, BEDDING AND BACKFILL MATERIALS AND DENSITY TESTS; B) DETERMINATION OF COMPACTIVE EFFORT NEEDED FOR COMPLIANCE WITH THE DENSITY REQUIREMENTS; C) PORTLAND CEMENT CONCRETE AND ASPHALT PAVING QUALITY CONTROL TESTING INCLUDING DESIGN MIX REVIEW, MATERIALS, FIELD SLUMP AND AIR CONTENT, AND FIELD AND LAB CURED STRENGTH SAMPLES AND TESTING.
13. IN ADDITION TO QUALITY CONTROL TESTING, THE CONTRACTOR SHALL BE RESPONSIBLE FOR REQUIRED TESTING OR APPROVALS FOR ANY WORK (OR ANY PART THEREOF) IF LAWS OR REGULATIONS OF ANY PUBLIC BODY HAVING JURISDICTION SPECIFICALLY REQUIRE TESTING, INSPECTIONS OR APPROVAL. THE CONTRACTOR SHALL PAY ALL COSTS IN CONNECTION THEREWITH AND SHALL FURNISH THE OWNER AND ENGINEER THE REQUIRED CERTIFICATES OF INSPECTION, TESTING OR APPROVAL.
14. ANY DESIGN OR TESTING LABORATORY UTILIZED BY THE CONTRACTOR SHALL BE AN INDEPENDENT LABORATORY ACCEPTABLE TO THE ENGINEER, APPROVED IN WRITINGS, AND COMPLYING WITH THE LATEST EDITION OF THE "RECOMMENDED REQUIREMENTS FOR INDEPENDENT LABORATORY QUALIFICATION", PUBLISHED BY THE AMERICAN COUNCIL OF INDEPENDENT LABORATORIES.
15. THE ENTIRE PROJECT SITE SHALL BE THOROUGHLY CLEANED AT THE COMPLETION OF THE WORK. CLEAN ALL INSTALLED PIPELINES, STRUCTURES, SIDEWALKS, PAVED AREAS, ACCUMULATED SILT IN PONDS, PLUS ALL ADJACENT AREAS AFFECTED BY CONSTRUCTION, AS DIRECTED BY THE OWNER OR JURISDICTIONAL AGENCY. EQUIPMENT TO CLEAN THESE SURFACES SHALL BE SUBJECT TO APPROVAL BY THE OWNER.

II. UTILITY PROVISIONS:

1. THE UTILITY DATA SHOWN ON THESE PLANS WAS LOCATED BY THE RESPECTIVE UTILITY, OR IS BASED ON UTILITY DRAWINGS, MAPS, OR FIELD RECONNAISSANCE.
6. IT IS THE CONTRACTORS RESPONSIBILITY TO CONTACT THE VARIOUS UTILITY COMPANIES WHICH MAY HAVE BURIED OR AERIAL UTILITIES WITHIN OR NEAR THE CONSTRUCTION AREA BEFORE COMMENCING WORK. THE CONTRACTOR SHALL PROVIDE 48 HOURS MINIMUM NOTICE TO ALL UTILITY COMPANIES PRIOR TO BEGINNING CONSTRUCTION. AN APPROPRIATE LIST OF THE UTILITY COMPANIES WHICH THE CONTRACTOR MUST CALL BEFORE COMMENCING WORK IS PROVIDED ON THE COVER SHEET OF THESE CONSTRUCTION PLANS. THIS LIST SERVES AS A GENERAL GUIDE ONLY AND IS NOT INTENDED TO LIMIT THE UTILITY COMPANIES WHICH THE CONTRACTOR WISHES TO NOTIFY.
7. A SINGLE POINT UTILITY IDENTIFICATION SERVICE HAS BEEN SET UP FOR EXISTING UTILITIES. THE CONTRACTOR IS TO CONTACT THE SUNSHINE STATE ONE CALL CENTER BY DIALING 811 AT LEAST TWO (2) AND NO MORE THAN FIVE (5) WORKING DAYS PRIOR TO THE SPECIFIC CONSTRUCTION ACTIVITY FOR FIELD LOCATION. NOTE THAT NOT ALL UTILITIES PARTICIPATE IN THIS PROGRAM. THE CONTRACTOR SHOULD CONTACT ALL NON-PARTICIPATING UTILITIES SEPARATELY FOR FIELD LOCATION OF THEIR FACILITIES AT LEAST TWO (2) WORKING DAYS PRIOR TO CONSTRUCTION. PER FLORIDA STATUTE §53.81, THE CONTRACTOR OR EXCAVATOR IS REQUIRED TO NOTIFY THE GAS COMPANY TWO (2) WORKING DAYS PRIOR TO STARTING EXCAVATION.
8. THE CONTRACTOR SHALL KEEP LOCATE TICKETS UP TO DATE AT ALL TIMES.
9. UPON THE RECEIPT OF THE "NOTICE TO PROCEED", THE CONTRACTOR SHALL CONTACT THE ENGINEER OF RECORD AND ARRANGE A PRE-CONSTRUCTION CONFERENCE TO INCLUDE ALL INVOLVED GOVERNMENTAL AGENCIES, UTILITY OWNERS, THE OWNER, AND THE ENGINEER OF RECORD.
10. THE CONTRACTOR IS RESPONSIBLE FOR ALL COORDINATION WITH EACH UTILITY AND ALL COSTS ASSOCIATED WITH THE PROTECTION OF EXISTING FACILITIES DURING CONSTRUCTION. THE CONTRACTOR SHALL COORDINATE WITH UTILITY COMPANIES TO ARRANGE FOR ANY REMOVAL, RELOCATION AND TEMPORARY SUPPORT OF UTILITY FEATURES, ETC. AS NECESSARY TO COMPLETE THE WORK, IF APPLICABLE.
11. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO MAINTAIN IN SERVICE ALL EXISTING PIPING ENCOUNTERED DURING CONSTRUCTION UNLESS OTHERWISE INDICATED IN THE DRAWINGS. ANY PIPING WHICH CAN BE REMOVED DURING CONSTRUCTION WITHOUT UNDUE INTERRUPTION OF SERVICE MAY BE REMOVED AND REPLACED BY THE CONTRACTOR WITH THE PERMISSION OF THE OWNER AND THE ENGINEER.
12. TYPICAL DETAILS AS SHOWN ARE TO ILLUSTRATE THE ENGINEER'S INTENT AND ARE NOT PRESENTED AS A SOLUTION TO ALL CONSTRUCTION PROBLEMS ENCOUNTERED IN THE FIELD. THE CONTRACTOR MAY ALTER THE METHOD OF CONSTRUCTION TO SUIT FIELD CONDITIONS, PROVIDED HE SUBMITS A PROPOSAL FOR AN ALTERNATE METHOD TO THE ENGINEER FOR APPROVAL AND USES MATERIALS AS DESIGNATED IN THE SPECIFICATIONS.
13. FOR EACH RESPECTIVE PIPELINE CONSTRUCTION REQUIRED, THE CONTRACTOR SHALL FIELD VERIFY THE LOCATION, DEPTH, AND ALIGNMENT OF ALL EXISTING PIPES, CABLES, ETC. TO BE CROSSED OR CONNECTED TO. IF THE CONTRACTOR DEEMS NECESSARY (A) A CHANGE IN ALIGNMENT OR DEPTH, OR THE NEED FOR ADDITIONAL FITTINGS, BENDS, OR COUPLINGS, WHICH REPRESENT A DEPARTURE FROM THE CONTRACT DRAWING, OR (B) A NEED FOR RELOCATION OF EXISTING UTILITIES, THEN DETAILS OF SUCH DEPARTURES, RELOCATIONS, OR ADDITIONAL FITTINGS, INCLUDING CHANGES IN RELATED PORTIONS OF THE PROJECT AND THE REASONS THEREFOR, SHALL BE SUBMITTED WITH SHOP DRAWINGS. APPROVED DEPARTURES FOR THE CONTRACTOR'S CONVENIENCE SHALL BE MADE AT NO ADDITIONAL COST TO THE OWNER.

III. SITE PREPARATION:

1. UNLESS OTHERWISE DIRECTED BY THE OWNER OR ENGINEER, THE CONTRACTOR IS EXPECTED TO CONTAIN ALL CONSTRUCTION ACTIVITIES WITHIN THE PROPERTY, RIGHT-OF-WAY, AND EASEMENTS AS INDICATED ON THE DRAWINGS. AT NO TIME SHALL THE CONTRACTOR DISTURB SURROUNDING PROPERTIES OR TRAVEL ON SURROUNDING PROPERTIES WITHOUT WRITTEN CONSENT FROM THE PROPERTY OWNER. ANY REPAIR OR RECONSTRUCTION OF DAMAGED AREAS IN SURROUNDING PROPERTIES SHALL BE REPAIRED BY THE CONTRACTOR ON AN IMMEDIATE BASIS. ALL COSTS FOR REPAIRS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AND NO EXTRA COMPENSATION SHALL BE PROVIDED.
2. STAKE OUT THE CONSTRUCTION, ESTABLISH LINES AND LEVELS, TEMPORARY BENCH MARKS, BATTER BOARDS, CENTERLINES, BASELINES, AND REFERENCE POINTS FOR THE WORK, AND VERIFY ALL DIMENSIONS RELATING TO INTERCONNECTION WITH EXISTING FEATURES. REPORT ANY INCONSISTENCIES IN THE PROPOSED GRADES, LINES AND LEVELS, DIMENSIONS AND LOCATIONS TO THE ENGINEER BEFORE COMMENCING WORK.
3. PROTECT ALL TREES AND SHRUBS LOCATED OUTSIDE THE RIGHT-OF-WAY, EASEMENTS, AND OWNER SECURED PROPERTY, PARTICULARLY THOSE TREES AND SHRUBS LOCATED ADJACENT TO WORK AREAS.
4. WITHIN THE RIGHT-OF-WAY, EASEMENTS, AND OWNER SECURED PROPERTY, THE INTENT IS TO ALLOW TREES AND SHRUBS TO REMAIN IN ACCORDANCE WITH THE FOLLOWING SCHEDULE: NEW ROADWAY CONSTRUCTION - TREES AND SHRUBS TO REMAIN WHERE LOCATED MORE THAN 15 FEET FROM THE BACK OF CURB, OR OUTSIDE THE LIMITS OF EXCAVATION OR FILL AREAS, WHICHEVER IS FURTHER. UTILITY PIPELINE CONSTRUCTION - TREES AND SHRUBS TO REMAIN OUTSIDE A 15 FOOT WIDE PATH, CENTERED ON THE PIPELINE.
5. TREES TO REMAIN IN THE CONSTRUCTION AREA SHALL BE BOXED, FENCED OR OTHERWISE PROTECTED IN ACCORDANCE WITH DETAILS ON THE DRAWINGS. DO NOT PERMIT HEAVY EQUIPMENT OR STOCKPILES WITHIN BRANCH SPREAD.
6. AREAS TO RECEIVE CLEARING AND GRUBBING SHALL INCLUDE ALL AREAS TO BE OCCUPIED BY THE PROPOSED IMPROVEMENTS, AREAS FOR FILL AND SITE GRADING, AND BORROW SITES. REMOVE TREES OUTSIDE OF THESE AREAS ONLY AS INDICATED ON THE DRAWINGS OR AS APPROVED IN WRITING BY THE ENGINEER.
7. CLEARING SHALL CONSIST OF REMOVING TREES AND BRUSH AND DISPOSAL OF OTHER MATERIALS THAT ENCROACH UPON OR OTHERWISE OBSTRUCT THE WORK.
8. EXERCISE EXTREME CARE DURING THE CLEARING AND GRUBBING OPERATIONS. DO NOT DAMAGE EXISTING STRUCTURES, PIPES OR UTILITIES.
9. GRUBBING SHALL CONSIST OF REMOVING AND DISPOSING OF STUMPS, ROOTS LARGER THAN 2" IN DIAMETER, AND MATTED ROOTS. REMOVE TO A DEPTH OF NOT LESS THAN 18" BELOW THE ORIGINAL SURFACE LEVEL OF THE GROUND.
10. ALL COMBUSTIBLE DEBRIS AND REFUSE FROM SITE PREPARATION OPERATIONS SHALL BE REMOVED TO LEGAL OFFSITE DISPOSAL AREAS.

IV. DEWATERING:

1. DESIGN AND PROVIDE DEWATERING SYSTEM USING ACCEPTED AND PROFESSIONAL METHODS CONSISTENT WITH THE TOPOGRAPHIC INFORMATION SHOWN ON THE DRAWINGS AND THE REQUIREMENTS OF THE PROJECT. THE GROUNDWATER IN A MANNER THAT PRESERVES STRENGTH OF FOUNDATION SOILS, DOES NOT CAUSE INSTABILITY OR RAVELING OF EXCAVATION SLOPES, AND DOES NOT RESULT IN DAMAGE TO EXISTING STRUCTURES. WHERE NECESSARY TO THESE PURPOSES, LOWER WATER LEVEL IN ADVANCE OF EXCAVATION, UTILIZING WELLS, WELLPOINTS, OR SIMILAR POSITIVE METHODS, MAINTAIN THE GROUNDWATER LEVEL TO A MINIMUM OF 2 FEET BELOW EXCAVATIONS. PROVIDE PIEZOMETERS IF DIRECTED BY THE ENGINEER TO DOCUMENT THE GROUNDWATER LEVEL. IS BEING MAINTAINED.
2. CONTROL BY ACCEPTABLE MEANS, ALL WATER REGARDLESS OF SOURCE AND BE FULLY RESPONSIBLE FOR DISPOSAL OF THE WATER. NO ADDITIONAL PAYMENT WILL BE MADE FOR ANY SUPPLEMENTAL MEASURES TO CONTROL SEEPAGE, GROUNDWATER, OR ARTESIAN HEAD.
3. OPEN PUMPING WITH SUMPS AND DITCHES SHALL BE ALLOWED, PROVIDED IT DOES NOT RESULT IN BOILS, LOSS OF FINES, SOFTENING OF THE GROUND, OR INSTABILITY OF SLOPES. SUMPS SHALL BE LOCATED OUTSIDE OF LOAD BEARING AREAS SO THE BEARING SURFACES WILL NOT BE DISTURBED. WATER CONTAINING SILT IN SUSPENSION SHALL NOT BE PUMPED INTO SEWER LINES OR ADJACENT STREAMS. DURING NORMAL PUMPING, AND UPON DEVELOPMENT OF WELL(S), LEVELS OF FINE SAND OR SILT IN THE DISCHARGE WATER SHALL NOT EXCEED 5 PPM.
4. IF DEWATERING EQUIPMENT NEEDED EXCEEDS ANY OF THE FOLLOWING: 1) 6" PUMP VOLUME; 2) 100,000 GPD TOTAL 24 HOUR (1 DAY) DEWATERING; AND, 3) 1,000,000 GPD PUMP CAPACITY, THE CONTRACTOR SHALL BE REQUIRED TO PERMIT THE DEWATERING SYSTEM WITH THE WATER MANAGEMENT DISTRICT.
5. CONTINUOUSLY MAINTAIN EXCAVATIONS IN A DRY CONDITION WITH POSITIVE DEWATERING METHODS DURING PREPARATION OF SUBGRADE, INSTALLATION OF PIPE, AND CONSTRUCTION OF STRUCTURES UNTIL THE CRITICAL PERIOD OF CONSTRUCTION AND/OR BACKFILL IS COMPLETED TO PREVENT DAMAGE OF SUBGRADE SUPPORT, PIPING, STRUCTURE, SIDE SLOPES, OR ADJACENT FACILITIES FROM FLOTATION OR OTHER HYDROSTATIC PRESSURE IMBALANCE.
6. WHEN CONSTRUCTION IS COMPLETE, REMOVE ALL DEWATERING EQUIPMENT FROM THE SITE, INCLUDING WELLS AND RELATED TEMPORARY ELECTRICAL SERVICE.

V. EROSION AND SEDIMENT CONTROL:

1. EROSION AND SEDIMENT CONTROL MEASURES ARE TO BE PROVIDED AND INSTALLED PRIOR TO COMMENCEMENT OF CONSTRUCTION. SEDIMENT CONTROL CONSISTS OF SILT FENCING AND FLOATING TURBIDITY BARRIERS PER FDOT INDEX NO. 102 AND 103. EROSION CONTROL CONSISTS OF SEEDING AND MULCHING, SODDING, WETTING SURFACES, PLACEMENT OF COARSE AGGREGATE, TEMPORARY PAVING.
2. MAINTAIN TEMPORARY EROSION CONTROL SYSTEMS AS DIRECTED BY OWNER OR GOVERNING AUTHORITIES TO CONTROL EROSION DURING LIFE OF CONTRACT. OWNER HAS AUTHORITY TO LIMIT SURFACE AREA OF ERODIBLE EARTH MATERIAL EXPOSED BY CLEARING AND GRUBBING, EXCAVATION, TRENCHING, BORROW AND EMBANKMENT OPERATIONS. OWNER ALSO HAS AUTHORITY TO DIRECT CONTRACTOR TO PROVIDE IMMEDIATE PERMANENT OR TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES.
3. CONTRACTOR SHALL RESPOND TO EROSION AND SEDIMENT CONTROL MAINTENANCE REQUIREMENTS OR IMPLEMENT ADDITIONAL MEASURES TO CONTROL EROSION ORDERED BY OWNER OR GOVERNING AUTHORITIES WITHIN 48 HOURS OR SOONER IF REQUIRED AT NO ADDITIONAL COST TO THE OWNER.
4. CONTRACTOR WILL BE REQUIRED TO INCORPORATE PERMANENT EROSION CONTROL FEATURES INTO PROJECT AT EARLIEST PRACTICAL TIME TO MINIMIZE NEED FOR TEMPORARY CONTROLS.
5. THE EROSION AND SEDIMENT CONTROL MEASURES SHOWN ON THE PLANS REPRESENT A MINIMUM REQUIREMENT. THE CONTRACTOR IS RESPONSIBLE FOR DETERMINING ADDITIONAL EROSION AND SEDIMENT CONTROL MEASURES NEEDED IN ORDER TO PREVENT THE TRANSFER OF SEDIMENT FROM THE PROJECT AREA AND PREVENT THE EROSION OF SURFACES DURING CONSTRUCTION, AS NEEDED TO PROTECT ADJACENT PROPERTIES AND WATER BODIES.
6. GRASS ALL DISTURBED AREAS WITHIN 7 DAYS OF INITIAL DISTURBANCE. TYPE OF GRASSING SHALL BE AS FOLLOWS: TEMPORARY GRASSING TO BE SODDING AT ALL DRAINAGE STRUCTURES, RETENTION AREAS, SWALES AND DITCHES, AND WHERE SLOPES ARE STEEPER THAN 5:1. TEMPORARY GRASSING CAN BE SEED AND MULCH AT ALL OTHER LOCATIONS UNLESS OTHERWISE INDICATED IN THE DRAWINGS OR SPECIFICATIONS.
7. INSPECT EVERY TWO WEEKS DURING CONSTRUCTION. REMOVE ANY SEDIMENT BUILD-UP. REPAIR AND REINSTALL ANY DAMAGED OR MISSING SEDIMENT CONTROL MEASURES. INSTALL ADDITIONAL MEASURES IF INSPECTION REVEALS ADDITIONAL SEDIMENTATION CONTROL IS NECESSARY.
8. AREAS TO BE PAVED SHALL BE TREATED WITH A BITUMINOUS PRIME COAT AND SANDED TO MINIMIZE EROSION, WHERE PAVING IS SCHEDULED TO OCCUR MORE THAN 48 HOURS AFTER INSTALLATION OF BASE COURSE. AREAS TO RECEIVE CONCRETE PAVING SHALL BE EITHER PROTECTED WITH A LAYER OF FOOT COARSE AGGREGATE MATERIAL OR SHALL BE PAVED WITHIN 48 HOURS OF INSTALLATION OF THE SUBGRADE. INSTALL FINAL SURFACE COURSES WITHIN 14 DAYS AFTER REMOVAL OF EXISTING PAVEMENT.

VI. TRAFFIC CONTROL:

1. THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING A MAINTENANCE OF TRAFFIC (M.O.T.) PLAN PRIOR TO CONSTRUCTION. THE M.O.T. PLAN SHALL SHOW ALL PROPOSED TRAFFIC CONTROL SIGNS, PAVEMENT MARKINGS, AND BARRICADES, AND SHALL DETAIL ALL PROPOSED CONSTRUCTION SEQUENCING. THE M.O.T. PLAN SHALL BE APPROVED BY THE ENGINEER, OWNER, AND ROADWAY JURISDICTIONAL AGENCY PRIOR TO CONSTRUCTION. ALL PROPOSED ROADWAY AND DRIVEWAY LANE CLOSURES SHALL BE RESTRICTED TO THE HOURS BETWEEN 9:00 A.M. AND 4:00 P.M. UNLESS OTHERWISE AUTHORIZED IN THE APPROVED M.O.T.
2. ALL CONSTRUCTION SIGNING AND MARKINGS SHALL BE INSTALLED PRIOR TO CONSTRUCTION AND MAINTAINED DURING CONSTRUCTION IN ACCORDANCE WITH FDOT INDEX NO. 600 AND THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD). THE PLACEMENT OF THE SIGNING AND MARKINGS SHALL BE APPROVED IN THE FIELD BY THE ENGINEER PRIOR TO CONSTRUCTION.
3. INSPECT TRAFFIC CONTROL DEVICES ON A DAILY BASIS TO ENSURE PLACEMENT OF BARRICADES AND FUNCTION OF LIGHTS IS MAINTAINED THROUGHOUT CONSTRUCTION.
4. CONTACT PROPERTY OWNERS AFFECTED BY CONSTRUCTION. COORDINATE TEMPORARY DRIVEWAY CLOSURES AND SEQUENCING. MAINTAIN ACCESS FOR ALL PROPERTY OWNERS DURING CONSTRUCTION.
5. WET UNSTABILIZED AREAS AS NECESSARY TO CONTROL DUST.
6. ADJUST TRAFFIC CONTROL DEVICES AS REQUIRED UNDER EMERGENCY CONDITIONS.
7. THE CONTRACTOR IS EXPECTED TO COORDINATE ITS ACTIVITIES WITH OTHER CONTRACTORS WHO MAY BE WORKING IN THE IMMEDIATE VICINITY.
8. WHEN WORK OCCURS WITHIN 15-FT OF ACTIVE ROAD TRAVEL LANES BUT NO CLOSER THAN 2-FT FROM THE EDGE OF PAVEMENT, SIGNAGE AND WARNING DEVICES ARE TO BE INSTALLED IN ACCORDANCE WITH FDOT INDEX NO. 600 AND 602, FOR A 2-LANE ROADWAY AND PER INDEX # 612 FOR A 4 LANE HIGHWAY.
9. TYPE I OR TYPE II BARRICADES AT 20-FT CENTERS SHALL BE PLACED AND MAINTAINED ALONG THE EDGE OF THE ROAD WHEREVER DROP-OFFS OR OTHER POTENTIAL HAZARDS EXIST AND TO BLOCK DRIVELANE INTO COMPLETED OR PARTIALLY COMPLETED PAVEMENTS UNTIL SUCH PAVEMENTS ARE OPEN TO PUBLIC USE.

VII. STORM DRAINAGE:

A. EXCAVATION, TRENCHING, AND FILL

1. THE CONTRACTOR SHALL RECOGNIZE AND ABIDE BY ALL OSHA EXCAVATION SAFETY STANDARDS, INCLUDING THE FLORIDA TRENCH SAFETY ACT (FS 553.60-553.64). ANY MATERIAL, CONSTRUCTION METHODS, OR MATERIAL COST TO COMPLY WITH THESE LAWS SHALL BE INCIDENTAL TO THE CONTRACT.
2. ROUGH EXCAVATE AND GRADE ANY PROPOSED STORMWATER PONDS AT THE START OF SITE GRADING ACTIVITIES. DIRECT SITE RUNOFF TO THE PONDS TO MINIMIZE RUNOFF TO OFFSITE AREAS.
3. POND CONSTRUCTION SHALL RESULT IN THE FINISHED POND HAVING SIDE SLOPES AND DIMENSIONS THAT ARE IN ACCORDANCE WITH THE CONSTRUCTION DRAWINGS. IT IS THE CONTRACTORS SOLE RESPONSIBILITY TO ENSURE THAT THESE REQUIREMENTS HAVE BEEN MET. IF THE CONSTRUCTED SIDE SLOPES ARE STEEPER THAN THE REQUIRED SIDE SLOPES, OR THE POND VOLUME IS NOT WITHIN THREE (3) PERCENT OF THE DESIGN VOLUME, THE CONTRACTOR MAY BE REQUIRED TO MAKE CORRECTIONS TO THE POND AT NO ADDITIONAL COST TO THE OWNER.
4. FIELD DENSITY TESTING FREQUENCIES: A) ONE TEST FOR EACH 10,000 SQUARE FEET OR FRACTION THEREOF PER LIFT OF GENERAL BACKFILL, MINIMUM 2 TESTS EACH LAYER; B) ONE TEST FOR EACH 100 SQUARE FEET OR FRACTION THEREOF OF BACKFILL AROUND AND UNDER STRUCTURES; C) ONE TEST FOR EACH 300 LINEAL FEET OR FRACTION THEREOF PER LIFT OF GENERAL BACKFILLING IN THE PIPELINE TRENCH; D) ONE TEST PER LIFT PER EACH CHANGE IN TYPE OF FILL; E) ONE TEST PER 1000 SQUARE FEET OF PAVEMENT SUBGRADE, MINIMUM OF 2 TESTS.
5. IT IS INTENDED THAT PREVIOUSLY EXCAVATED MATERIALS CONFORMING TO THE FOLLOWING REQUIREMENTS BE UTILIZED WHEREVER POSSIBLE.
 - VI. ACCEPTABLE MATERIALS: AASHTO M145 CLASSIFICATION A-1, A-3, A-2.4, A-2.6; ASTM D2487 CLASSIFICATION GC, GP, GM, SM, SW, SP, UNLESS OTHERWISE DISAPPROVED WITHIN THE SOIL AND SUBSURFACE INVESTIGATION REPORTS. NO MORE THAN 12% OF ACCEPTABLE MATERIALS SHALL PASS THE NUMBER 200 SIEVE.
 - VJ. UNACCEPTABLE MATERIALS: AASHTO M145 CLASSIFICATION A-2.5, A-2.7, A-4, A-5, A-6, A-7, A-8; ASTM D2487 CLASSIFICATION GC, SC, ML, MH, CL, CH, OL, OH, PT; UNLESS OTHERWISE APPROVED WITHIN THE SOIL AND SUBSURFACE INVESTIGATION REPORTS.
6. PROVIDE BARRIERS, WARNING LIGHTS AND OTHER PROTECTIVE DEVICES AT ALL EXCAVATIONS.
7. SIDEWALKS, ROADS, STREETS, AND PAVEMENTS SHALL NOT BE BLOCKED OR OBSTRUCTED BY EXCAVATED MATERIALS, EXCEPT AS AUTHORIZED BY THE ENGINEER, IN WHICH CASE ADEQUATE TEMPORARY PROVISIONS MUST BE MADE FOR SATISFACTORY TEMPORARY PASSAGE OF PEDESTRIANS, AND VEHICLES. MINIMIZE INCONVENIENCE TO PUBLIC TRAVEL OR TO TENANTS OCCUPYING ADJOINING PROPERTY.
8. FURNISH, INSTALL, AND MAINTAIN, WITHOUT ADDITIONAL COMPENSATION, SHEETING, BRACING, AND SHORING SUPPORT REQUIRED TO KEEP EXCAVATIONS WITHIN THE PROPERTY OR EASEMENTS PROVIDED, TO SUPPORT THE SIDES OF THE EXCAVATION, AND TO PREVENT ANY MOVEMENT WHICH MAY DAMAGE ADJACENT PAVEMENTS OR STRUCTURES, DAMAGE OR DELAY THE WORK, OR ENDANGER LIFE AND HEALTH. VOIDS OUTSIDE THE SUPPORTS SHALL BE IMMEDIATELY FILLED AND COMPACTED.
9. ALL EXCAVATIONS SHALL BE MADE BY OPEN CUT UNLESS OTHERWISE INDICATED. SLOPE SIDES OF TRENCHES IN ACCORDANCE WITH OSHA REQUIREMENTS AND THE RECOMMENDATIONS CONTAINED WITHIN THE PROJECT GEOTECHNICAL REPORT.
10. EXCAVATE TRENCHES TO DEPTH INDICATED OR REQUIRED FOR INDICATED FLOW LINES AND INVERT ELEVATIONS. OVER EXCAVATION OF TRENCHES A MINIMUM OF 2 FEET WHERE EXCAVATIONS OCCUR WITHIN UNSUITABLE SOILS, AND REPLACE OVER EXCAVATED MATERIAL WITH SUITABLE SOILS.
11. EXCEPT AS OTHERWISE INDICATED, EXCAVATE FOR PRESSURE PIPING SO TOP OF PIPING IS MINIMUM 3 FEET BELOW FINISHED GRADE.
12. TRENCH BOTTOMS AND THE BOTTOMS OF ALL STRUCTURES SHALL BE KEPT DRY, COMPACTED, AND STABLE TO A DEPTH TWO FEET BELOW THE BOTTOM OF THE TRENCH OR STRUCTURE.
13. ALL BEDDING, FILL, AND BACKFILL MATERIAL SHALL BE SUITABLE SOILS OR FLOWABLE FILL, WHERE TRENCH OR EXCAVATION IS WITHIN THE INFLUENCE AREA OF ROADWAYS, STRUCTURES, FOUNDATIONS, SLABS, PLACE BACKFILL IN LAYERS OF 8 INCH LOOSE DEPTH. IN ALL OTHER AREAS, PLACE FILL AND BACKFILL IN LAYERS OF 12 INCH LOOSE DEPTH.
14. MINIMUM DENSITY REQUIREMENT (ASTM D1557 OR AASHTO T180): BACKFILL AND FILL UNDER AND WITHIN THE INFLUENCE AREA OF ROADWAYS, STRUCTURES, SLABS, FOUNDATIONS = 98 PERCENT; BACKFILL AND FILL PLACED WITHIN PUBLIC ROAD RIGHT-OF-WAY AND UTILITY EASEMENTS = 95 PERCENT; BACKFILL AND FILL PLACED WITHIN POND AND ROAD EMBANKMENT = 95 PERCENT; BACKFILL AND FILL PLACED IN ALL OTHER AREAS = 90 PERCENT.

B. STORM SEWER SYSTEMS

1. ALL STORM SEWER PIPE SHALL BE REINFORCED CONCRETE PIPE (RCP) UNLESS OTHERWISE INDICATED ON THE DRAWINGS. ROUND CONCRETE PIPE SHALL COMPLY WITH ASTM C76. ELLIPTICAL CONCRETE PIPE SHALL COMPLY WITH ASTM C507. PIPE JOINTS AND O-RING GASKETS SHALL COMPLY ASTM C443. MINIMUM COVER OVER THE PIPE, INCLUDING COVER OVER THE BELL OF THE PIPE WHERE APPLICABLE, SHALL BE 30 INCHES.
2. RCP PIPE SHALL NOT BE SHIPPED FROM MANUFACTURER UNTIL THE COMPRESSIVE STRENGTH OF THE PIPE HAS REACHED 4000 PSI AND A MINIMUM OF 5 DAYS HAVE PASSED SINCE THE MANUFACTURING OR REPAIR OF THE PIPE HAS BEEN COMPLETED.
3. CORRUGATED POLYETHYLENE (PE) PIPE AND FITTINGS SHALL BE HIGH DENSITY, IN ACCORDANCE WITH ASTM D3339, CELL CLASSIFICATION 3344000 (4'-10") OR CELL CLASSIFICATION 3354000 (12'-36"). PIPE 4'-10" SHALL COMPLY WITH AASHTO M252, TYPE S. PIPE 12'-36" SHALL COMPLY WITH AASHTO M294, TYPE S. BELL JOINTS FOR 4'-10" PIPE SHALL BE PUSH-ON SLEEVE. BELL JOINTS FOR 12'-36" PIPE SHALL BE INTEGRALLY FORMED ON PIPE. GASKETS SHALL BE INSTALLED BY PIPE MANUFACTURER AND SHALL COMPLY WITH ASTM D1058, GRADE 2A2. FITTINGS SHALL COMPLY WITH AASHTO M234.
4. UNDERDRAIN PIPE SHALL BE PERFORMED POLYVINYL CHLORIDE PIPE IN ACCORDANCE WITH ASTM F758. FILTER FABRIC UNDERDRAIN SOCK SHALL BE TYPE D-3 IN ACCORDANCE WITH FDOT INDEX NO. 199.
5. ALL PIPE JOINTS SHALL BE WRAPPED WITH FILTER FABRIC. FILTER FABRIC SHALL BE IN ACCORDANCE WITH FDOT INDEX NO. 199, TYPE D-3, A.O.S. 70-100. INSTALL IN ACCORDANCE WITH FDOT INDEX NO. 280. PROVIDE MINIMUM 12" OVERLAP.
6. INSTALL POLYETHYLENE PIPE IN ACCORDANCE WITH ASTM D2321. BACKFILL AND COMPACT EVENLY ON EACH SIDE TO PREVENT DISPLACEMENT. MINIMUM COVER OVER POLYETHYLENE PIPE SHALL BE AS FOLLOWS: A) PIPE UNDER FLEXIBLE PAVEMENT, RIGID PAVEMENT, OR UNPAVED AREAS WHERE BEDDING IS SUITABLE SOILS AS DEFINED IN THE GENERAL NOTES; MINIMUM COVER SHALL BE 36 INCHES OR ONE PIPE DIAMETER, WHICHEVER IS GREATER; B) PIPE UNDER FLEXIBLE PAVEMENT, RIGID PAVEMENT, OR UNPAVED AREAS WHERE BEDDING IS MANUFACTURED AGGREGATES CLASS 1A OR 1B AS DEFINED IN ASTM D2321; MINIMUM COVER SHALL BE 30 INCHES OR ONE PIPE DIAMETER, WHICHEVER IS GREATER.
7. INSTALL UNDERDRAINS IN ACCORDANCE WITH FDOT SPECIFICATION SECTION 440. INSTALL CLEANOUTS AS SHOWN ON THE DRAWINGS.
8. PRIOR TO INSPECTIONS AND TESTING, CLEAN ALL INSTALLED LINES AND STRUCTURES.
9. ALL STORM PIPE SHALL BE SUBJECTED TO LEAKAGE TESTING. WHEN THE GROUND WATER LEVEL IS ABOVE THE TOP OF THE PIPE, AN INFILTRATION TEST SHALL BE PERFORMED BY SEALING OFF A LENGTH OF PIPE AND MEASURING THE DEPTH OF FLOW OVER A MEASURING WEIR, OR BY PUMPING THE INFILTRATED WATER INTO CONTAINERS FOR MEASUREMENT. TESTS SHALL BE CONDUCTED FOR A MINIMUM OF FOUR HOURS. INFILTRATION LEAKAGE SHALL NOT EXCEED 150 GALLONS PER 24 HOURS, PER INCH DIAMETER, PER MILE OF PIPE, WHEN THE GROUND WATER LEVEL IS BELOW THE TOP OF THE PIPE, THE PIPE SHALL BE TESTED FOR LEAKAGE BY INFILTRATION. INFILTRATION LEAKAGE TEST SHALL CONSIST OF ISOLATING THE PARTICULAR SECTION, FILLING WITH WATER TO A POINT 4 FEET ABOVE THE TOP OF THE PIPE AT THE UPPER MANHOLE OR INLET, AND ALLOWING IT TO STAND NOT LESS THAN FOUR HOURS. THE SECTION SHALL THEN BE REFILLED WITH WATER TO THE ORIGINAL LEVEL AND AFTER TWO HOURS THE DROP IN WATER SURFACE SHALL BE MEASURED. THE COMPUTED LEAKAGE SHALL NOT EXCEED 150 GALLONS PER INCH DIAMETER, PER 24 HOURS, PER MILE OF PIPE.


VIII. PAVING AND GRADING:

A. PAVING, SIDEWALKS, AND CURBING

1. MATERIALS AND CONSTRUCTION METHODS FOR THE ROADWAY AND PAVING CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE FLORIDA DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION, 2014 EDITION.
 2. ROADWAY PAVING, BASE, AND SUBGRADE THICKNESSES SHALL BE IN ACCORDANCE WITH DETAILS ON THESE DRAWINGS. MATERIAL STABILITY AND DENSITY REQUIREMENTS ARE AS FOLLOWS.
 - VII. TYPE S ASPHALTIC CONCRETE: MINIMUM STABILITY 1500 LBS, COMPACTED TO A MINIMUM OF 95% OF THE MARSHALL DESIGN DENSITY, FOR OFFSITE PAVEMENT USE TYPE SP PAVEMENT PER THE FDOT STABILITY AND SPECIFICATIONS.
 - VII. LIMEROCK BASE: MINIMUM LBR OF 100, PLACED IN 6" MAXIMUM LIFTS, COMPACTED TO A MINIMUM DENSITY OF 98% OF THE MODIFIED PROCTOR DRY DENSITY (AASHTO T-99). CONTRACTOR MAY SUBSTITUTE ASPHALT BASE COURSE TYPE 3 (MIN. STABILITY OF 1000 LBS) AT NO ADDITIONAL COST, PROVIDED STRUCTURAL NUMBER EQUALS OR EXCEEDS THAT OF THE SPECIFIED LIMEROCK BASE.
 - VIII. SUBGRADE: STABILIZE TO A MIN. LBR OF 40, COMPACT TO A MINIMUM DENSITY OF 98% OF THE MODIFIED PROCTOR DRY DENSITY (AASHTO T-99). CONTRACTOR MAY SUBSTITUTE LIMEROCK SUBGRADE (MIN. LBR OF 100) OR CONTROLLED LOW STRENGTH MATERIAL ("FLOWABLE FILL"), F_c (28 DAY) = 100-125 PSI AT NO ADDITIONAL COST, PROVIDED STRUCTURAL NUMBER EQUALS OR EXCEEDS THAT OF THE SPECIFIED SUBGRADE.
 3. SIDEWALKS ARE TO BE CONSTRUCTED IN THE AREAS AS SHOWN ON THE CONSTRUCTION PLANS. THE SIDEWALK SHALL BE CONSTRUCTED OF 6" THICK CONCRETE WITH A 28-DAY COMPRESSIVE STRENGTH OF 3000 PSI. JOINTS SHALL BE EITHER TOoled OR SAW CUT AT A DISTANCE OF 10'. HANDICAPPED RAMPS SHALL BE PROVIDED AT ALL INTERSECTIONS AND SHALL BE IN ACCORDANCE WITH THE FLORIDA ACCESSIBILITY CODE FOR BUILDING CONSTRUCTION, LATEST EDITION.
 4. CURBING SHALL BE CONSTRUCTED WHERE NOTED ON THE CONSTRUCTION PLANS. CONCRETE FOR CURBS SHALL BE FDOT CLASS "1" CONCRETE WITH A 28-DAY COMPRESSION STRENGTH OF 2500 PSI. ALL CURBS SHALL HAVE SAW CUT JOINTS AND SHALL BE CONSTRUCTED AT INTERVALS NOT TO EXCEED 10'-0" ON CENTER. CONSTRUCTION OF CURBS SHALL BE IN CONFORMANCE WITH FDOT STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION (LATEST EDITION) SECTION 520 AND DETAILS PROVIDED ON THE CONSTRUCTION PLANS.
 5. FIELD COMPACTION DENSITY, STABILITY, AND THICKNESS TESTING FREQUENCIES OF SUB-BASE, BASE, AND ASPHALT SHALL BE TESTED ONCE EVERY 300 LINEAR FEET OF PAVING PER 24" WIDE STRIP, STAGGERED LEFT, CENTER AND RIGHT OF CENTERLINE, WHERE LESS THAN 300 LINEAR FEET OF SUB-BASE, BASE, AND ASPHALT IS PLACED IN ONE DAY, PROVIDE MIN. OF ONE TEST FOR EACH PER DAY'S CONSTRUCTION AT A LOCATION DESIGNATED BY THE ENGINEER. ASPHALT EXTRACTION GRADATION SHALL BE TESTED FROM CRAB SAMPLES COLLECTED ONCE EVERY 1600 SQUARE YARDS OF ASPHALT DELIVERED TO THE SITE (OR A MINIMUM OF ONCE PER DAY).
- B. PAVING TIMING REQUIREMENTS**
1. INSTALL SUBGRADE AND BASE COURSE MATERIALS WITHIN 48 HOURS OF THE REMOVAL/OPEN CUTTING OF EXISTING PAVEMENT CONSISTING OF STREETS, DRIVEWAYS, OR SIDEWALK. INSTALL FINAL SURFACE COURSES WITHIN 14 DAYS AFTER REMOVAL OF EXISTING PAVEMENT.
 2. AREAS TO RECEIVE ASPHALT SHALL RECEIVE EROSION CONTROL MEASURES NO LATER THAN 48 HOURS AFTER ACCEPTANCE OF BASE COURSE. TEMPORARY EROSION CONTROL CONSISTS OF PLACEMENT OF A BITUMINOUS PRIME COAT AND SANDING THE SURFACE. PERMANENT EROSION CONTROL CONSISTS OF PLACEMENT OF THE STRUCTURAL COURSE.
 3. AREAS TO RECEIVE CONCRETE PAVING SHALL BE EITHER PROTECTED WITH A LAYER OF FDOT COARSE AGGREGATE MATERIAL OR SHALL BE PAVED WITHIN 48 HOURS OF ACCEPTANCE OF THE SUBGRADE.
- C. GRADING**
1. GRADING SHOWN ON THESE PLANS ARE PROVIDED TO THE CONTRACTOR TO EXPRESS THE GENERAL GRADING INTENT OF THE PROJECT. THE CONTRACTOR SHALL BE EXPECTED TO GRADE THE ENTIRE SITE TO PROVIDE POSITIVE DRAINAGE IN ALL AREAS THROUGHOUT THE SITE. SMOOTH TRANSITIONS SHALL BE PROVIDED BETWEEN CONTOURS OR SPOT ELEVATIONS AS SHOWN ON THE PLANS. DURING THE GRADING INTENT, ALL SLOPES SHALL BE STABILIZED IMMEDIATELY AFTER FINAL GRADING HAS BEEN COMPLETED. CONTRACTOR SHALL NOTIFY OWNER AND ENGINEER PRIOR TO DEMOBILIZATION OF GRADING EQUIPMENT TO DETERMINE THAT THE GRADING INTENT HAS BEEN ACHIEVED.
 2. ALL PAVING SURFACES IN INTERSECTIONS AND ADJACENT SECTIONS SHALL BE GRADED TO DRAIN POSITIVELY AND TO PROVIDE A SMOOTHLY TRANSITIONED DRIVING SURFACE FOR VEHICLES WITH NO SHARP BREAKS IN GRADE, AND NO UNUSUALLY STEEP OR REVERBERATING CROWN PROFILES. THE STANDARD CROWN MAY HAVE TO BE CHANGED IN ORDER TO DRAIN POSITIVELY IN THE AREA OF INTERSECTIONS. IT IS THE CONTRACTORS RESPONSIBILITY TO ACCOMPLISH THE ABOVE AND THE ENGINEER SHALL BE CONSULTED SO THAT HE MAY MAKE ANY AND ALL REQUIRED INTERPRETATIONS OF THE PLANS OR GIVE SUPPLEMENTARY INSTRUCTIONS TO ACCOMPLISH THE INTENT OF THE PLANS.
 3. UNIFORMLY SMOOTH GRADE THE SITE. DEPRESSIONS FROM SETTLEMENT SHALL BE FILLED AND COMPACTED. TOPS OF EMBANKMENTS AND BREAKS IN GRADE SHALL BE ROUNDED. FINISHED SURFACES SHALL BE REASONABLY SMOOTH, COMPACTED, FREE FROM IRREGULAR SURFACE CHANGES AND COMPARABLE TO THE SMOOTHNESS OBTAINED BY BLADE, GRADER OPERATIONS.
 4. SLOPE GRADES TO DRAIN AWAY FROM STRUCTURES AT A MINIMUM OF ¼-INCH PER FOOT FOR 10 FEET. FINISHED SURFACES ADJACENT TO PAVED AREAS AND WITHIN 10 FEET OF STRUCTURES SHALL BE WITHIN 1 INCH OF THE PROPOSED GRADE. ALL OTHER AREAS SHALL BE WITHIN 3 INCHES OF THE PROPOSED GRADE.
 5. NEWLY GRADED AREAS SHALL BE PROTECTED FROM TRAFFIC AND EROSION. ALL SETTLEMENT OR WASHING AWAY THAT MAY OCCUR FROM ANY CAUSE PRIOR TO SEEDING OR ACCEPTANCE SHALL BE REPAIRED AND GRADES RE-ESTABLISHED TO THE REQUIRED ELEVATIONS AND SLOPES AT NO ADDITIONAL COST TO THE OWNER.



666 N.E. 125th STREET,
SUITE 247
NORTH MIAMI, FL 33161
Phone: 305.720.2029
C.O.A. 33221

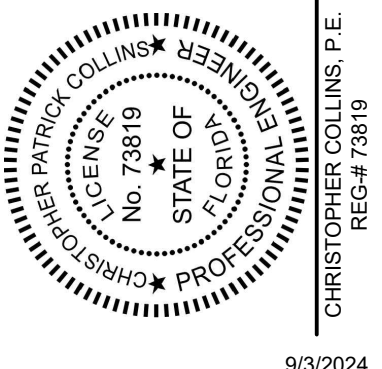

This item has been digitally signed and sealed by Christopher P. Collins, P.E. on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronics copies.

Revision Date
Comment

Revision Date
Comment

Revision Date
Comment

Revision Date
Comment

Revision Date
Comment

Revision Date
Comment

Designed by: C.P.C.
Drawn by: A.T.S.
Checked by: C.P.C.
Approved by: C.P.C.
Scale: N.T.S.
Date: 05/25/2022
Job No.: 1002
© 2025
Plans for

FESTIVAL
MARKETPLACE
2900 W SAMPLE ROAD
POMPAÑO BEACH,
FLORIDA

GENERAL
NOTES

Sheet No.

C-2.0



Call 811 or visit sunshine811.com two full business days before digging to have buried facilities located and marked. Check positive response codes before you dig!