

EXISTING CONDITIONS.
Contractor must visit the
site and familiarize with
existing conditions prior to
bidding. There is work
involved in areas outside
the space. Contractor shall
coordinate such work,
minimize disruptions and
bring those areas to the
same condition it was prior
the work was performed.

This item has been digitally
signed and sealed by
Alejandro Ramirez, PE on:
see seal date Printed
copies of this document
are not considered signed
and sealed and the
signature must be verified
on any electronic copies.
Alejandro Ramirez, PE 52742

No.	Description	Date

Proposed
Mausoleum
Building
At


Forest Lawn
Memorial
Gardens

200 WEST COPANS ROAD
POMPANO BEACH
FLORIDA

Project number 2024-05
Date December 14, 2024

S-2

Scale 1/4"=1'-0"

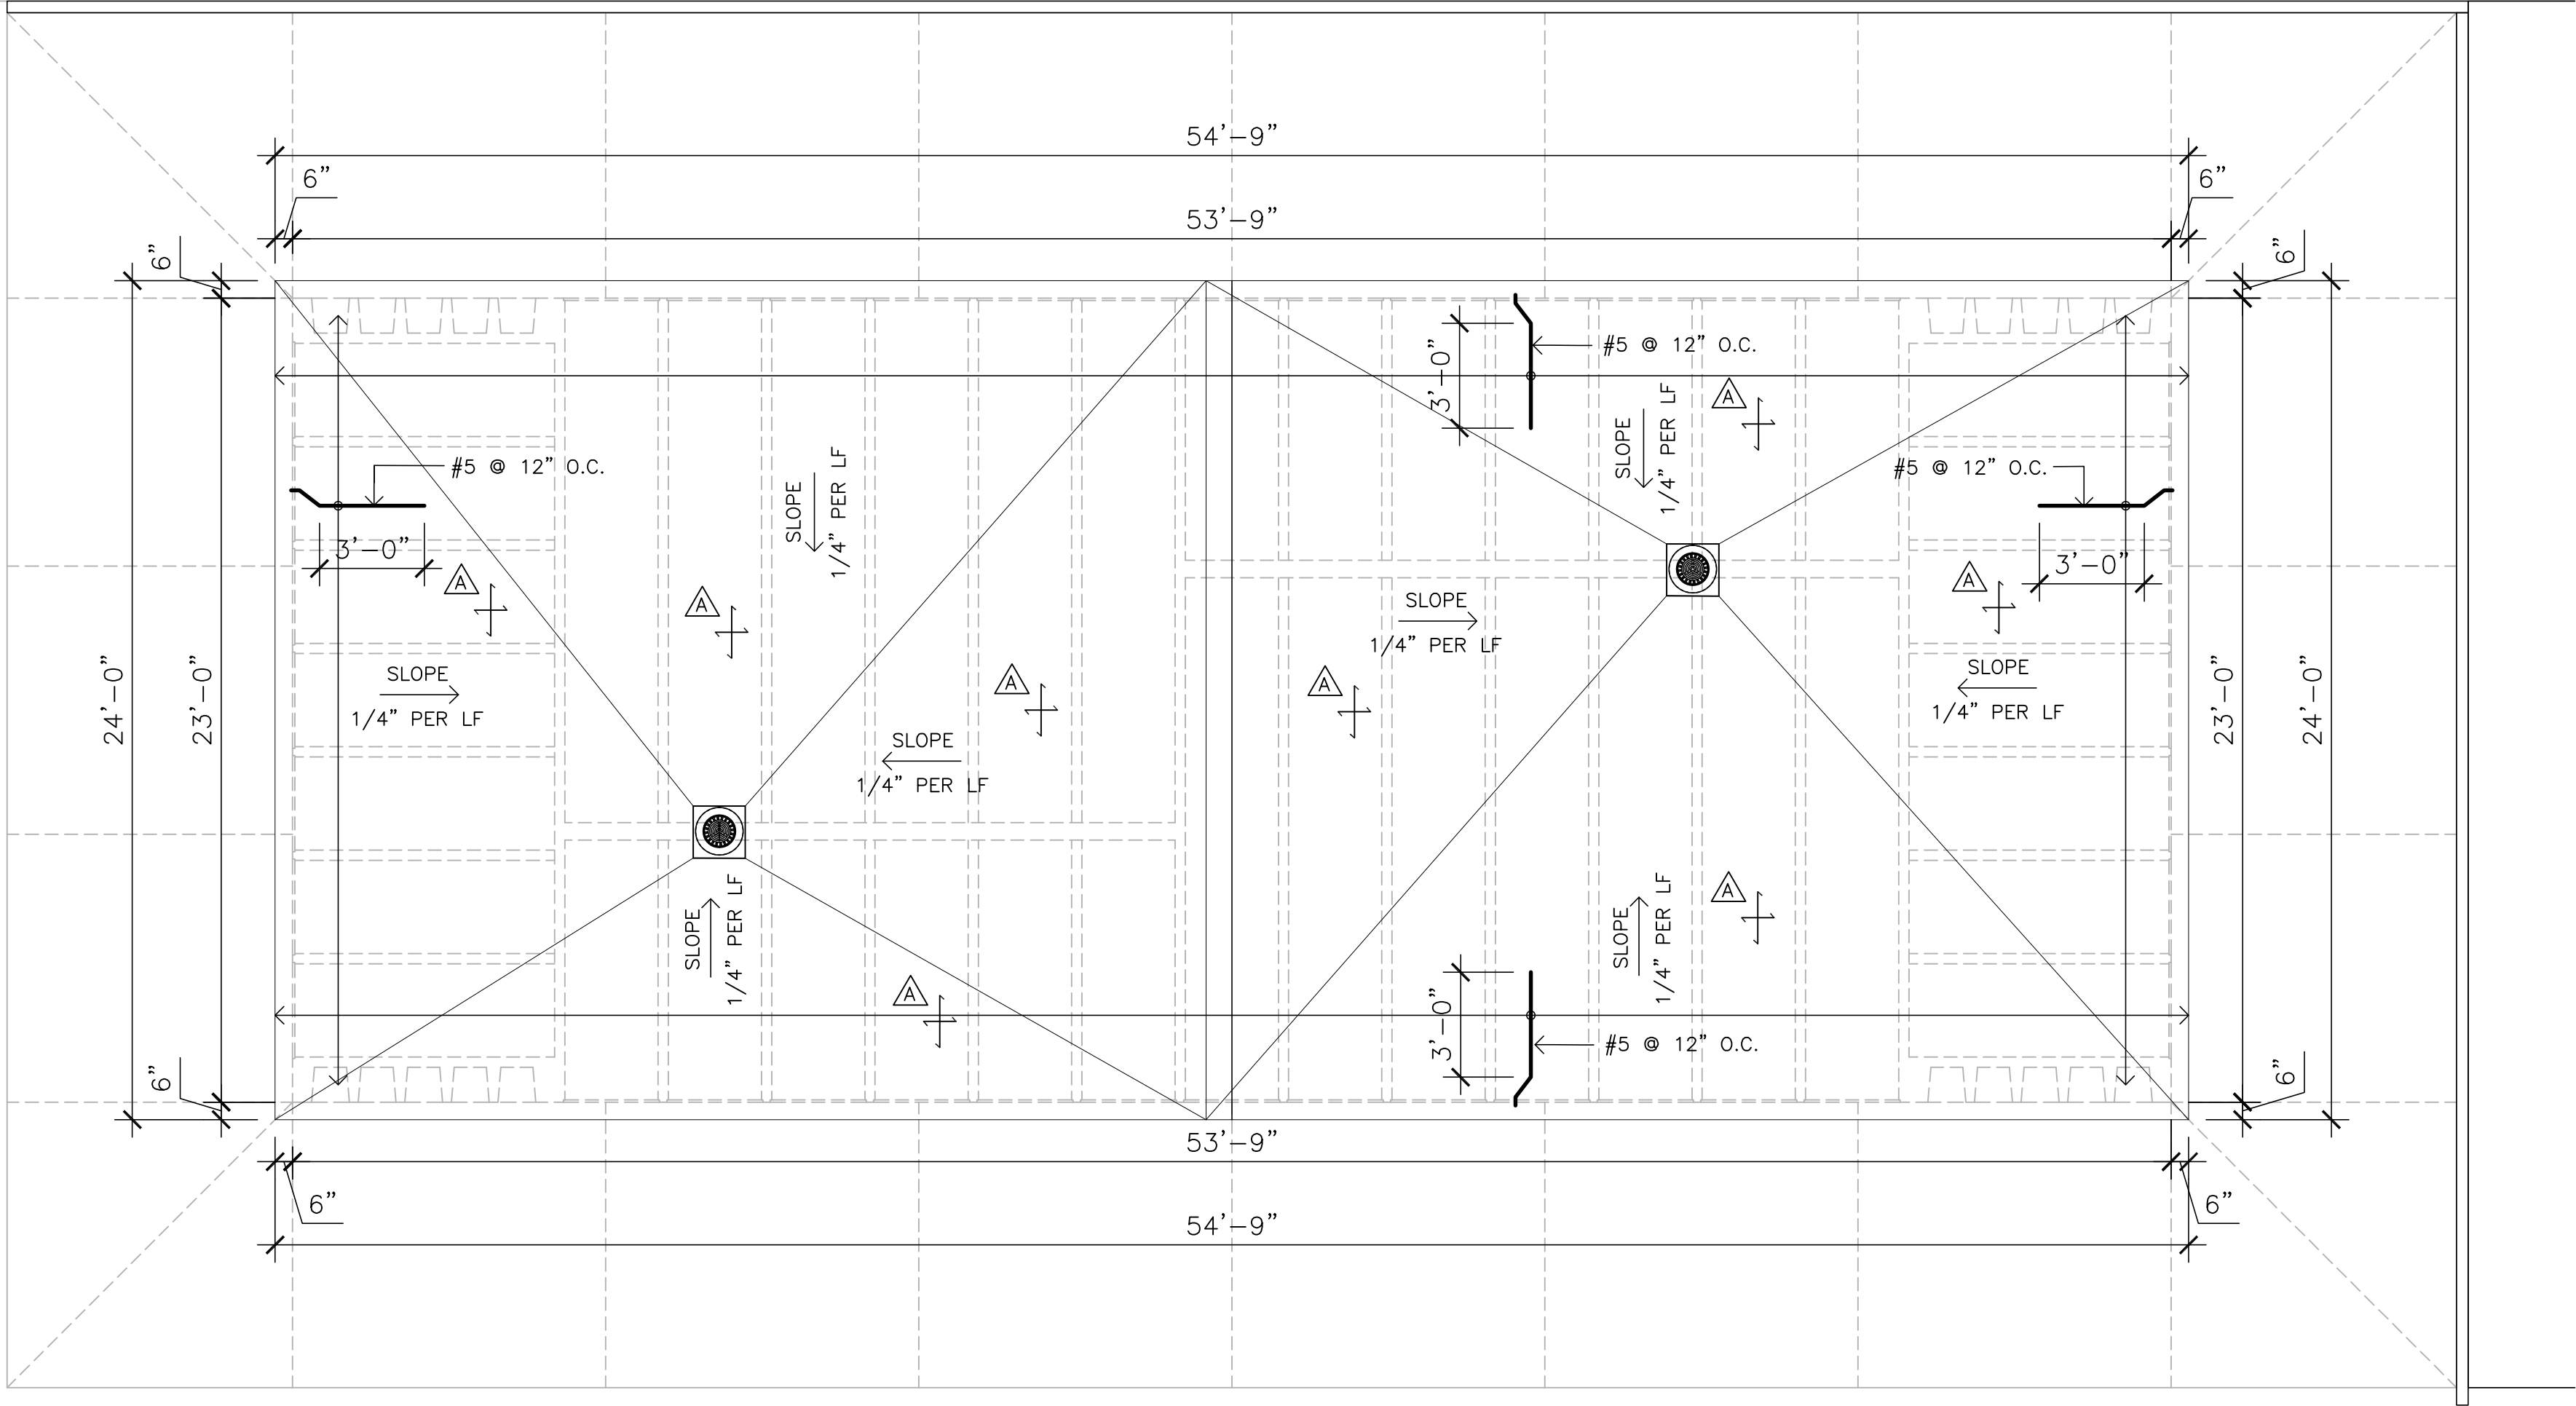

ROOF FRAMING PLAN
BUILDING 12

SCALE: 1/4"=1'-0"

SCHEDULE OF SLAB & REINFORCING			
MARK	THICKNESS	MAIN REINFORCING	CENTER OF BAR FROM BOTTOM OF SLAB
A	6"	#5 12" O.C. E.W.	1 1/2"

NOTE: ALL SLAB HAVE #3 TEMP. REINFORCING PERPENDICULAR
TO MAIN REINFORCING @ 12" O.C.
EXTEND BOTTOM BARS 6" INTO ADJACENT SUPPORTS

TYPICAL CONCRETE COVERAGE
BEAMS & COLUMNS 1 1/2" EXCEPT SHOWN OTHERWISE
FOUNDATION 3" EXCEPT SHOWN OTHERWISE
SLAB 3/4" EXCEPT SHOWN OTHERWISE

LEGEND

- 1 DIRECTION OF MAIN REINFORCING
- ←→ SAME REINFORCING EACH WAY
- #5 TOP REINFORCING LOCATED 1" FROM
TOP OF SLAB
& CENTER AT SUPPORT.
(FOR SPACING SEE PLAN)

ROOF NOTE:
DIFFERENCE IN LEVEL BETWEEN ROOF DRAIN & EDGE OF ROOF FOR FREE
EVACUATION OF WATER IS 6" MAX.
EXCESS OF WATER OVER PERMITTED 5" HAS BEEN CONSIDERED IN THE
DESIGN OF THE ROOF STRUCTURE

DRC

PZ25-12000004

04.02.2025