



PZ22-12000042

02/01/2023

BOARD OF COUNTY COMMISSIONERS
WATER AND WASTEWATER SERVICES (WWS)
CUSTOMER SERVICE CENTER
 2555 WEST COPANS ROAD, BLDG. 1
 POMPANO BEACH, FL 33069
 (954) 831-3250 • water@broward.org

ATTACHED:
 ① PHOTO ID (S)
 ② SUPP DOCS
 By _____
 Date _____

APPLICATION FOR FIRE HYDRANT PRESSURE & FLOW TEST

Complete the following and indicate service required by placing a check mark in the appropriate square. Sign, date, and return to WWS along with payment. Please include a map or sketch illustrating the location of the testing area or hydrant to be tested.

- 24-Hour Pressure Test with Chart Reading.....\$150.00
- Pressure and Flow Test including 24-hour chart recording.....\$200.00
- Tapping into Main (this would be rare but if necessary to accomplish any of the above, in addition to all other charges).....\$300.00

CONTACT NAME: Niles Warrick

BUSINESS NAME: KEITH

MAILING ADDRESS: 301 E. Atlantic Blvd Pompano Beach FL 33060
STREET CITY STATE ZIP + 4

LOCATION ADDRESS: 2504 NW 19th St. Pompano Beach FL 33069
STREET CITY STATE ZIP + 4

PHONE: HOME: (954) 788-3400 WORK: (954) 788-3400 MOBILE: (_____)

E-MAIL ADDRESS: NWarrick@keithteam.com

X 

DATE 11/07/2022

Please allow a maximum of ten (10) working days to be notified of results of test(s). Customer is contacted by phone.

APPLICATION PACKAGE CAN BE SUBMITTED BY:


Mail or In Person: Water & Wastewater Services (WWS)
 Customer Service Payment Center
 2555 West Copans Road, Bldg. 1
 Pompano Beach, FL 33069

MAKE CHECKS PAYABLE TO: Water & Wastewater Services or WWS

FOR INTERNAL USE ONLY:

DATE RECEIVED _____
CHECK NO. \$ _____
AMOUNT PAID _____
CS REP

PZ22-12000042
02/01/2023

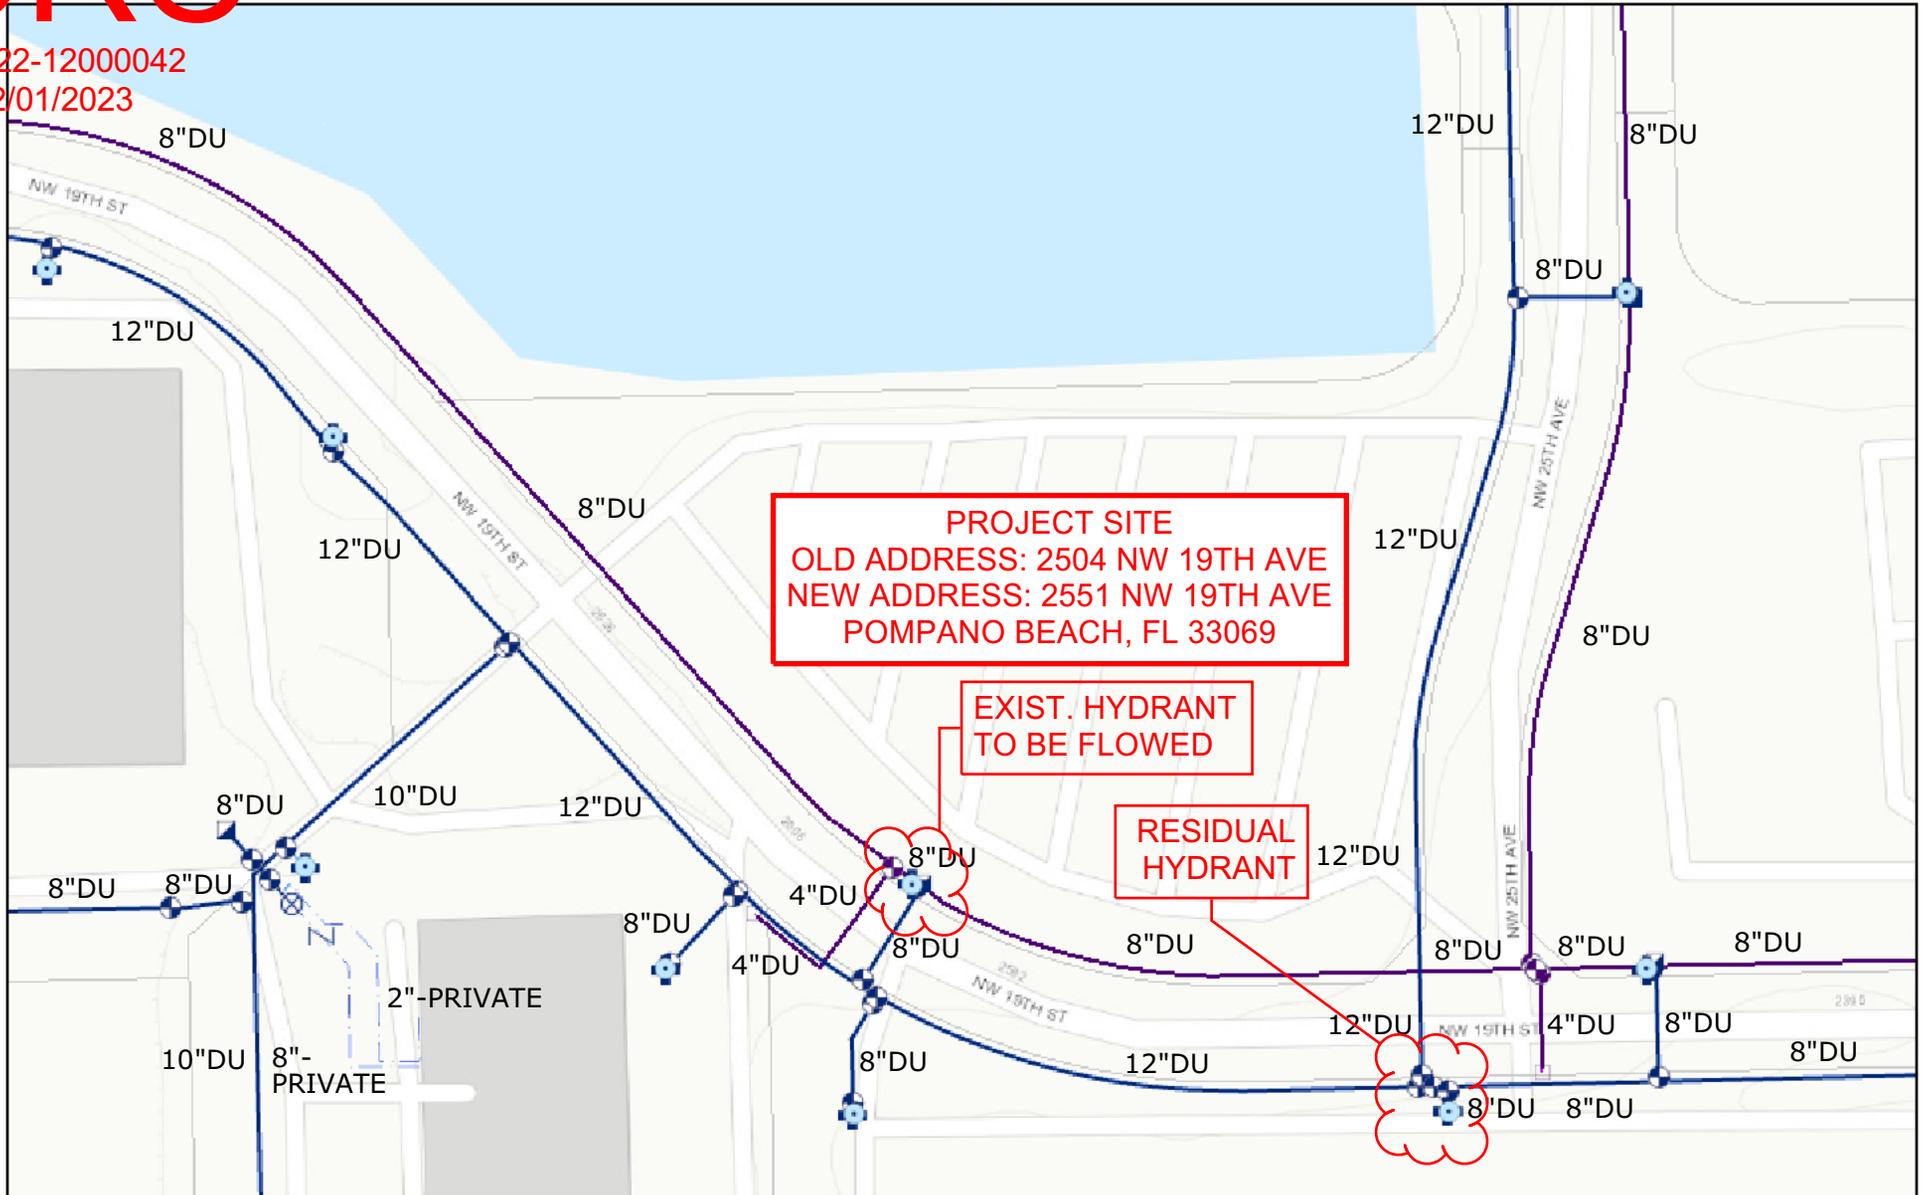

8/30/2022, 11:57:27 AM

- PW Abandoned Pipe
- PW Private Pipe
- PW Service Connection Pipe
- PW BV Connection Pipe
- PW ARV Connection Pipe
- PW Hydrant Connection Pipe
- PW Casing
- PW Main
- PW Private Facilities
- ⊕ Air Release Valve
- ⊕ Backflow Preventor
- ⊕ Blow Off Valve
- ⊕ Control Valve
- ⊕ Hydrant

