


1. REFER TO ARCHITECTURAL LIFE SAFETY PLAN FOR ALL EMERGENCY EGRESS ROUTES AND EMERGENCY EXITS FROM BUILDING
2. VISIBILITY AND UNOBSTRUCTED WORKING SPACE MUST BE MAINTAINED FROM FIRE APPARATUS ACCESS ROUTES TO FIRE PROTECTION AND LIFE SAFETY APPLIANCES/EQUIPMENT. THESE INCLUDE BUT NOT LIMITED TO: FIRE HYDRANTS, FIRE DEPARTMENT CONNECTIONS (FDC), POST INDICATING VALVES (PIV), FIRE SPRINKLER RISERS, FIRE ALARM CONTROL PANELS AND ELECTRICAL ROOM LOCATIONS.
3. CLEAR SPACE AROUND FIRE HYDRANTS, FIRE DEPARTMENT CONNECTIONS (FDC), AND ANY OTHER FIRE APPLIANCE REQUIRING CLEARANCE FOR ACCESS. A 36 INCH CLEAR SPACE SHALL BE MAINTAINED AROUND THE CIRCUMFERENCE OF FIRE HYDRANT/APPLIANCE.
4. VERTICAL CLEARANCE OF A MINIMUM 13'-6" SHALL BE PROVIDED FOR ALL FIRE APPARATUS ACCESS ROADS
5. FIRE APPARATUS ROADS SHALL BE DESIGNED AND MAINTAINED TO SUPPORT THE IMPOSED LOADS OF FIRE APPARATUS AND SHALL BE SURFACED SO AS TO PROVIDE ALL WEATHER DRIVING CAPABILITIES
6. REFER TO CIVIL DETAILS FOR FIRE HYDRANT CLEAR ZONE DETAIL

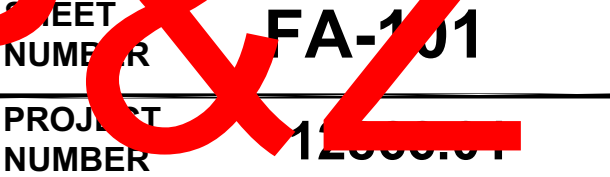

**P&Z**  
MEETING NUMBER **FA-101**  
PROJECT NUMBER **12000052**  
**PZ22-12000052**  
**07/26/2023**

STATIS. PREI IMINARY