

AMERICAN EAGLE FIRE PROTECTION, INC.

4711 North Dixie Highway – Boca Raton, FL 33431

Telephone: 561-750-3698 – Fax: 561-750-8496

LIC # 33490800012003


FLOW TEST

STATIC PRESSURE (psi)	RESIDUALPRESSURE (psi)	PITOT PRESSURE (psi)	PITOT FLOW (gpm)	OUTLET SIZE
82	75	33	960	2"

Address: 855 S Federal Highway, Pompano Beach

Flow Test Date: Monday, October 6, 2025 at 8:00 a.m. to Tuesday, October 7, 2025 at 8:00 a.m

Sketch of Test Location

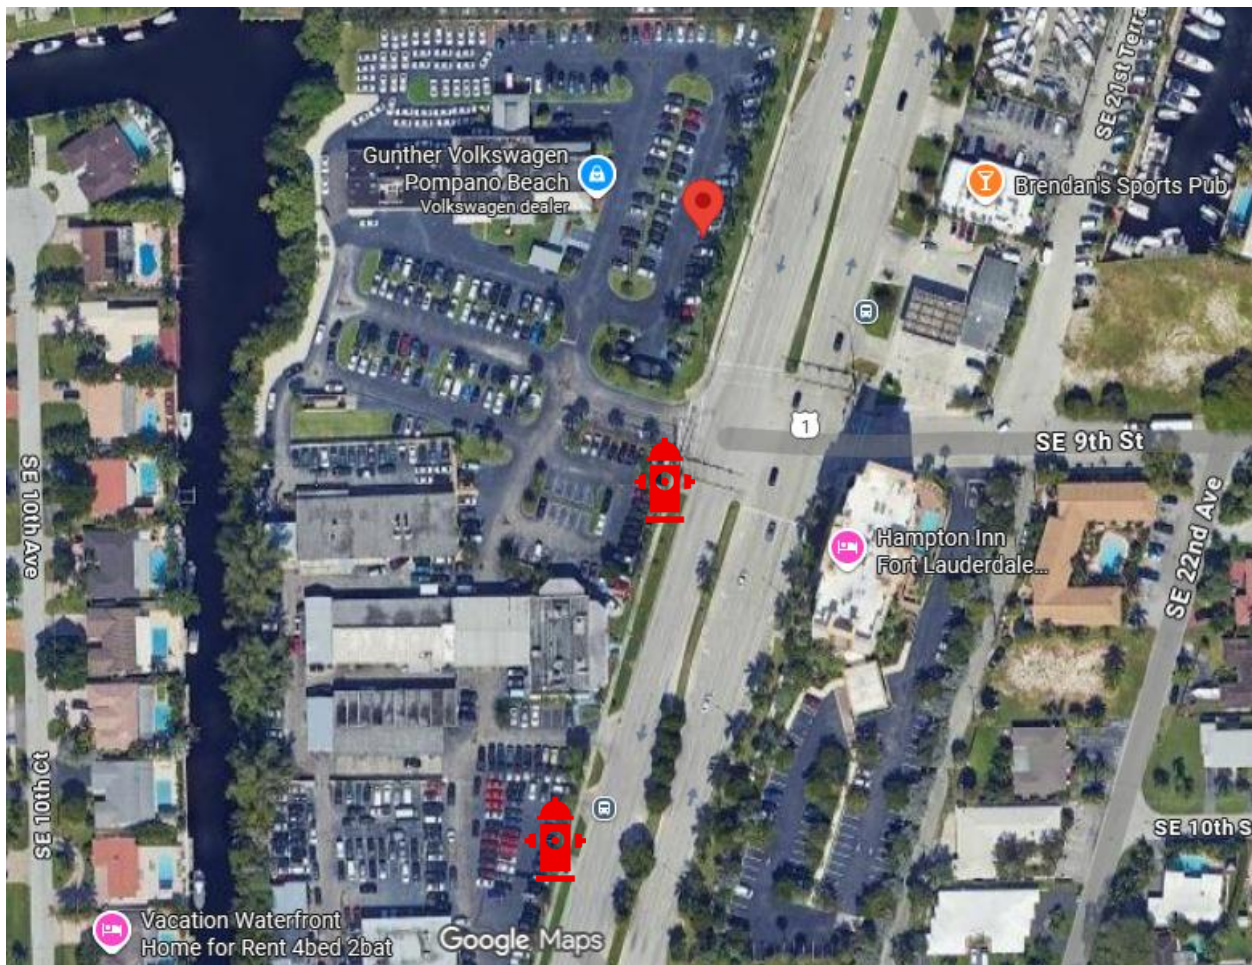

Please note this test was performed using "The Little Hose Monster". The co-efficient and flow data are based on manufactures UL Listed specific specs designed for use of the 2 inch pitotless nozzle.

DRC

X *Daria Cinetta*

PZ25- 12000028
03/18/2026 American Eagle Technician

Date: 10-08-2025