

DRC

PZ24- 12000017
11/19/2025



JMC FIRE PROTECTION SERVICES, INC.

5449 NW 24th St. Suite #4 Margate, FL. 33063

Phone #954-600-6899 Fax #954-973-6998

jackf@jmcfireprotection.com

CFPC II 09560500012008

FLOW TEST REPORTS

Flow Property: Blossman Gas

Address: 261 S. Andrews Ave.

Pompano, FL. 33069

Date of test: 4/28/2025 & 4/29/2025

Time: 8:00am

Conducted by:

JMC Fire - Sammy (S.M) / JMC Fire - Jack France (Qualifier) / JMC Fire – Udesch (tech/inspector)

Witnessed By: Pompano Beach Fire Rescue Inspector Jim Galloway

Residual Hydrant

2005 Clow 5-1/4"

Color: Red

Location: Andrews Ave. center of field

Hydrant nozzle coefficient: 0.90

Static: 79 psi

Residual: 68 psi

Gauge scale +1% certification gauge #JMC-2222

(0-300psi) Expires 6-13-2025

DRC

Hydrant #1 Flow

1985 Clow 4-1/2"

Color: Red

Location: Hydrant (NW corner of Racetrack Road & Andrews Ave.)

Hydrant nozzle coefficient: 0.80

Gauge scale +1% certification gauge #JMC-4102

(0-60psi) Expires 6-14-2025

2" Lil Hose Monsters Pitot-less grooved (26 psi = 795 = GPM. total flow)

1-3/4" Lil Hose Monsters Pitot-less grooved (32 psi 592 = GPM total flow)

PZ24-12000017

07/02/2025

Hydrant #2 Flow

2019 Mueller 5-1/4"

Color: Red

Location: Hydrant (351 S Andrews Ave)

Hydrant nozzle coefficient: 0.90

Gauge scale +1% certification gauge #JMC-3230 (0-60psi) Expires 6-14-2025

2" Lil Hose Monsters Pitot-less grooved (18 psi = 662 GPM total flow)

2" Lil Hose Monsters Pitot-less grooved (22 psi = 732 GPM total flow)

TOTAL FLOWED 2,871 GPM

DRC

PZ24- 12000017
11/19/2025

HOSE MONSTER
COMPANY

[SHOP](#) [USES](#) [RESOURCES](#) [HOSE MONSTER UNIVERSITY](#) [CONTACT](#) [SOFTWARE LOGIN](#)

HYDRANT FLOW TEST CALCULATOR

Static Pressure (PSI):

79

Residual Pressure (PSI):

68

Total Test Flow Rate (GPM):

2781

Calculate

DRC

PZ24-12000017

07/02/2025


GPM at 20 psi: 6889

Class: AA

Marking color: Light Blue

% Pressure Drop: 14%

File Name: P:\Projects\2023\237806 Blossman Gas Pompano\CADD Files\Drawings\Exhibit\237806-C-EXHIBIT-FIRE.dwg - (Plotted by: Jessica Cano on Thursday, October 10, 2024 4:28:52 PM)

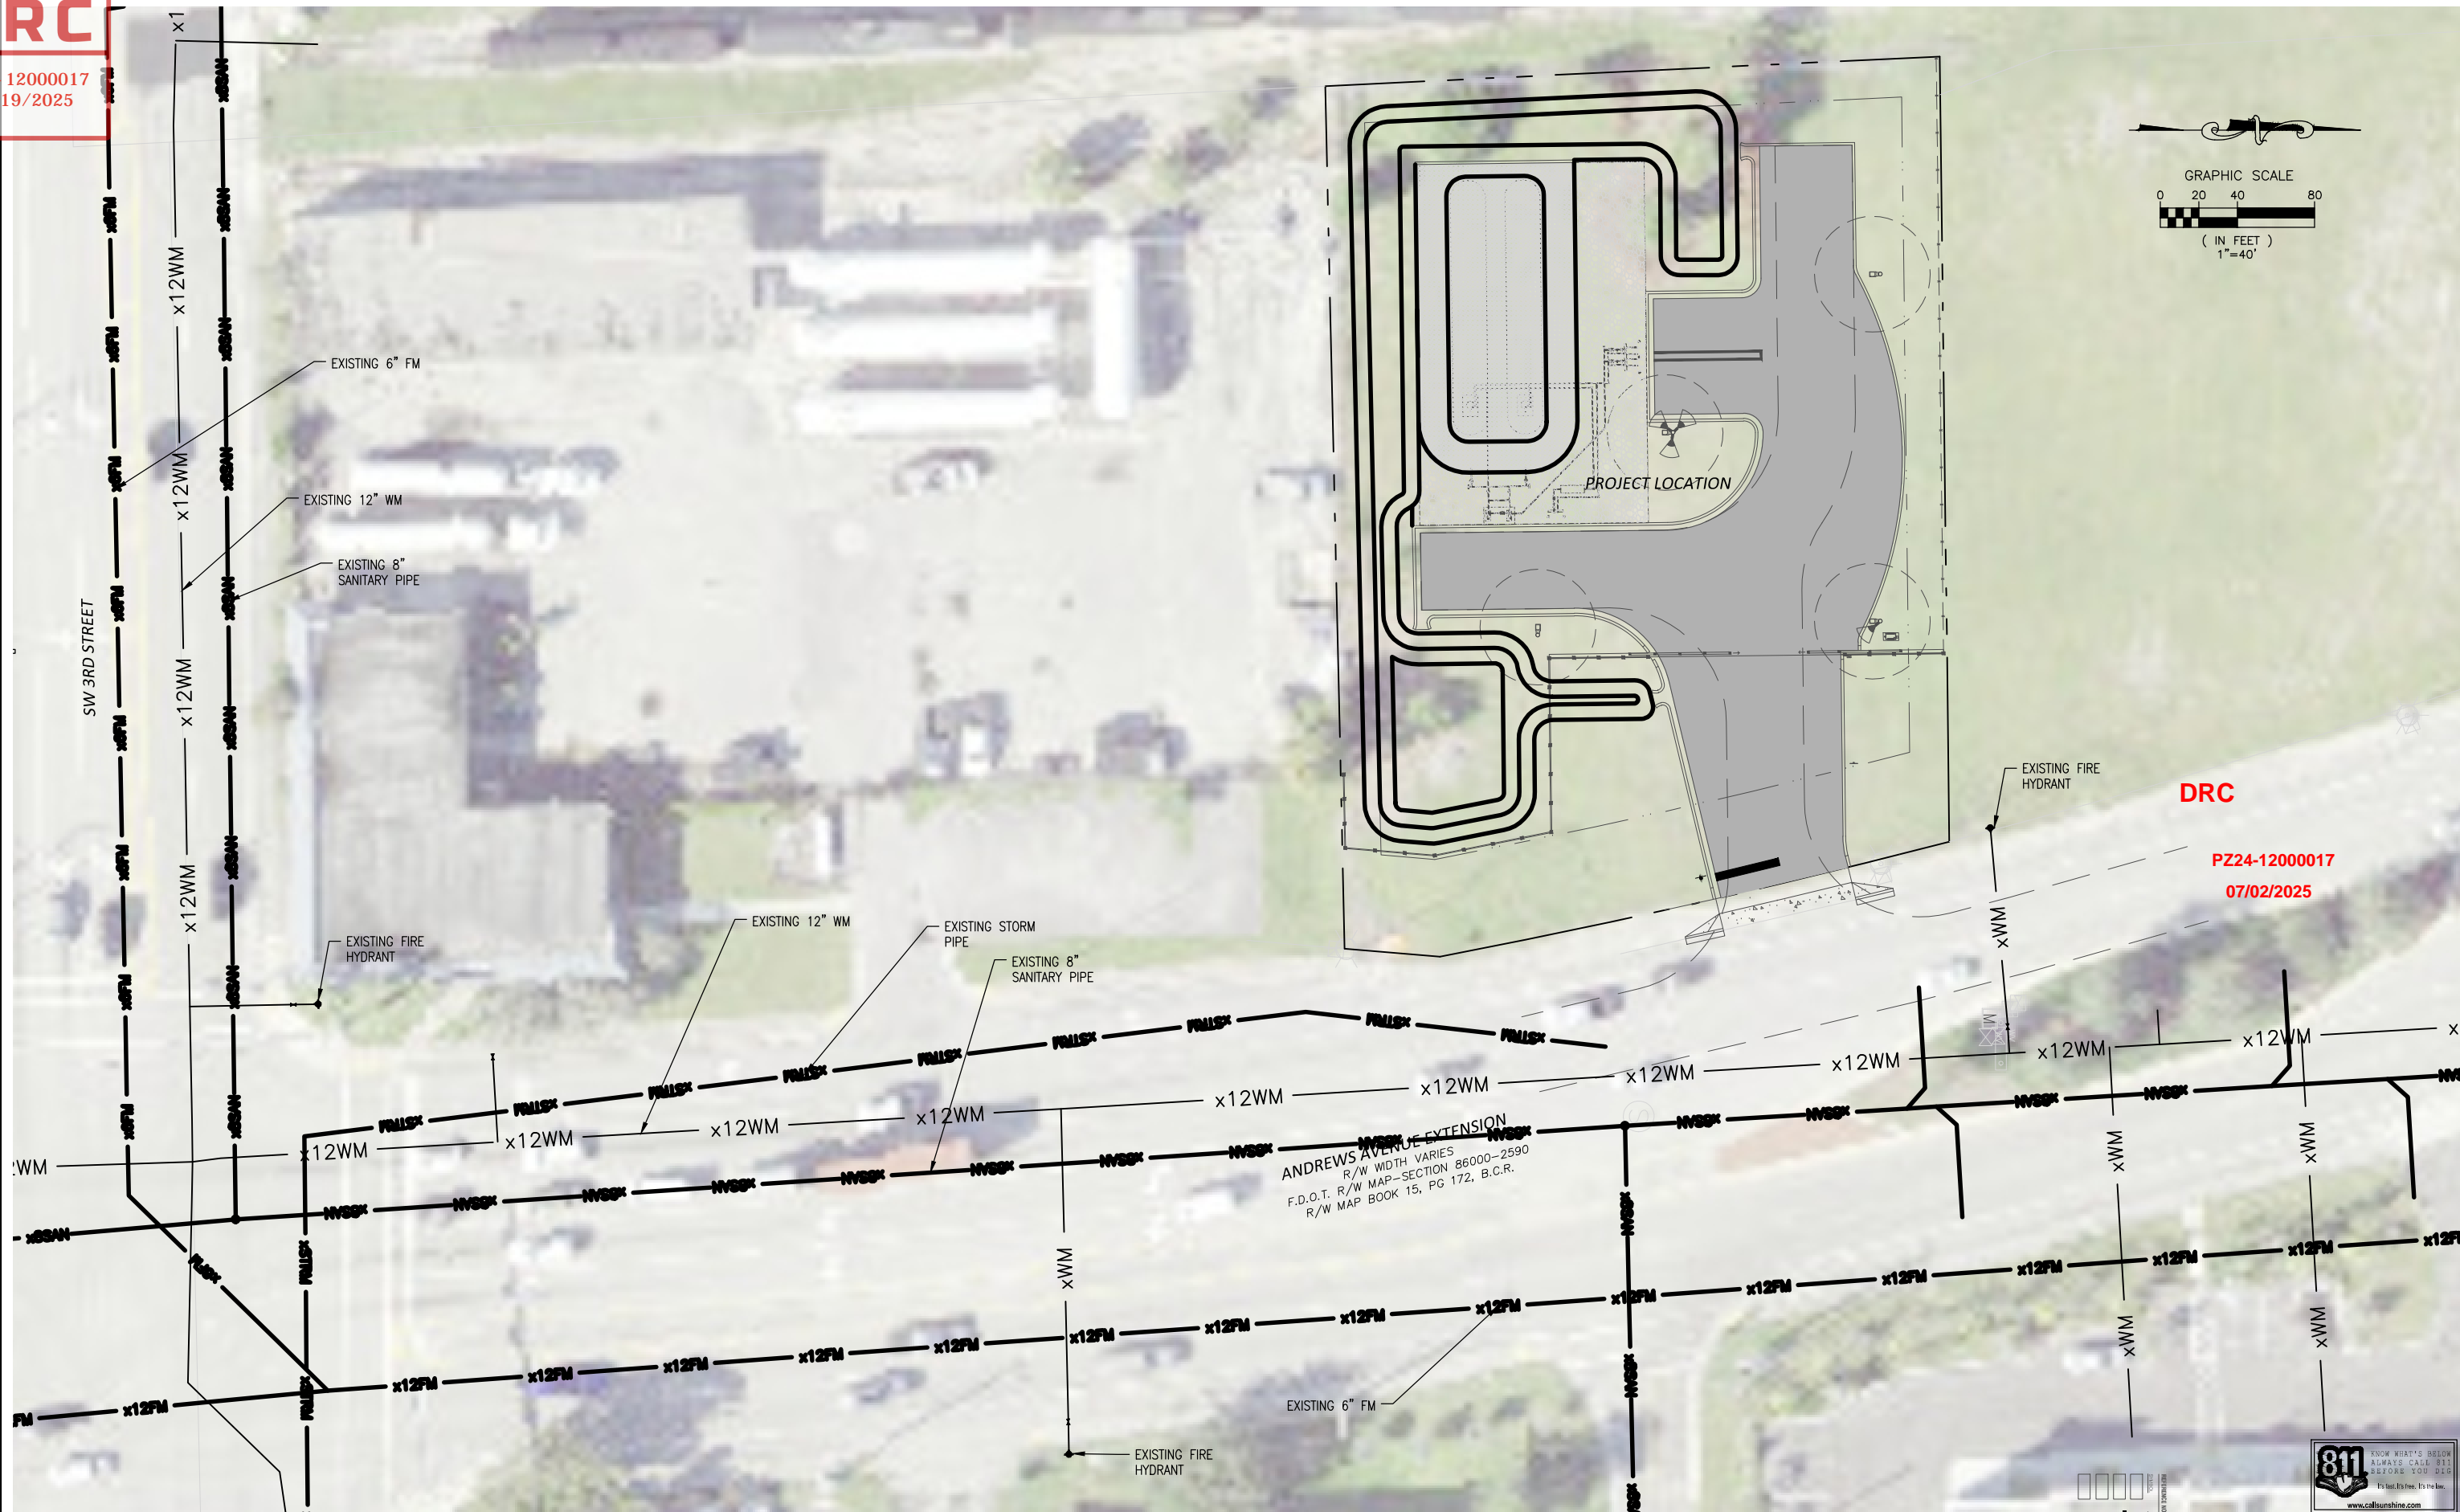

NO	DATE	REVISION	BY	NO	DATE	REVISION	BY



Calvin, Giordano & Associates, Inc.
A **SAFEBuilt** COMPANY
1800 Eller Drive, Suite 600, Fort Lauderdale, FL 33316
Phone: 954.921.7781 • Fax: 954.921.8807

BLOSSMAN GAS COMPANY
261 S. ANDREWS AVENUE
POMPANO BEACH, FL 33069

EXISTING FIRE EXHIBIT

JAMES D. MESSICK, STATE OF FLORIDA, PROFESSIONAL ENGINEER, LICENSE NO. 70870.
THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY JAMES D. MESSICK, P.E. DATE INDICATED
HERE.
PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE
SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.
DATE: 9/36/2024

ED	SCALE
	AS NOTED
	PROJECT No
	23-7806

SHEET:

EX1