



BROWARD
COUNTY
FLORIDA

BOARD OF COUNTY COMMISSIONERS
Public Works Department
WATER AND WASTEWATER SERVICES (WWS)
2555 W. COPANS RD., POMPANO BEACH FL 33069
(954) 831-3250 FAX (954) 831-0789

HYDRANT FLOW AND PRESSURE TEST RESULTS

DATE: 03/05/2026

WORK ORDER:

CUSTOMER NAME: Architec

Attn: Carlos Dougnac

ADDRESS: 1945 NW 113th Dr., Gainesville, Florida 32606-1434

PHONE: Work:

Mobile: (352) 260-1829

LOCATION: 1150 SW 30th Ave Pompano Beach, Florida 33069

Pressure HYDRANT #1: PHR 10130201

LOGGER S/N 14209056

Flow HYDRANT #2: PHR 10103801

LOGGER S/N 14209054

HYDRANT # 1	DATE	TIME	PRESSURE
STATIC	03/03/2026	10:26:00 AM	81.17 PSI
RESIDUAL	03/03/2026	10:34:00 AM	73.35 PSI

HYDRANT # 2	DATE	TIME	FLOW
FLOW One	03/03/2026	10:34:05 AM	964.1 GPM

Flow calculated with a discharge coefficient of .90

EQUIPMENT USED:

TELOGER model HPR-31 (Serial numbers listed above)

POLLARD DIFFUSER 2.5 in

DRC

PZ25-12000048
05/20/2026



BOARD OF COUNTY COMMISSIONERS
WATER AND WASTEWATER SERVICES (WWS)
CUSTOMER PAYMENT CENTER
2555 WEST COPANS ROAD, BLDG. 1
POMPANO BEACH, FL 33069
(954) 831-3250 • water@broward.org

☐ ATTACHED:
☐ PHOTO ID (S)
☐ SUPP DOCS
By _____
Date _____

APPLICATION FOR FIRE HYDRANT PRESSURE & FLOW TEST

Complete the following and indicate service required by placing a check mark in the appropriate square. Sign, date, and return to WWS along with payment. Please include a map or sketch illustrating the location of the testing area or hydrant to be tested.

- ☐ 24-Hour Pressure Test with Chart Reading.....\$150.00
☒ Pressure and Flow Test including 24-hour chart recording.....\$200.00

CONTACT NAME: CARLOS DOUGNAC

BUSINESS NAME: ARCHITECT

MAILING ADDRESS: 1945 NW 113TH DR, GAINESVILLE, FLORIDA 32606-1434
STREET CITY STATE ZIP + 4

LOCATION ADDRESS: 1150 SW 30TH AVE POMPANO BEACH FLORIDA 33069
STREET CITY STATE ZIP + 4

PHONE: HOME: () WORK: () MOBILE: (352) 260-1829

E-MAIL ADDRESS: N1801E@COMCAST.NET

X 19 DATE 2/19/26

Please allow a maximum of ten (10) working days to be notified of results of test(s). Customer is contacted by phone.

APPLICATION PACKAGE CAN BE SUBMITTED BY:

Mail or In Person: Water & Wastewater Services (WWS)
Customer Payment Center
2555 West Copans Road, Bldg. 1
Pompano Beach, FL 33069



MAKE CHECKS PAYABLE TO: Water & Wastewater Services or WWS

FOR INTERNAL USE ONLY: 2-27-26 DATE RECEIVED 1763 CHECK NO. \$ 200.00 AMOUNT PAID 00 CS REP

WWS Fire Hydrant Pressure & Flow Test App - Revised 2025

PHR 16130281 - static
s/n# 19209056


PHR 16103801 - flow
s/n# 19209054

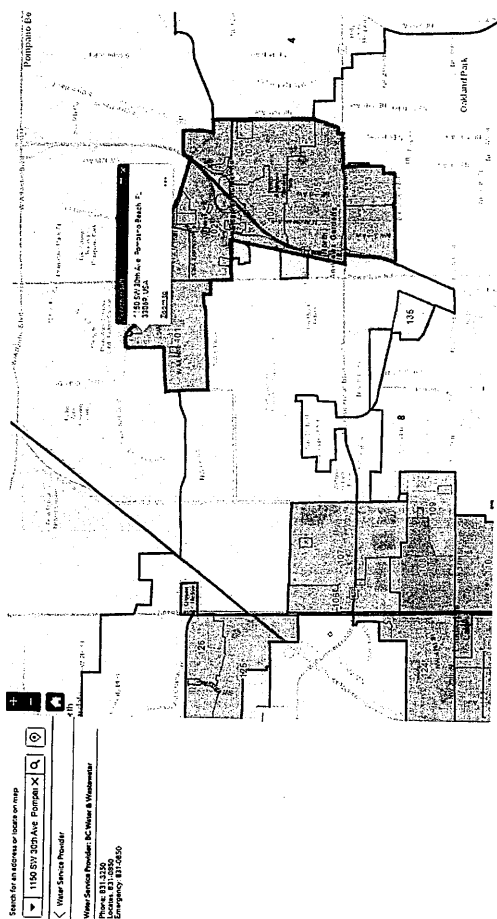

DRC

PZ25-12000048
05/20/2026

14209056 Pressure (PSI)

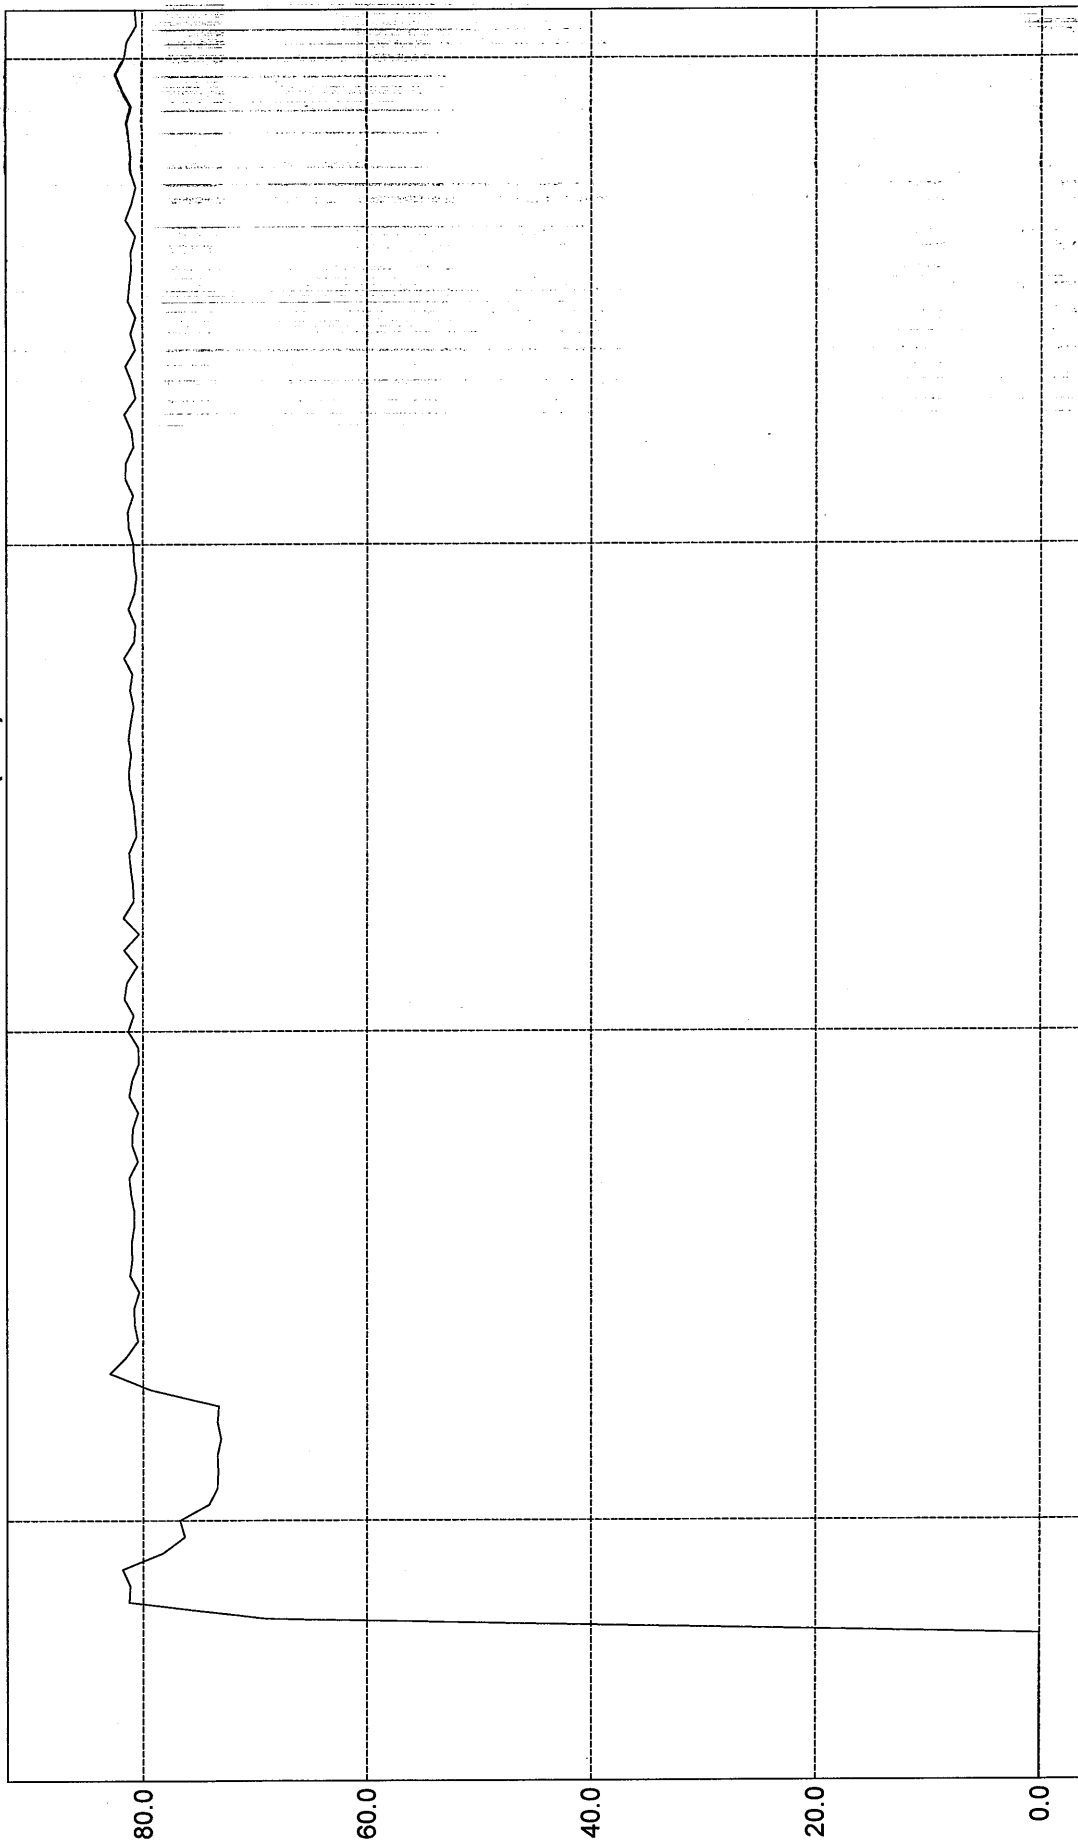

10:30:00 AM
3/3/2026

11:00:00 AM
3/3/2026

11:30:00 AM
3/3/2026

12:00:00 PM
3/3/2026

DRC

PZ25-12000048
05/20/2026

	Time	14209056 Pressure Avg
44	3/3/2026 10:10:00 AM	0.049
45	3/3/2026 10:11:00 AM	0.049
46	3/3/2026 10:12:00 AM	0.049
47	3/3/2026 10:13:00 AM	0.049
48	3/3/2026 10:14:00 AM	0.049
49	3/3/2026 10:15:00 AM	0.049
50	3/3/2026 10:16:00 AM	0.049
51	3/3/2026 10:17:00 AM	0.049
52	3/3/2026 10:18:00 AM	0.049
53	3/3/2026 10:19:00 AM	0.049
54	3/3/2026 10:20:00 AM	0.049
55	3/3/2026 10:21:00 AM	0.049
56	3/3/2026 10:22:00 AM	0.049
57	3/3/2026 10:23:00 AM	0.024
58	3/3/2026 10:24:00 AM	69.084
59	3/3/2026 10:25:00 AM	81.245
60	3/3/2026 10:26:00 AM	81.172
61	3/3/2026 10:27:00 AM	81.832
62	3/3/2026 10:28:00 AM	78.266
63	3/3/2026 10:29:00 AM	76.264
64	3/3/2026 10:30:00 AM	76.703
65	3/3/2026 10:31:00 AM	74.115
66	3/3/2026 10:32:00 AM	73.358
67	3/3/2026 10:33:00 AM	73.309
68	3/3/2026 10:34:00 AM	73.358
69	3/3/2026 10:35:00 AM	73.04
70	3/3/2026 10:36:00 AM	73.358
71	3/3/2026 10:37:00 AM	73.26
72	3/3/2026 10:38:00 AM	79.316
73	3/3/2026 10:39:00 AM	82.93
74	3/3/2026 10:40:00 AM	81.49
75	3/3/2026 10:41:00 AM	80.464
76	3/3/2026 10:42:00 AM	80.757
77	3/3/2026 10:43:00 AM	80.781

Channel Plot 1:

Telogs for Windows 6.92 Build: 707 printed this table on 3/5/2026 8:39:07 AM

DRC

PZ25-12000048
05/20/2026

14209056 Pressure		Time	Avg
50	3/3/2026 10:16:00 AM	0.049	
51	3/3/2026 10:17:00 AM	0.049	
52	3/3/2026 10:18:00 AM	0.049	
53	3/3/2026 10:19:00 AM	0.049	
54	3/3/2026 10:20:00 AM	0.049	
55	3/3/2026 10:21:00 AM	0.049	
56	3/3/2026 10:22:00 AM	0.049	
57	3/3/2026 10:23:00 AM	0.024	
58	3/3/2026 10:24:00 AM	69.084	
59	3/3/2026 10:25:00 AM	81.245	
60	3/3/2026 10:26:00 AM	81.172	
61	3/3/2026 10:27:00 AM	81.832	
62	3/3/2026 10:28:00 AM	78.266	
63	3/3/2026 10:29:00 AM	76.264	
64	3/3/2026 10:30:00 AM	76.703	
65	3/3/2026 10:31:00 AM	74.115	
66	3/3/2026 10:32:00 AM	73.358	
67	3/3/2026 10:33:00 AM	73.309	
68	3/3/2026 10:34:00 AM	73.358	
69	3/3/2026 10:35:00 AM	73.04	
70	3/3/2026 10:36:00 AM	73.358	
71	3/3/2026 10:37:00 AM	73.26	
72	3/3/2026 10:38:00 AM	79.316	
73	3/3/2026 10:39:00 AM	82.93	
74	3/3/2026 10:40:00 AM	81.49	
75	3/3/2026 10:41:00 AM	80.464	
76	3/3/2026 10:42:00 AM	80.757	
77	3/3/2026 10:43:00 AM	80.781	
78	3/3/2026 10:44:00 AM	80.342	
79	3/3/2026 10:45:00 AM	81.148	
80	3/3/2026 10:46:00 AM	80.952	
81	3/3/2026 10:47:00 AM	81.026	
82	3/3/2026 10:48:00 AM	80.781	
83	3/3/2026 10:49:00 AM	80.781	


Channel Plot 1:

Telogers for Windows 6.92 Build: 707 printed this table on 3/5/2026 8:31:35 AM

DRC

PZ25- 12000048
05/20/2026

14209056 Pressure (PSI)

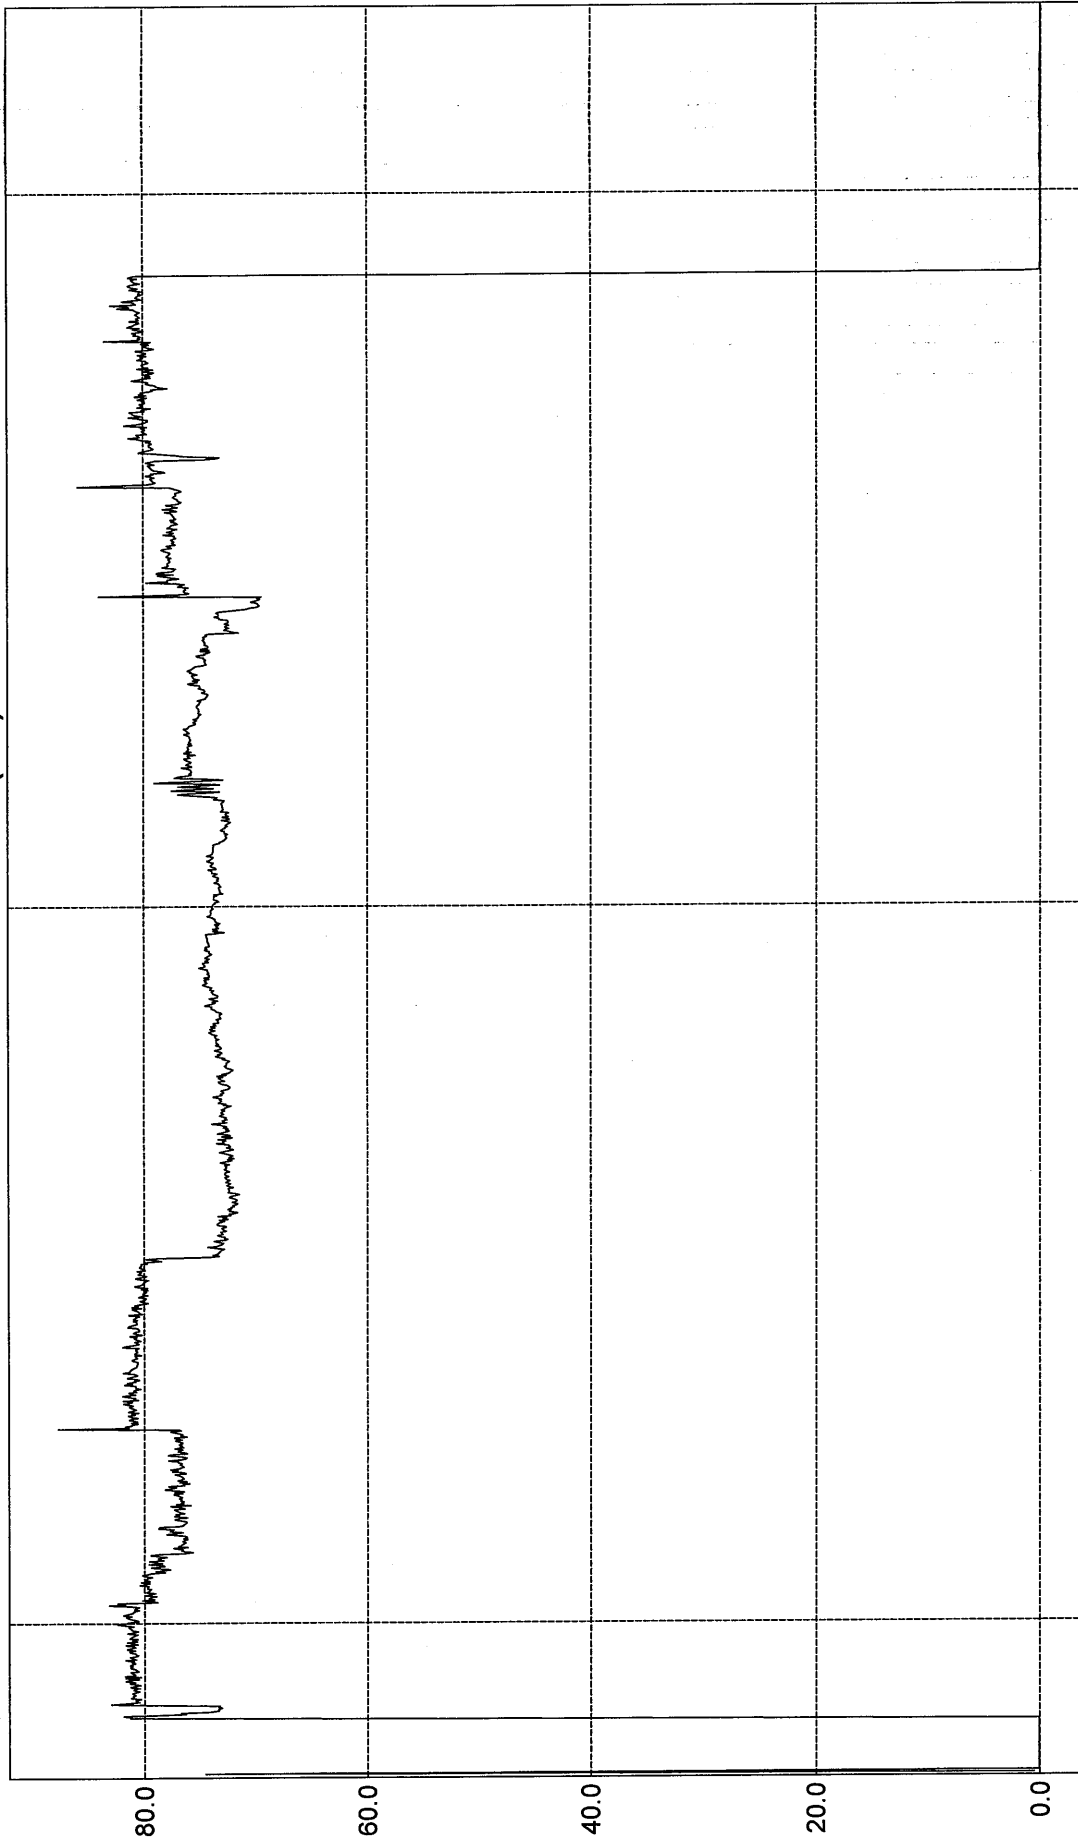

12:00:00 PM
3/3/2026


12:00:00 AM
3/4/2026

12:00:00 PM
3/4/2026

DRC

PZ25-12000048
05/20/2026

14209054 Pressure (gpm)

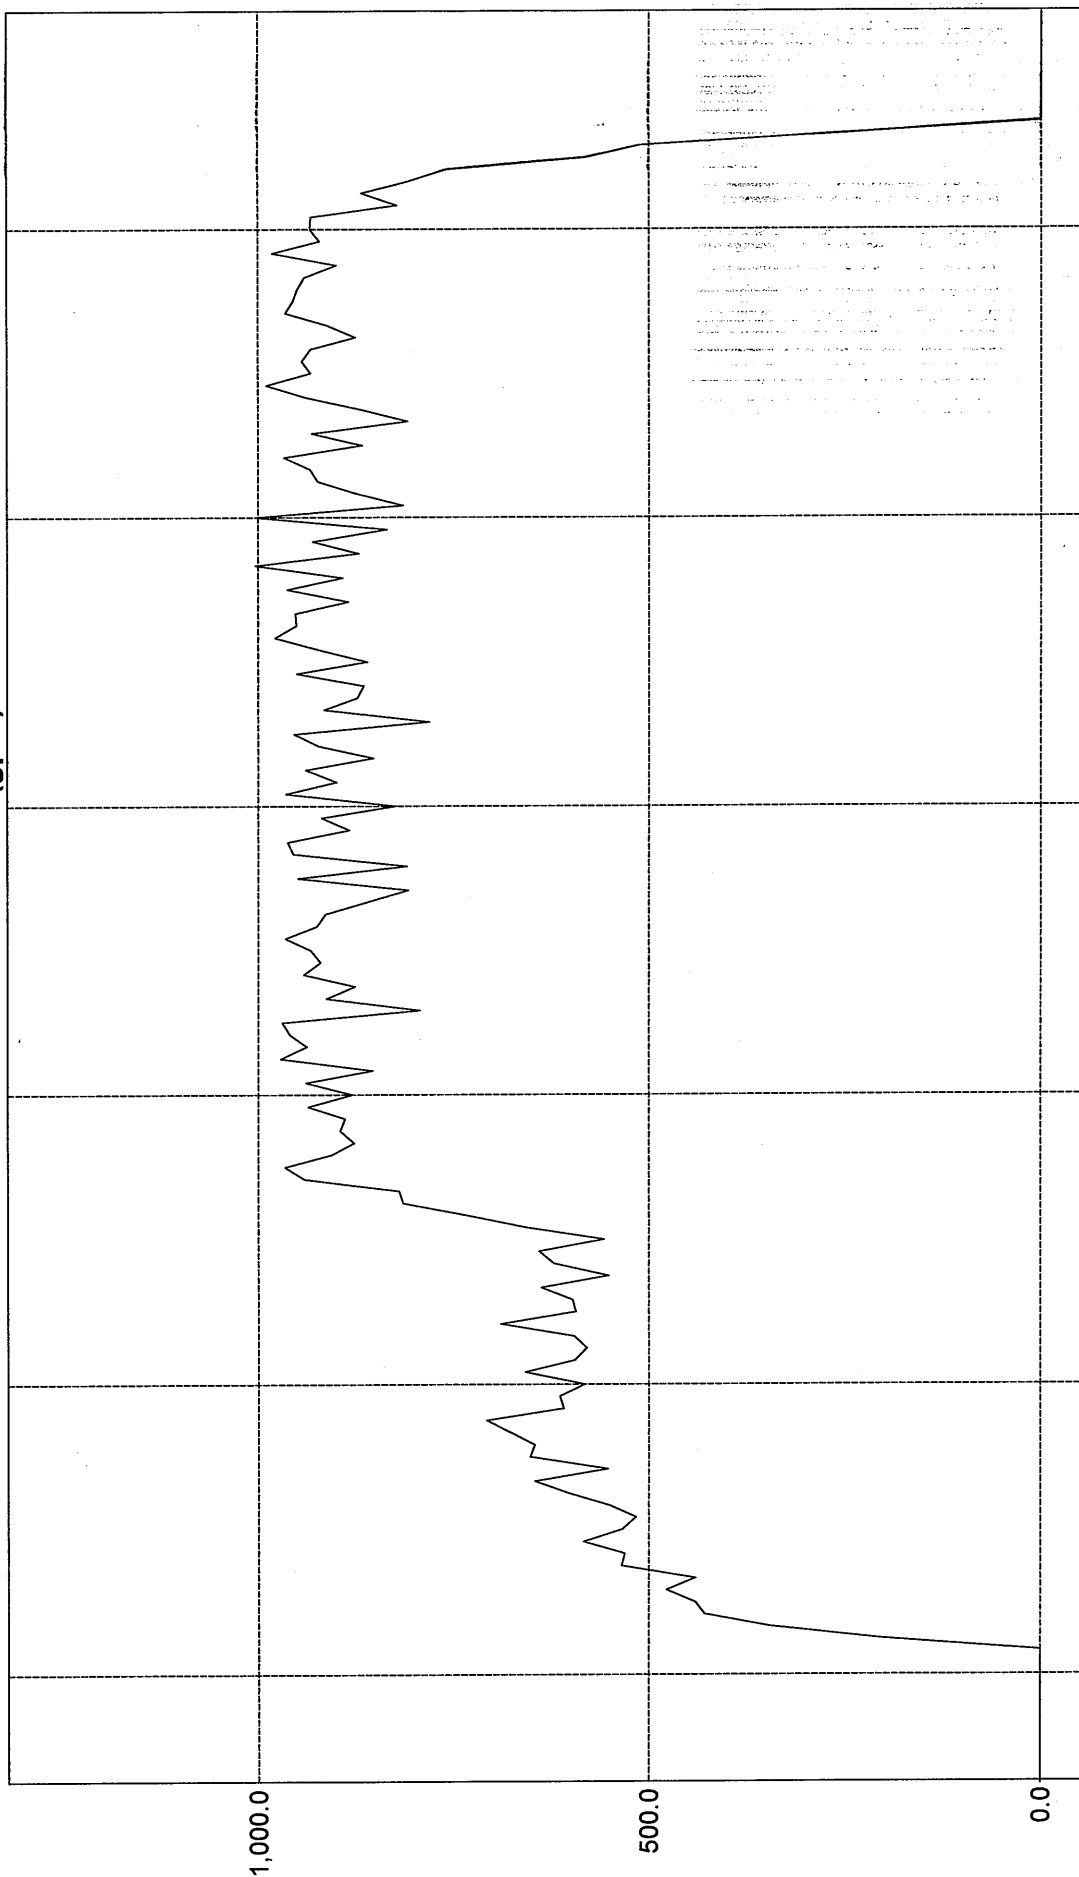

10:28:00 AM 3/3/2026 10:30:00 AM 3/3/2026 10:32:00 AM 3/3/2026 10:34:00 AM 3/3/2026 10:36:00 AM 3/3/2026 10:38:00 AM 3/3/2026

	Time	14209054 Pressure Flow Rate
867	3/3/2026 10:32:40 AM	912.3
868	3/3/2026 10:32:45 AM	875.8
869	3/3/2026 10:32:50 AM	941.2
870	3/3/2026 10:32:55 AM	920.0
871	3/3/2026 10:33:00 AM	932.3
872	3/3/2026 10:33:05 AM	965.0
873	3/3/2026 10:33:10 AM	924.5
874	3/3/2026 10:33:15 AM	913.9
875	3/3/2026 10:33:20 AM	861.4
876	3/3/2026 10:33:25 AM	807.6
877	3/3/2026 10:33:30 AM	948.7
878	3/3/2026 10:33:35 AM	809.1
879	3/3/2026 10:33:40 AM	955.0
880	3/3/2026 10:33:45 AM	962.2
881	3/3/2026 10:33:50 AM	882.9
882	3/3/2026 10:33:55 AM	918.4
883	3/3/2026 10:34:00 AM	823.6
884	3/3/2026 10:34:05 AM	964.1
885	3/3/2026 10:34:10 AM	899.2
886	3/3/2026 10:34:15 AM	938.6
887	3/3/2026 10:34:20 AM	852.2
888	3/3/2026 10:34:25 AM	922.7
889	3/3/2026 10:34:30 AM	953.7
890	3/3/2026 10:34:35 AM	780.6
891	3/3/2026 10:34:40 AM	915.0
892	3/3/2026 10:34:45 AM	872.7
893	3/3/2026 10:34:50 AM	864.5
894	3/3/2026 10:34:55 AM	950.2
895	3/3/2026 10:35:00 AM	860.2
896	3/3/2026 10:35:05 AM	922.3
897	3/3/2026 10:35:10 AM	978.5
898	3/3/2026 10:35:15 AM	951.3
899	3/3/2026 10:35:20 AM	952.0
900	3/3/2026 10:35:25 AM	884.3