

ALL WORK UNDER THE COUNTY RIGHT-OF-WAY SHALL CONFORM BROWARD COUNTY MINIMUM STANDARDS (BCMS) SUBGRADE BCMS 6-1.6

- A. LRB MINIMUM OF 40
- B. TOP 12" OF UNDISTURBED SOIL SHALL BE COMPACTED TO 100% MAXIMUM DRY DENSITY PER AASHTO T-99C BASE BCMS 6-1.7
- C. TWELVE (12) INCH CONSTRUCTED IN TWO SIX (6) INCH LIFTS
- D. CARBONATE CEMENT MINIMUM 70% AND LRB MINIMUM OF 100%
- E. COMPACTED TO A MINIMUM 98% MAXIMUM DRY DENSITY PER AASHTO T-180

WEARING COURSE BCMS 6-1.8

- F. MINIMUM TOTAL THICKNESS OF TWO AND HALF (2 1/2) INCHES OF ASPHALTIC CONCRETE IN TWO (2) LIFTS, FOR FORMS

3) STRUCTURAL COURSE TYPE SP ASPHALT CONCRETE MIXTURE PER FDOT STANDARD SPECIFICATIONS SECTION 334 (344-1.4.1) 1 1/2 INCHES MINIMUM

2) FRICTION COURSE PER FDOT FLEXIBLE PAVEMENT DESIGN MANUAL TABLE 4.1 (1 INCH MINIMUM)

3) TACK COAT SHALL BE USED BETWEEN PAVING COURSES
4) PRIME COAT SHALL BE USED ON THE FINISHED ROCK BASE



REVISIONS

DATE

THIS DOCUMENT HAS BEEN
DIGITALLY SIGNED AND
SEALED BY STEPHEN F. BOTEK
P.E. ON THE DATE ADJACENT
TO THE SEAL.

**PRINTED COPIES OF THIS
DOCUMENT ARE NOT
CONSIDERED SIGNED AND
SEALED AND THE SIGNATURE
MUST BE VERIFIED ON ANY
ELECTRONIC COPIES.**

PAVING AND GRADING DETAILS

O BEACH MARINE CENTER

Pompano Beach, Florida 33062


**Botek Thurlow
Engineering, Inc.**

BTE PROJECT #:
23-1102


PROJECT DATE:
7-9-25

SHEET #:


C-2.2

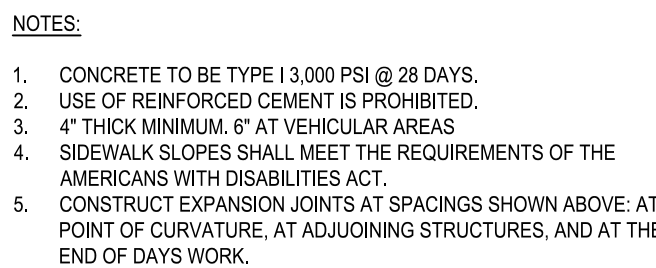

NTS

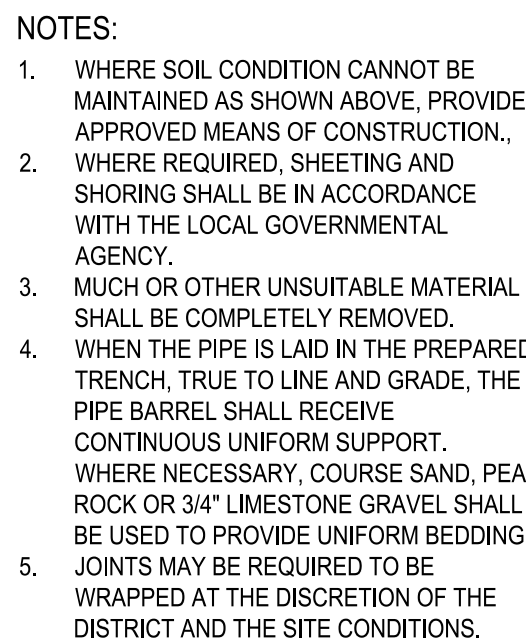

NTS

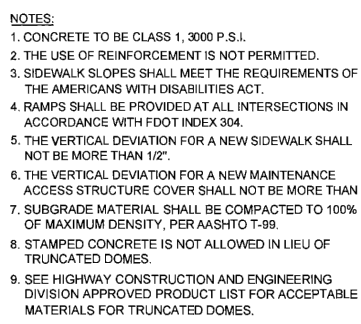

N.T.S.

