

**From:** James Hampson <jhampson@velocityfireprotection.com>

**Sent:** Tuesday, July 19, 2022 7:10:07 PM

**To:** Tom Benedict <tom@thebenedictgroup.com>

**Subject:** RE: Pompano Beach flow test question

Good evening,

We performed the flow test this morning for 3232 NE 12<sup>th</sup> Street at 9:23am. Aaron Lyons, Water/Reuse Distribution Manager, witnessed this flow test. I have attached his contact info if needed.

Static 80 psi

Residual 71 psi


Flow from 2.5 was 1190 gpm at 50 psi

If you have any questions, please don't hesitate to contact us.

Thank you,

James Hampson

772.607.1220



<https://velocityfireprotection.com/about-us/>




**Aaron Lyons**  
Water/Reuse Distribution Manager

**City of Pompano Beach**  
1201 NE 3rd Avenue  
Pompano Beach, FL 33060  
Phone: 954-786-5511  
Fax: 954-786-4003  
aaron.lyons@copbfl.com  
pompanobeachfl.gov

**DRC**  
All-America City

PZ22-12000015

10/5/2022

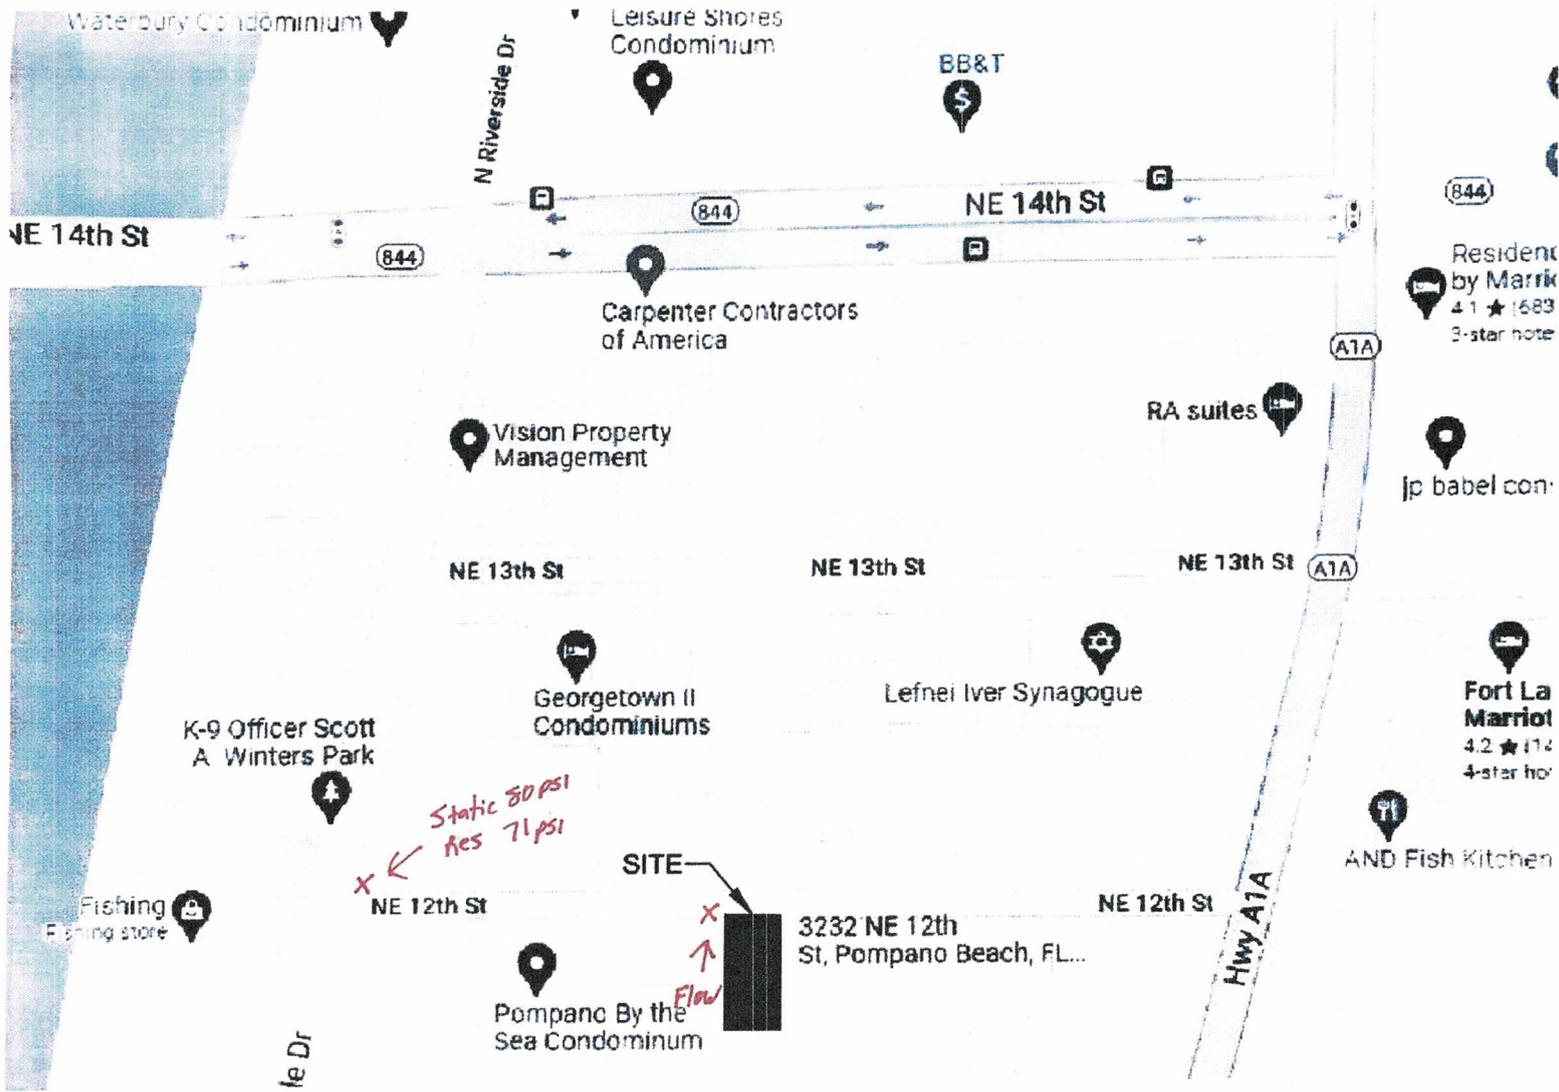

# DRC

PZ22-12000015

10/5/2022



# DRC

PZ22-12000015

10/5/2022



**DRC**

PZ22-1200015

10/5/2022



**DRC**

PZ22-12000015

10/5/2022