
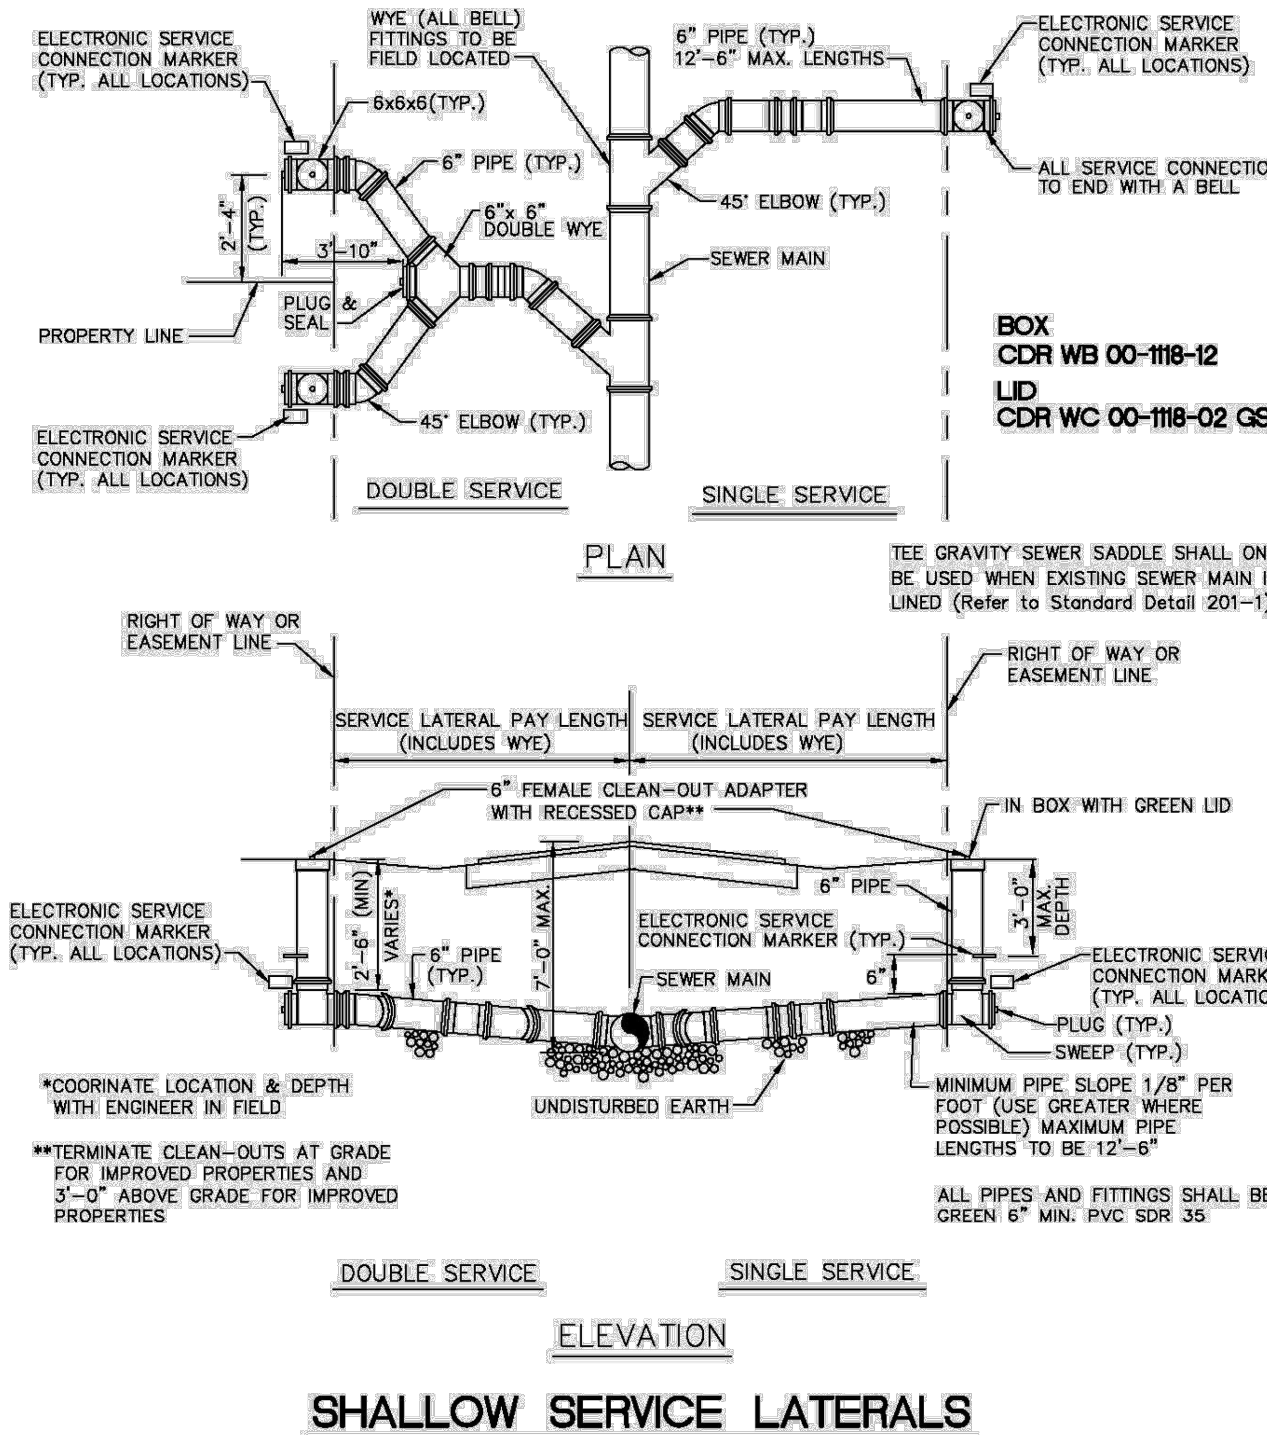


Plotted By: Fernandez, Giovanni Sheet Set: MILLCREEK POMPANO Layout: C-404 WATER & SEWER DETAILS November 21, 2025 04:05:53pm K:\ETL\_Civil\043 jobs\043175014 Mill Creek POMPANO\Design\CADD\Plots\Sheets\C-UTIL-DTL.dwg  
This document, together with the concepts and designs presented herein, is an instrument of service, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

PROTECTION OF POTABLE WATER SUPPLY NOTES

- A. GENERAL**  
IN ADDITION TO THESE REQUIREMENTS, ALL POTABLE WATER MAINS CONSTRUCTED IN THE VICINITY OF STORM SEWERS, SANITARY SEWERS OR FORCE MAINS SHALL COMPLY WITH THE APPLICABLE PROVISIONS OF FLORIDA ADMINISTRATIVE CODE CHAPTER 62-555, GREAT LAKES-UPPER MISSISSIPPI RIVER BOARD OF STATE SANITARY ENGINEERS (GLUMRB) "RECOMMENDED STANDARDS FOR WATER WORKS", AND GLUMRB "RECOMMENDED STANDARDS FOR WASTEWATER FACILITIES".
- B. DEFINITIONS**  
FOR THE PURPOSES OF THIS SPECIFICATION, THE WORDS "OTHER PIPE" OR "OTHER PIPES" SHALL MEAN SANITARY SEWER MAIN, SEWAGE FORCE MAIN, STORMWATER MAIN OR ANY COMBINATION THEREOF.
- C. CROSS CONNECTIONS PROHIBITED**  
THERE SHALL BE NO PHYSICAL CONNECTIONS BETWEEN A PUBLIC OR PRIVATE POTABLE WATER SUPPLY SYSTEM AND ANY OTHER PIPE OR APPURTENANCE THERE TO WHICH WOULD PERMIT THE PASSAGE OF ANY WASTEWATER, POLLUTED WATER, OR ANY OTHER WATER INTO THE POTABLE SUPPLY. NO WATER PIPE SHALL PASS THROUGH OR COME INTO CONTACT WITH ANY PART OF A SANITARY SEWER MANHOLE OR STORMWATER MANHOLE.
- D. RELATION OF OTHER PIPES TO POTABLE WATER MAINS**
- 1. HORIZONTAL SEPARATION**
- A.** NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST THREE FEET BETWEEN THE OUTSIDE OF THE WATER MAIN AND THE OUTSIDE OF ANY EXISTING OR PROPOSED STORM WATER, STORM WATER FORCE MAIN, OR PIPELINE CONVEYING REUSE WATER NOT REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C.
- B.** NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST THREE FEET, AND PREFERABLY TEN FEET, BETWEEN THE OUTSIDE OF THE WATER MAIN AND THE OUTSIDE OF ANY EXISTING OR PROPOSED VACUUM-TYPE SANITARY SEWER.
- C.** NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST SIX FEET, AND PREFERABLY TEN FEET, BETWEEN THE OUTSIDE OF THE WATER MAIN AND THE OUTSIDE OF ANY EXISTING OR PROPOSED GRAVITY-OR PRESSURE-TYPE SANITARY SEWER, WASTEWATER FORCE MAIN, OR PIPELINE CONVEYING REUSE WATER NOT REGULATED UNDER CHAPTER 62-610, F.A.C. THE MINIMUM HORIZONTAL SEPARATION DISTANCE BETWEEN WATER MAINS AND GRAVITY TYPE SEWERS SHALL BE REDUCED TO THREE FEET WHERE THE BOTTOM OF THE WATER IS LAID AT LEAST SIX INCHES ABOVE THE TOP OF THE SEWER.

- D.** NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST TEN FEET BETWEEN THE OUTSIDE OF THE WATER MAIN AND ALL PARTS OF ANY EXISTING OR PROPOSED "ON-SITE SEWAGE TREATMENT AND DISPOSAL SYSTEM".
- 2. VERTICAL SEPARATION**
- A.** NEW OR RELOCATED, UNDERGROUND WATER MAINS CROSSING ANY EXISTING OR PROPOSED GRAVITY-OR VACUUM-TYPE SANITARY SEWER OR STORM SEWER SHALL BE LAID SO THE OUTSIDE OF THE WATER MAIN IS AT LEAST SIX INCHES, AND PREFERABLY 12 INCHES, ABOVE OR AT LEAST 12 INCHES BELOW THE OUTSIDE OF THE OTHER PIPELINE. HOWEVER, IT IS PREFERABLE TO LAY THE WATER MAIN ABOVE THE OTHER PIPELINE.
- B.** NEW OR RELOCATED, UNDERGROUND WATER MAINS CROSSING ANY EXISTING OR PROPOSED PRESSURE-TYPE SANITARY SEWER, WASTEWATER OR STORM WATER FORCE MAIN, OR PIPELINE CONVEYING REUSE WATER SHALL BE LAID SO THE OUTSIDE OF THE WATER MAIN IS AT LEAST 12 INCHES, ABOVE OR BELOW THE OUTSIDE OF THE OTHER PIPELINE. HOWEVER, IT IS PREFERABLE TO LAY THE WATER MAIN ABOVE THE OTHER PIPELINE.
- C.** AT THE UTILITY CROSSINGS DESCRIBED IN PARAGRAPHS (A) AND (B) ABOVE, ONE FULL LENGTH OF WATER MAIN PIPE SHALL BE CENTERED ABOVE OR BELOW THE OTHER PIPELINE SO THE WATER MAIN JOINTS WILL BE AS FAR AS POSSIBLE FROM THE OTHER PIPELINE. ALTERNATIVELY, AT SUCH CROSSINGS, THE PIPES SHALL BE ARRANGED SO THAT ALL WATER MAIN JOINTS ARE AT LEAST THREE FEET FROM ALL JOINTS IN VACUUM-TYPE SANITARY SEWERS, STORM SEWERS, STORM WATER FORCE MAINS, OR PIPELINES CONVEYING REUSE WATER REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C. AND AT LEAST SIX FEET FROM ALL JOINTS IN GRAVITY-OR PRESSURE-TYPE SANITARY SEWERS, WASTEWATER FORCE MAINS, OR PIPELINES CONVEYING REUSE WATER NOT REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C. WHERE THE HORIZONTAL CAN BEING LOCATED LESS THAN THE REQUIRED MINIMUM DISTANCES FROM JOINTS IN THE OTHER PIPELINE OR THE HORIZONTAL IS LESS THAN THREE FEET FROM ANOTHER PIPELINE OR THE UNDERGROUND WATER MAIN IS CROSSING ANOTHER PIPELINE AND IS LESS THAN THE REQUIRED MINIMUM VERTICAL DISTANCE FROM THE OTHER PIPELINE, THE CONTRACTOR SHALL CONTACT THE ENGINEER IMMEDIATELY FOR RECOMMENDED SOLUTIONS TO MEET THE FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION REQUIREMENTS PER CHAPTER 62-555, F.A.C.




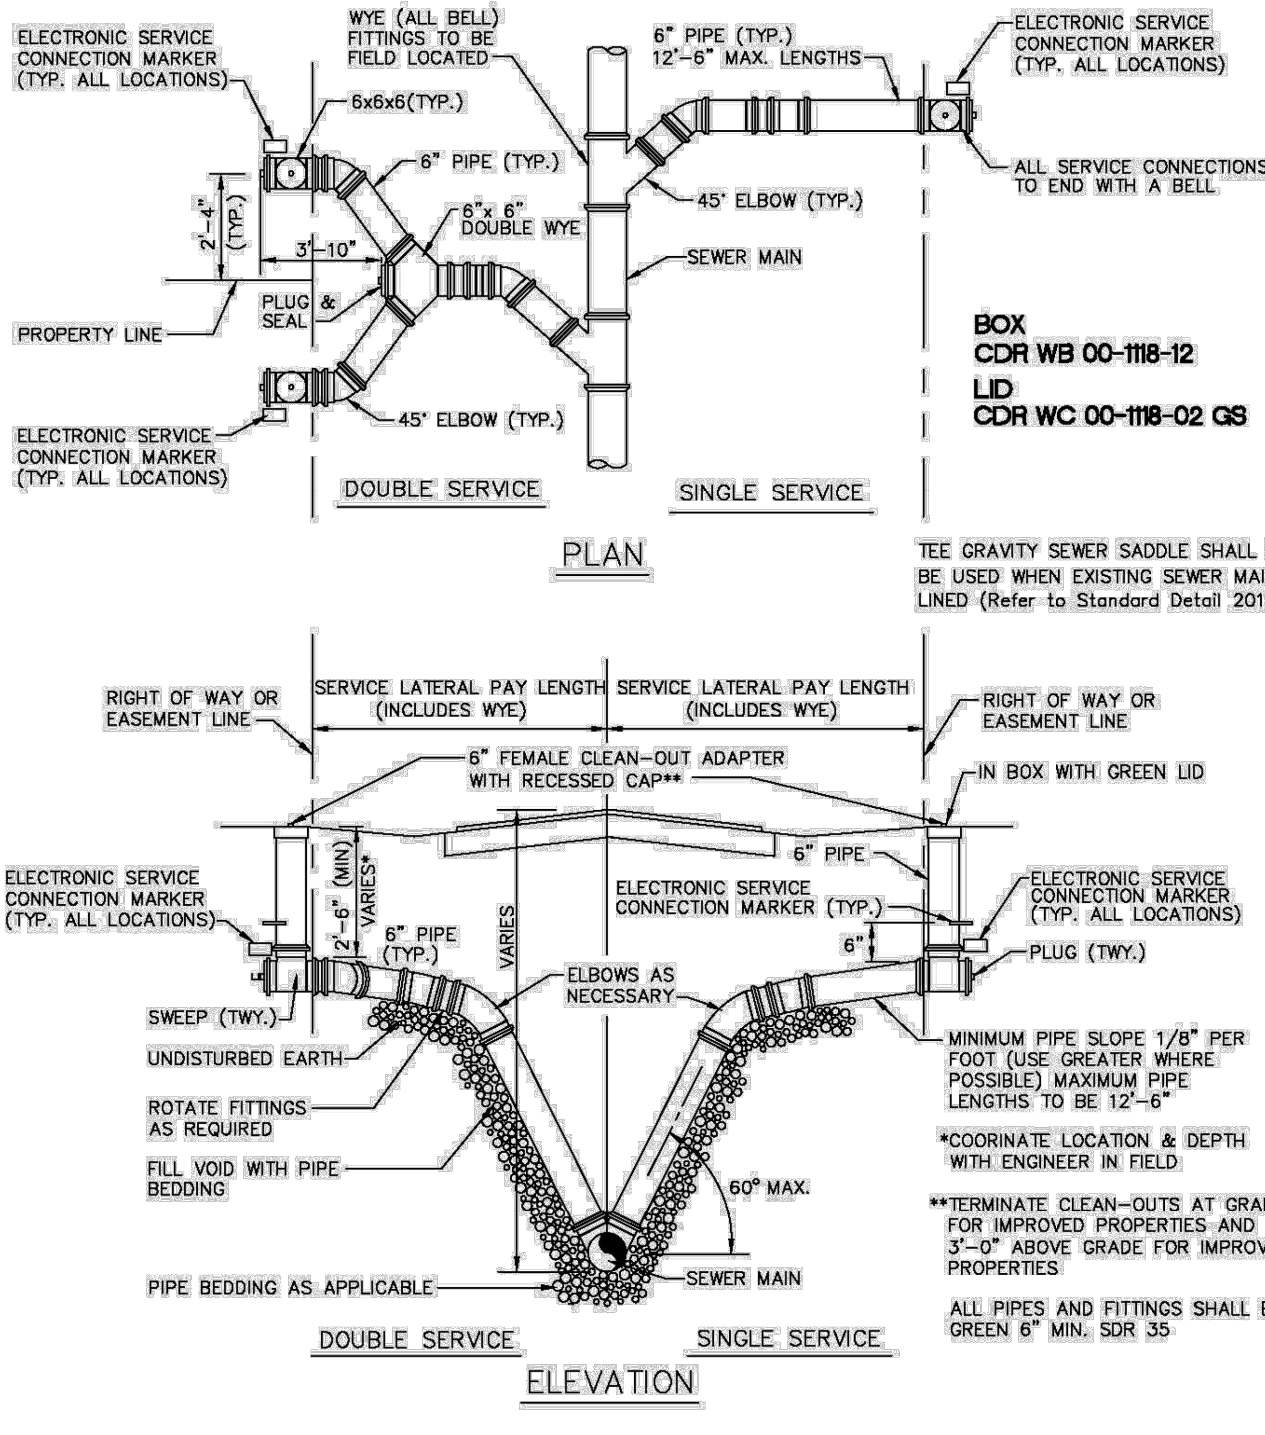


ENGINEERING STANDARDS 2025		
REVISIONS		POTABLE WATER SUPPLY NOTES
BY	DATE	
S.S.	01/12	CITY OF POMPANO BEACH
		DATE: JAN. 2022 DWG. NO. 122-2
		SCALE: N.T.S.

ENGINEERING STANDARDS 2025		
REVISIONS		POTABLE WATER SUPPLY NOTES
BY	DATE	
S.S.	01/12	CITY OF POMPANO BEACH
		DATE: JAN. 2022 DWG. NO. 122-3
		SCALE: N.T.S.

ENGINEERING STANDARDS 2025		
REVISIONS		SERVICE LATERALS
BY	DATE	
T.W.	11-2007	CITY OF POMPANO BEACH
S.S.	01/27/12	
S.S.	07/10/12	
S.S.	02/05/16	
		DATE: JUNE 2022 DWG. NO. 200-1
		SCALE: N.T.S.

ENGINEERING STANDARDS 2025		
REVISIONS		SERVICE LATERALS
BY	DATE	
T.W.	11-2007	CITY OF POMPANO BEACH
S.S.	01/27/12	
S.S.	07/10/12	
S.S.	02/05/16	
		DATE: JUNE 2022 DWG. NO. 200-2
		SCALE: N.T.S.

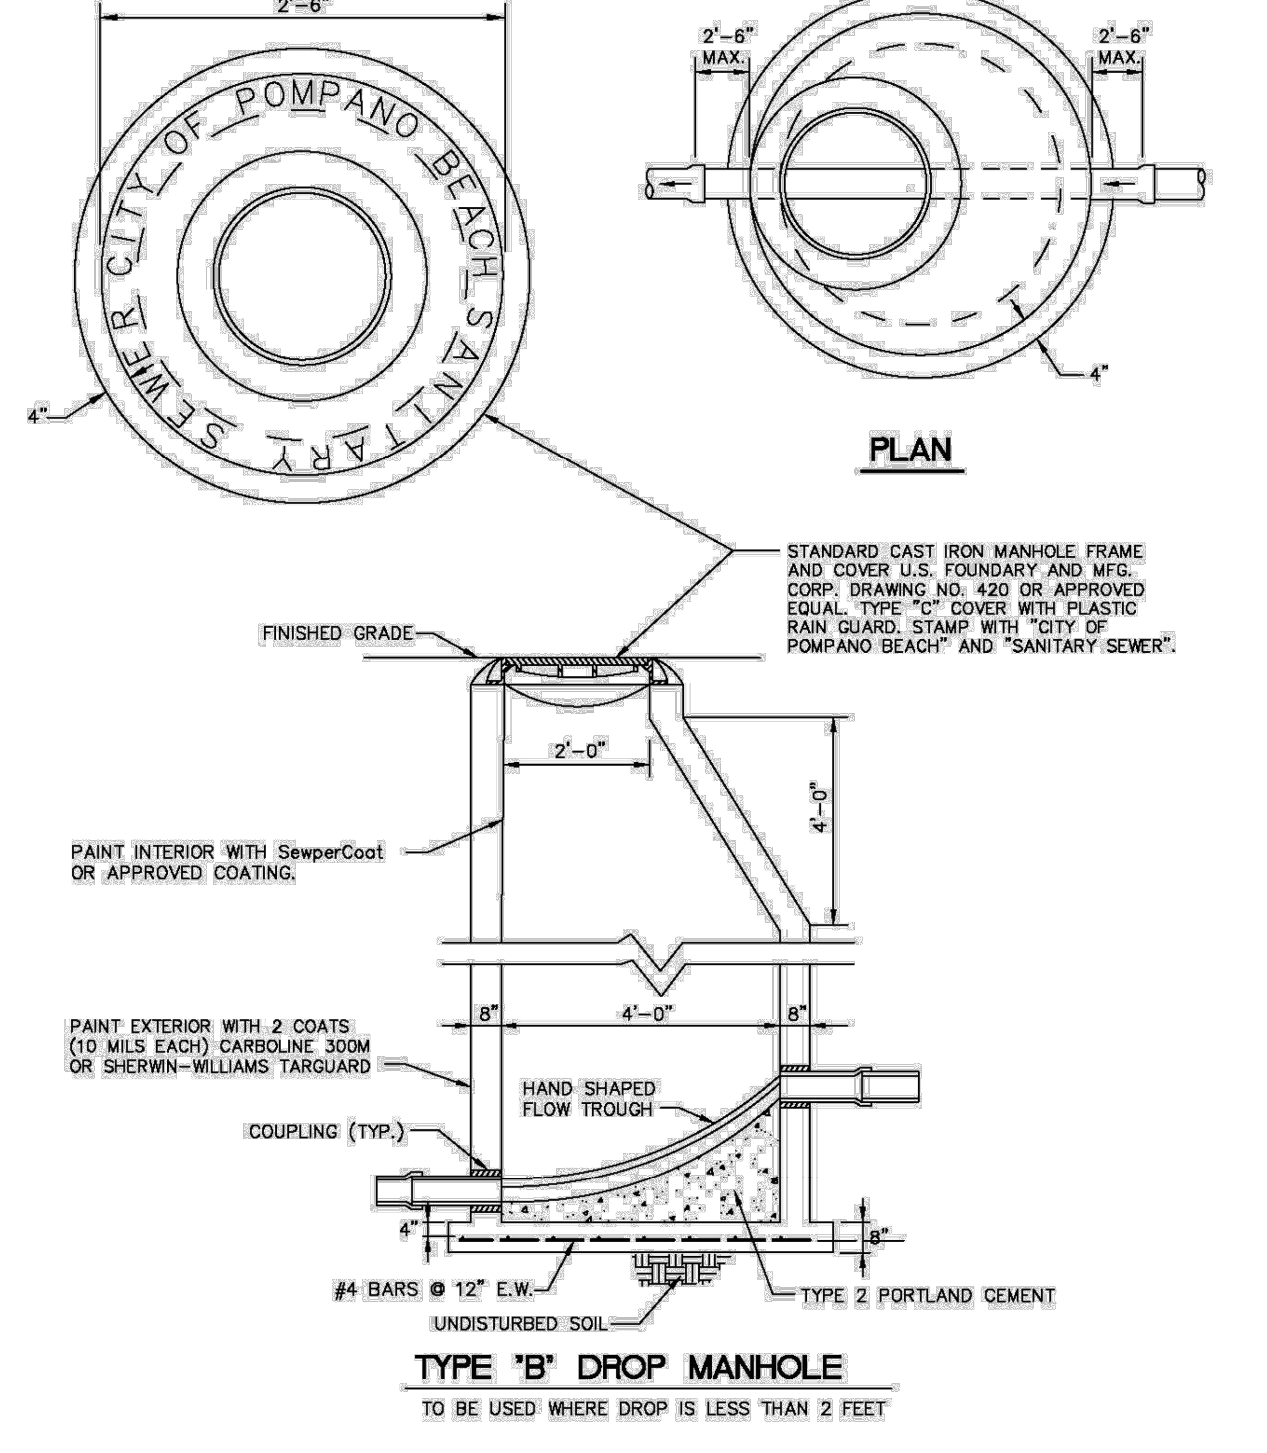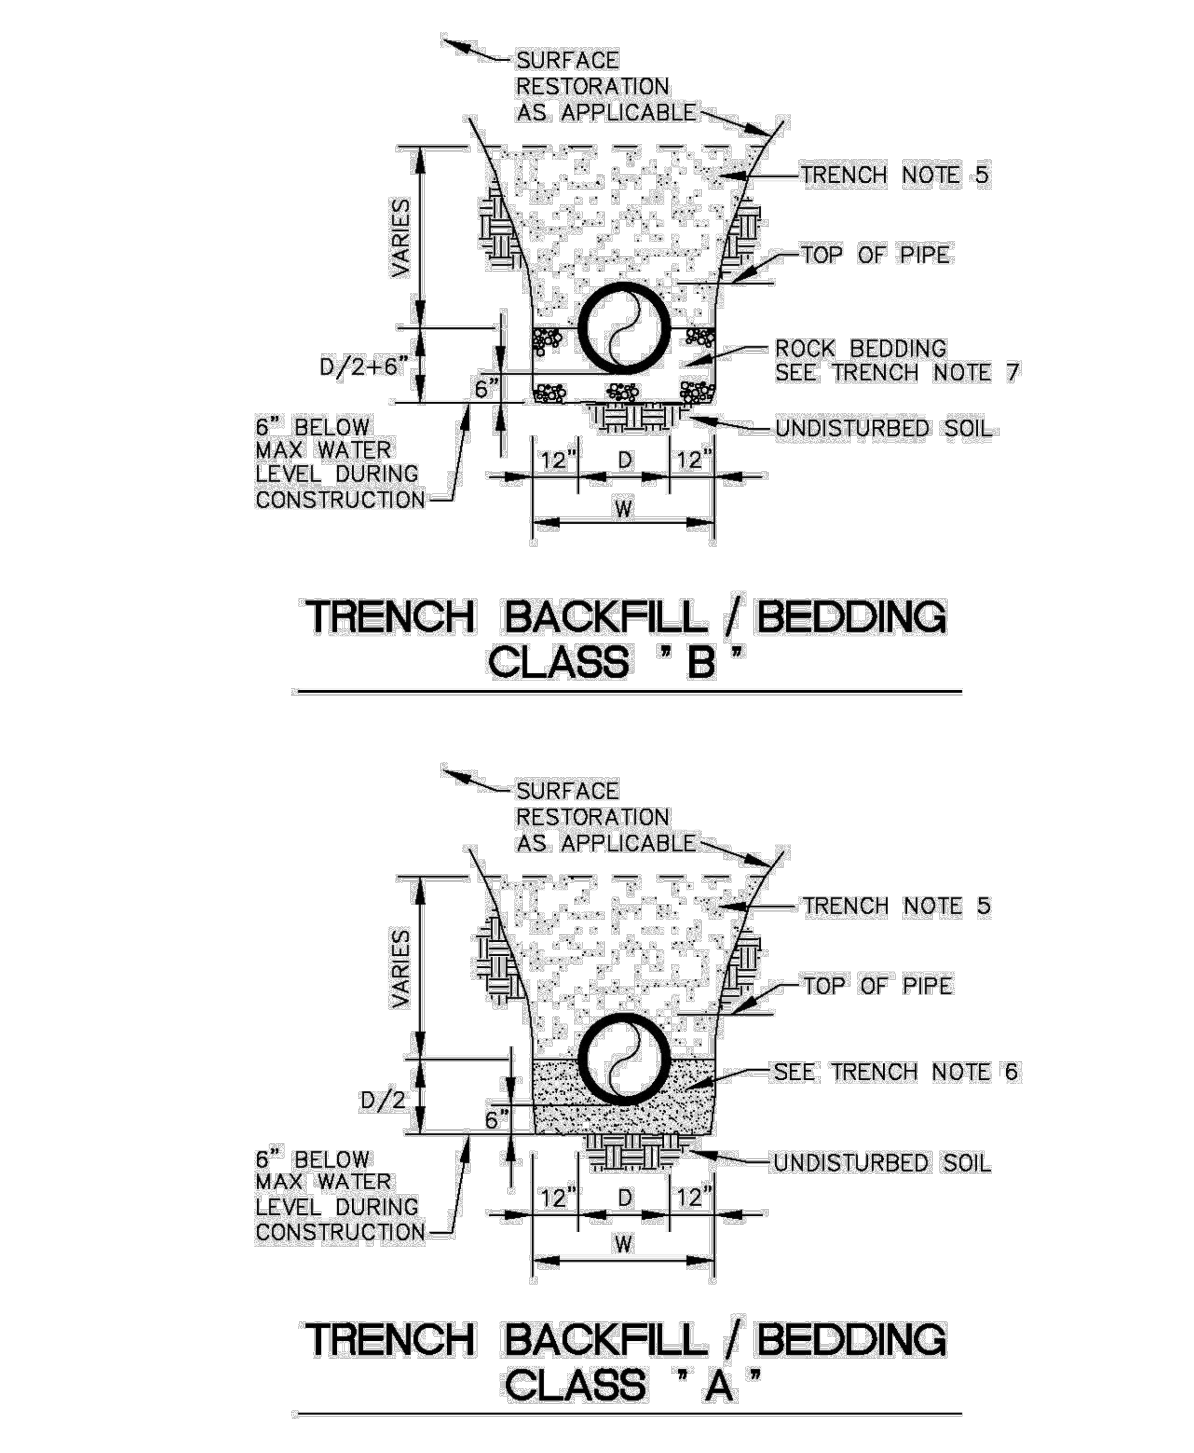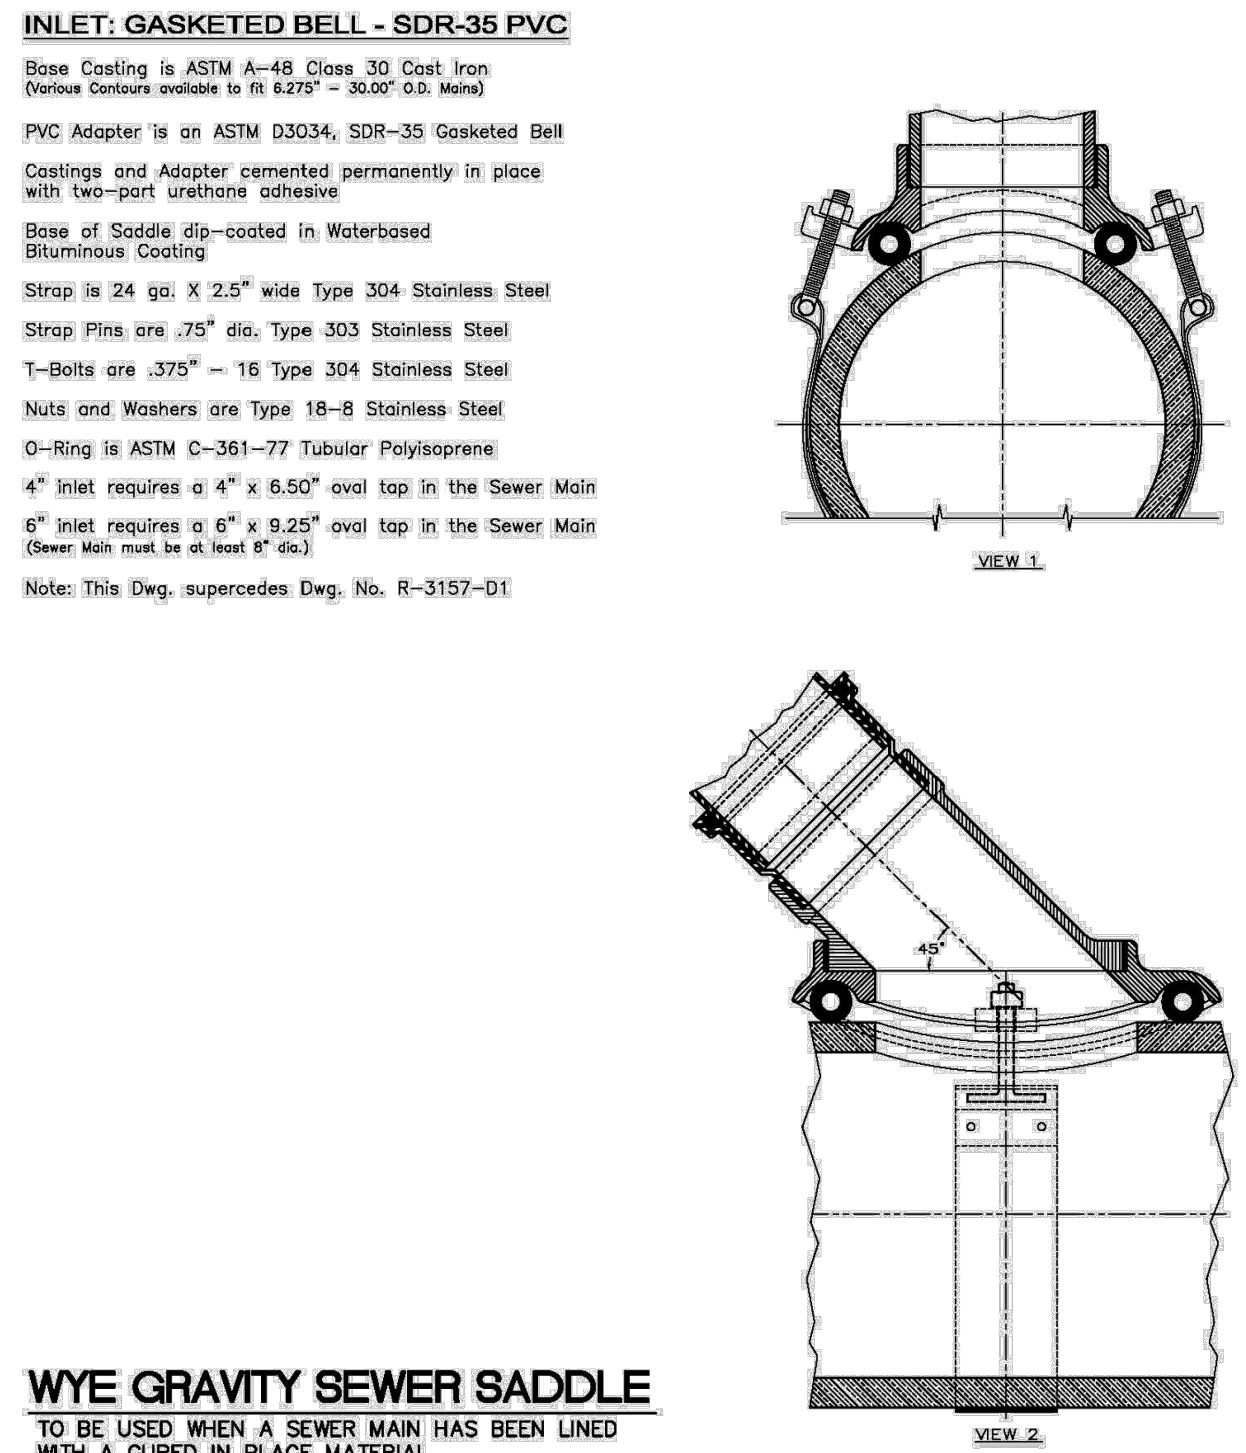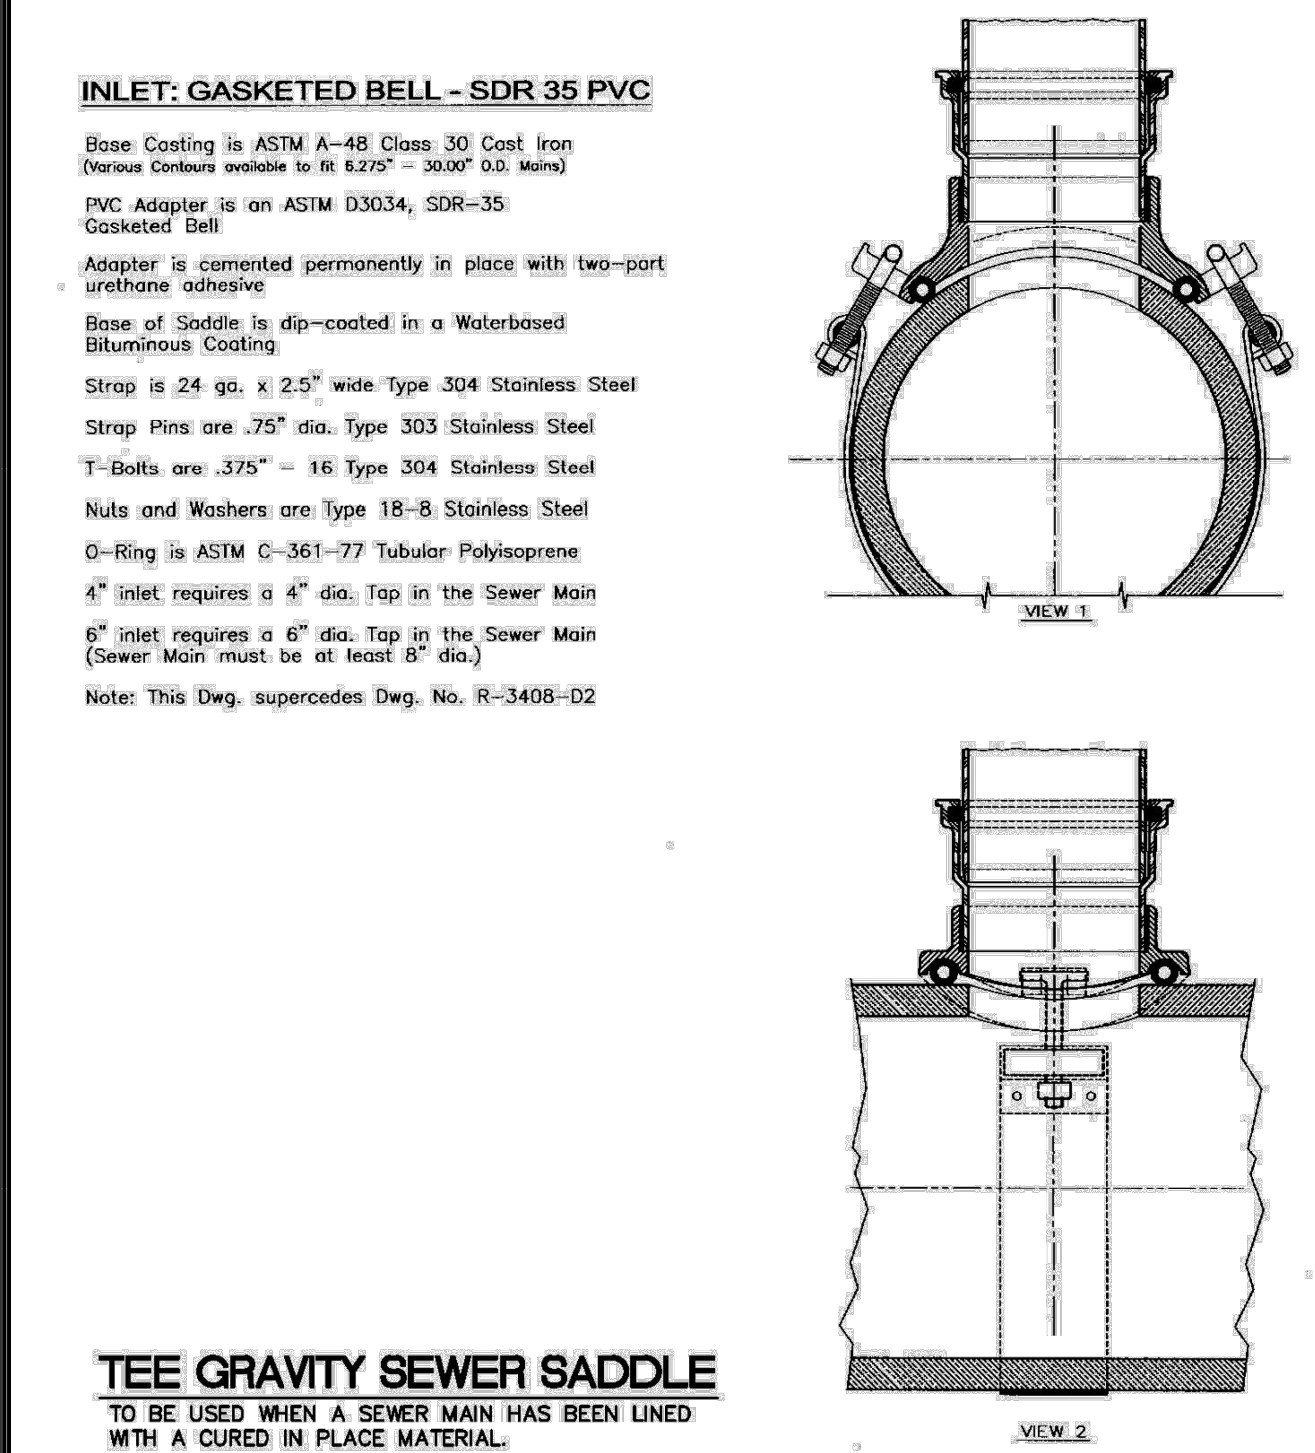

ENGINEERING STANDARDS 2025		
REVISIONS		TEE GRAVITY SEWER SADDLE
BY	DATE	
S.S.	11/23/16	CITY OF POMPANO BEACH
		DATE: MAY 2022 DWG. NO. 201-1
		SCALE: N.T.S.

ENGINEERING STANDARDS 2025		
REVISIONS		WYE GRAVITY SEWER SADDLE
BY	DATE	
		CITY OF POMPANO BEACH
		DATE: MAY 2022 DWG. NO. 201-2
		SCALE: N.T.S.


ENGINEERING STANDARDS 2025		
REVISIONS		TRENCH BACKFILL / BEDDING
BY	DATE	
S.S.	JUNE 2005	CITY OF POMPANO BEACH
		DATE: JUNE 2022 DWG. NO. 203-1
		SCALE: N.T.S.

ENGINEERING STANDARDS 2025		
REVISIONS		TYPE 'B' DROP MANHOLE
BY	DATE	
S.S.	JUNE 2005	CITY OF POMPANO BEACH
T.W.	11-2007	
S.S.	12-2013	
A.S.	09-2021	
		DATE: JUNE 2022 DWG. NO. 214-1
		SCALE: N.T.S.

DRC  
PZ25-12000028  
01/07/2026

Kimley»Horn

© 2025 KIMLEY-HORN AND ASSOCIATES, INC.  
8201 PETERS ROAD, SUITE 2200, PLANTATION, FL 33324  
PHONE: 954-555-5100 FAX: 954-739-2247  
WWW.KIMLEY-HORN.COM REGISTRY NO. 35106

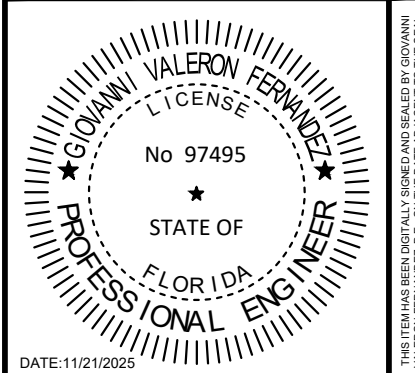

KHA PROJECT	043175014
DATE	11/6/2025
SCALE	AS SHOWN
DESIGNED BY	GVF
DRAWN BY	EA
CHECKED BY	GVF

WATER & SEWER  
DETAILS

MODERA POMPANO  
BEACH  
PREPARED FOR  
MCRT INVESTMENTS LLC  
FLORIDA  
POMPANO BEACH

SHEET NUMBER  
C-404