
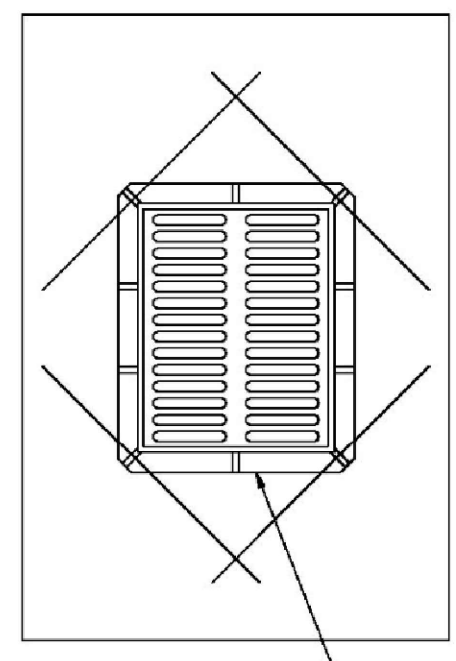


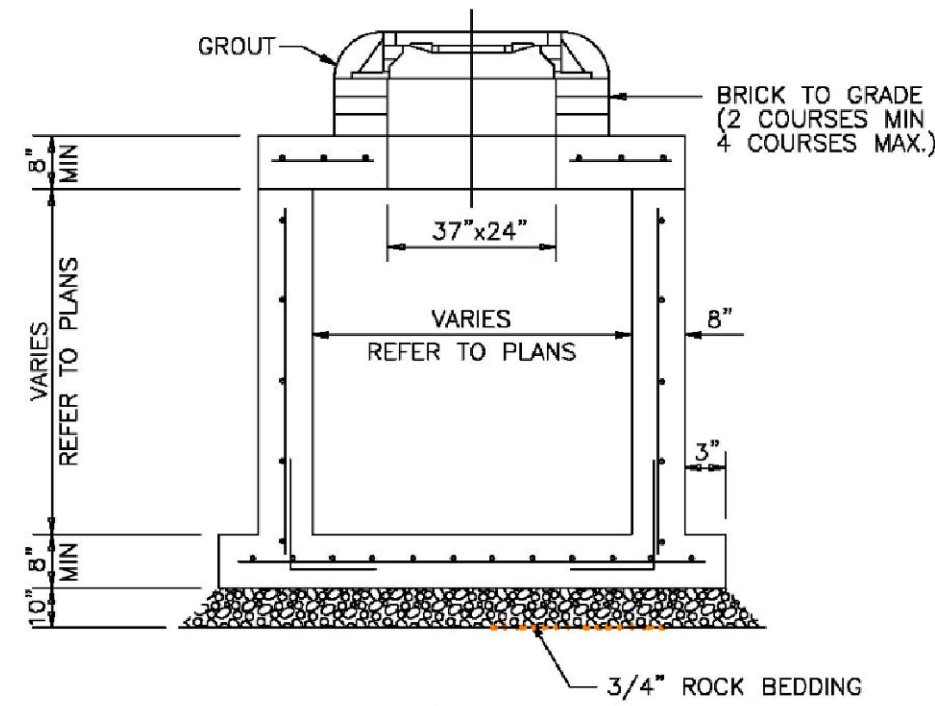

PLAN



U.S. FOUNDRY FRAME & GRATE
DRAWING No. 4155-6210 OR
(APPROVED EQUAL)

SECTION

- NOTES:
1. STEEL PER FDOT INDEX 425-010.
 2. MINIMUM 18" SUMP.
 3. TYPE II CEMENT, MINIMUM 4000 PSI COMPRESSIVE STRENGTH AT 28 DAYS.

ENGINEERING STANDARDS 2025

REVISIONS		ENGINEERING DIVISION	PRECAST DRAINAGE STRUCTURE
BY	DATE		
A.S.	04-24	CITY OF POMPAÑO BEACH	
		SCALE: N.T.S.	DATE: APRIL 2024 DWG. NO. 400-1A

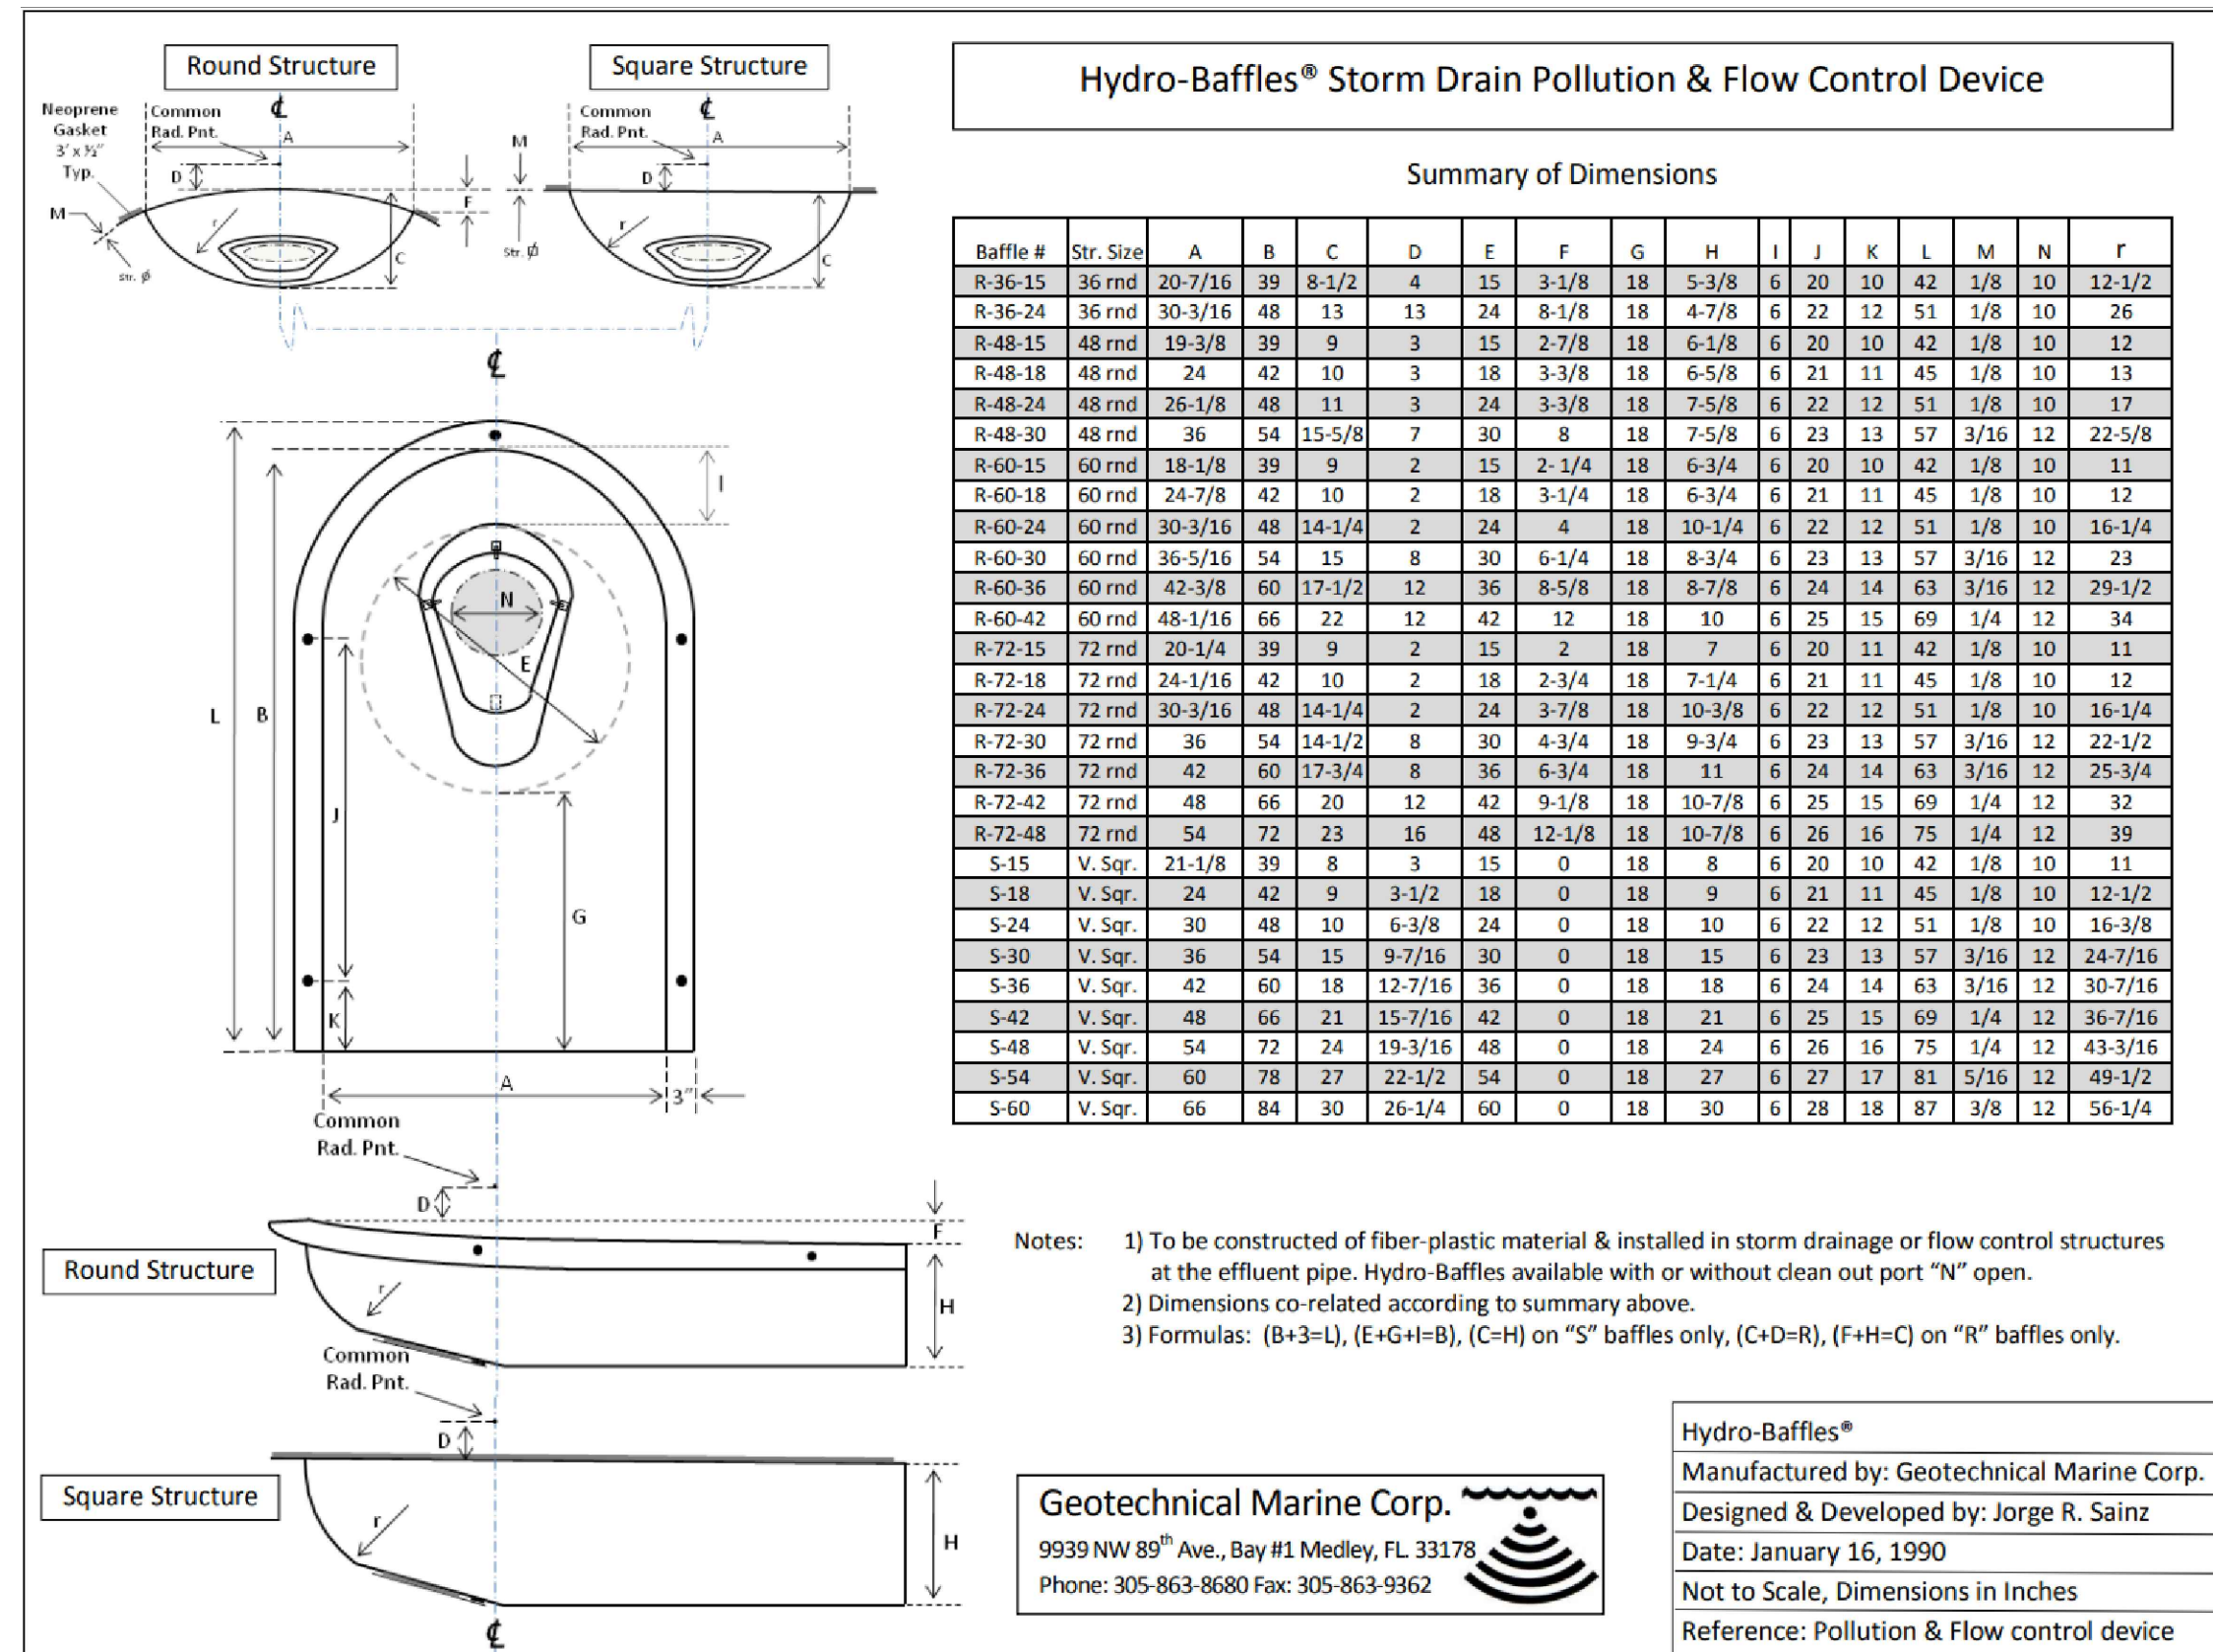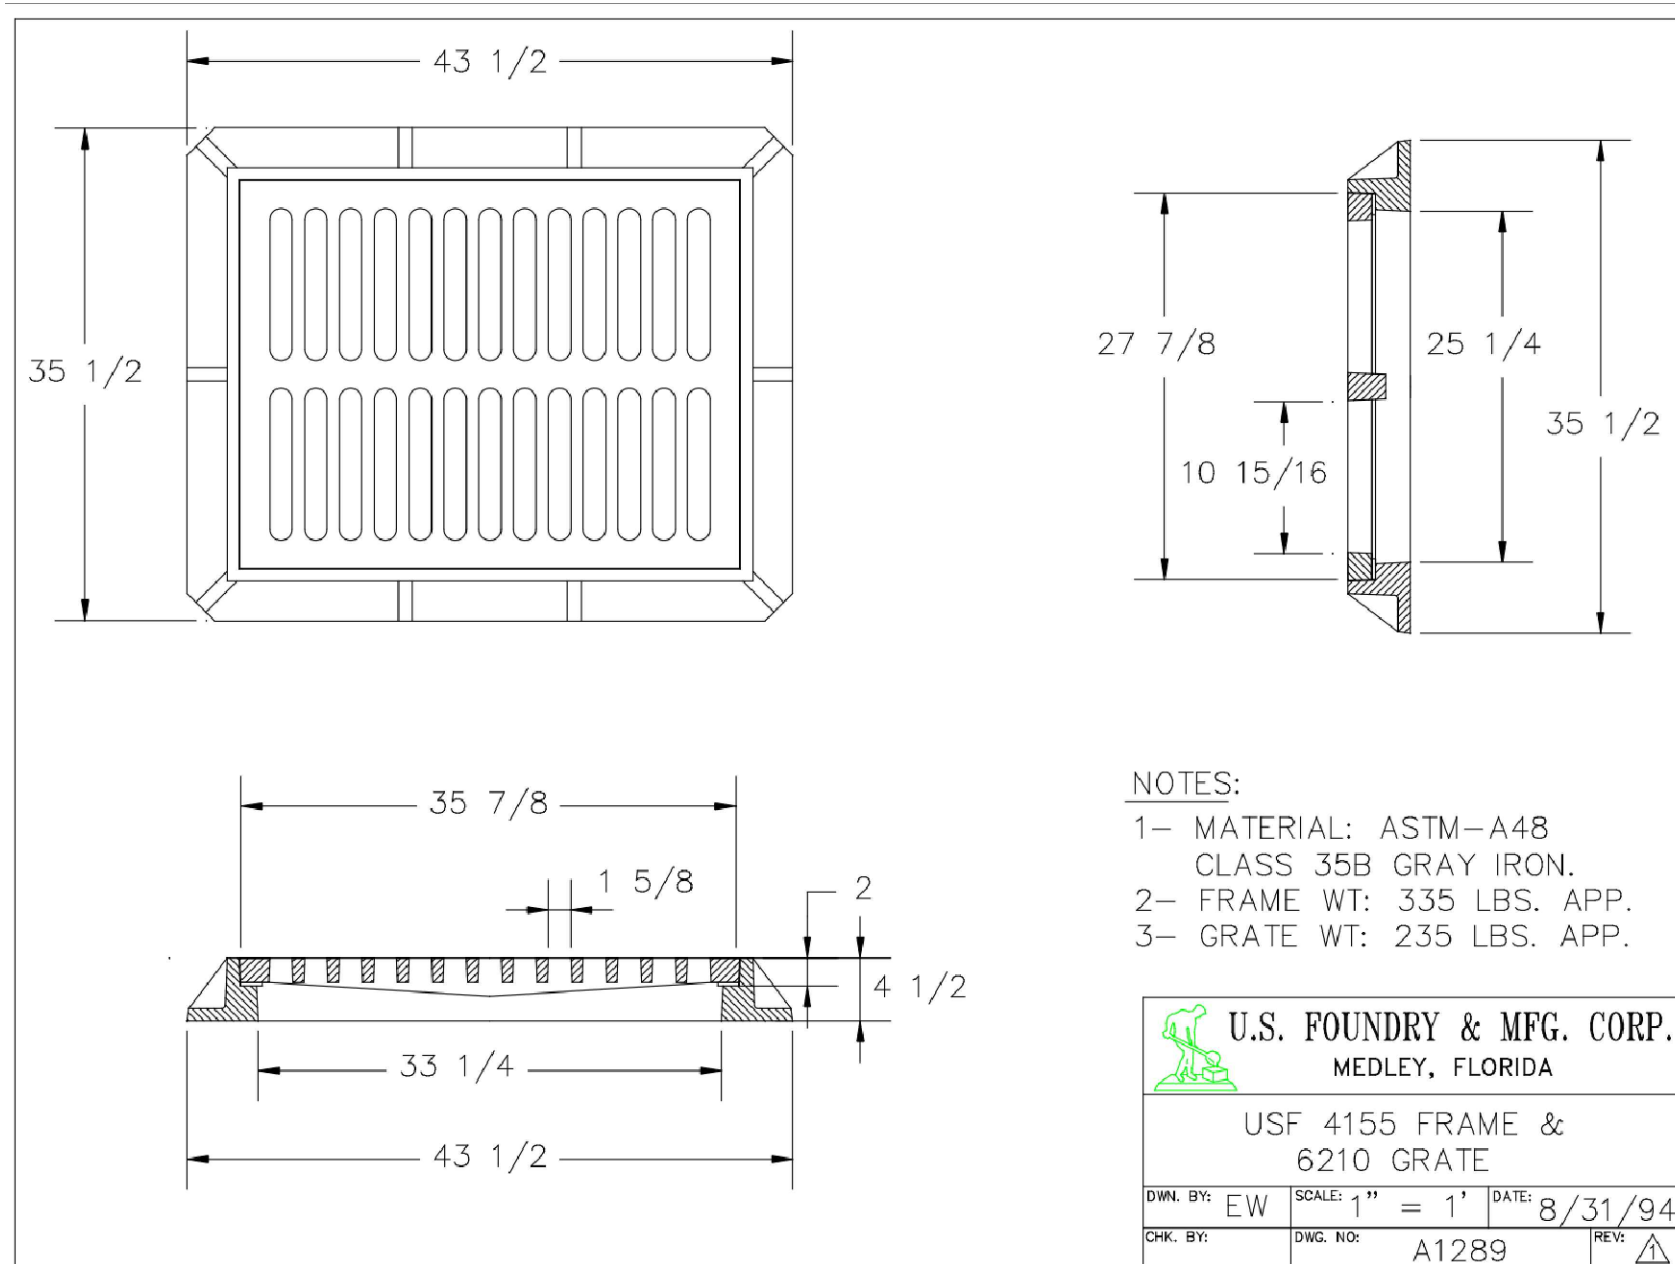

REVISIONS

△ REV:


△ REV:

△ REV:

△ REV:

PROPERTY ID:
484233030321

TRUTH & HOLINESS FULL GOSPEL
1210 NW 27 AVE
POMPAÑO BEACH FL 33069

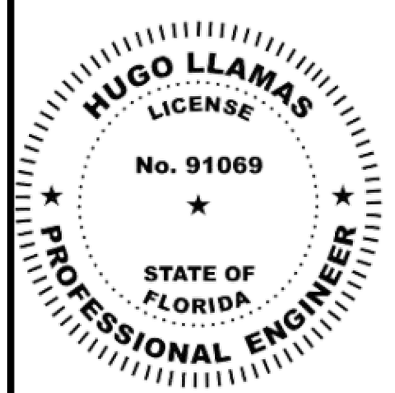

HUGO LLAMAS, P.E.
FL. LICENSE 91069

DATE 02-08-2026




SCALE AS SHOWN

DRAWN H.LL

ENGINEER OF RECORD HEREBY EXPRESSLY RESERVES HIS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THE DESIGNS AND DRAWINGS ARE NEITHER TO BE REPRODUCED, COPIED NOR CHANGED IN ANY FORM OR MANNER WHAT SO EVER NOR ASSIGNED TO ANY PARTY WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN PERMISSION AND CONSENT OF ALTO ENGINEERING P.A.

DETAILS PLAN
SHEET 3 OF 4

C-3

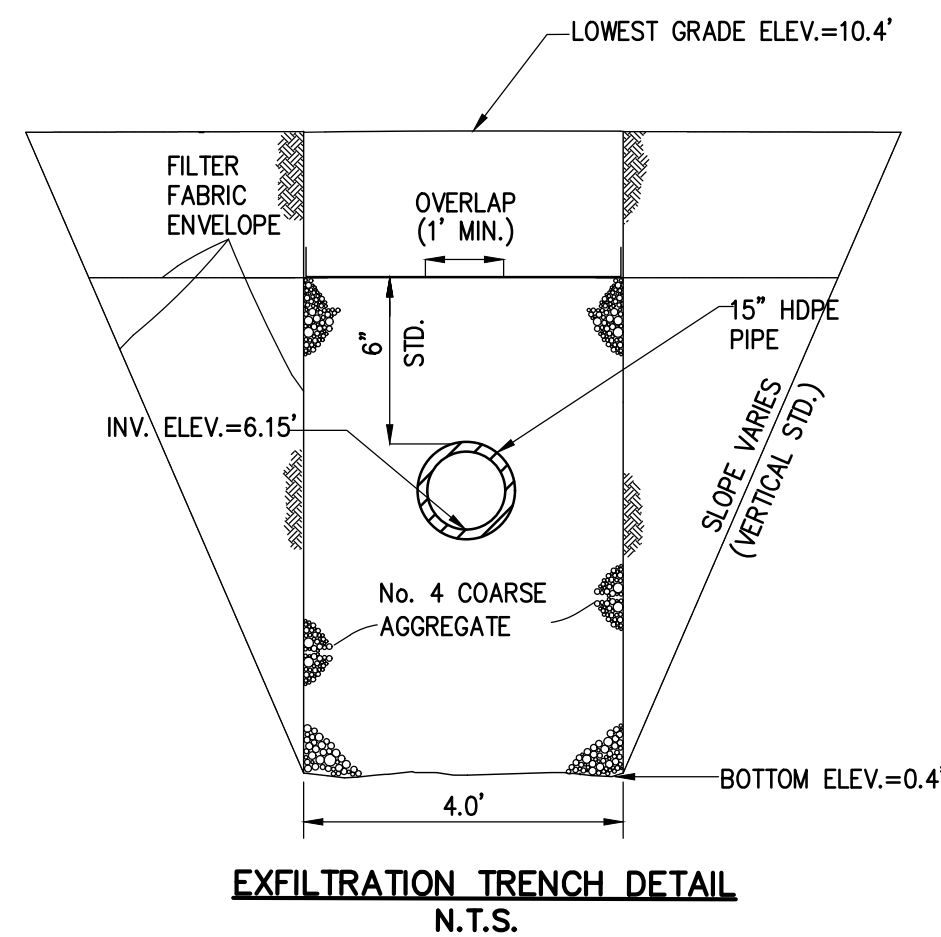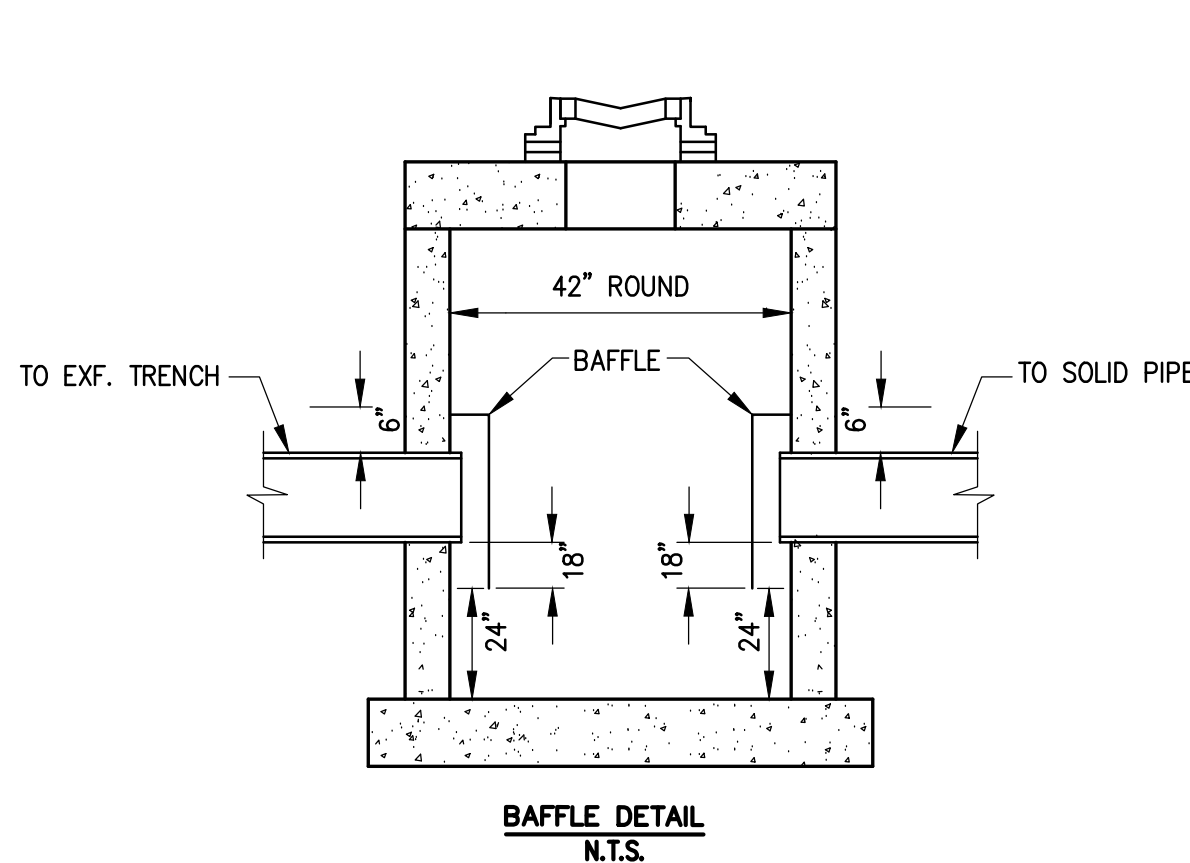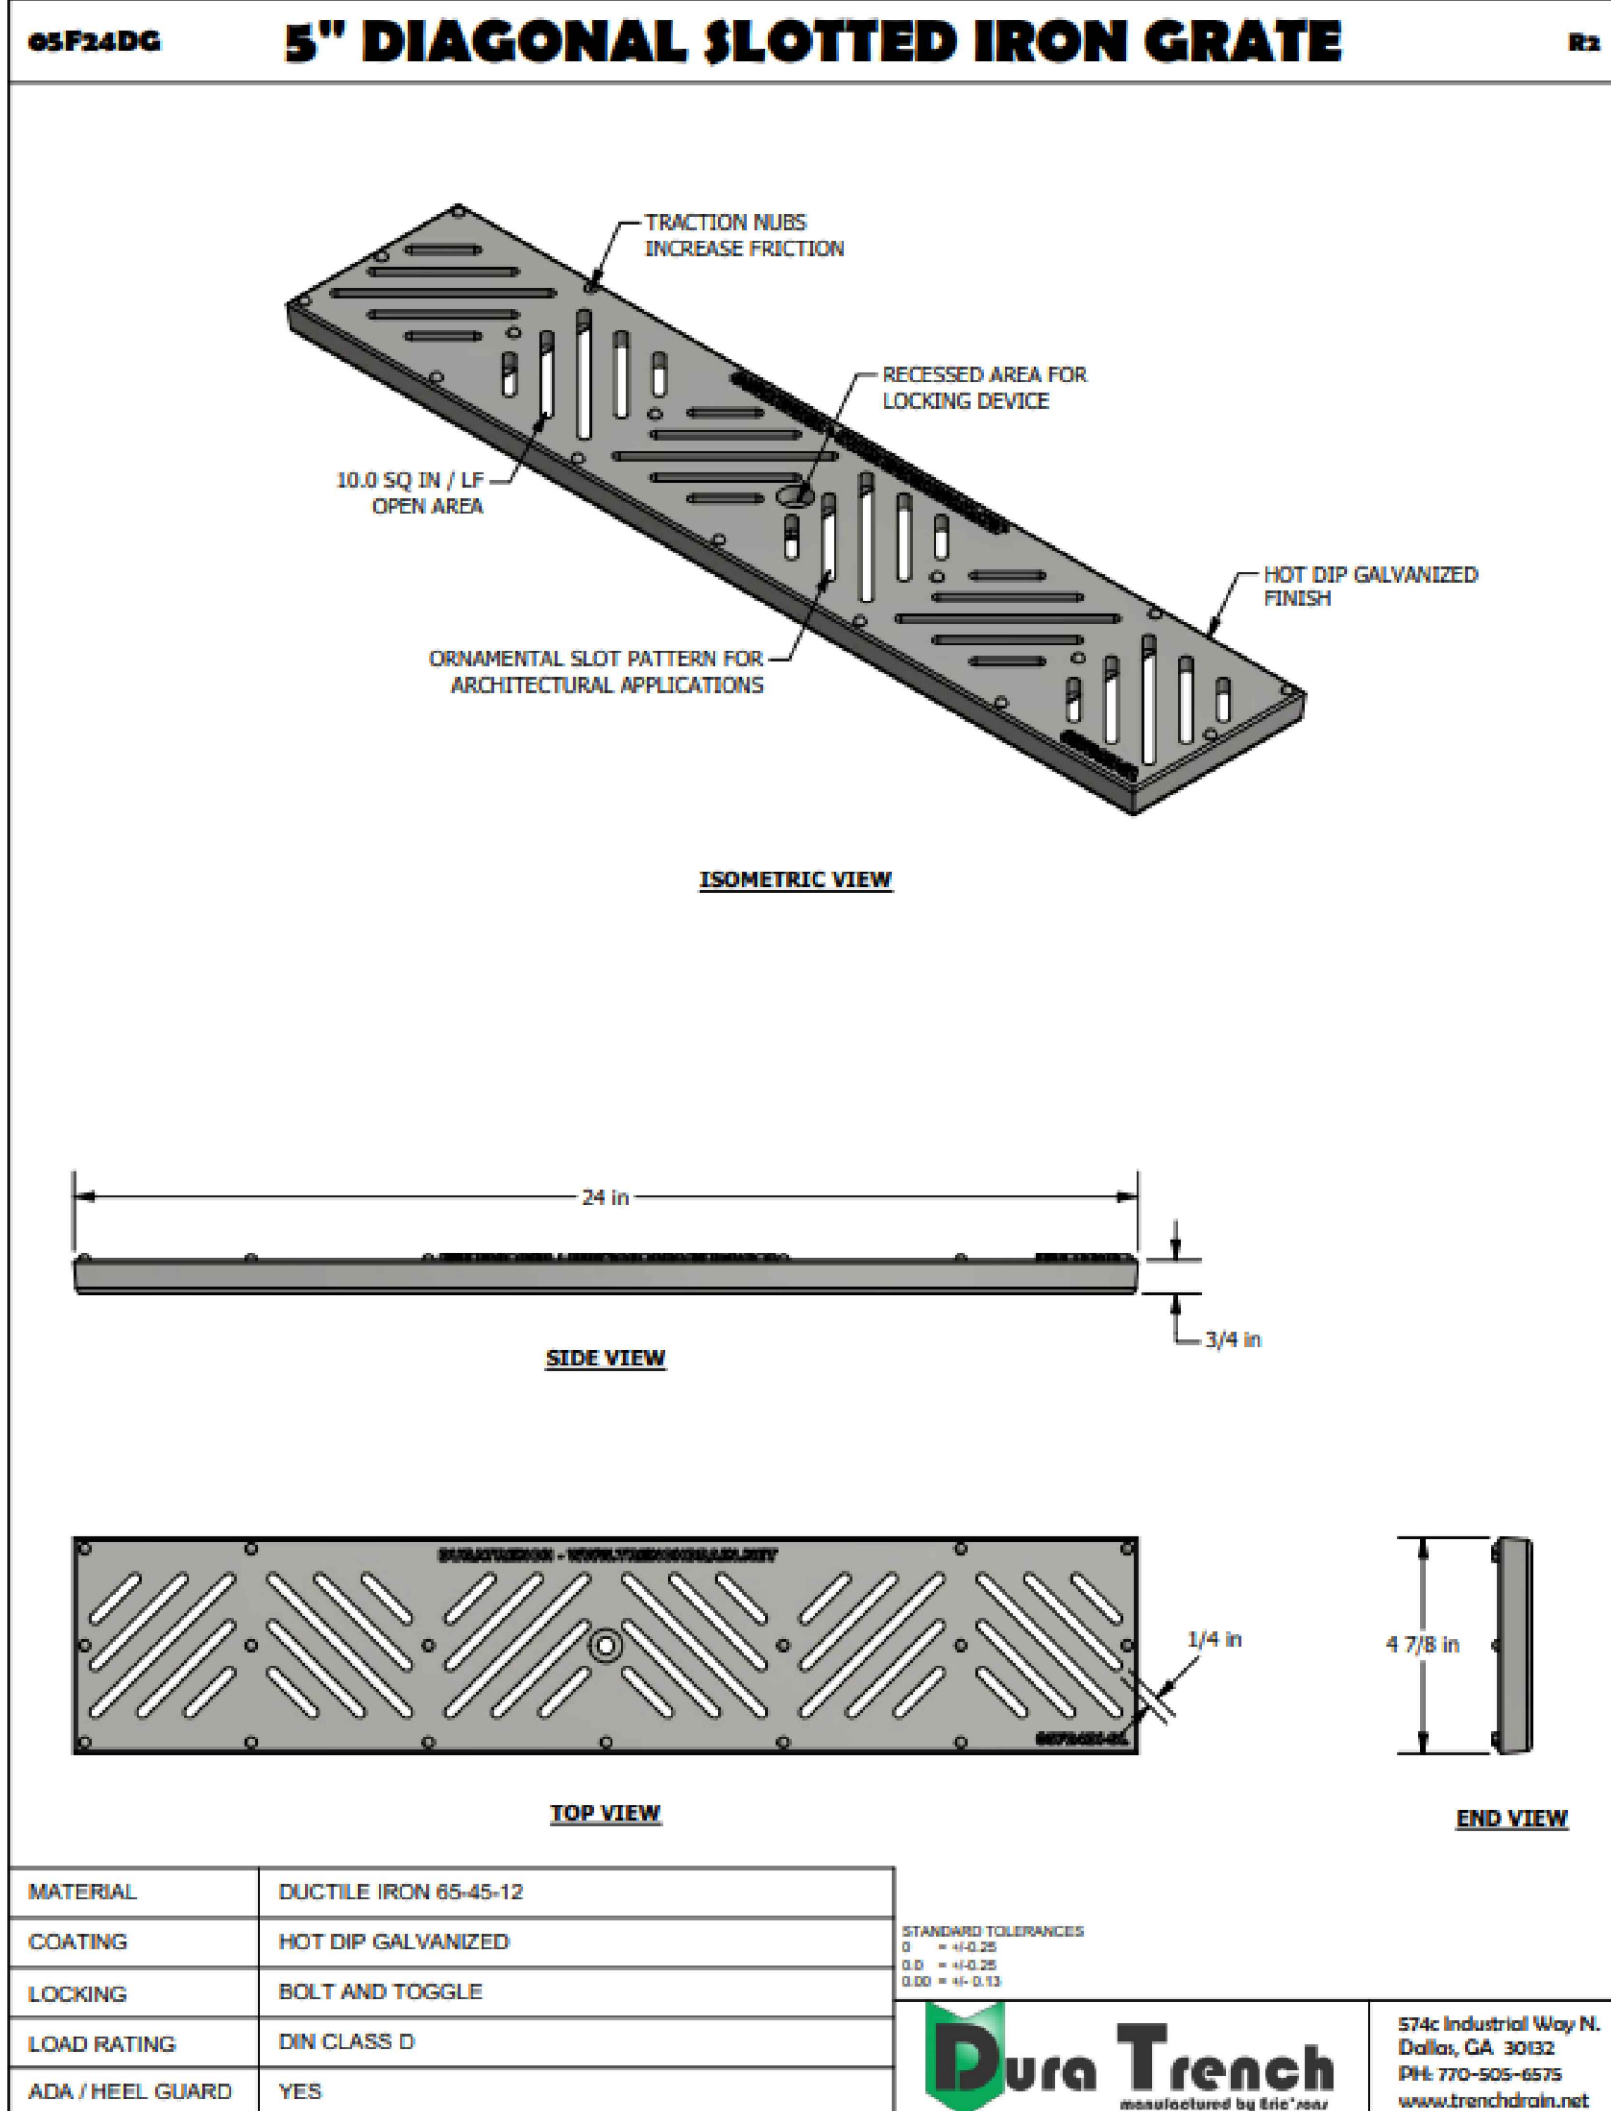

GENERAL NOTES:

1. AFTER THE BALLAST ROCK HAS BEEN PLACED TO THE PROPER ELEVATION IT SHALL BE CAREFULLY WASHED DOWN WITH CLEAN WATER IN ORDER TO ALLOW INITIAL SETTLEMENT THAT MAY OCCUR. IF IT DOES TAKE PLACE, ADDITIONAL BALLAST ROCK WILL BE ADDED TO RESTORE THE BALLAST ROCK TO PROPER ELEVATION, SO THAT THE EXFILTRATION TRENCH BE COMPLETED IN ACCORDANCE WITH THE DETAILS.
2. FILTER FABRIC SHALL BE TYPE D-3. ALL FILTER FABRIC JOINTS SHALL LAP A MINIMUM OF ONE FOOT.