




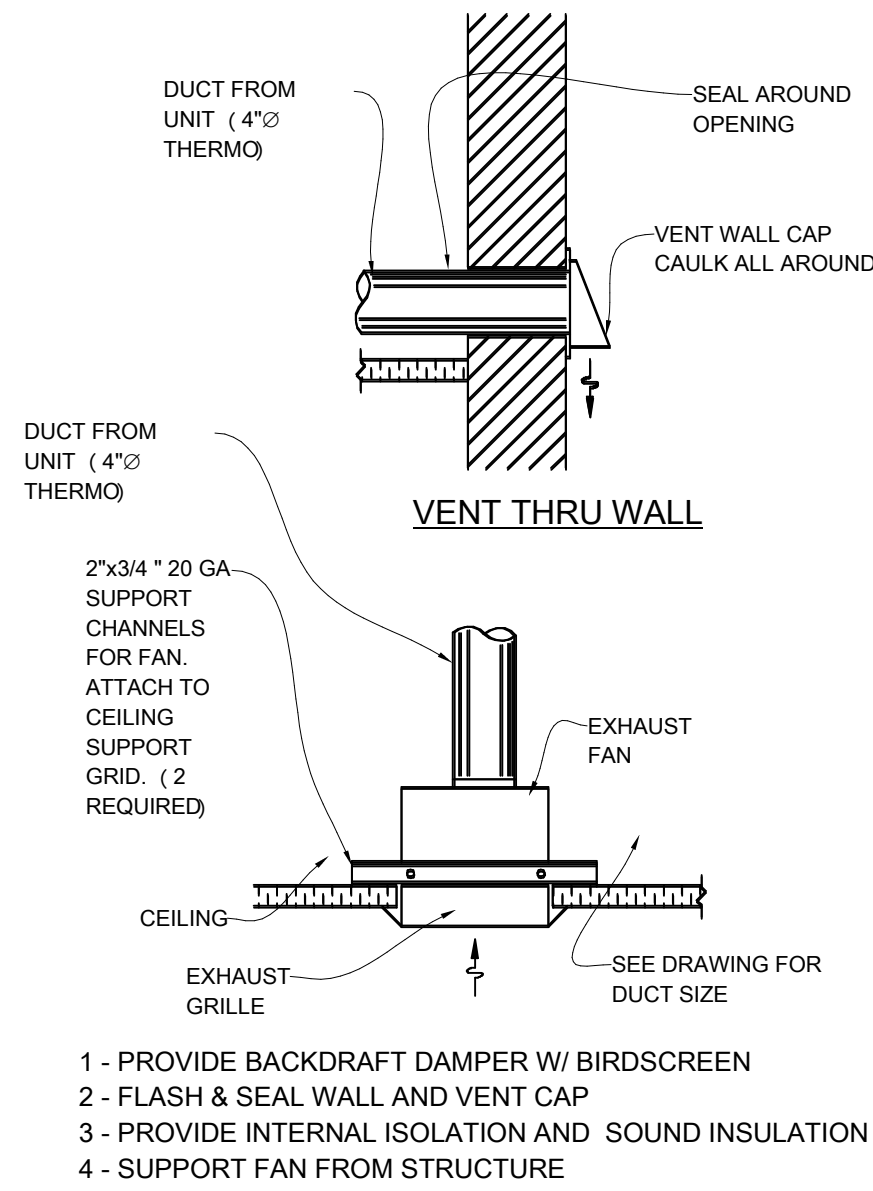


10 | EXHAUST VENT DETAIL
N.T.S.

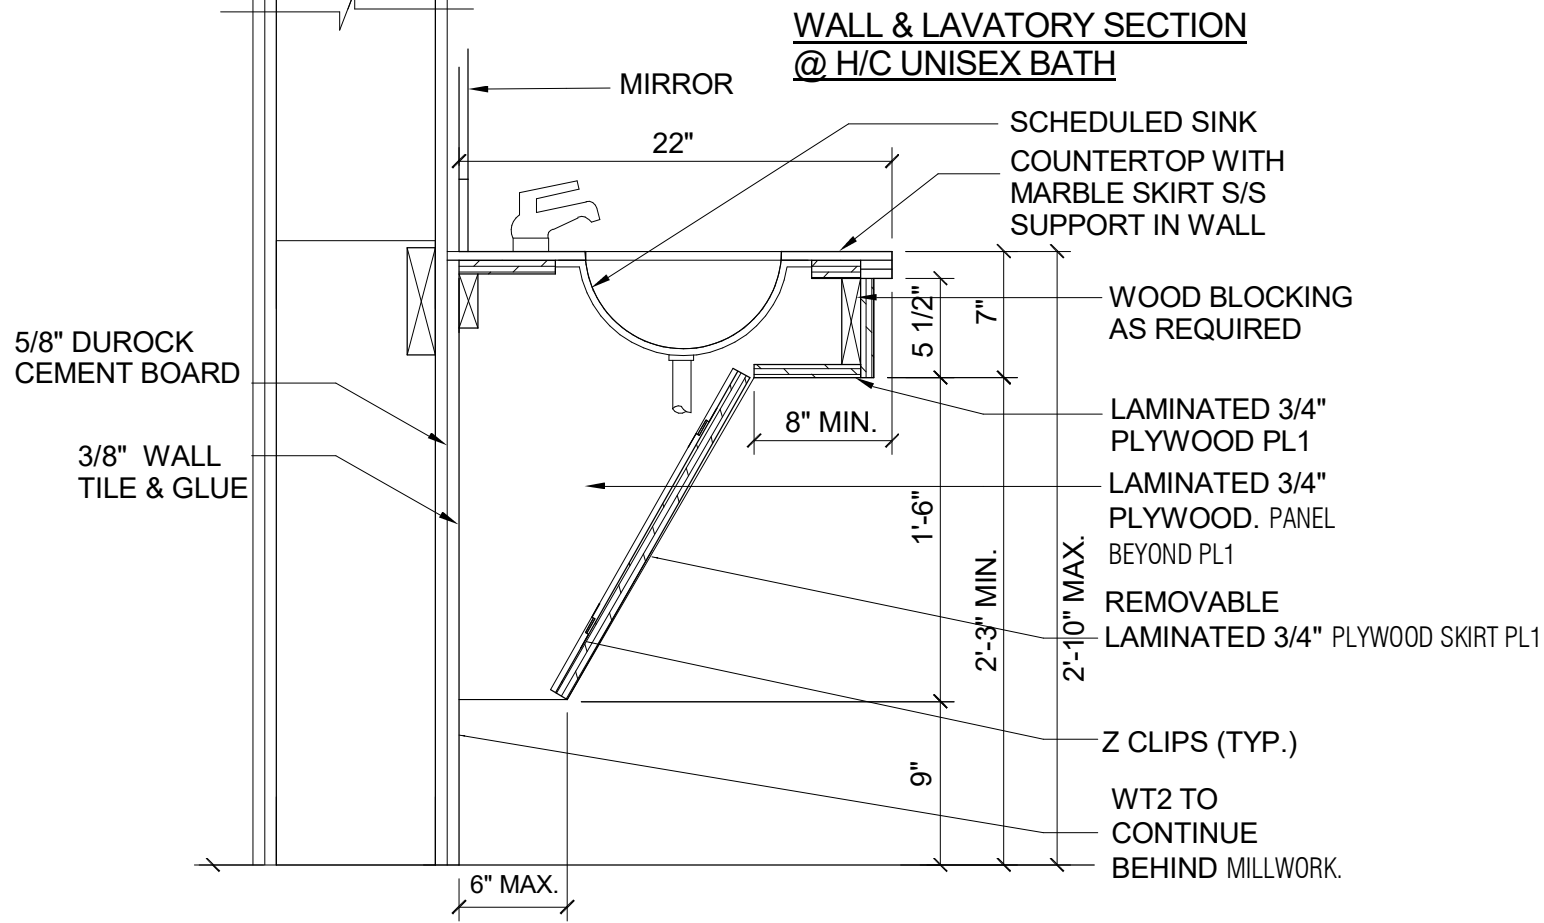


11 | LVH - ADA LAVATORY
N.T.S.

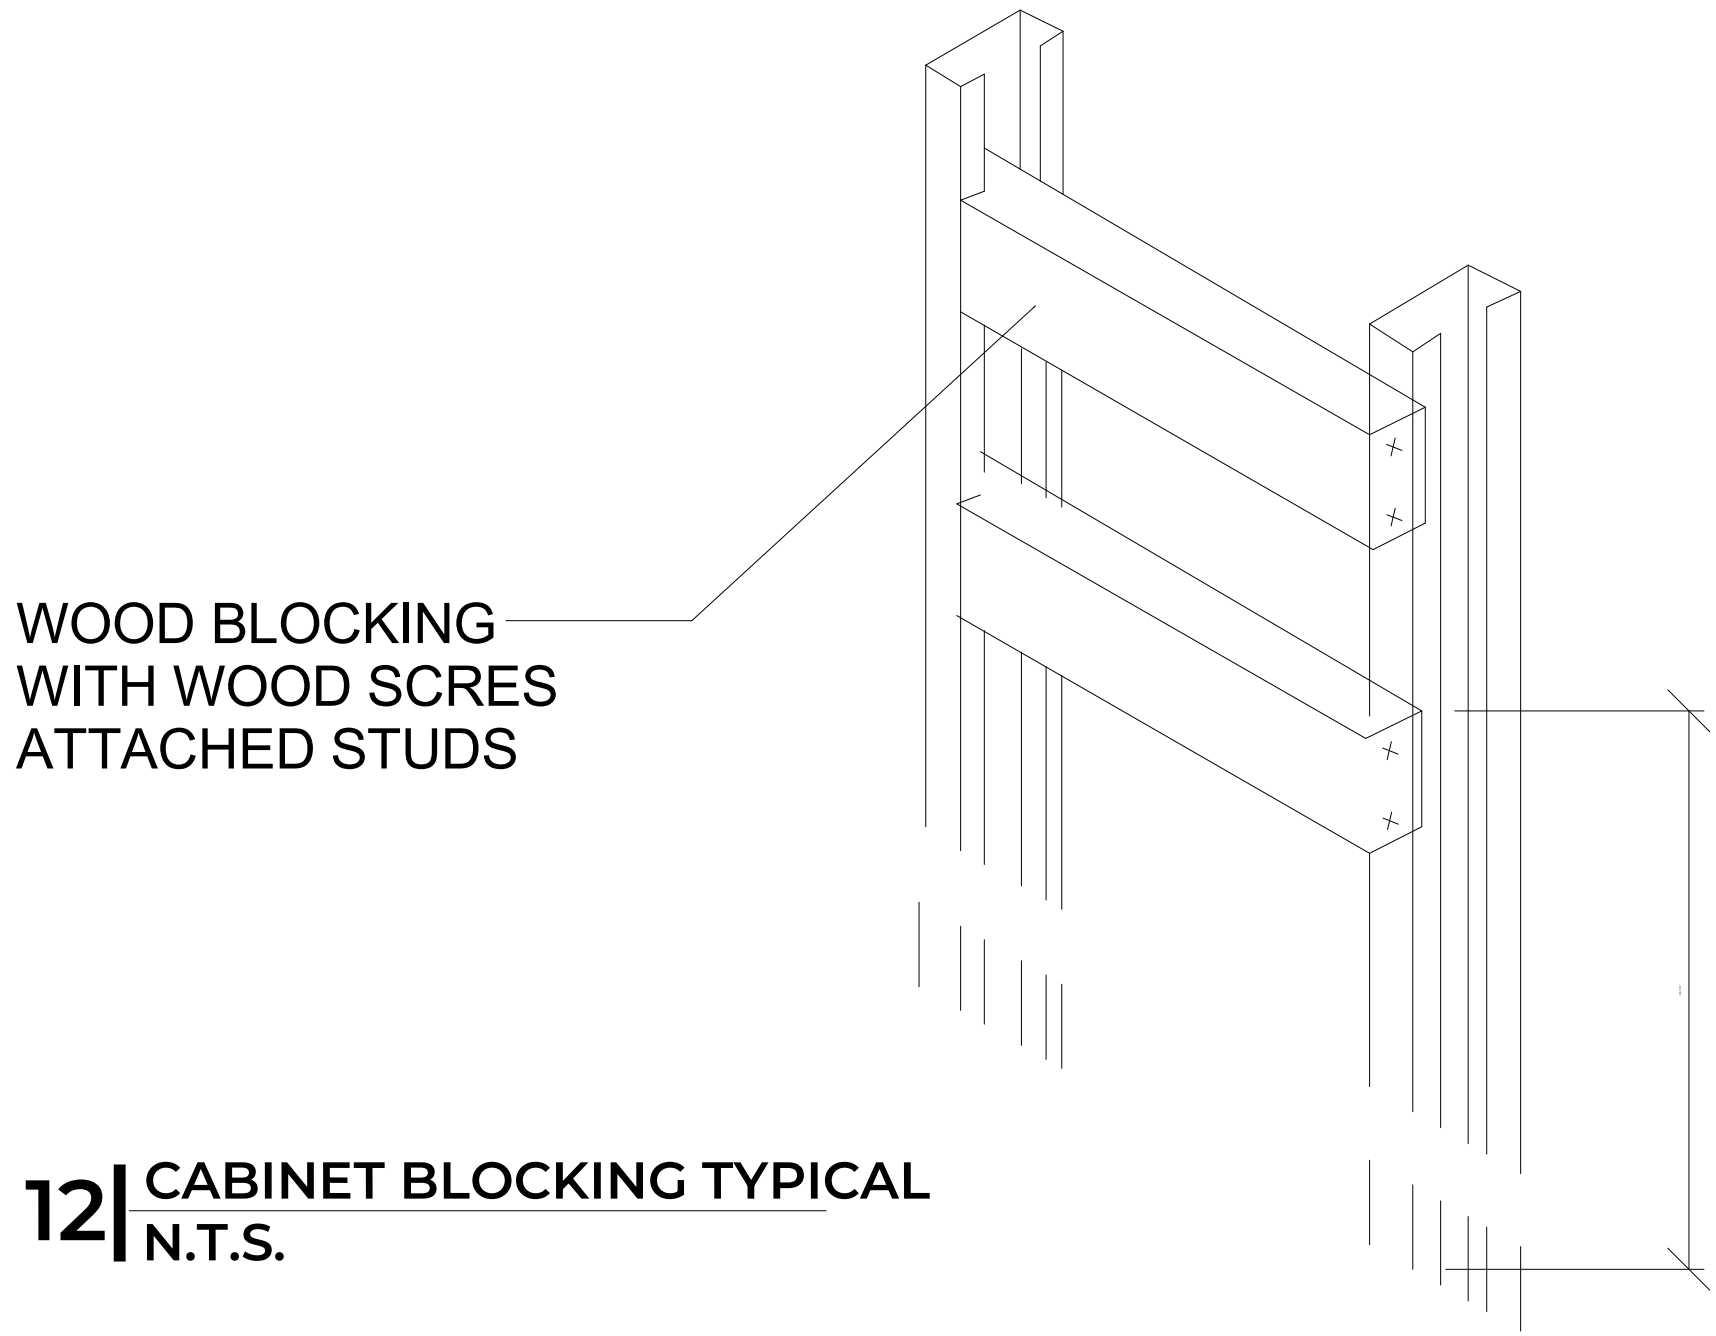


12 | CABINET BLOCKING TYPICAL
N.T.S.

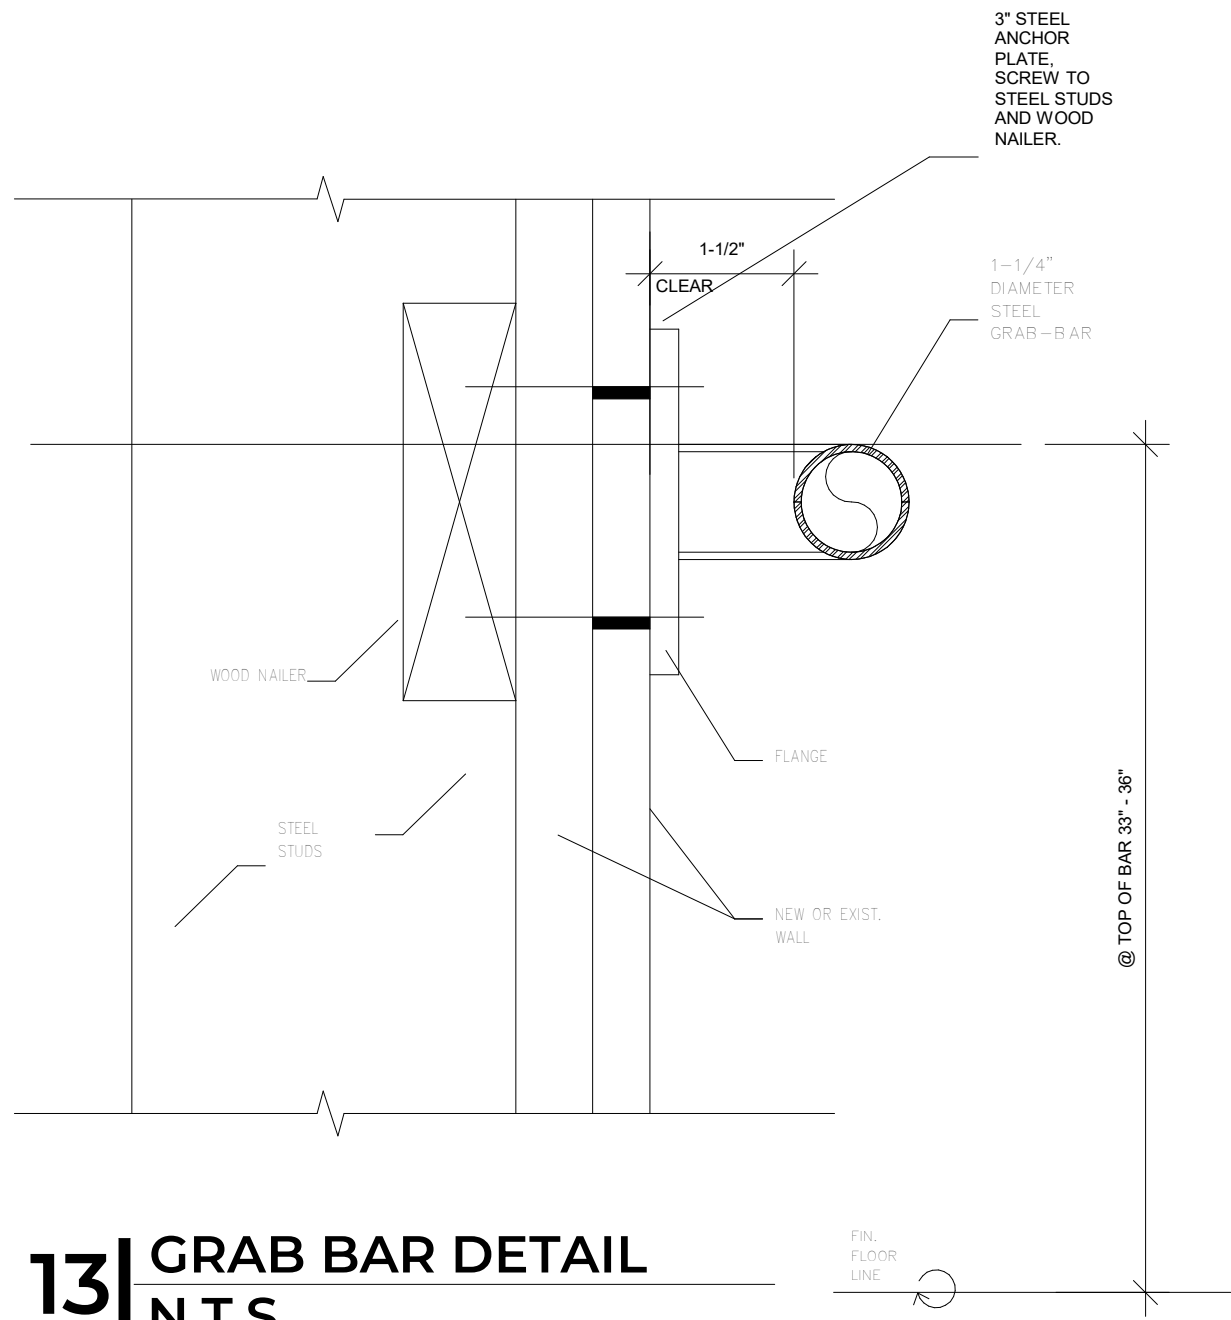

13 | GRAB BAR DETAIL
N.T.S.

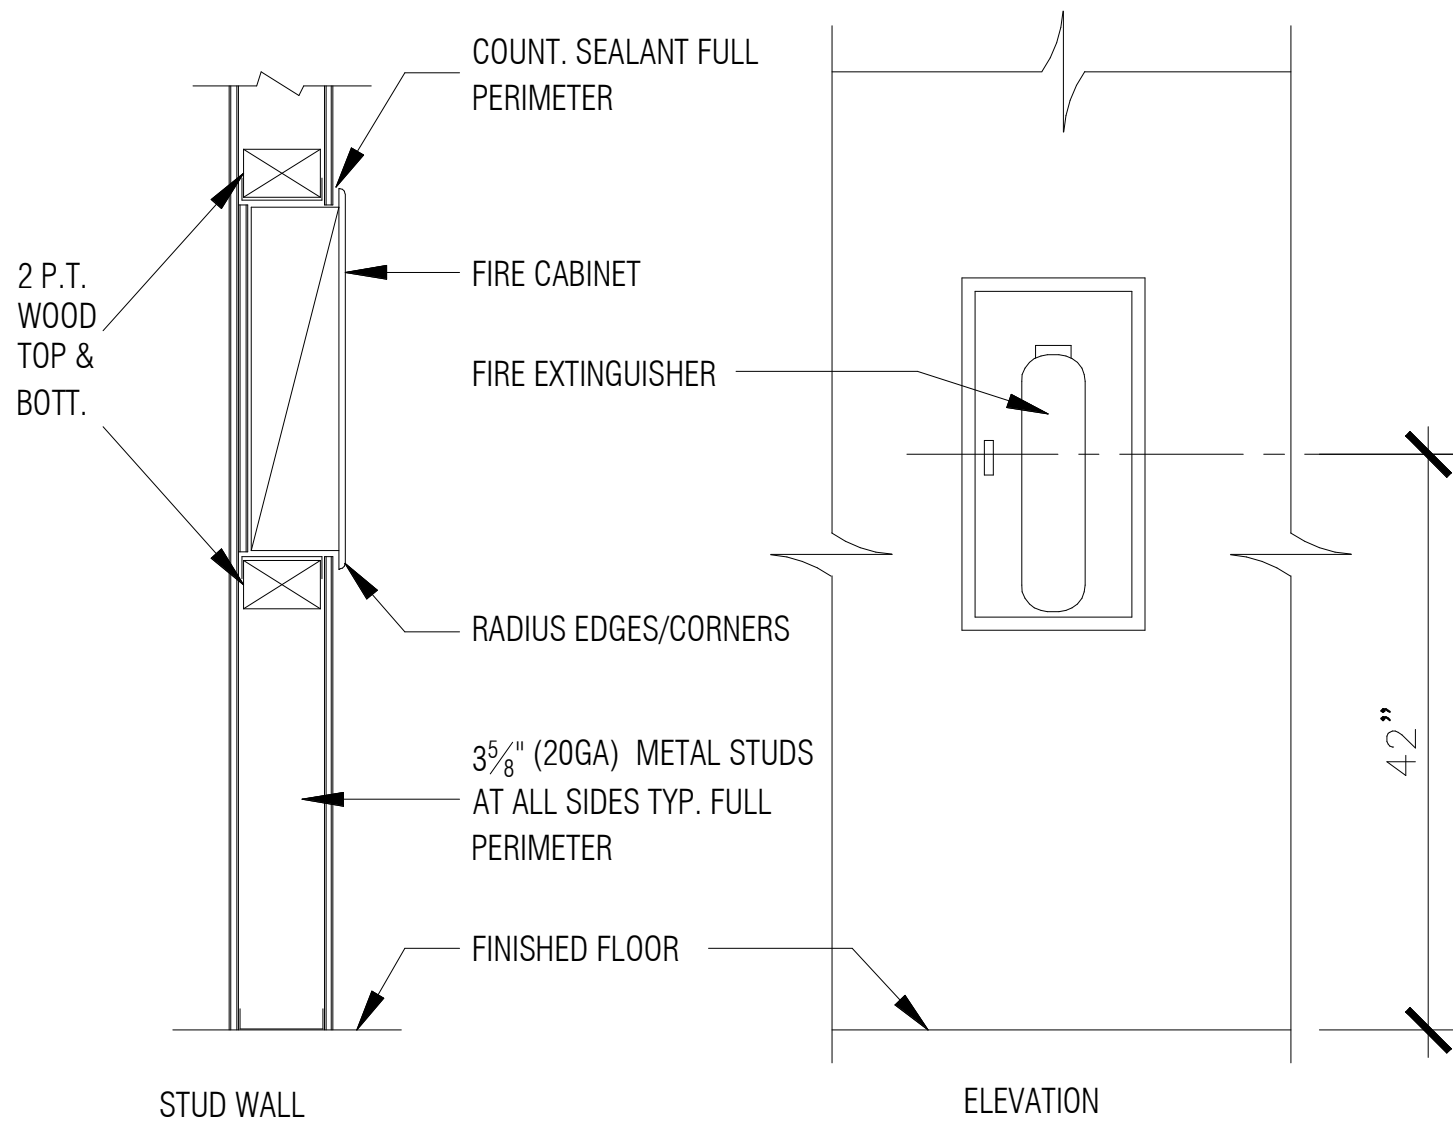


14 | FIRE EXTINGUISHER DETAIL
N.T.S.

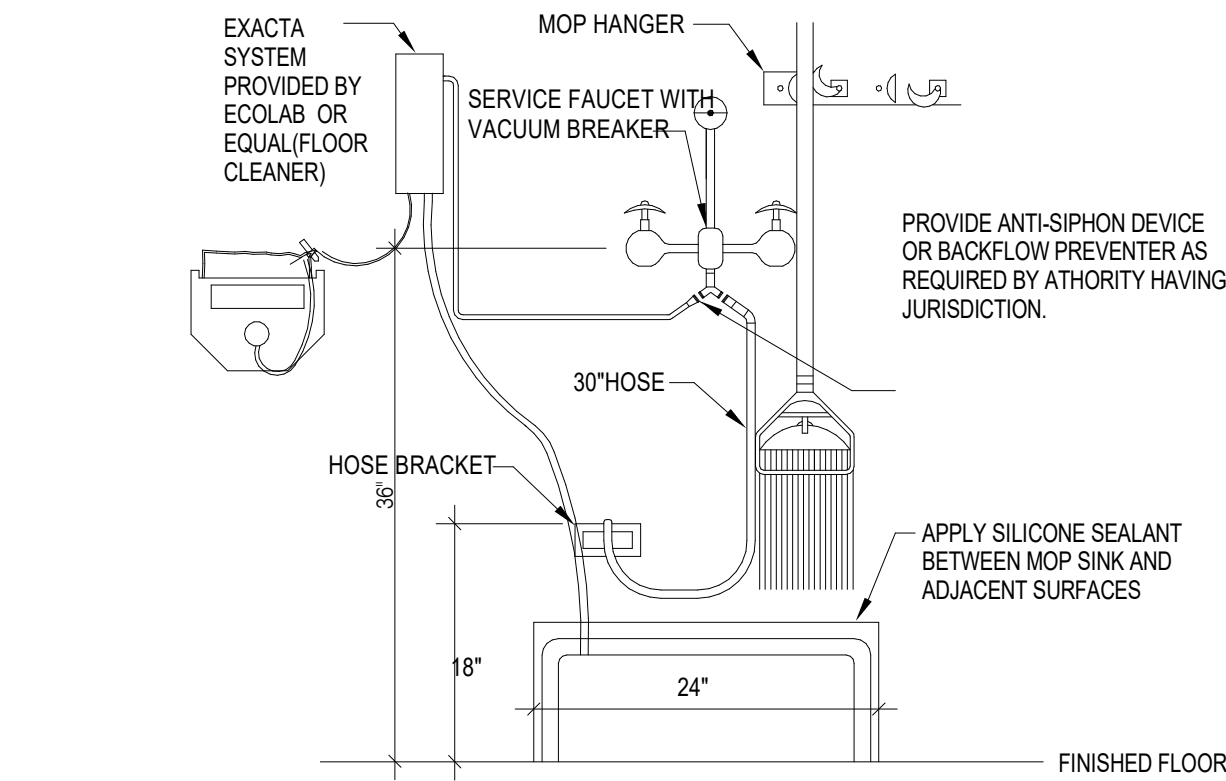

- COMMENTS:
1. EACH CHEMICAL DISPENSER MUST HAVE A DEDICATED WATER SUPPLY. LOCATED WITHIN 4 FEET OF THE DISPENSER. IT MUST PROVIDE TEMPERED WATER (ADJUSTABLE FROM 80-120°F) WITH A FLOW RATE OF 4 GPM AT 40 PSI DYNAMIC FLOWING PRESSURE (35 PSID MIN.). THE HOT AND COLD WATER SUPPLY LINES MUST HAVE CHECK VALVES TO PREVENT HOT/COLD WATER CROSSOVER. IF THE TEMPERING VALVE DOES NOT INCLUDE THEM, IT MUST INCLUDE A SHUTOFF VALVE TERMINATING AT GARDEN HOSE MALE FITTING.
 2. THE DEDICATED WATER SUPPLY SHOULD NOT HAVE ANY BACKFLOW PREVENTION (E.G. NO ATMOSPHERIC VACUUM BREAKER, ETC.), UNLESS REQUIRED BY THE LOCAL PLUMBING CODE OR UTILITY. EACH CHEMICAL DISPENSER INCLUDES AN INTEGRAL BACKFLOW PREVENTOR ASSE 1055)

15 | CHEMICAL SYSTEM AT JANITOR'S SINK
N.T.S.

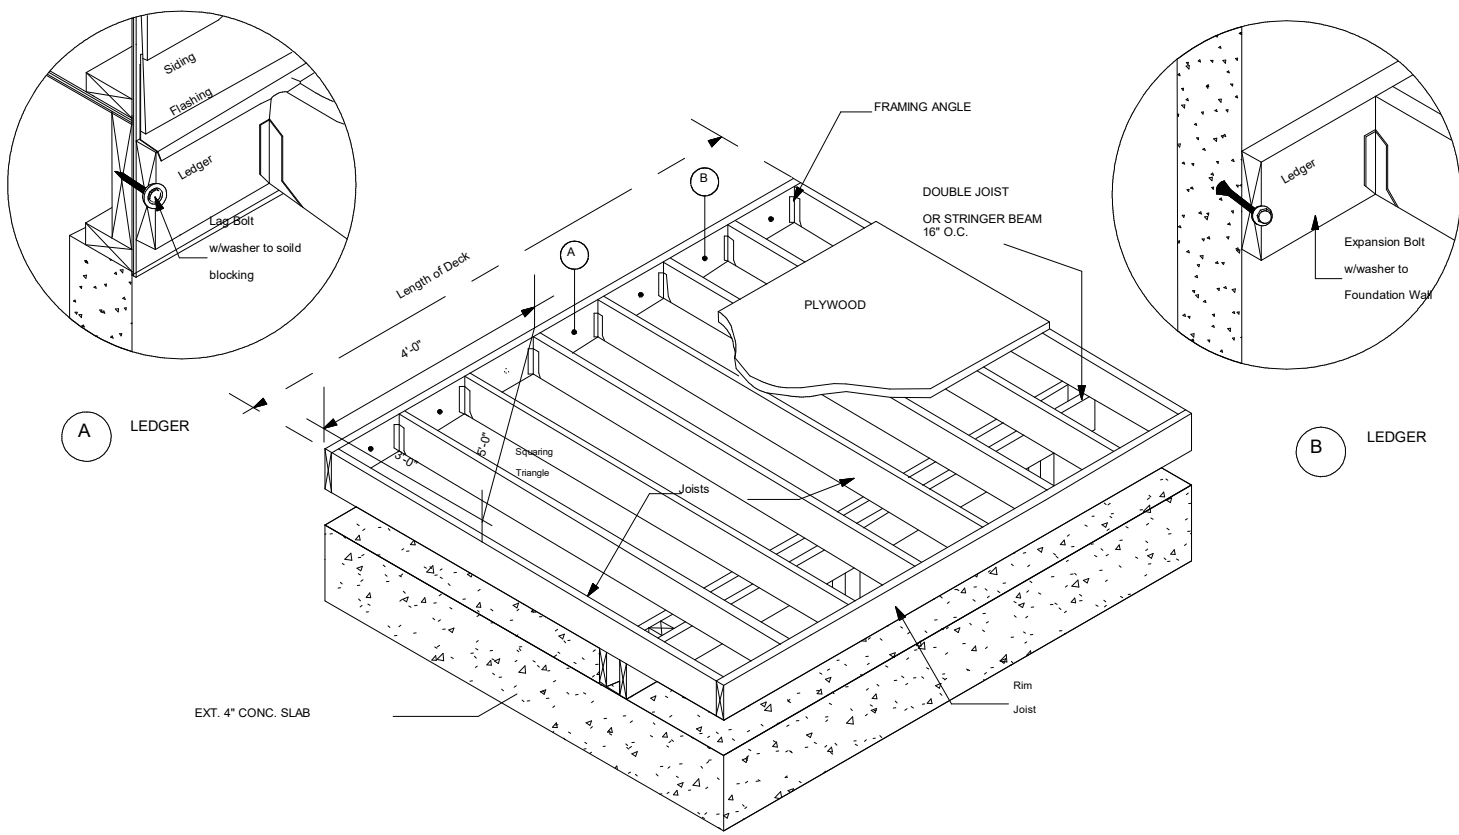

16 | STAGE FRAMING DETAIL
N.T.S.



DRAWING INFO

DATE:	11/25/2025
SCALE:	As indicated
DRAWN BY:	K.R.B.
CHECKED BY:	I.A.A.
APPROVED BY:	P.M.N.
CONTRACT NO.:	CD241610

IN MY PROFESSIONAL JUDGEMENT AND TO THE BEST OF MY KNOWLEDGE AND BELIEF, THESE PLANS AND SPECIFICATIONS COMPLY WITH APPLICABLE BUILDING CODES AND FIRESAFETY CODES, AS MANDATE BY STATUTE, FOR THE JURISDICTION IN WHICH THE STRUCTURE CONTAINED IN THESE DOCUMENTS SHALL BE CONSTRUCTED.

REVISIONS