



R1-1  
30" x 30"  
(STOP SIGN)

### SIGNAGE DETAILS

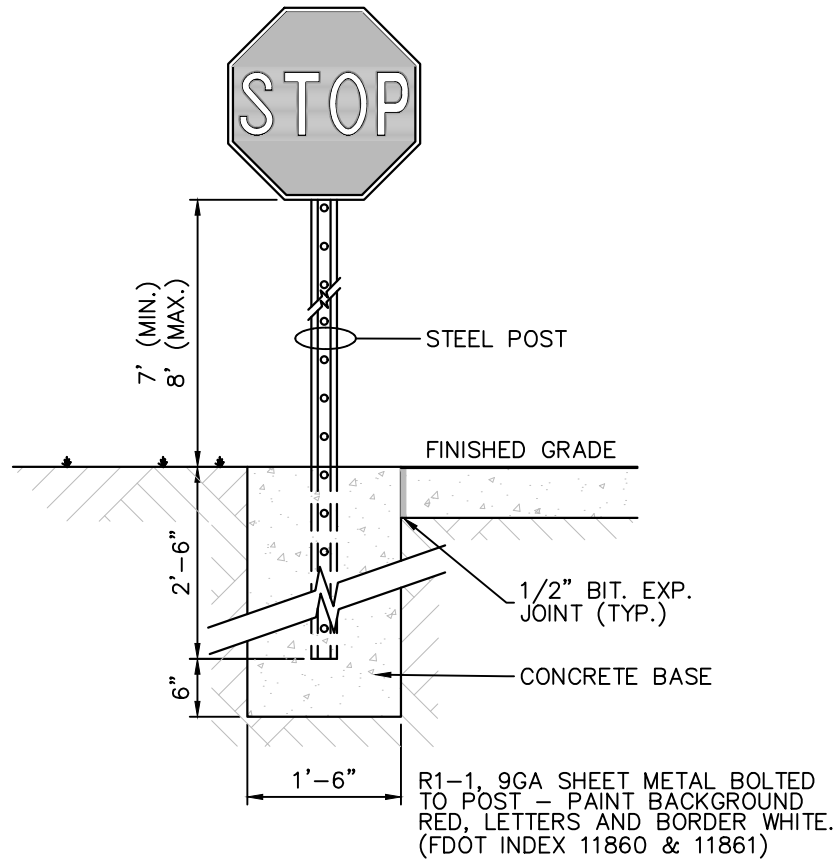

### TRAFFIC SIGN MOUNTING DETAIL


N.T.S.

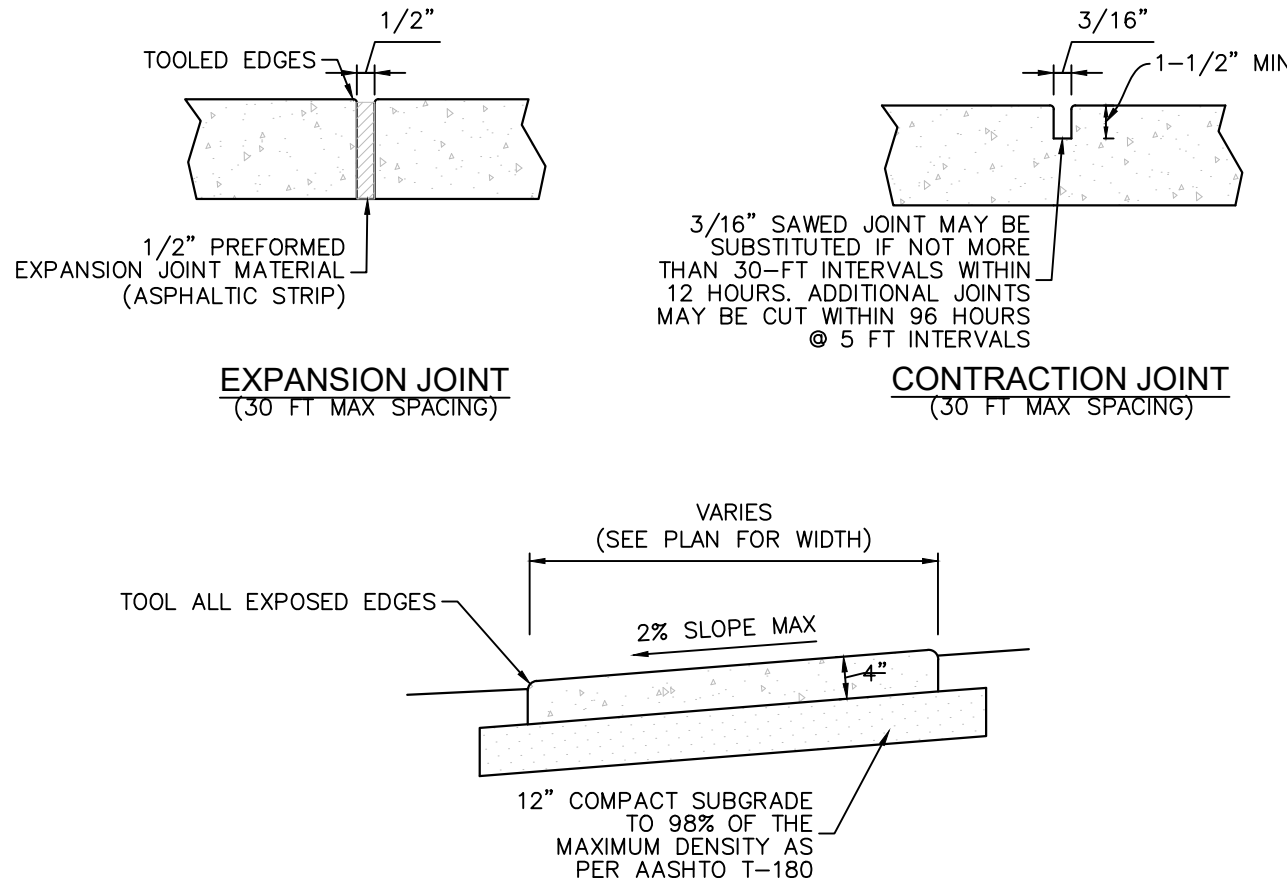

- NOTES:
1. PROVIDE EXPANSION JOINTS BETWEEN SIDEWALK AND CURB OR AT ANY OTHER RIGID STRUCTURE/MATERIAL.
  2. EXPANSION JOINTS SHALL BE PROVIDED AT 30 FT MAX SPACING. SIDEWALK JOINTS PLACEMENT SHALL BE IN ACCORDANCE WITH F.D.O.T. STANDARDS OR AS APPROVED BY ENGINEER.
  3. ULTIMATE COMPRESSIVE STRENGTH OF CONCRETE SHALL BE 3,000 PSI @ 28 DAYS FOR SIDEWALKS/WALKWAYS.
  4. FOR SIDEWALKS COMPACT SUBGRADE TO 98% OF THE MAXIMUM DENSITY AS DETERMINED BY AASHTO T-180.
  5. TOOLED CONTRACTION JOINT SHALL BE PROVIDED AT 5 FT MAXIMUM SPACING. SAWED CONTRACTION JOINT MAY BE SUBSTITUTED IF CUT AT NO MORE THAN 30 FT INTERVALS WITHIN 12 HOURS AFTER CONCRETE HAS SET. ADDITIONAL CUTS AT 5 FT INTERVALS MUST BE CUT WITHIN 96 HOURS. SIDEWALK JOINTS PLACEMENT SHALL BE IN ACCORDANCE WITH F.D.O.T. STANDARDS OR AS APPROVED BY ENGINEER.
  6. ALL CONCRETE SIDEWALKS SHALL BE CONSTRUCTED IN ACCORDANCE WITH F.D.O.T. STANDARDS, INCLUDING ANY REQUIRED 'CURB RAMPS'.
  7. SIDEWALK SHALL BE 6" THICK AT DRIVEWAY LOCATIONS.


### CONCRETE WALKWAY/SIDEWALK

N.T.S.

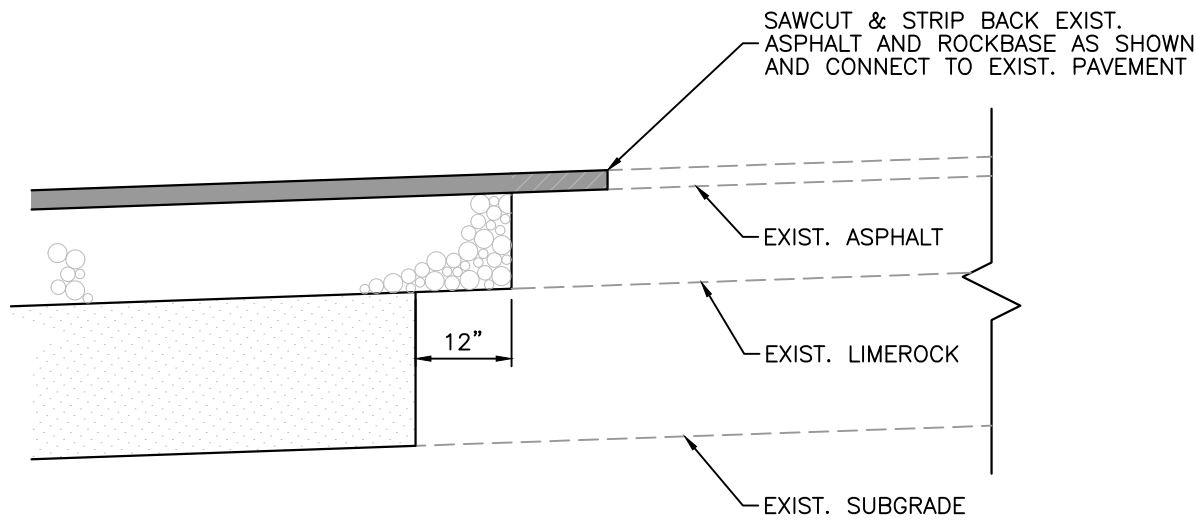

### CONNECTION TO EXISTING PAVEMENT DETAIL


N.T.S.

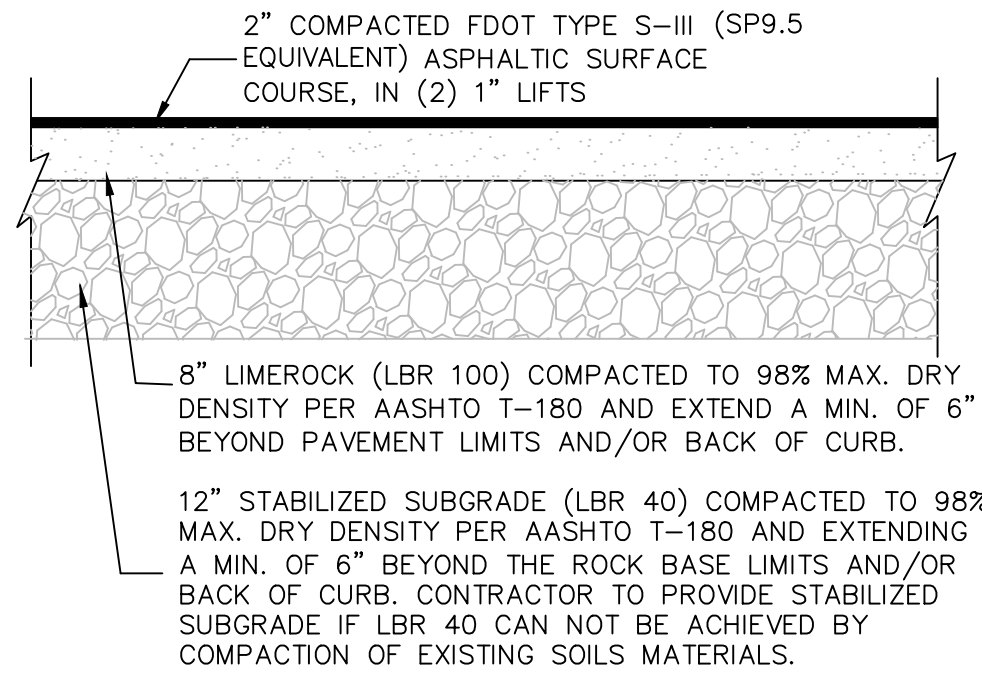

NOTE:  
PAVEMENT AREAS SHOULD BE COMPACTED TO A MINIMUM OF 98% OF THE MODIFIED PROCTOR MAXIMUM DRY DENSITY TO A DEPTH OF AT LEAST 12" BELOW THE SUBGRADE LEVEL.


### ASPHALT PAVEMENT TYPICAL CROSS-SECTION

N.T.S.

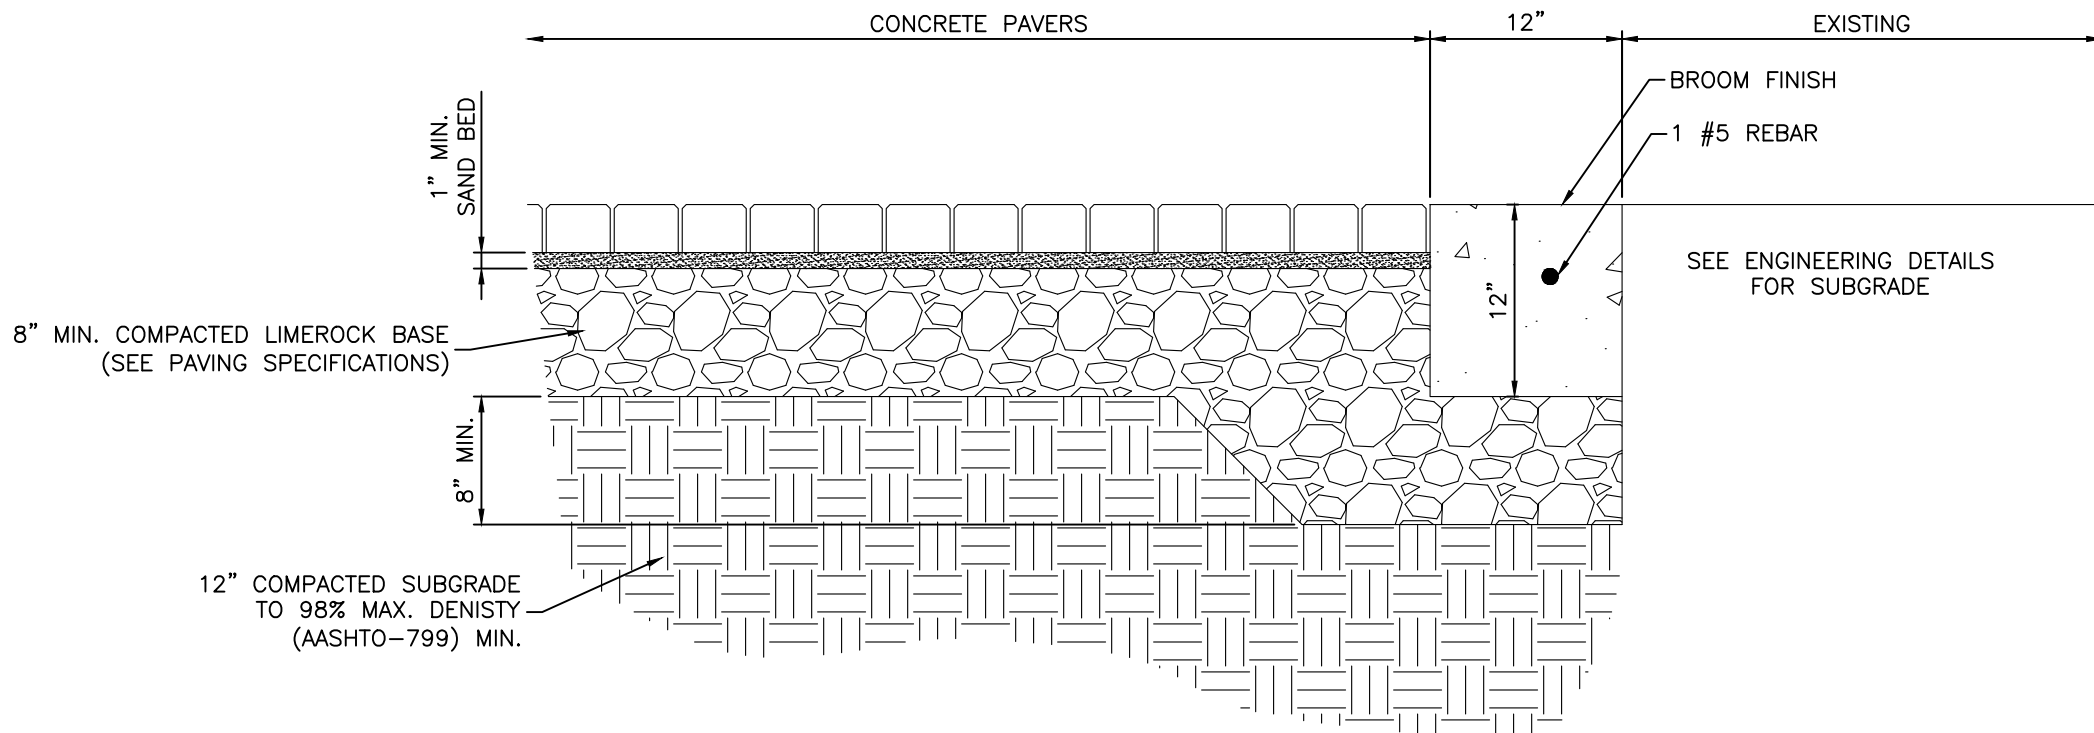

### PROPOSED BRICK PAVER DETAIL

THINKQ ENGINEERING, LLC  
PROFESSIONAL ENGINEER  
e-mail: dsantana@civiltthinkq.com  
5226 SW 139<sup>th</sup> PLACE MIAMI, FLORIDA 33175  
MOBILE: (786) 491-8545

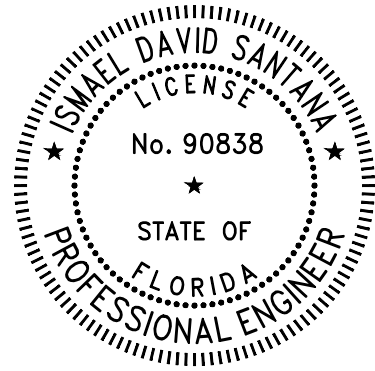

APPROVED : \_\_\_\_\_ DATE : \_\_\_\_\_  
FLA. REGISTRATION NO. ISMAEL DAVID SANTANA, P.E. 90838 1/31/2025

This item has been digitally signed and sealed by Ismael David Santana, P.E. on the date adjacent to the seal.  
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

#### REVISIONS:

SHEET NAME:

### GENERAL CONSTRUCTION DETAILS

SHEET NUMBER:

C-3.1

PROJECT NAME:

RIVERSIDE

PROJECT ADDRESS:

3214 SE 11TH STREET,  
POMPANO BEACH, FLORIDA 33062

PROJECT No.: 24-008  
DRAWN & DESIGN: JLG & JLG  
IDS  
SUB DATE: 12/23/2024

DRC

PZ25-12000005

03/05/2025