

**DRC**PZ25- 12000030  
11/19/2025**AMERICAN EAGLE FIRE PROTECTION, INC.**

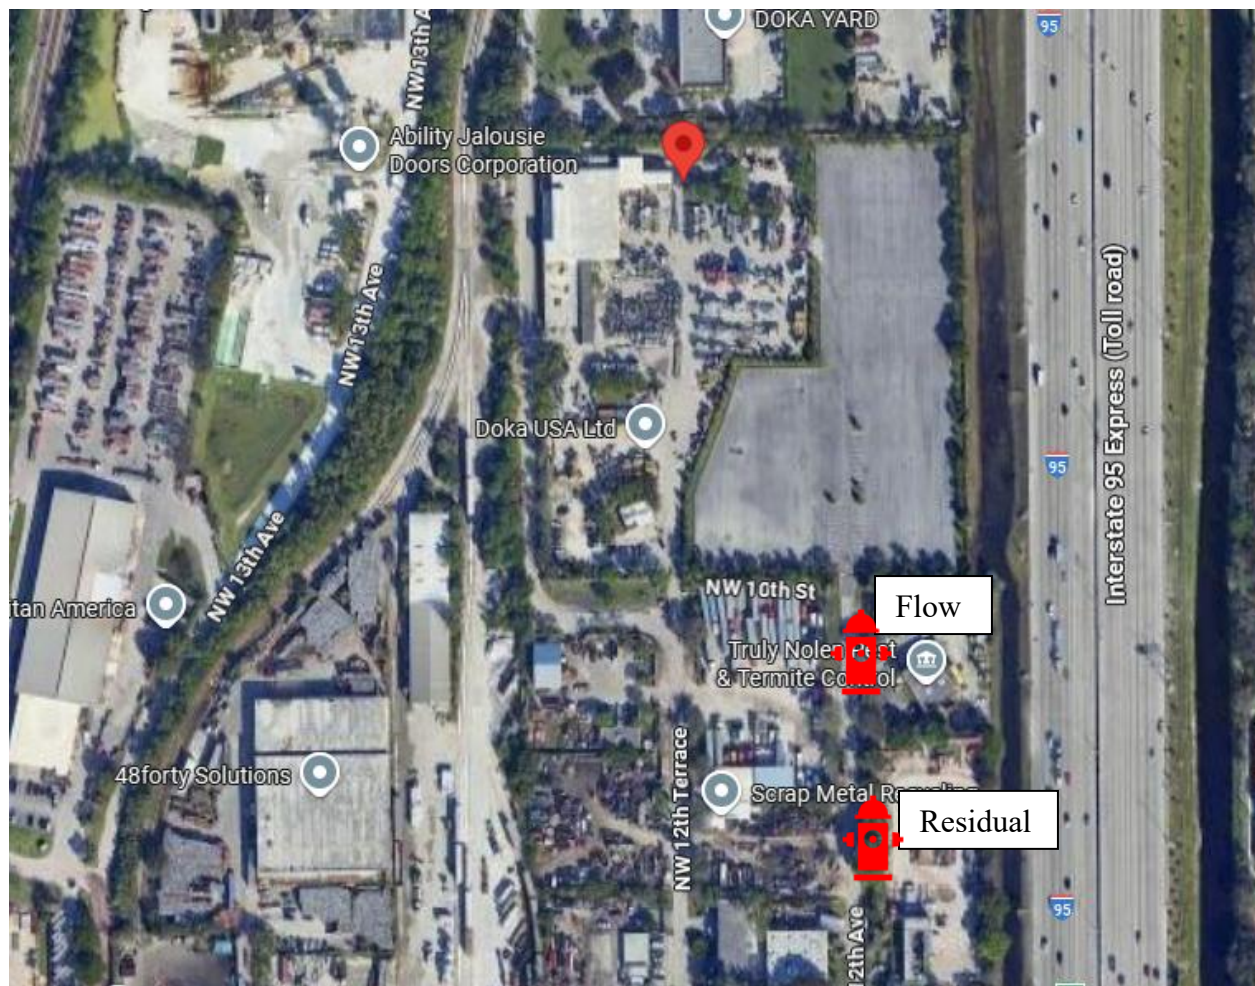
4711 North Dixie Highway – Boca Raton, FL 33431

Telephone: 561-750-3698 – Fax: 561-750-8496

LIC # 33490800012003

**FLOW TEST**

STATIC PRESSURE (psi)	RESIDUAL PRESSURE (psi)	PITOT PRESSURE (psi)	PITOT FLOW (gpm)	OUTLET SIZE
<b>74</b>	<b>78</b>	<b>25</b>	<b>836</b>	<b>2"</b>

**Address:** 1200 NW 12<sup>th</sup> Terrace, Pompano Beach, FL 33069**Flow Test Date:** Wednesday, August 20, 2025 at 8:00 a.m. – Thursday, August 21, 2025 at 8:00 a.mSketch of Test Location

Please note this test was performed using "The Little Hose Monster". The co-efficient and flow data are based on manufactures UL Listed specific specs designed for use of the 2 inch pitotless nozzle.

X Dario Cimetta - AEFP Technician**DRC**

Date: 08-21-25

PZ25-12000030

10/01/2025