

1. SEALED CONCRETE
2. 12" x 12" VINYL COMPOSITION FLOOR TILE
3. ALL GYPSUM BOARD WALLS TO RECEIVE 4" BLACK VINYL BASE
4. INSTALL BLACK NEOPRENE EDGE STRIP WHERE VINYL MEETS SEALED CONCRETE.

$$1/8'' = 1'-0''$$

INTERIOR TILE PLAN

2" DEEP 18 GA. TRACK
ANCHOR TO DECK W/ (2) #10
SCREWS @ 12" STAGGERED

ROOFING SYSTEM
OVER METAL DECK

20 GA. STUDS AND
TRACK CONNECT W/
#8 LOW PROFILE
SCREWS @ EA. STUD

D.P.R. JOIST

PROVIDE CORNER TRIM
AROUND ALL EDGES OF THE
OPENINGS IN WALL WHERE
BAR JOIST PASSES
THROUGH

3" 20 GA. STEEL
STUDS @ 16" O.C.

BACK TO BACK 6" 16 GA.
JOIST STUDS W/ 3/8" 20
GA. TRACK TOP & BOTTOM.
RUN CONTINUOUS FROM
BATH WALL TO END OF
CURTAIN WALL.

SEE ELEVATIONS
THIS SHEET FOR
REQUIRED HEIGHTS

1/2" GYPSUM BOARD W/ CORNER BEAD ON OUTSIDE CORNERS	SALES FLOOR SIDE
--	---------------------

2	CURTAIN WALL
---	--------------

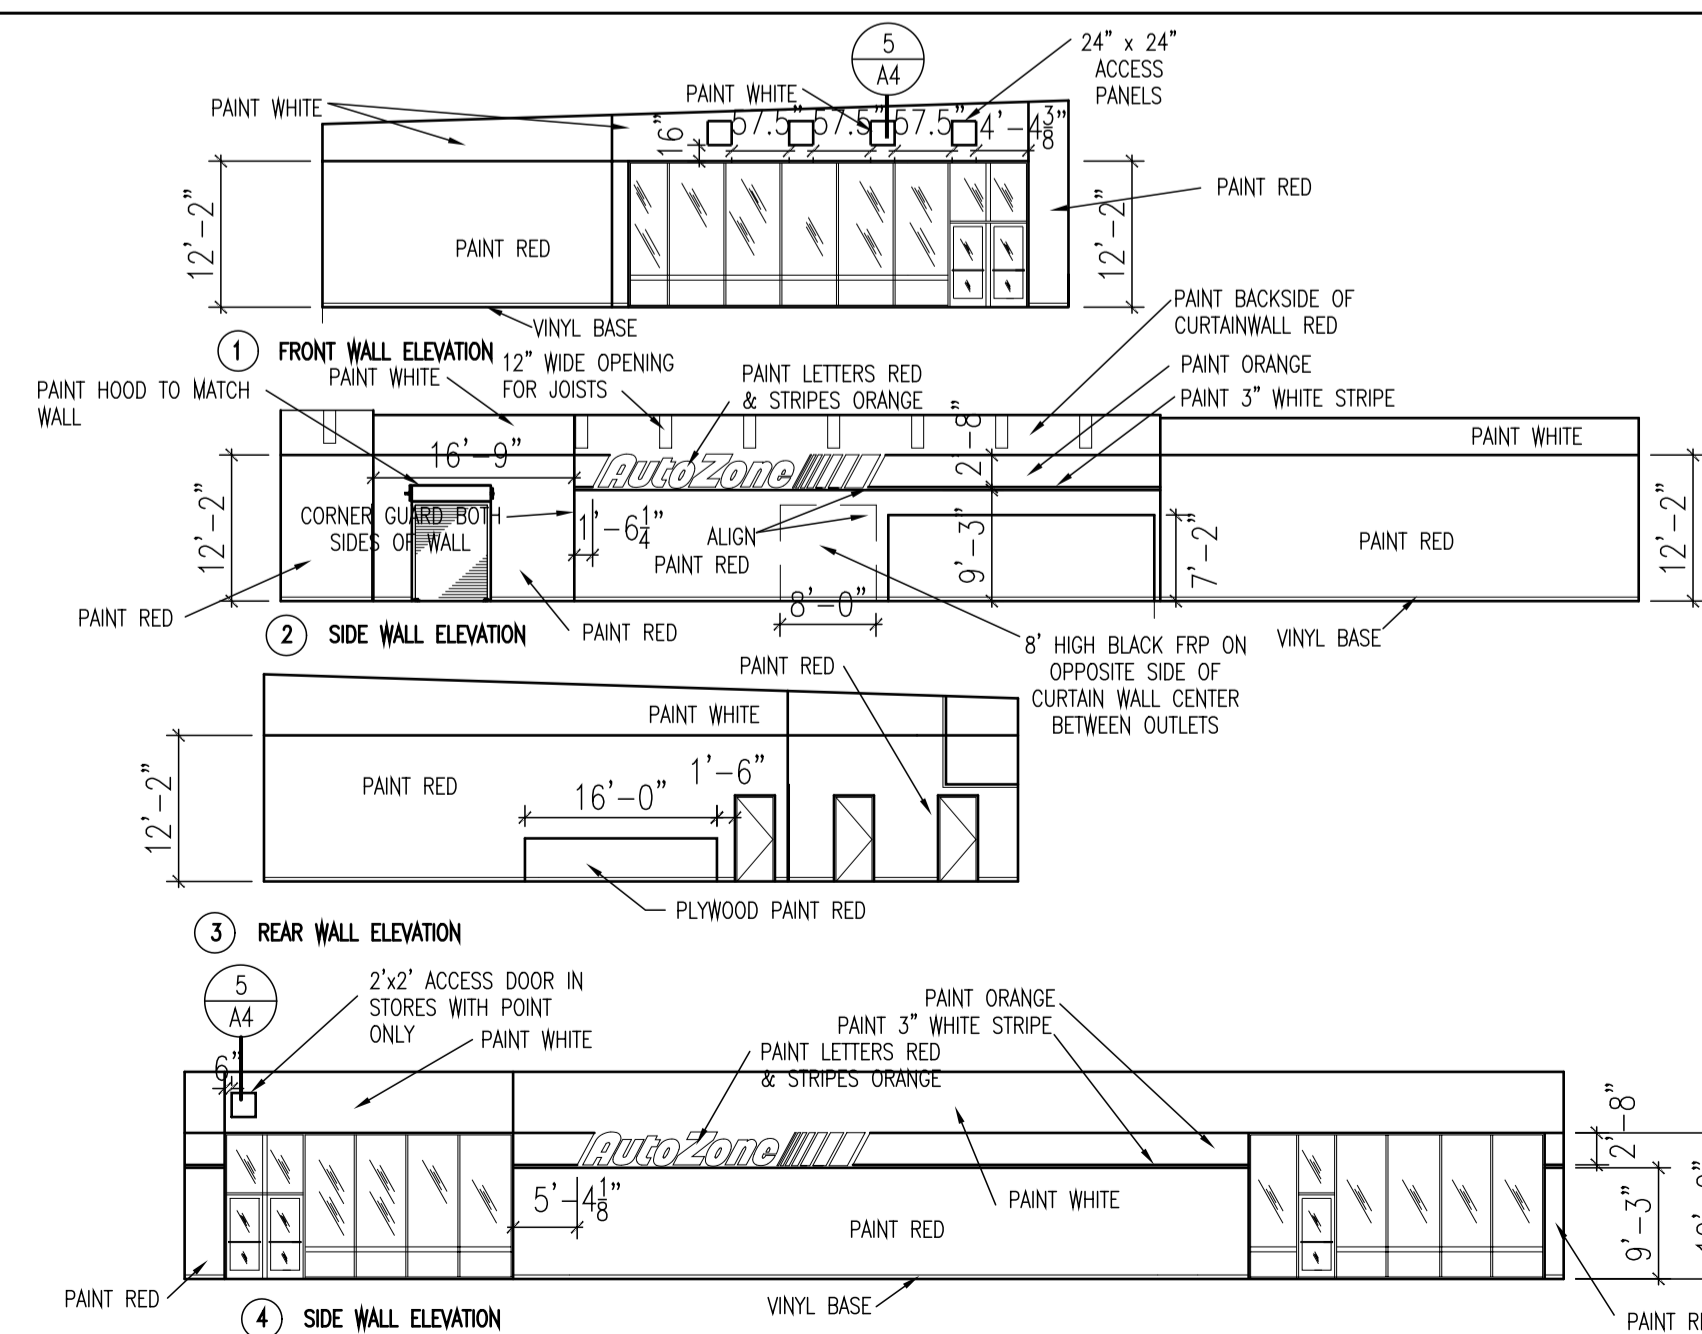
$$1/16'' = 1'-0''$$


Diagram illustrating the floor assembly cross-section:

- SEALLED CONCRETE FLOOR
- NEOPRENE REDUCER STRIP. COLOR TO BE BLACK. GLUE TO CONCRETE W/ 3M CONTACT CEMENT.
- VINYL TILE OR SHEET VINYL FLOORING
- Dimensions: 1" (width of the strip), 1/8" (thickness of the strip)

FULL SIZE	
4	TRANSITION STRIP

AIS01


4 | TRANSITION STRIP

LINE OF SOFFIT
(TOP OF
STOREFRONT)

SEE INTERIOR ELEVATIONS
FOR LOCATION.

AIS03

05 ACCESS PANEL SECTION

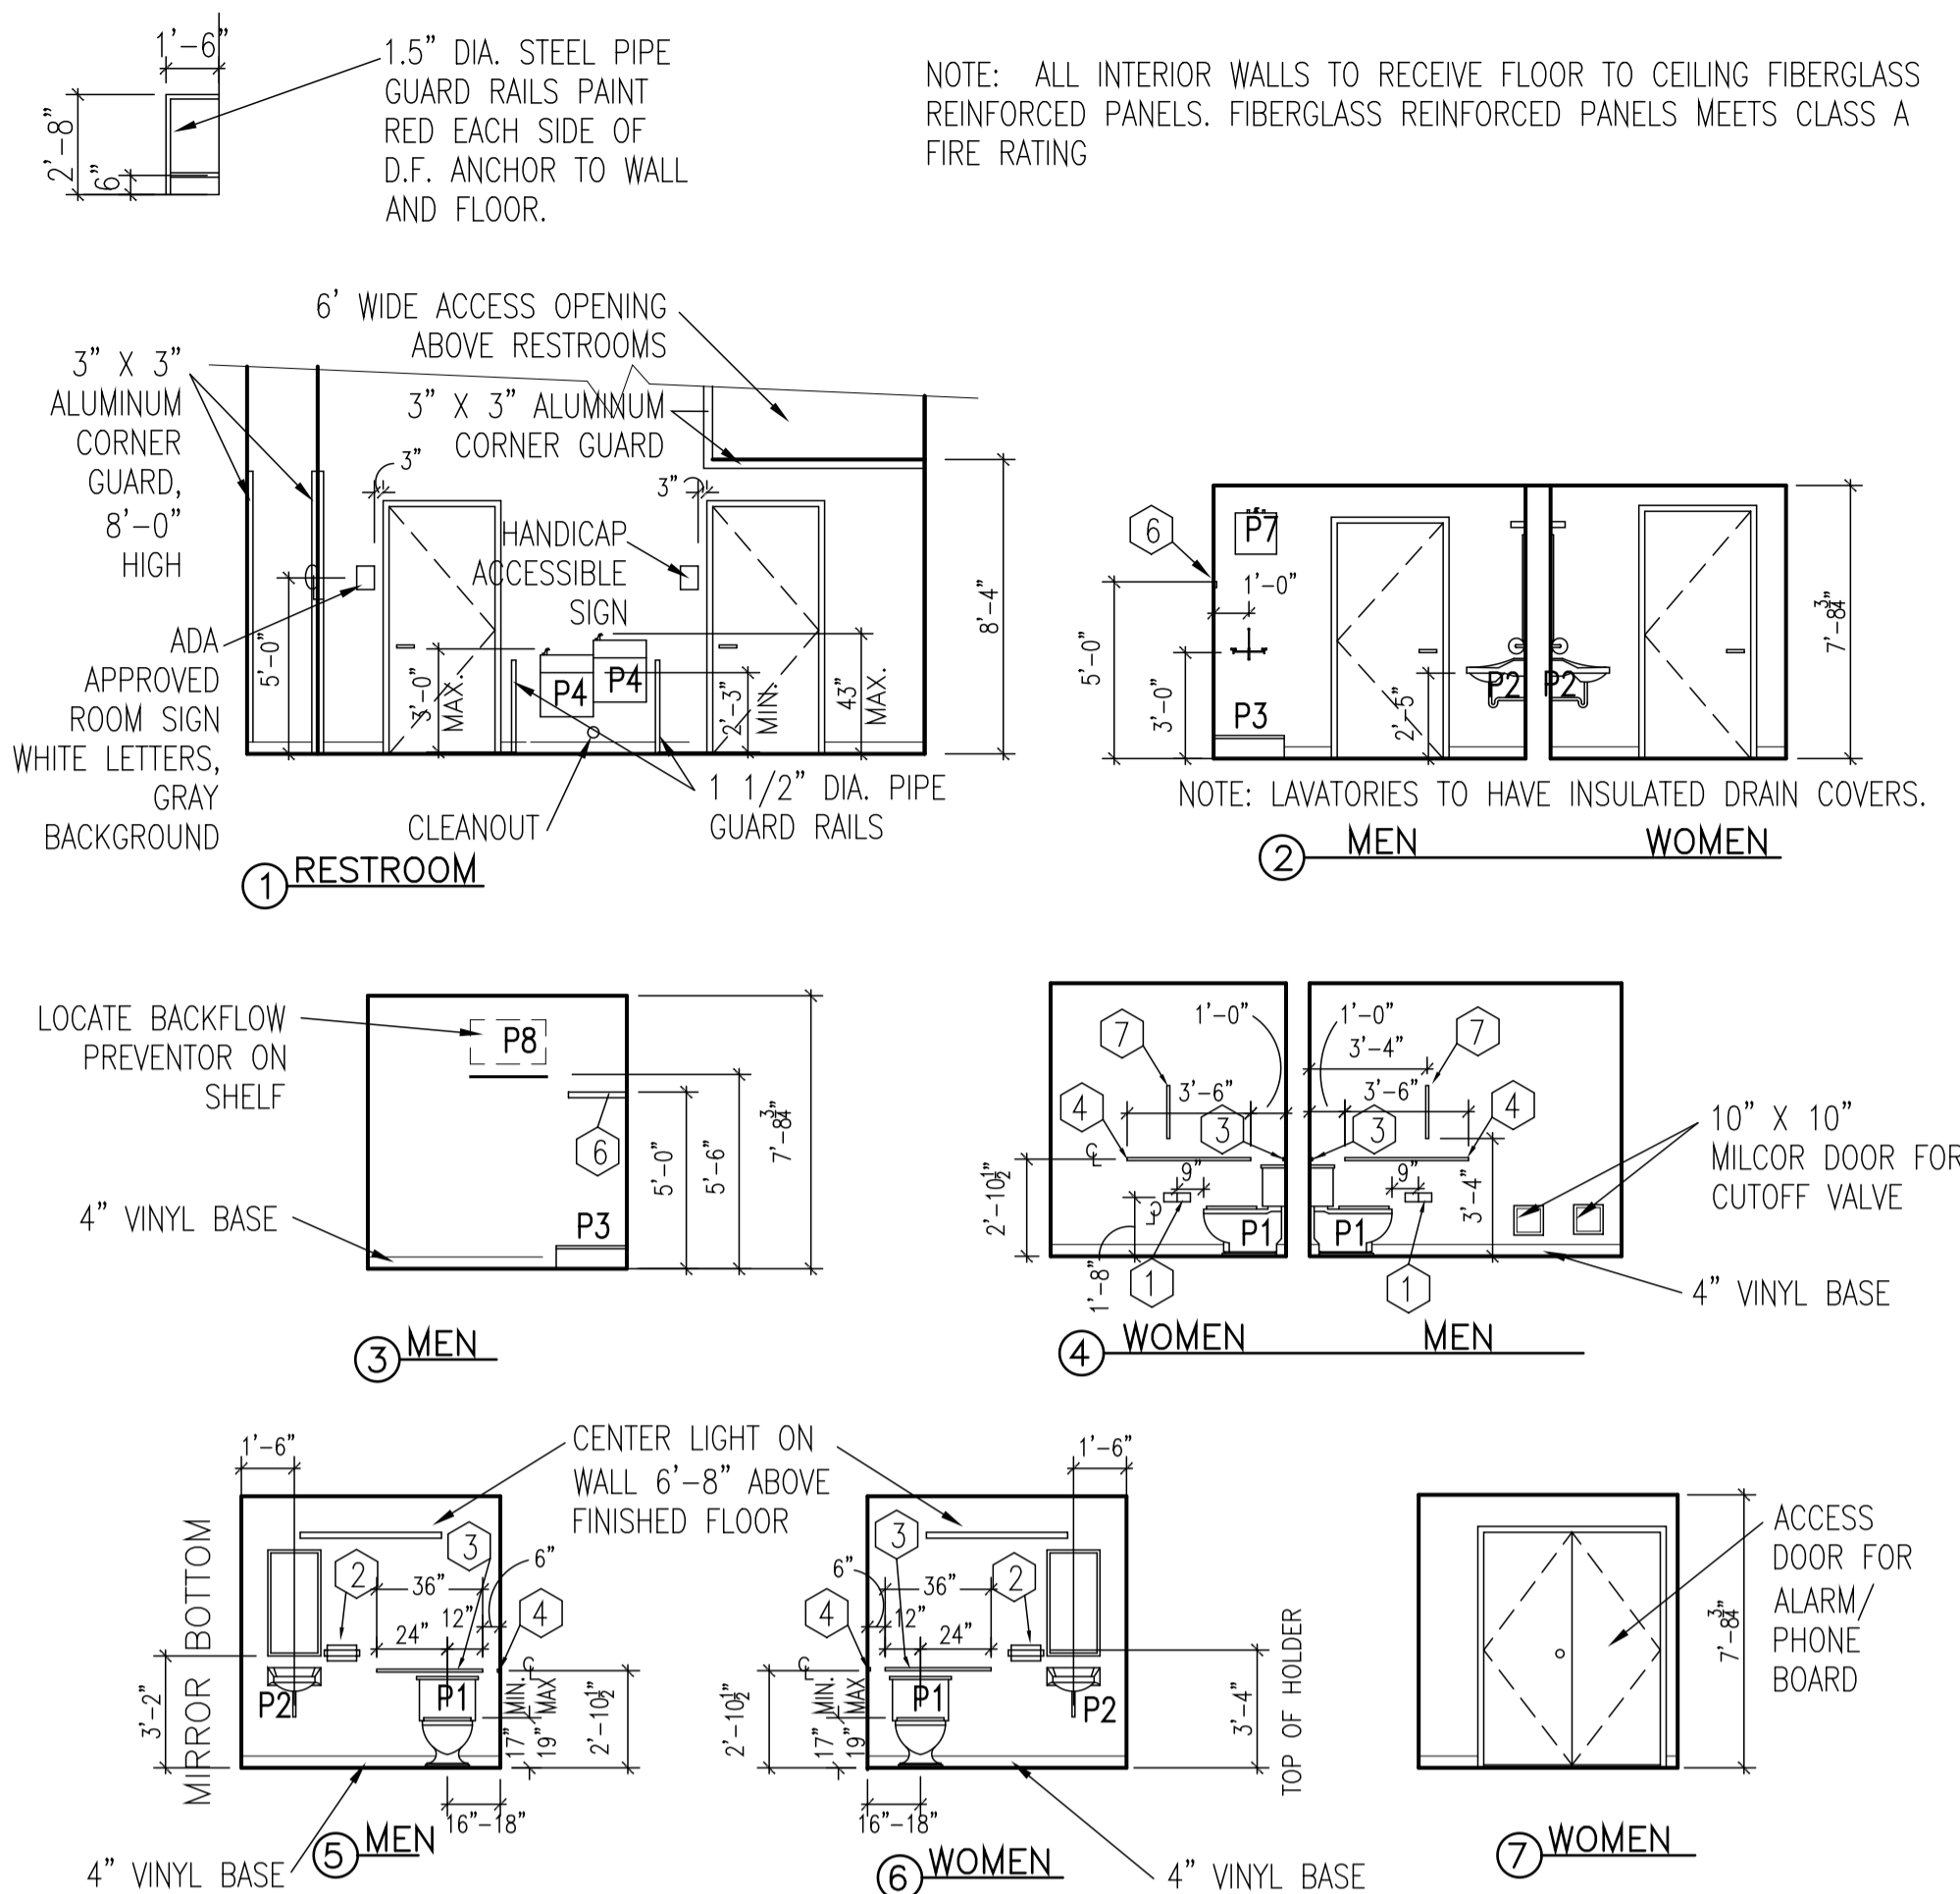

ABE01R


6 INTERIOR BATHROOM ELEVATIONS

FRAME THIS WALL W/ 3-5/8"
16 GA. METAL STUDS

CONNECT BOTTOM TRACK OF WALL TO
CONCRETE SLAB WITH 0.157" DIA.
POWDER ACTUATED FASTENER
EMBEDDED 1" MIN. INTO CONCRETE
SLAB SPACED @ 24" O.C. MAX.
CONNECT TOP AND BOTTOM TRACK OF
WALL STUDS WITH 2 SCREWS TO
PERPENDICULAR CEILING STUDS OR
WITH 1 SCREW @ 16" O.C. MAX. TO
PERIMETER FRAMING.

PROVIDE A 2" DEEP X 18 GAGE
DEFLECTION TRACK @ TOP OF WALL
STUDS THAT EXTEND TO THE BOTTOM
OF THE STEEL DECK WITH (2) #10
SCREWS @ 12 O.C. STAGGERED.
REFER TO SPECIFICATION SECTION
05400 FOR ADDITIONAL MINIMUM
CONNECTION INFORMATION.

1 1/2" DIAMETER PIPE GUARD
RAIL ON EITHER SIDE OF
DRINKING FOUNTAIN. PAINT RAIL
RED AND ANCHOR TO FLOOR
AND WALL. OVERALL HEIGHT TO
BE 32" AND BOTTOM
HORIZONTAL TO BE NO MORE
THAN 5" ABOVE FLOOR LINE.

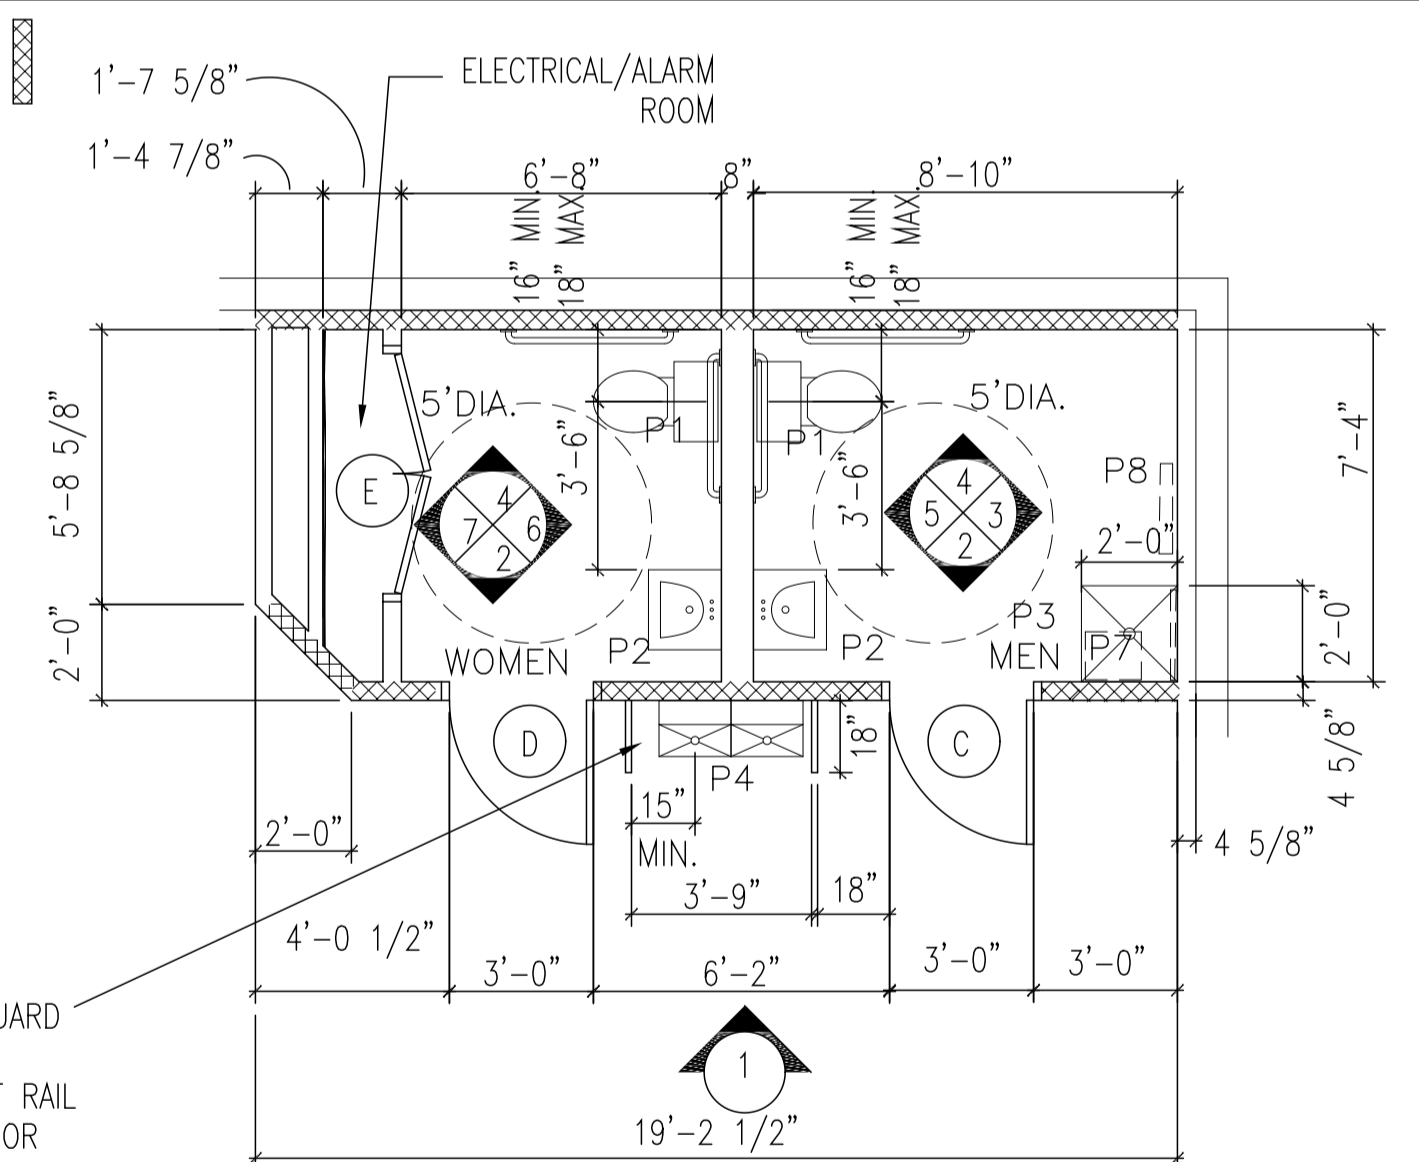

NOTE: REFER TO 1/A1 FOR RESTROOM LOCATION

APB0165W2R

7	RESTROOM PLAN
---	---------------

FIXTURES				ACCESSORIES			
P1	TOILET	P5	NOT USED	1	TOILET PAPER HOLDER	4	GRAB BAR 42" LONG 1-1/2" DIA.
P2	LAVATORY	P6	NOT USED		PAPER TOWEL HOLDER		5
P3	MOP SINK	P7	WATER HEATER	3	GRAB BAR 36" LONG 1-1/2" DIA.	6	MOP HOLDER
P4	ELECTRIC DRINKING FOUNTAIN	P8	BACKFLOW PREVENTOR				7

3	$1/8'' = 1'-0''$
---	------------------

8	RESTROOM LEGEND
---	-----------------

REVISIONS	
1	REV1
2	REV2
3	REV3
4	REV4
5	REV5
6	REV6

REVISIONS

AutoZone Store No. 6365
33001 WEST ATLANTICA\

33096

33096

33096

Architect: George Callow - License #AR0014155
123 South Front Street
Memphis, Tennessee 38103
TEL: (901) 495-8705 FAX: (901) 495-8969
For Bidding & Contractor Information Contact:
McGraw - Hill Construction Tel. 615-884-1017
www.construction.com

George W Callow
AR0014155
55 State of Florida

03/19/17

71-R

P720-12000007

03/03/2020