



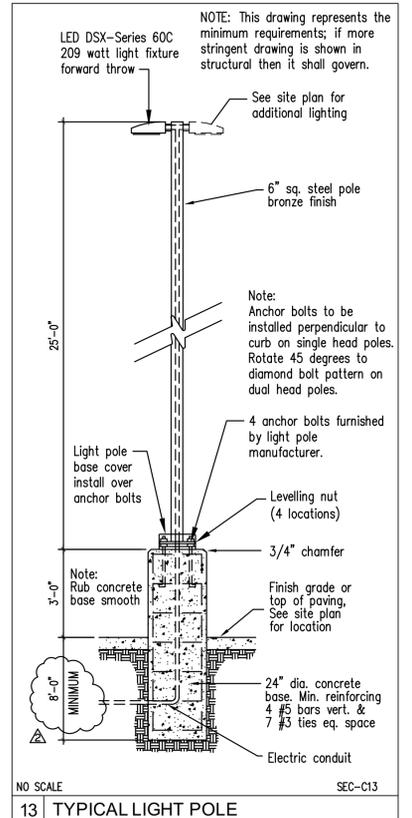

PHOTOMETRIC PLAN

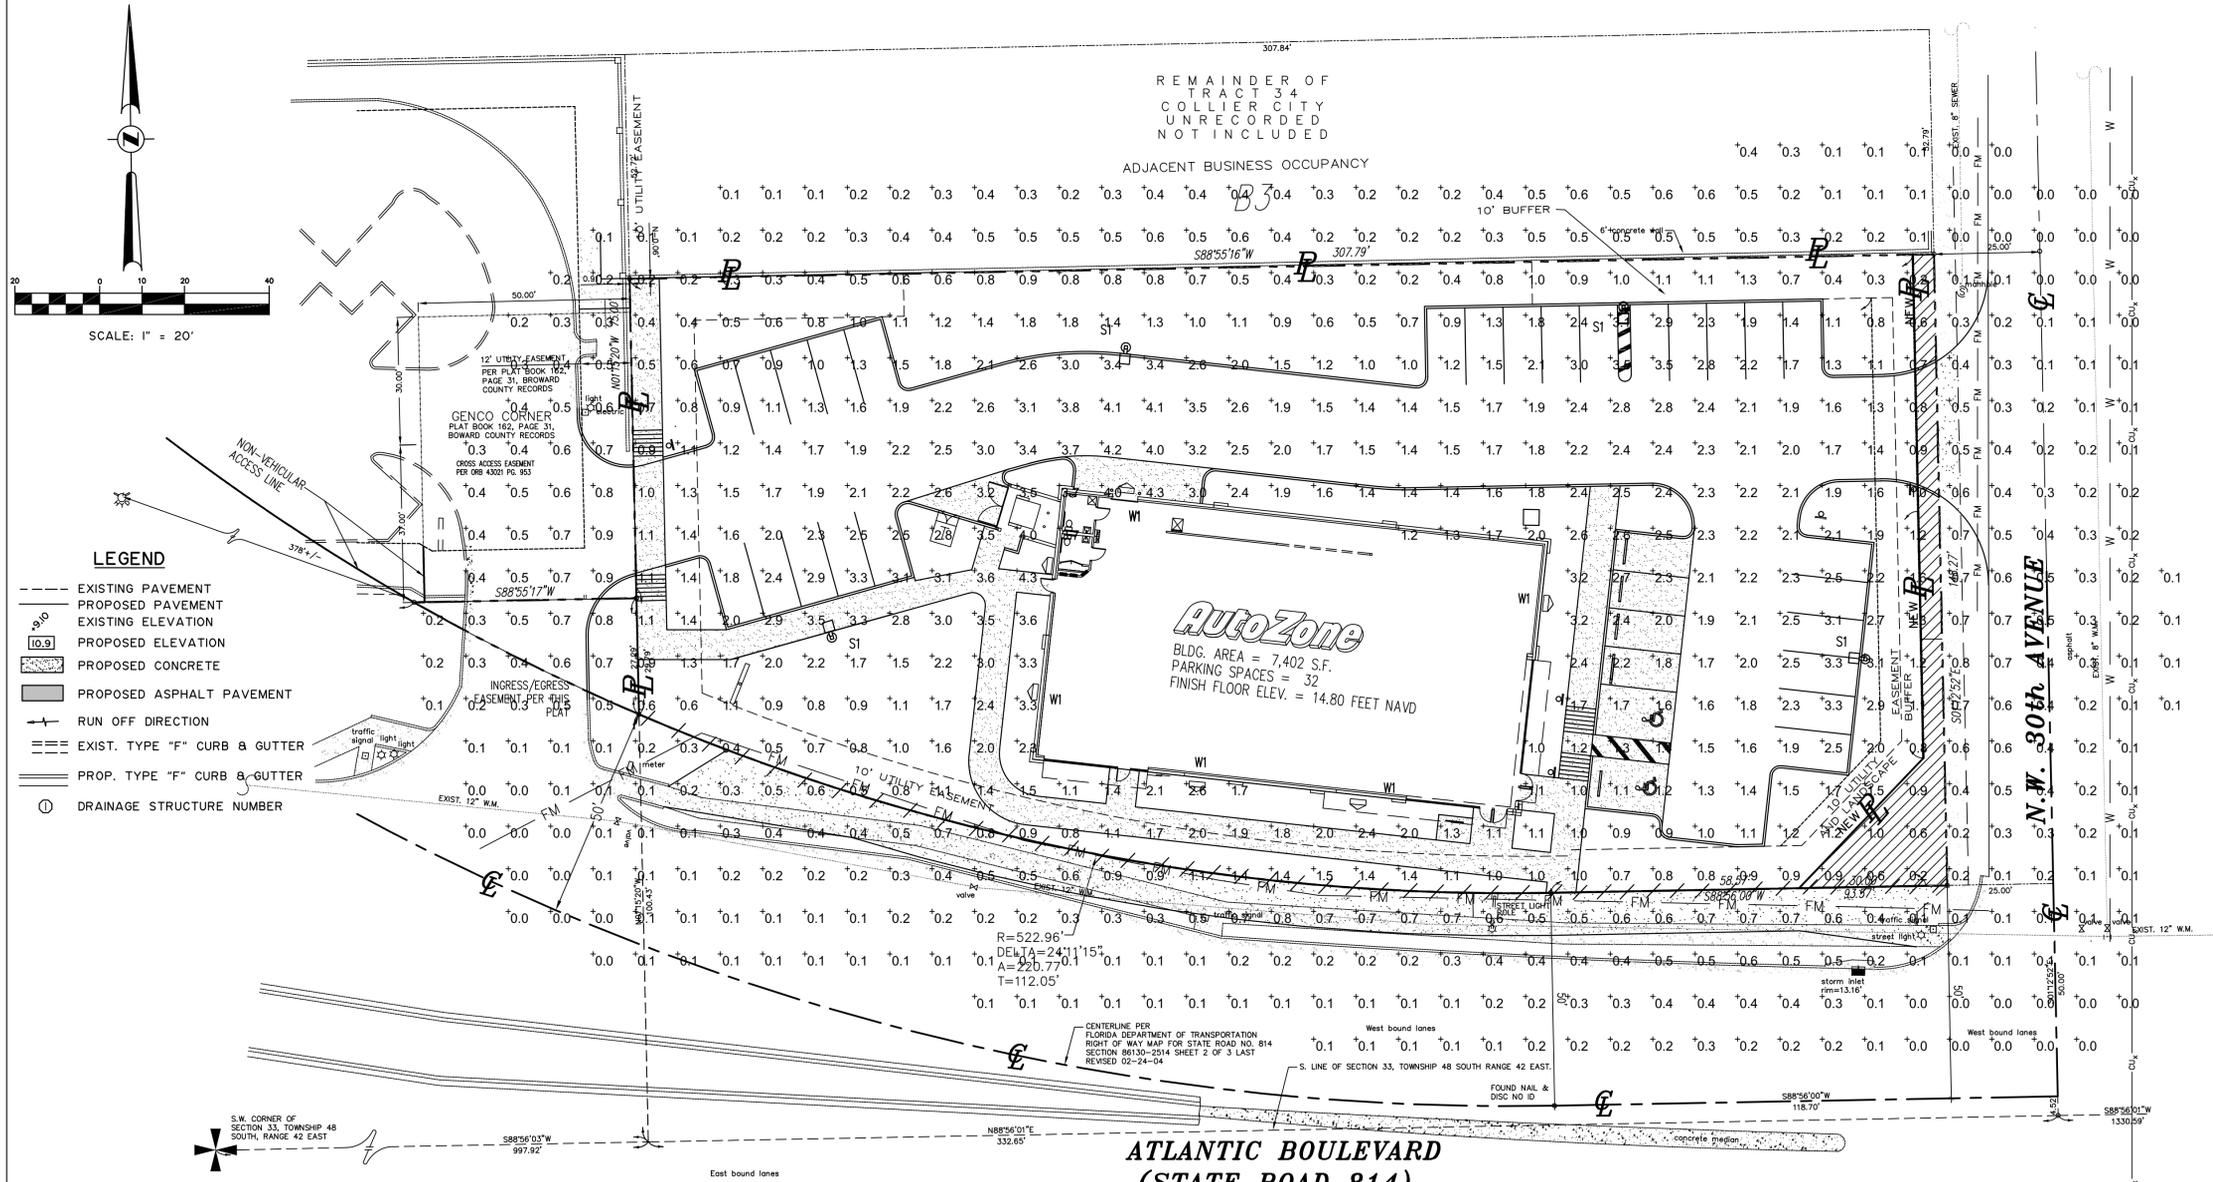

TYP	SYMBOL	DESCRIPTION	LAMP	LUMENS	LLF	QTY
S1	☐	UTLUNA - DSX LED 60CIES FULL CUTOFF DISTRIBUTION MOUNTED @ DOWN POSITION MOUNTED HEIGHT = 25'-0"	LED - 209 WATTS	ABSOLUTE	0.95	4
W1	⊂	UTLUNA - DSX LED 60CIES FULL CUTOFF DISTRIBUTION MOUNTED @ DOWN POSITION MOUNTED HEIGHT = 12'-0"	LED - 40 WATTS	ABSOLUTE	0.95	6

STATISTICS	Description	Symbol	Avg	Max	Min
Calc Zone	*		1.0 fc	4.3 fc	0.0 fc

NOTE TO CONTRACTOR
 CONTRACTOR SHALL FAMILIARIZE HIMSELF WITH THE SOILS REPORT PREPARED UNIVERSAL SOILS AND SHALL IMPLEMENT ALL RECOMMENDATIONS IDENTIFIED. CONTRACTOR TO NOTIFY ENGINEER IF THERE IS A DISCREPANCY BETWEEN THE PLANS AND THE REPORT.

- UNDERGROUND CONTRACTOR:**
- Underground Contractor shall comply with the Trench Safety Act, HB 3083, Florida Statutes, which incorporates, but is not limited to, the following:
 - OSHA Standard 29 C.F.R. Part 1926, Subpart P, Excavation and Trenches.
 - Contract bids for trench excavations (in excess of 5 feet deep) shall include reference to the safety standards, written assurance of compliance, and a separate item identifying the cost of compliance.
 - Adhere to any special shoring requirements of the state or other political subdivision.
 - Engineer is not responsible for the safety of the excavation or design and construction of any shoring.

LIGHTING NOTES:

- TIME CONTROLS: ALL SITE LIGHTING IS CONTROLLED AND MONITORED BY AN ENERGY MANAGEMENT SYSTEM CALLED VENSTAR WHICH IS CONTROLLED AT AUTOZONE CORPORATE OFFICES. ALL SITE LIGHTING IS PROGRAMMED TO AUTOMATICALLY TURN ON AT DUSK AND REDUCED BY 50 PERCENT AFTER THE CLOSE OF BUSINESS TO THE MINIMUM LEVEL NEEDED UNDER THE IESNA TO ENSURE SAFETY AND SECURITY.
- ALL FIXTURES ARE FULL CUTOFF DISTRIBUTION AND MOUNTED @ 0° DOWN POSITION.
- NO FLOODLIGHTS ARE PROPOSED.

OWNER: **AutoZone, Inc.**
 123 S. FRONT STREET, 3RD FLOOR
 MEMPHIS, TENNESSEE 38103

PREPARED FOR: **AutoZone STORE DEVELOPMENT**
 Store No.: 6365
 3001 W. Atlantic Avenue
 Pompano Beach, FL 33069

PHOTOMETRIC PLAN

SCALE: 1" = 20'-0"

REVISIONS
1. 1/5/18 COORDINATION
2. 2/7/20 CITY COMMENTS
3.
4.
5.
6.
7.

ARCHITECT:
 DRAFTSMAN: CEH
 CHECKED BY:
 DATE: 11/17/15
 PROTOTYPE SIZE

AAC
 PZ20-12000007
 2/2/21

Gerardo Zamora
 Digitally signed by Gerardo Zamora
 Date: 2020.02.10 07:12:06 -0500
 Gerardo Zamora P.E.
 CIVIL ENGINEER
 P.E. No. 44207
 E.B. 0006791
 STATE OF FLORIDA

PROJECT No. 2015-14 DATE: 4/5/20
ZAMORA & ASSOCIATES, INC.
 ENGINEERING LAND PLANNING
 11410 N. KENDALL DRIVE SUITE 302 MIAMI, FLORIDA 33157
 (305) 273-7801 FAX (305) 273-9514

AAC
 PZ20-12000007
 03/03/2020