

COPYRIGHT 2021 GALLO HERBERT ARCHITECTS  
IT IS A VIOLATION OF THE LAW FOR ANY PERSON, UNLESS ACTING UNDER THE DIRECTION OF A LICENSED ARCHITECT TO ALTER THESE PLANS AND SPECIFICATIONS. THIS DOCUMENT CONTAINS PROPERTY INFORMATION AND SHALL NOT BE USED OR REPRODUCED, OR ITS CONTENTS DISCLOSED, IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN CONSENT OF GALLO HERBERT ARCHITECTS.  
CONTRACTOR(S) SHALL VERIFY EXISTING CONDITIONS AND CORRELATE DIMENSIONS PRIOR TO PROVIDING THE WORK DETAILED IN THESE DRAWINGS, AND SHALL PROMPTLY NOTIFY THE DESIGNER OF ANY DISCREPANCIES.


NFPA LIFE SAFETY DATA	FLORIDA BUILDING CODE DATA
FLORIDA FIRE PREVENTION CODE, SEVENTH EDITION INCLUDING NFPA, 1 FIRE CODE AND NFPA 101, LIFE SAFTEY CODE, 2018 EDITION	FLORIDA BUILDING CODE 2020- SEVENTH EDITION
NEW AIRCRAFT HANGAR STORAGE OCCUPANCY CHAPTER 42 ORDINARY HAZARD BUILDING IS NOT FULLY SPRINKLERED	USE AND OCCUPANCY S-1 AIRCRAFT STORAGE HANGAR CHAPTER 3
NFPA 42.6 SPECIAL PROVISIONS FOR AIRCRAFT HANGARS	SPECIAL DETAILED REQUIREMENTS BASED ON USE & OCCUPANCY CHAPTER 4- 412- AIRCRAFT RELATED SPECIAL REQUIREMENTS
2 MEANS OF EGRESS REQUIRED FROM ALL AIRCRAFT HNAGAR AREAS.	[F] 412.4.6.1 HAZARDOUS OPERATIONS. ANY GROUP III AIRCRAFT HANGAR ACCORDING TO TABLE 412.4.6 THAT CONTAINS HAZARDOUS OPERATIONS INCLUDING, BUT NOT LIMITED TO, THE FOLLOWING SHALL BE PROVIDED WITH A GROUP I OR II FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH NFPA 409 AS APPLICABLE. 1. DOPING. 2. HOT WORK INCLUDING, BUT NOT LIMITED TO, WELDING, TORCH CUTTING AND TORCH SOLDERING. 3. FUEL TRANSFER. 4. FUEL TANK REPAIR OR MAINTENANCE NOT INCLUDING DEFUELED TANKS IN ACCORDANCE WITH NFPA 409, INERTED TANKS OR TANKS THAT HAVE NEVER BEEN FUELED. 5. SPRAY FINISHING OPERATIONS. 6. TOTAL RUEL CAPACITY OF ALL AIRCRAFT WITHIN THE UNSPRINKLERED SINGLE AREA IN EXCESS OF 1,600 GALLONS (6057 L). 7. TOTAL FUEL CAPACITY OF ALL AIRCRAFT WITHIN THE MAXIMUM SINGLE FIRE AREA IN EXCESS OF 7,500 GALLONS (28,390 L) FOR A HANGAR WITH AN AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH SECTION 903.3.1.1.
EXITS FROM AIRCRAFT STORAGE AREASSHALL BE AT INTERVALS NOT EXCEEDING 150 FT.	GENERAL BUILDING HEIGHTS AND AREAS CHAPTER 5- ALLOWABLE HEIGHT TYPE IIIB N.S. 55 FT.
HORIZAONTAL EXITS AT FIRE BARRIERS SHALL NOT EXCEED 100 FT. SPACING.	STORIES ABOVE GRADE PLANE S-1, N.S. = 3 MAX
"SMASH DOORS" NOT APPLICABLE	BUILDING AREA, S-1, N.S. = 17,500 SF
MEZZANINES NOT APPLICABLE.	AREA MOD. FOR BUILDING D,E,F NOT REQUIRED
DEAD ENDS SHALL NOT EXCEED 50 FT. FOR NON HIGH HAZARD AREAS.	TYPE CONSTRUCTION: IIIB
MAXMUM COMMON PATH OF TRAVEL- ORDINARY HAZARD, UN-SPRINKLERED = 50 FT	CH 6 FIRE RATED EXTERIOR WALLS S-1 OCC , X IS GREATER THAN
DEAD END 50 FT. MAX.	OR EQUAL TO 30 FT ALLOW ZERO HOUR RATED EXT WALLS.
MAXIMUM TRAVEL DISTANCE TO EXITS ORDINARY HAZARD, UNSPRINKLERED=200 FT MAX	
UNPROTECTED VERTICAL OPENINGS NOT APPLICABLE	
INTERIOR WALL AND CEILING FINISHES-PER REQUIREMENTS	
DETECTION ALARM & COMMUNICATION NOT REQUIRED	
NFPA 409 STANDARD ON AIRCRAFT HANGERS	
GROUP III HANGAR TYPE III(200) CONSTRUCTION TYPE PER NFPA 220	
HANGAR DOORS LESS THAN 28 FT. HIGH	
MAXIMUM FIRE AREA LESS THAN 12,000 S.F.	
BUILDING UNSPRINKLERED AS ALLOWED AS ORDINARY HAZARD PER FBC 412.4.6.1	

EMERGENCY RADIO SIGNAL / BI-DIRECTIONAL AMPLIFICATION

ALL BUILDINGS SHALL BE TESTED FOR EMERGENY RADIO SIGNAL STRENGTH AFTER THE SHELL IS CONSTRUCTED. VERIFY WITH MUNICIPALITY FIRE DEPARTMENT FOR TESTING REQUIREMENTS PRIOR TO TESTING. IF THE BUILDING IS FOUND TO REQUIRE A B.D.A. (BI-DIRECTIONAL AMPLIFICATION SYSTEM) OWNER WILL ENGAGE A SPECIALTY ENGINEER TO DESIGN A BOOSTER SYTEM IN FULL ACCORDANCE WITH NFPA 72 AND LOCAL AUTHORITIES HAVING JURISDICTION.

DETAILS OF CONSTRUCTION SUCH AS LOCATION OF HEAD END EQUIPMENT AND CABLE PATHWAYS VERTICALLY AND HORIZONTALLY SHALL BE SPECIFIED.

THE CONSTRUCTION DRAWINGS WILL INCLUDE PLANNING FOR POSSIBLE BDA EQUIPMENT LOCATION AND CONDUITS. BDA WILL BE IN A TWO HOUR FIRE RATED ROOM NOT LESS THAN 3'WIDE BY 5' LONG. VERTICAL CABLE CHASES IF NECESSARY WILL NEED TO PROVIDE 2 HOUR FIRE RATING. HORIZONTAL CABLE NEED NOT BE FIRE RATED. CABLE AND EQUIPMENT SHALL NOT BE LOCATED IN STAIRS

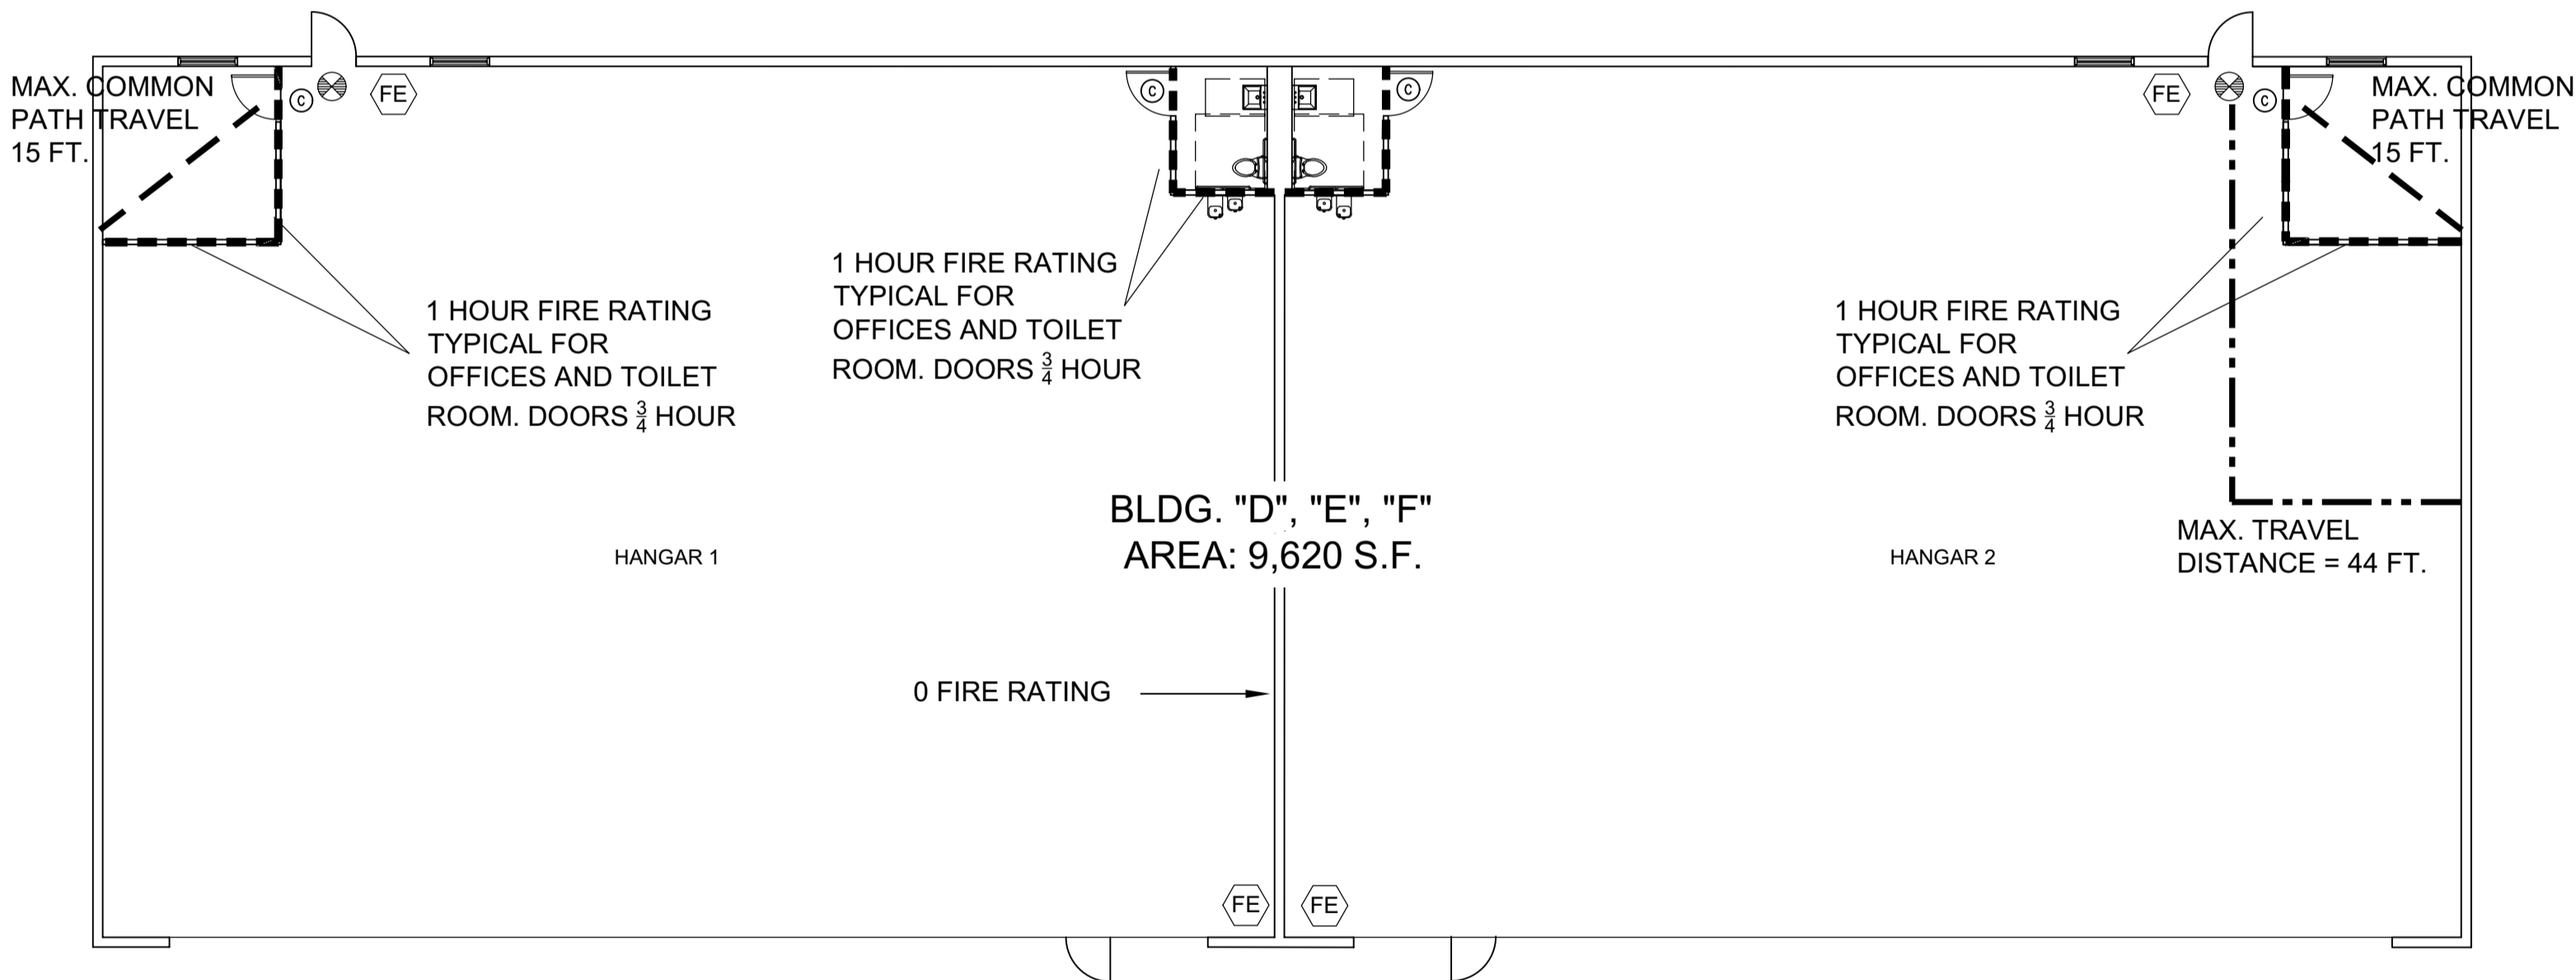

GENERAL NOTES: UN-SPRINKLERED	LEGEND --- TRAVEL DISTANCE PATH --- COMMON PATH --- DEAD-END CORRIDOR CLG. MTD. DIRECTIONAL EXIT SIGN WALL MTD. EXIT SIGN FIRE EXTINGUISHER - SEMI-RECESSED CABINET W/ 3A 4BC RATING FIRE EXTINGUISHER - WALL MOUNTED WRACKET W/ 3A 4BC RATING F.D. KEY F.D. KEY BOX LOCATION (VERIFY W/ F.D. MANUF. TYPE KNOX OR SUPRA) EMERGENCY LIGHT	EGRESS DATA: FBC S-1 OCC OCCUPANCY LOAD S-1 MAX. TRAVEL DISTANCE TO EXIT (FT) 200' MAX. DEAD END CORRIDOR 20' MIN. CORRIDOR WIDTH 44" MIN. CLEAR OPENING 32" MAX. COMMON PATH (FT) 90'	OCCUPANCY LOAD SUMMARY FBC CH 10 OCCUPANCY CLASSIFICATION: GROUP S-1 CAPACITY PER F.B.C 1004.5 AIRCRAFT HANGARS 1 PER 500 GROSS EACH HANGAR IS 5600 SF THEREFORE OCCUPANT LOAD IS 5600 / 500= 11.2 THEREFORE 13 PEOPLE EACH BAY.	INTERIOR FINISH CLASSIFICATION LIMITATIONS OCCUPANCY S-1 UN-SPRINKLERED FLOOR CLASS I OR II ARE PERMITTED CEILING CLASS I OR II ARE PERMITTED WALLS CLASS I OR II ARE PERMITTED PARTITIONS CLASS I OR II ARE PERMITTED FIRE EXTINGUISHER 2A-10B:C 5 LB.
----------------------------------	---	--	---	---

LIFE SAFETY SYMBOLS

COMMON PATH OF TRAVEL

DEAD END

MAXIMUM TRAVEL DISTANCE

EXIT SIGNS, WITH OR WITHOUT DIRECTION ARROWS

EMERGENCY LIGHTS

FIRE EXTINGUISHERS DISTRIBUTED PER REQUIREMENTS ON ALL LEVELS.

GHAA

GALLO HERBERT ARCHITECTS

1311 W NEWPORT CENTER DRIVE DEERFIELD BEACH, FLORIDA 33442 PH. 954.794.0300 FAX. 954.794.0301

AA226001731  
[SEAL]  
WILLIAM J. GALLO FL AR0008440

Brian Herbert

Digitally signed by Brian Herbert  
Date: 2022.06.30 14:35:26 -04'00'  
BRIAN P. HERBERT FL AR0015474  
[PROJECT]

POMPANO BEACH AIR PARK PARCEL Y  
601 NE 10TH ST.  
POMPANO BEACH  
FL 33060  
[OWNER]

POMPANO BEACH

COMPANY NAME  
[REVISIONS]  
No. Description Date  
D.R.C. SUBMITTAL 2022-06-28

PROJECT STATUS  
D.R.C.  
DATE  
2021-03-24  
PROJECT NUMBER  
83-2020  
SCALE  
AS SHOWN  
DRAWN BY  
JET  
CHECKED BY  
JET  
DRAWING TITLE  
BLDG. "D","E","F"  
LIFE SAFETY PLAN  
DRAWING NUMBER  
DEF 102

PZ22-12000020  
8/21/2022

PZ22-12000020  
8/3/2022