

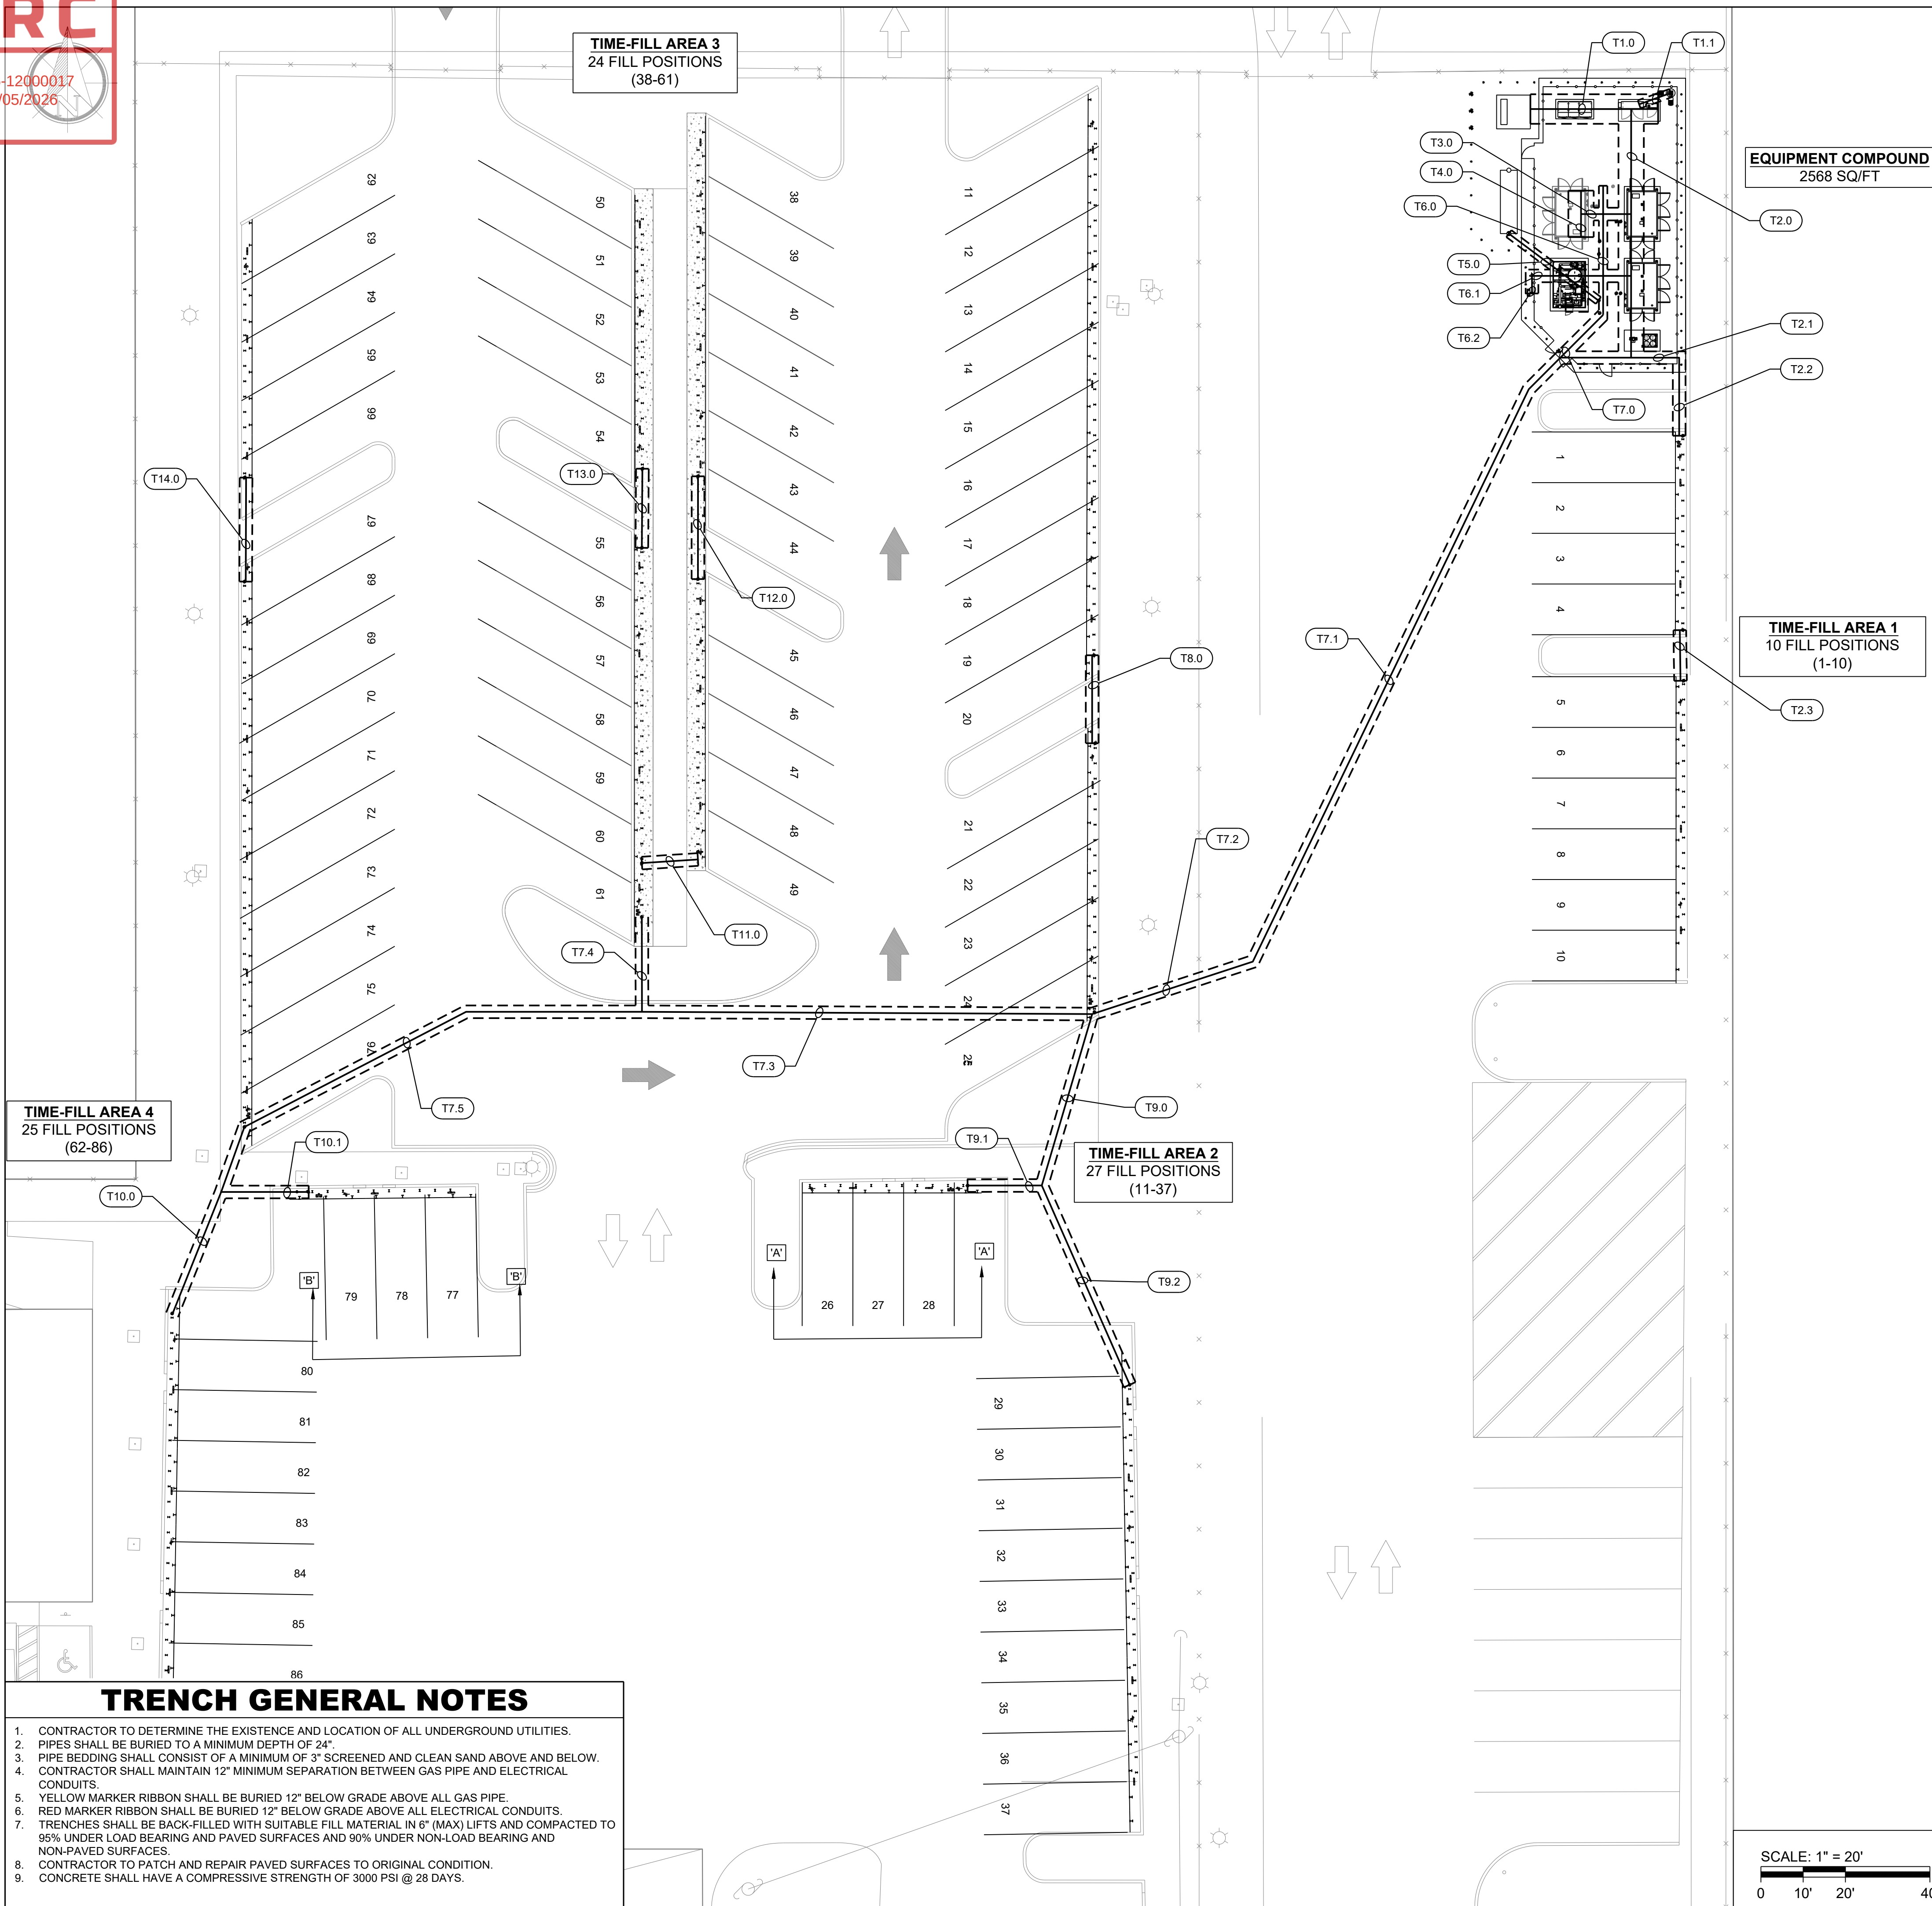
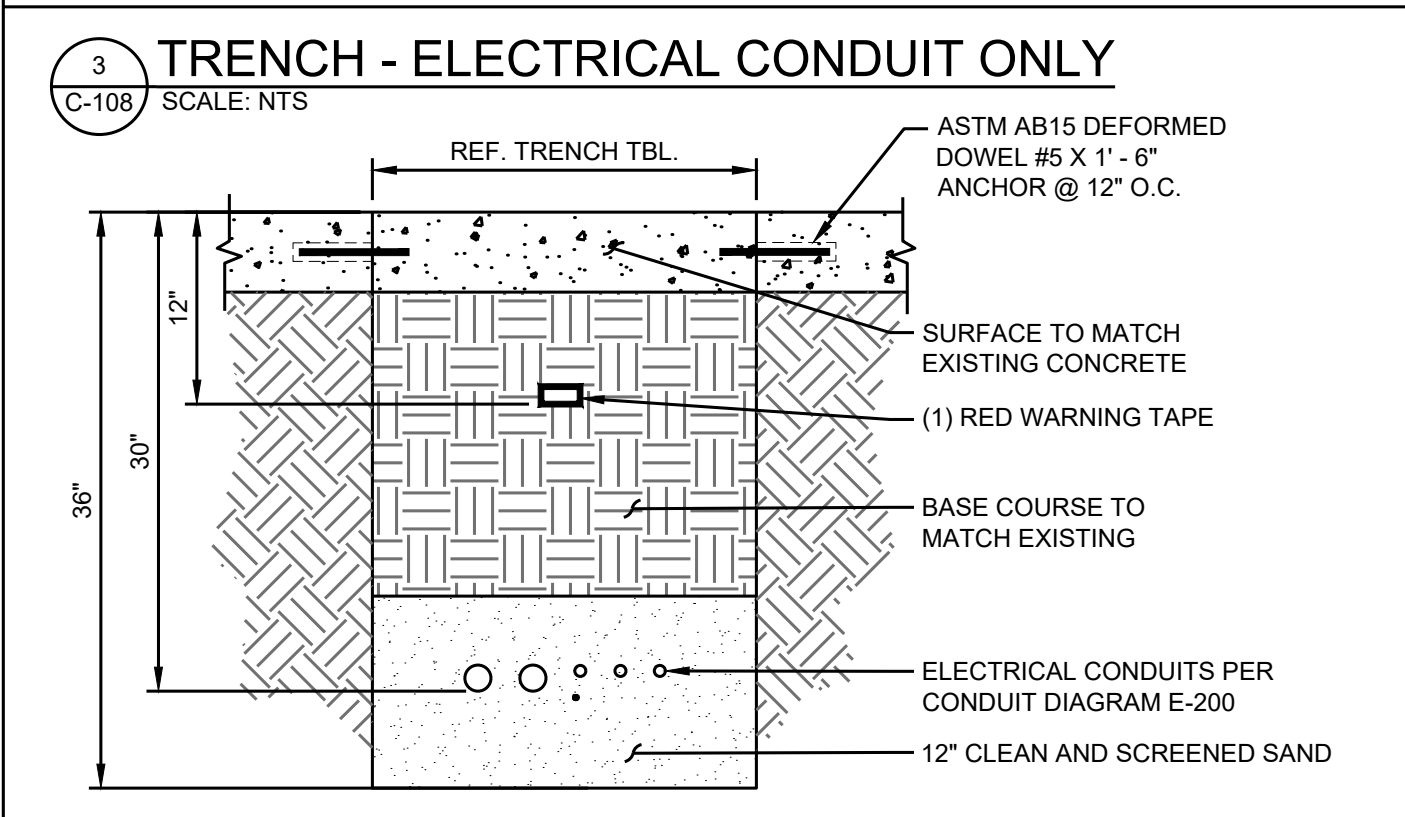


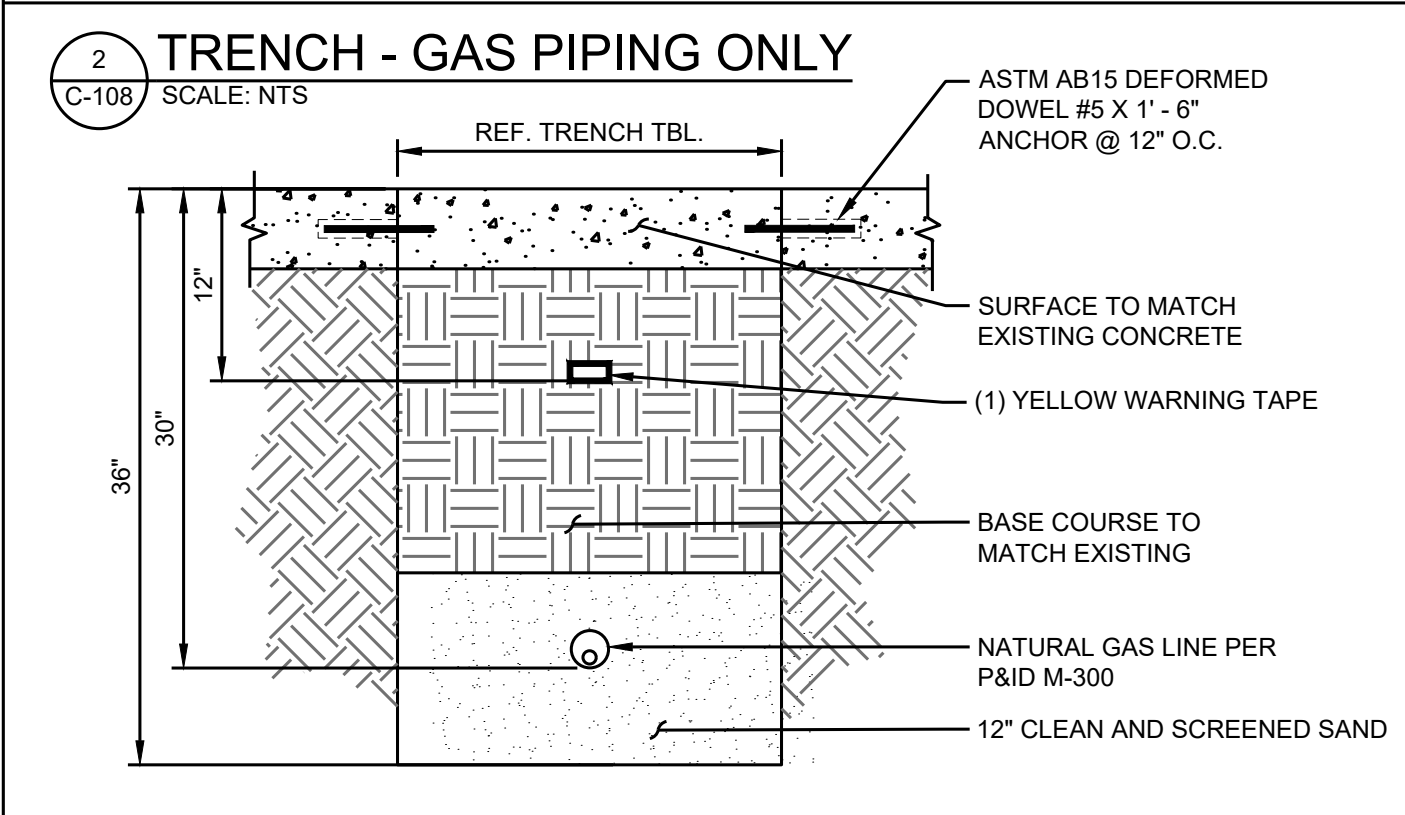

TRENCH TABLE			
ITEM	WIDTH	LENGTH	DETAIL
T1.0	84"	30'	C-108-3
T1.1	24"	8'	C-108-3
T2.0	72"	59'	C-108-1
T2.1	36"	29'	C-108-1
T2.2	36"	19'	C-108-1
T2.3	36"	21'	C-108-1
T3.0	36"	12'	C-108-1
T4.0	72"	11'	C-108-1
T5.0	24"	27'	C-108-2
T6.0	24"	31'	C-108-1
T6.1	36"	24'	C-108-1
T6.2	24"	4'	C-108-1
T7.0	36"	25'	C-108-1
T7.1	36"	151'	C-108-1
T7.2	36"	40'	C-108-1
T7.3	36"	149'	C-108-1
T7.4	36"	23'	C-108-1
T7.5	36"	60'	C-108-1
T8.0	36"	21'	C-108-1
T9.0	36"	43'	C-108-1
T9.1	36"	18'	C-108-1
T9.2	36"	52'	C-108-1
T10.0	36"	48'	C-108-1
T10.1	36"	21'	C-108-1
T11.0	36"	14'	C-108-1
T12.0	36"	25'	C-108-1
T13.0	36"	19'	C-108-1
T14.0	36"	25'	C-108-1

ALL TRENCH @36" DEPTH

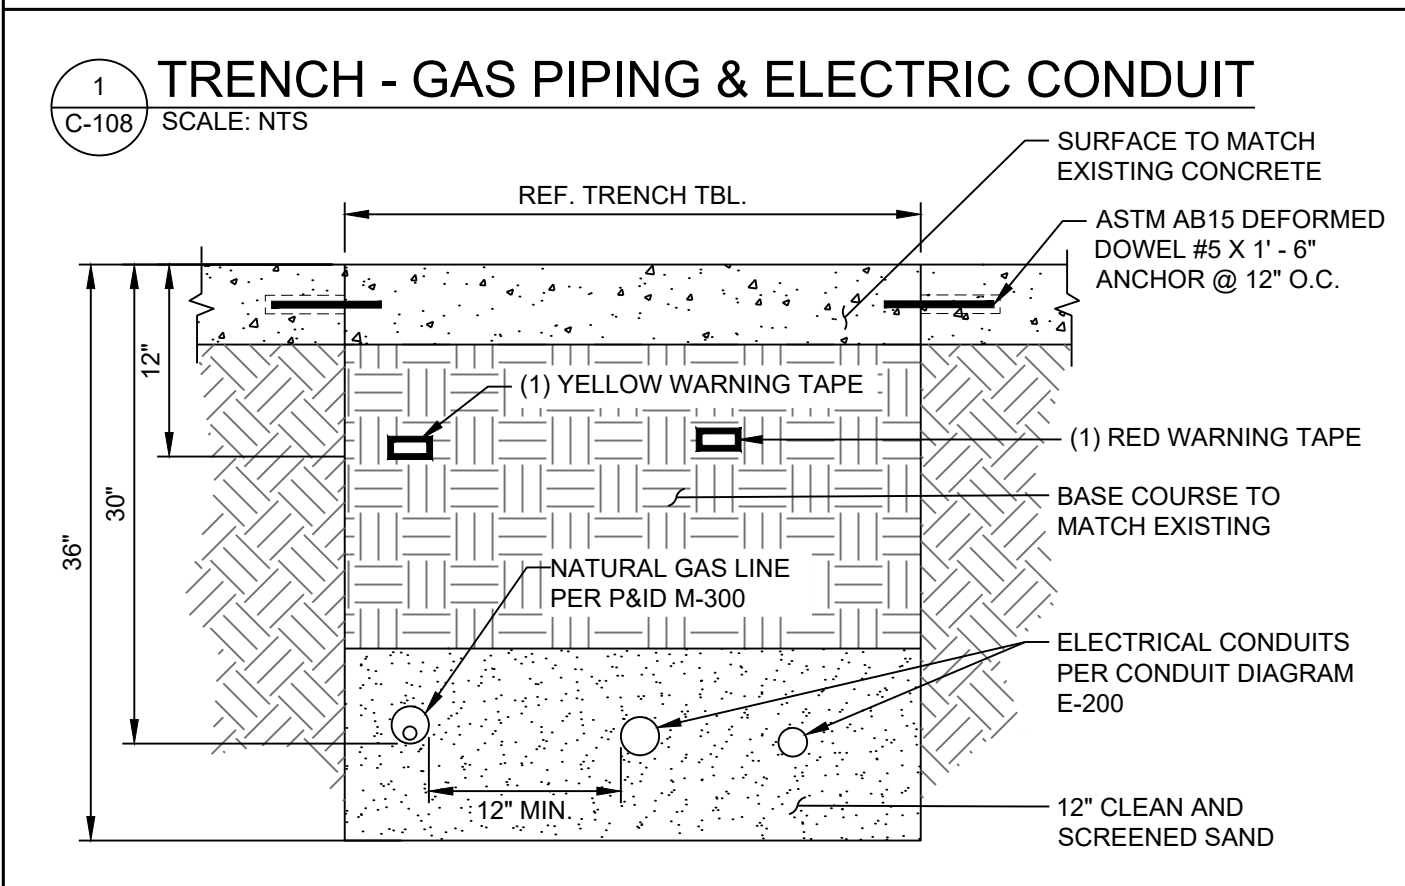

TRENCH GENERAL NOTES

- CONTRACTOR TO DETERMINE THE EXISTENCE AND LOCATION OF ALL UNDERGROUND UTILITIES.
- PIPES SHALL BE BURIED TO A MINIMUM DEPTH OF 24".
- PIPE BEDDING SHALL CONSIST OF A MINIMUM OF 3" SCREENED AND CLEAN SAND ABOVE AND BELOW.
- CONTRACTOR SHALL MAINTAIN 12" MINIMUM SEPARATION BETWEEN GAS PIPE AND ELECTRICAL CONDUITS.
- YELLOW MARKER RIBBON SHALL BE BURIED 12" BELOW GRADE ABOVE ALL GAS PIPE.
- RED MARKER RIBBON SHALL BE BURIED 12" BELOW GRADE ABOVE ALL ELECTRICAL CONDUITS.
- TRENCHES SHALL BE BACK-FILLED WITH SUITABLE FILL MATERIAL IN 6" (MAX) LIFTS AND COMPACTED TO 95% UNDER LOAD BEARING AND PAVED SURFACES AND 90% UNDER NON-LOAD BEARING AND NON-PAVED SURFACES.
- CONTRACTOR TO PATCH AND REPAIR PAVED SURFACES TO ORIGINAL CONDITION.
- CONCRETE SHALL HAVE A COMPRESSIVE STRENGTH OF 3000 PSI @ 28 DAYS.

SCALE: 1" = 20'

0 10' 20' 40'

OWNER
COASTAL WASTE
DENNIS PANTANO
954-947-4000
2407 HAMMONDVILLE RD
POMPANO BEACH, FL 33069

GENERAL CONTRACTOR:
OPAL FUELS
(LIC# SCC131151866)
10225 PHILADELPHIA CT
RANCHO CUCAMONGA, CA 91730
(909)793-3700



COASTAL WASTE

2407 HAMMONDVILLE RD
POMPANO BEACH, FL 33069
CNG FUELING FACILITY



No. DATE BY REMARK
PERMITTING REVISIONS

TRENCH LAYOUT

DRAWN: MRZ
CHECKED: EC
DATE: 08/12/25
PAPER SIZE: D SIZE
SCALE: 1" = 20'
JOB NO.: 24022

C-108

REV NO. **0**