DRC
PZ22-12000051
05/15/2024

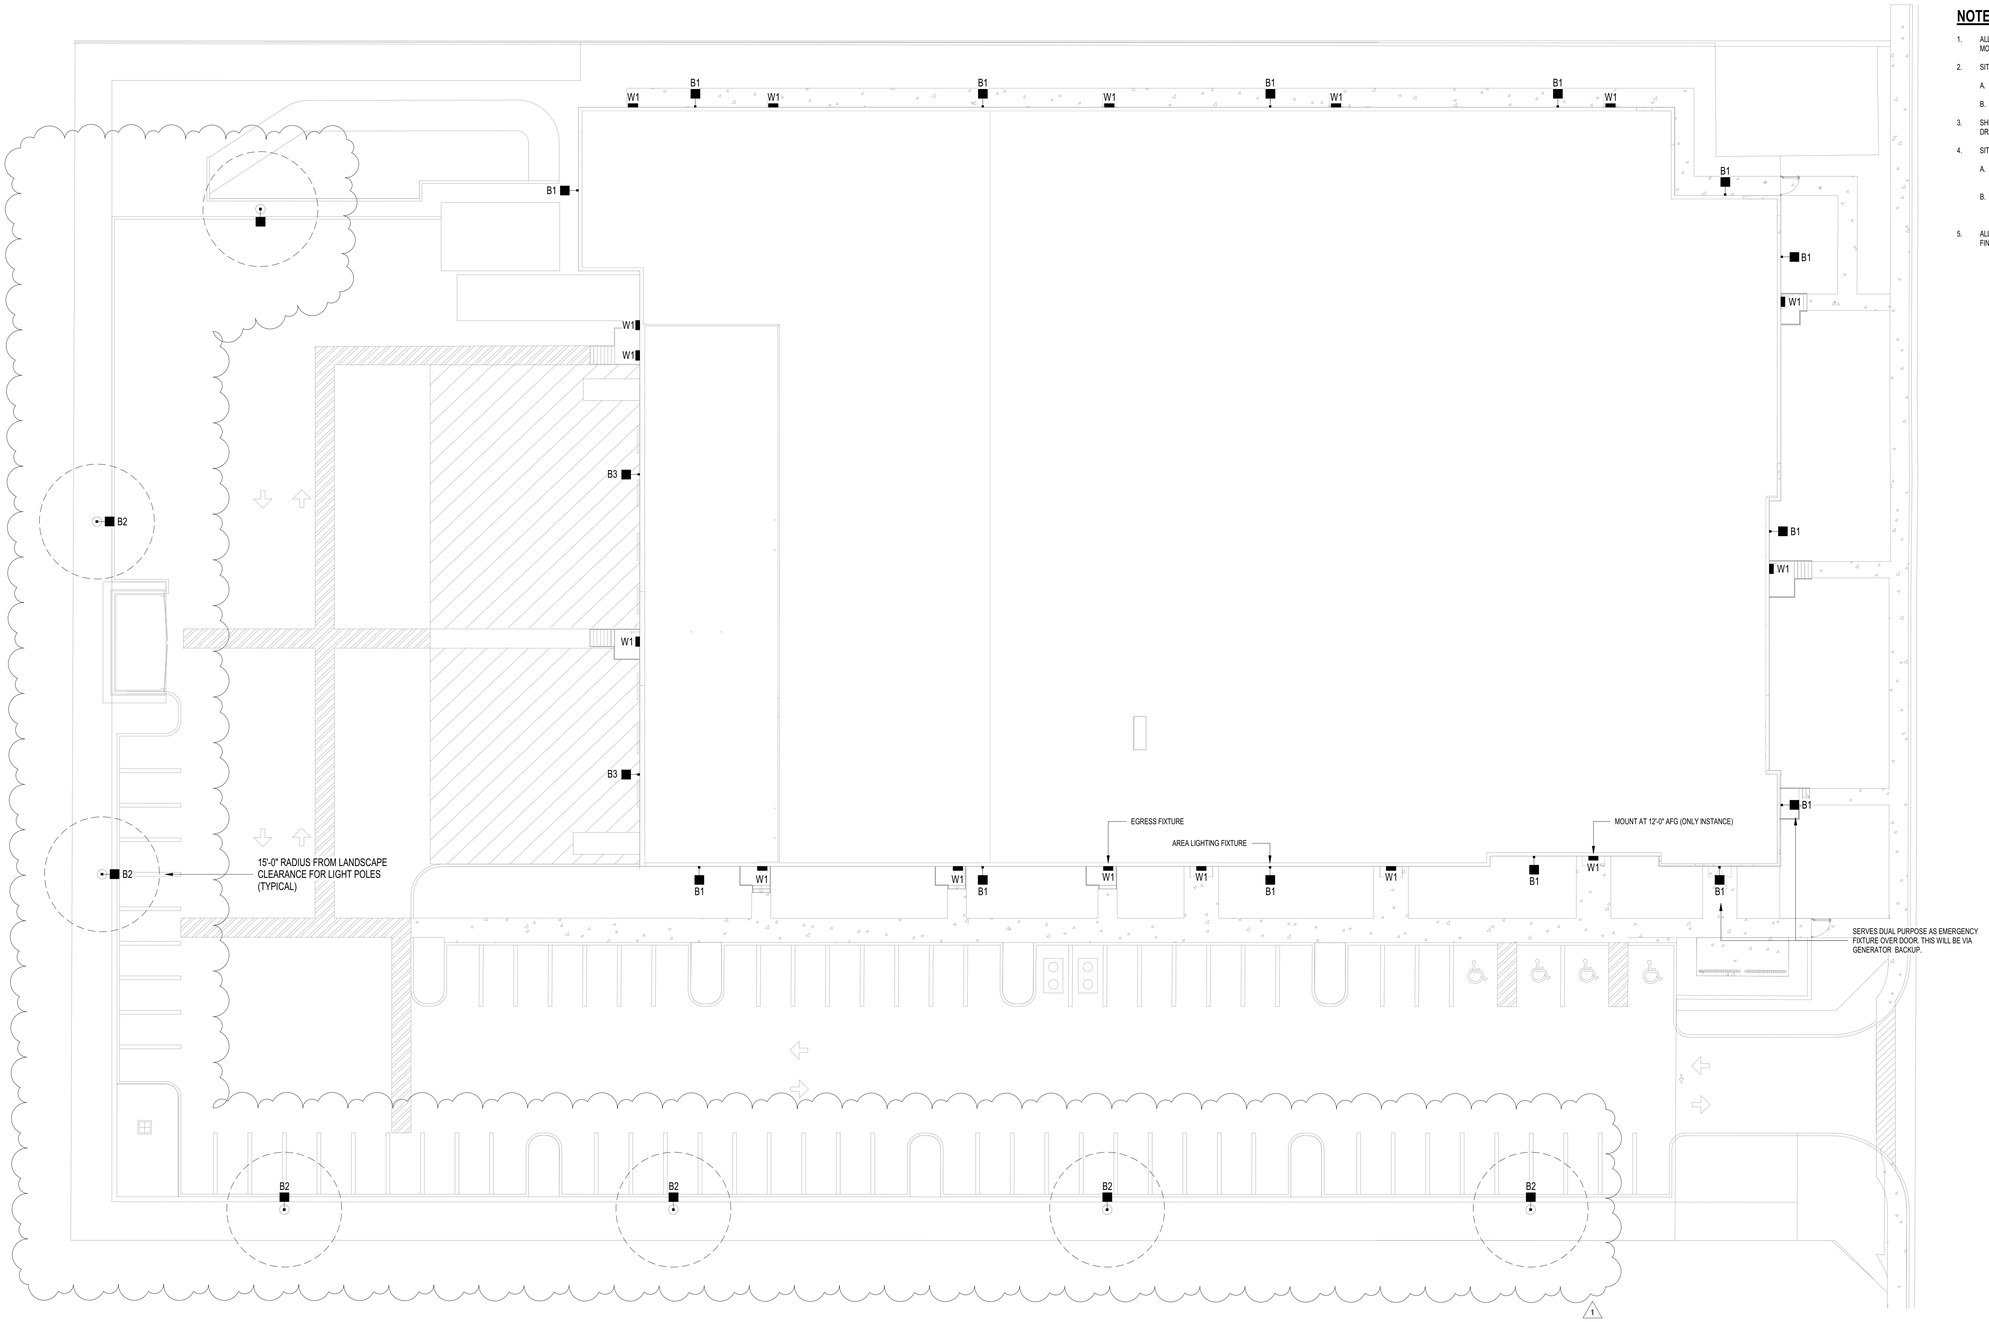

1 SITE LIGHTING
1/16" = 1'-0"

NOTES:

1. ALL SITE LIGHTING FIXTURE HEADS SHALL BE ALIGNED AS SHOWN ON THE DRAWINGS AND MOUNTED AT THE SPECIFIED HEIGHTS. SEE NOTE #2.
2. SITE LIGHTING FIXTURES SHALL BE MOUNTED AS FOLLOWS:
   - A. POLES MOUNTED FIXTURES: 25'-0" POLES WITH 5'-0" BASES.
   - B. WALL MOUNTED FIXTURES: 30'-0" ON WALL.
3. SHIFT WALL FIXTURES AS NECESSARY TO ACCOMMODATE OBSTRUCTIONS AND ROOF DRAINAGE.
4. SITE LIGHTING CONTROL
   - A. ALL SITE AREA LIGHTING SHALL BE CONTROLLED VIA A CONTACTOR ASSEMBLY ACTUATED BY A ROOF MOUNTED PHOTOCELL.
   - B. LOCATE THE CONTACTOR ASSEMBLY WITHIN CLOSE PROXIMITY OF THE ASSOCIATED LIGHTING PANEL (50FT OR LESS). IF NECESSARY, INSTALL THE CONTACTOR ABOVE THE LIGHTING PANEL.
5. ALL SITE LIGHTING SHALL BE FED BY #8 CABLE (WALL MOUNTED, POLE MOUNTED, AND AT FINISHED GRADE).

TRUE NORTH

PLAN NORTH

A·M·KING
1610 East Morehead
Suite 200
Charlotte, NC 28207
704 365 3160 telephone
704 365 3101 facsimile
www.amkinggroup.com

JOHN KOURY, ARCHITECT
704.596.0013 john@jkoury.com

STATE OF FLORIDA
JOHN N. KOURY
AR10137B
REGISTERED ARCHITECT

04.15.2024

Cheney Brothers C-B-I

PROJECT PHASE:SITE DEVELOPMENT

ISSUED: 02.28.2024

REVISIONS & BULLETINS:

NO.	DATE	DESCRIPTION
1	04.15.2024	REVISION 1 - DRC COMMENTS

CHENEY BROTHERS - POMPANO BEACH

2001 N. Andrews Avenue, Pompano Beach, FL

SITE LIGHTING PLANS

E-2

© Copyright 2023 John N. Koury, Architect all rights reserved JOHNKOURYARCHITECT P.L.L.C 245HOGSEDRD, BREVARD, NC 28712