


FITTING TYPE		PIPE SIZE																200psi	
		4"	6"	8"	10"	12"	16"	20"	24"	30"	36"	42"	48"						
90° HORIZ. BEND		14	20	25	30	35	45	54	62	68	112	124	135						
22.5° HORIZ. BEND		6	9	11	13	15	19	22	25	41	48	51	56						
22.5° HORIZ. BEND		3	4	5	6	7	9	11	12	19	22	25	27						
11.25° HORIZ. BEND		1	2	3	3	4	4	5	6	8	10	11	12						
90° VERT. OFFSET		29	41	53	64	74	95	115	134	214	245	279	304						
45° VERT. OFFSET		12	19	24	29	34	39	45	56	89	102	114	126						
22.5° VERT. OFFSET		6	9	12	14	17	19	23	27	43	49	55	60						
11.25° VERT. OFFSET		3	4	6	7	8	9	11	13	21	24	27	30						
PLUG (DEAD END)		32	45	59	70	83	107	129	151	214	245	279	304						
IN-LINE VALVE		32	45	59	70	83	107	129	151	214	245	279	304						
TIE (BRANCH RESTRAINT)		4" x 8"	23	—	—	—	—	—	—	—	—	—	—						
		6" x 8"	21	30	—	—	—	—	—	—	—	—	—						
		8" x 8"	18	24	42	—	—	—	—	—	—	—	—						
		10" x 8"	16	22	46	58	—	—	—	—	—	—	—						
		12" x 8"	13	20	44	57	66	—	—	—	—	—	—						
		16" x 8"	7	26	41	55	67	80	—	—	—	—	—						
		20" x 8"	1	21	38	52	65	88	105	—	—	—	—						
		24" x 8"	1	16	24	43	62	86	108	125	—	—	—						
		30" x 8"	1	8	26	44	58	83	105	127	208	—	—						
		36" x 8"	1	1	22	39	54	80	103	124	206	240	—						
		42" x 8"	1	1	10	33	48	72	100	122	205	238	270						
		48" x 8"	1	1	7	27	44	73	97	120	203	236	269						
REDUCER (LARGER PIPE RESTRAINT)		6" x 8"	23	—	—	—	—	—	—	—	—	—	—						
		8" x 8"	28	25	—	—	—	—	—	—	—	—	—						
		10" x 8"	37	43	24	—	—	—	—	—	—	—	—						
		12" x 8"	72	60	44	41	—	—	—	—	—	—	—						
		16" x 8"	99	80	76	75	45	—	—	—	—	—	—						
		20" x 8"	123	116	107	105	81	46	—	—	—	—	—						
		24" x 8"	148	140	132	121	111	82	45	—	—	—	—						
		30" x 8"	205	204	197	188	177	153	116	75	—	—	—						
		36" x 8"	243	236	233	228	217	196	168	135	74	—	—						
		42" x 8"	273	270	265	259	234	211	183	133	73	—	—						
		48" x 8"	301	298	294	289	258	234	204	163	131	71	—						

NOTES:
1. THE DATA IN THE ABOVE TABLE ARE BASED UPON THE FOLLOWING INSTALLATION CONDITIONS:
204 TYPE-SAND TEST PRESSURE-150/200 PSI DEPTH OF BURIAL-3' TRENCH TYPE-1 SAFETY FACTOR-1.5 VERTICAL OFFSET-3' MINIMUM PIPE LENGTH ALONG THE MAIN-5'
2. THE RESTRAINED PIPE LENGTHS APPLY TO DUCTILE IRON AND PVC PIPE.
3. ALL JOINTS BETWEEN UPPER AND LOWER BENDS SHALL BE RESTRAINED.
4. RESTRAINED PIPE LENGTHS APPLY TO PIPE ON BOTH SIDES OF VALVES AND FITTINGS.

RESTRAINED JOINT INFORMATION

REVISIONS		ENGINEERING STANDARDS 2025		RESTRAINED JOINT INFORMATION	
BY	DATE	ENGINEERING DIVISION		CITY OF POMPANO BEACH	
		SCALE: N.T.S.		DATE: JAN. 2022 DWG. NO. 118-3	

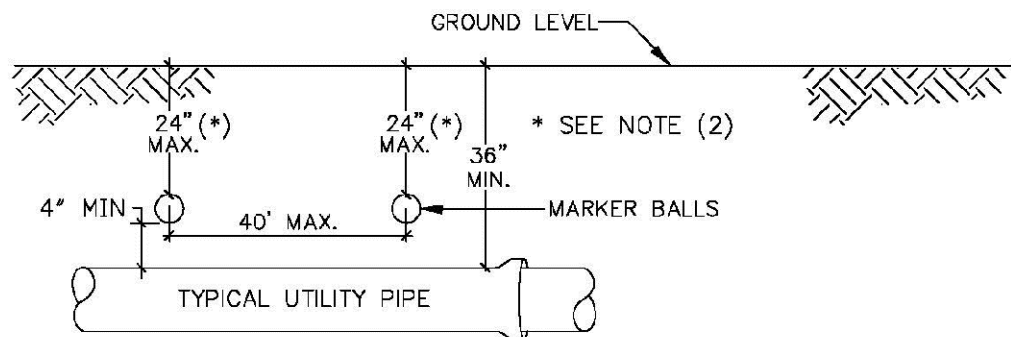

GENERAL NOTES:


- ALL UTILITY PIPE SHALL BE INSTALLED WITH 4"Ø MARKING BALLS PLACED EVERY 40' AND AT EVERY FITTING, FOR IDENTIFICATION AND WARNING PURPOSES, BURIED ABOVE THE PIPE AT A MAXIMUM DEPTH OF 24 INCHES OR AS APPROVED BY THE OWNER. IT SHALL BE COLOR CODED AND WORDED AS FOLLOWS:
POTABLE WATER:
A. COLOR: BLUE PER 62-555.320(21)(b)(3) F.A.C.
B. LETTERING: WATER
C. FREQUENCY OF MARKER BALLS SHALL BE 145.7 Khz.
D. THE MARKER BALLS CAN BE BURIED IN ANY ORIENTATION.

THE MARKER BALLS SHALL BE DETECTABLE BY STANDARD METAL DETECTION EQUIPMENT AND SHALL BE MANUFACTURED BY TEMPO OR 3M LOCATOR SYSTEM OR EQUIVALENT (FREQUENCY 145.7 Khz)

- FOR LARGE DIAMETER PIPE INSTALLED AT DEPTHS BELOW 4'-0" MARKER BALLS SHALL BE PLACED AT A MAXIMUM DEPTH OF 4'-0" BELOW GRADE *

WATER PIPE IDENTIFICATION

REVISIONS		ENGINEERING STANDARDS 2025		WATER PIPE IDENTIFICATION	
BY	DATE	ENGINEERING DIVISION		CITY OF POMPANO BEACH	
S.S.	01/12			DATE: JAN. 2022 DWG. NO. 119-1	
S.S.	05/16			SCALE: N.T.S.	

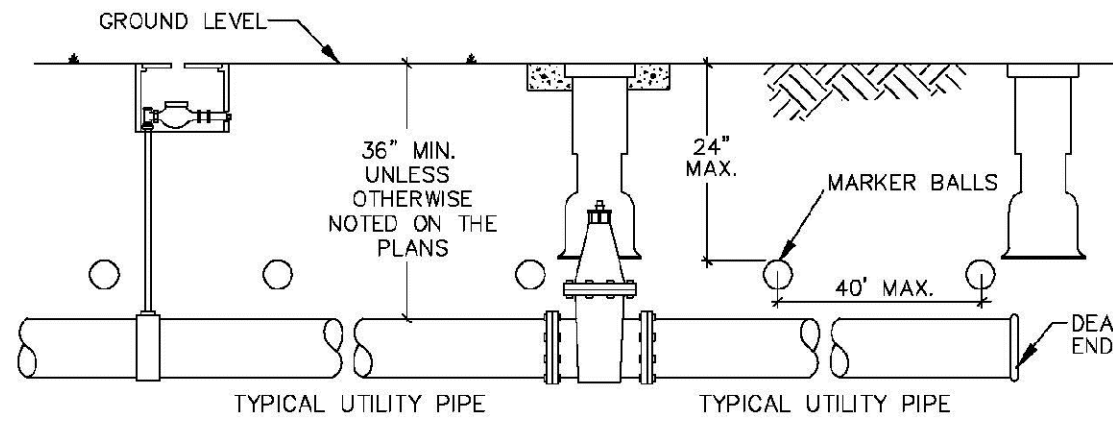


GENERAL NOTES:

- ALL NONMETALLIC PIPE SHALL BE INSTALLED WITH 12 THHN SOLID COPPER TRACING WIRE.
- THE MARKER BALLS MUST BE INSTALLED DIRECTLY ABOVE THE PIPE.
- MARKER BALLS SHALL BE INSTALLED AT 40' O.C.
- BALL COLOR CODING:
POTABLE WATER SYSTEM: BLUE PER 62-555.320(21)(b)(3) F.A.C.

UTILITY PIPE AND MARKER BALLS LOCATION

REVISIONS		ENGINEERING STANDARDS 2025		UTILITY PIPE AND MARKER BALLS LOCATION	
BY	DATE	ENGINEERING DIVISION		CITY OF POMPANO BEACH	
S.S.	01/12			DATE: JAN. 2022 DWG. NO. 120-1	
S.S.	06/16			SCALE: N.T.S.	

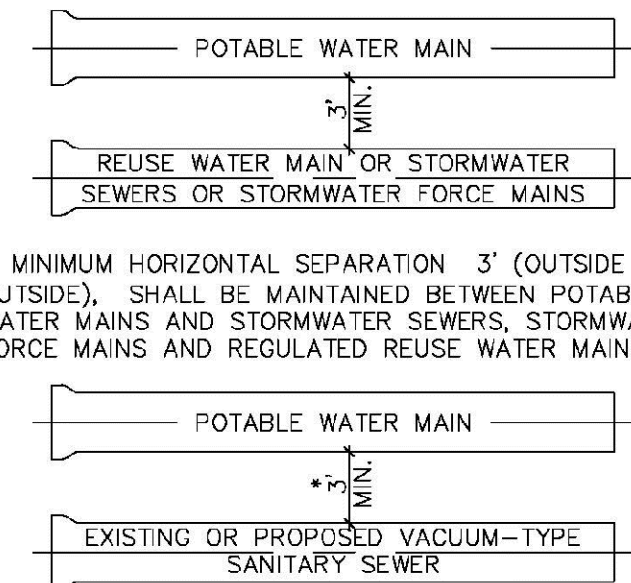


A MINIMUM HORIZONTAL SEPARATION 3' (OUTSIDE TO OUTSIDE), SHALL BE MAINTAINED BETWEEN POTABLE WATER MAINS AND STORMWATER SEWERS, STORMWATER FORCE MAINS AND REGULATED REUSE WATER MAINS.

A MINIMUM HORIZONTAL SEPARATION 3' (OUTSIDE TO OUTSIDE), SHALL BE MAINTAINED BETWEEN EXISTING OR PROPOSED VACUUM-TYPE SANITARY SEWER. * SEE NOTE D(1)(b).

A MINIMUM HORIZONTAL SEPARATION OF 6' (OUTSIDE TO OUTSIDE), SHALL BE MAINTAINED BETWEEN POTABLE WATER MAINS AND EXISTING OR PROPOSED GRAVITY-OR PRESSURE-TYPE SANITARY SEWER, WASTEWATER FORCE MAIN OR NOT REGULATED REUSE WATER MAIN. ** SEE NOTE D(1)(c).

MINIMUM HORIZONTAL SEPARATION REQUIREMENTS FOR POTABLE WATER, REUSE, STORMWATER AND SEWER LINES


REVISIONS		ENGINEERING STANDARDS 2025		MIN. HORIZONTAL SEPARATION FOR POTABLE WATER	
BY	DATE	ENGINEERING DIVISION		CITY OF POMPANO BEACH	
S.S.	01/12			DATE: JAN. 2022 DWG. NO. 121-1	
		SCALE: N.T.S.			

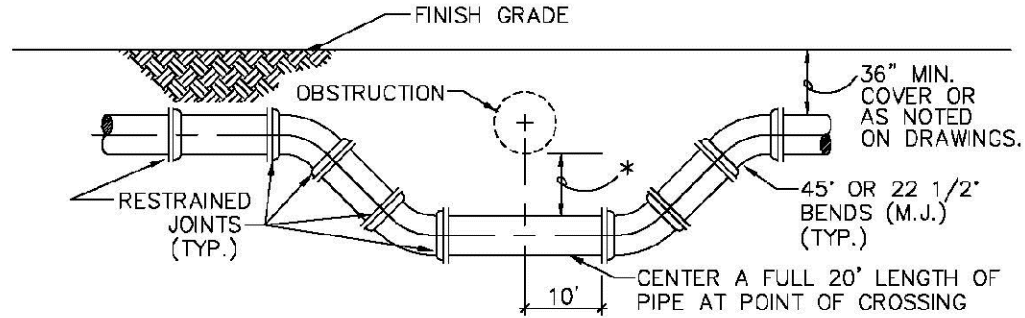

SPECIAL UTILITY CROSSING - FITTING TYPE

* 12" MINIMUM CLEARANCE REQUIRED FOR PRESSURE-TYPE SANITARY SEWER, WASTEWATER OR STORMWATER FORCE MAIN OR REUSE WATER MAIN CROSSINGS. IF MINIMUM CLEARANCE CANNOT BE OBTAINED, REFER TO "PROTECTION OF POTABLE WATER SUPPLY" FOR WATER MAIN CROSSINGS. SEE NOTE 2(b), ON STANDARD NO. 122-3

6" MINIMUM CLEARANCE REQUIRED FOR WATER AND STORMWATER, SEWER MAIN CROSSINGS. SEE NOTE 2(a), ON STANDARD NO. 122-3.

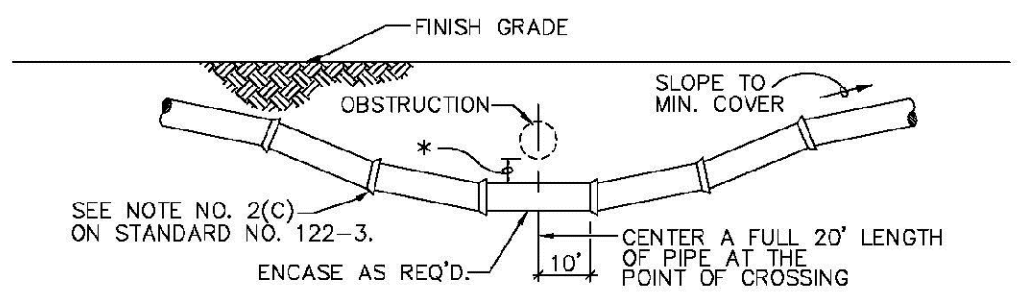

STANDARD UTILITY CROSSING - DEFLECTION TYPE

NOTES:

- THE DEFLECTION TYPE CROSSING SHALL BE USED WHEREVER POSSIBLE. ONLY UNDER SPECIFIC ORDERS BY THE ENGINEER SHALL THE FITTING TYPE CROSSING BE ALLOWED.
- CONSTRUCT STANDARD CROSSING USING NO MORE THAN 75% OF MANUFACTURERS' MAXIMUM JOINT DEFLECTION.
- FOR POTABLE WATER MAINS, REFER TO "PROTECTION OF POTABLE WATER SUPPLY".

UTILITY CROSSINGS

REVISIONS		ENGINEERING STANDARDS 2025		UTILITY CROSSINGS	
BY	DATE	ENGINEERING DIVISION		CITY OF POMPANO BEACH	
S.S.	01/12			DATE: JAN. 2022 DWG. NO. 122-1	
		SCALE: N.T.S.			

PROTECTION OF POTABLE WATER SUPPLY NOTES

A. GENERAL

IN ADDITION TO THESE REQUIREMENTS, ALL POTABLE WATER MAINS CONSTRUCTED IN THE VICINITY OF STORM SEWERS, SANITARY SEWERS OR FORCE MAINS SHALL COMPLY WITH THE APPLICABLE PROVISIONS OF FLORIDA ADMINISTRATIVE CODE CHAPTER 62-555, GREAT LAKES-UPPER MISSISSIPPI RIVER BOARD OF STATE SANITARY ENGINEERS (GLUMRB) "RECOMMENDED STANDARDS FOR WATER WORKS", AND GLUMRB "RECOMMENDED STANDARDS FOR WASTEWATER FACILITIES".

B. DEFINITIONS

FOR THE PURPOSES OF THIS SPECIFICATION, THE WORDS "OTHER PIPE" OR "OTHER PIPES" SHALL MEAN SANITARY SEWER MAIN, SEWAGE FORCE MAIN, STORMWATER MAIN OR ANY COMBINATION THEREOF.

C. CROSS CONNECTIONS PROHIBITED

THERE SHALL BE NO PHYSICAL CONNECTIONS BETWEEN A PUBLIC OR PRIVATE POTABLE WATER SUPPLY SYSTEM AND ANY OTHER PIPE OR APPURTENANCE THERETO WHICH WOULD PERMIT THE PASSAGE OF ANY WASTEWATER, POLLUTED WATER, OR ANY OTHER WATER INTO THE POTABLE SUPPLY. NO WATER PIPE SHALL PASS THROUGH OR COME INTO CONTACT WITH ANY PART OF A SANITARY SEWER MANHOLE OR STORMWATER MANHOLE.

D. RELATION OF OTHER PIPES TO POTABLE WATER MAINS

1. HORIZONTAL SEPARATION

A. NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST THREE FEET BETWEEN THE OUTSIDE OF THE WATER MAIN AND THE OUTSIDE OF ANY EXISTING OR PROPOSED STORM WATER, STORM WATER FORCE MAIN, OR PIPELINE CONVEYING REUSE WATER NOT REGULATED UNDER PART III OF CHAPTER 62-610,F.A.C.

B. NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST THREE FEET, AND PREFERABLY TEN FEET, BETWEEN THE OUTSIDE OF THE WATER MAIN AND THE OUTSIDE OF ANY EXISTING OR PROPOSED VACUUM-TYPE SANITARY SEWER.

C. NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST SIX FEET, AND PREFERABLY TEN FEET, BETWEEN THE OUTSIDE OF THE WATER MAIN AND THE OUTSIDE OF ANY EXISTING OR PROPOSED GRAVITY-OR PRESSURE-TYPE SANITARY SEWER, WASTEWATER FORCE MAIN, OR PIPELINE CONVEYING REUSE WATER NOT REGULATED UNDER CHAPTER 62-610, F.A.C. THE MINIMUM HORIZONTAL SEPARATION DISTANCE BETWEEN WATER MAINS AND GRAVITY-TYPE SEWERS SHALL BE REDUCED TO THREE FEET WHERE THE BOTTOM OF THE WATER IS LAID AT LEAST SIX INCHES ABOVE THE TOP OF THE SEWER.

REVISIONS		ENGINEERING STANDARDS 2025		POTABLE WATER SUPPLY NOTES	
BY	DATE	ENGINEERING DIVISION		CITY OF POMPANO BEACH	
S.S.	01/12			DATE: JAN. 2022 DWG. NO. 122-2	
		SCALE: N.T.S.			

- NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST TEN FEET BETWEEN THE OUTSIDE OF THE WATER MAIN AND ALL PARTS OF ANY EXISTING OR PROPOSED "ON-SITE SEWAGE TREATMENT AND DISPOSAL SYSTEM".
- VERTICAL SEPARATION
 - NEW OR RELOCATED, UNDERGROUND WATER MAINS CROSSING ANY EXISTING OR PROPOSED GRAVITY-OR VACUUM-TYPE SANITARY SEWER OR STORM SEWER SHALL BE LAID SO THE OUTSIDE OF THE WATER MAIN IS AT LEAST SIX INCHES, AND PREFERABLY 12 INCHES, ABOVE OR AT LEAST 12 INCHES BELOW THE OUTSIDE OF THE OTHER PIPELINE. HOWEVER, IT IS PREFERABLE TO LAY THE WATER MAIN ABOVE THE OTHER PIPELINE.
 - NEW OR RELOCATED, UNDERGROUND WATER MAINS CROSSING ANY EXISTING OR PROPOSED PRESSURE-TYPE SANITARY SEWER, WASTEWATER OR STORM WATER FORCE MAIN, OR PIPELINE CONVEYING REUSE WATER SHALL BE LAID SO THE OUTSIDE OF THE WATER MAIN IS AT LEAST 12 INCHES, ABOVE OR BELOW THE OUTSIDE OF THE OTHER PIPELINE. HOWEVER, IT IS PREFERABLE TO LAY THE WATER MAIN ABOVE THE OTHER PIPELINE.
 - AT THE UTILITY CROSSINGS DESCRIBED IN PARAGRAPHS (A) AND (B) ABOVE, ONE FULL LENGTH OF WATER MAIN PIPE SHALL BE CENTERED ABOVE OR BELOW THE OTHER PIPELINE SO THE WATER MAIN JOINTS WILL BE AS FAR AS POSSIBLE FROM THE OTHER PIPELINE. ALTERNATIVELY, AT SUCH CROSSINGS, THE PIPES SHALL BE ARRANGED SO THAT ALL WATER MAIN JOINTS ARE AT LEAST THREE FEET FROM ALL JOINTS IN VACUUM-TYPE SANITARY SEWERS, STORM SEWERS, STORM WATER FORCE MAINS, OR PIPELINES CONVEYING REUSE WATER REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C. AND AT LEAST SIX FEET FROM ALL JOINTS IN GRAVITY- OR PRESSURE-TYPE SANITARY SEWERS, WASTEWATER FORCE MAINS, OR PIPELINES CONVEYING REUSE WATER NOT REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C. WHERE THE HORIZONTAL CAN BE LOCATED LESS THAN THE REQUIRED MINIMUM DISTANCES FROM JOINTS IN THE OTHER PIPELINE OR THE HORIZONTAL IS LESS THAN THREE FEET FROM ANOTHER PIPELINE OR THE UNDER GROUND WATER MAIN IS CROSSING ANOTHER PIPELINE AND IS LESS THAN THE REQUIRED MINIMUM VERTICAL DISTANCE FROM THE OTHER PIPELINE, THE CONTRACTOR SHALL CONTACT THE ENGINEER IMMEDIATELY FOR RECOMMENDED SOLUTIONS TO MEET THE FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION REQUIREMENTS PER CHAPTER 62-555, F.A.C.

PROTECTION OF POTABLE WATER SUPPLY NOTES

ENGINEERING STANDARDS 2025			
REVISIONS		ENGINEERING DIVISION CITY OF POMPANO BEACH	POTABLE WATER SUPPLY NOTES
BY	DATE		
S.S.	01/12		
		SCALE: N.T.S.	DATE: JAN. 2022
			DWG. NO.
			122-3