

SECTION 907  
FIRE ALARM AND DETECTION SYSTEMS (2020  
F.B.C., B., 7th EDITION)

907.2.9 GROUP R-2  
FIRE ALARM SYSTEMS AND SMOKE ALARMS SHALL BE INSTALLED IN GROUP R-2  
OCCUPANCIES AS REQUIRED IN SECTIONS 907.2.9.1 AND 907.2.9.3.

907.2.9.2 SMOKE ALARMS,  
SINGLE- AND MULTIPLE-STATION SMOKE ALARMS SHALL BE INSTALLED IN ACCORDANCE  
WITH SECTION 907.2.11.

907.2.11.2 GROUPS R-2, R-3, R-4 AND I-1,  
SINGLE- OR MULTIPLE-STATION SMOKE ALARMS SHALL BE INSTALLED AND MAINTAINED IN  
GROUPS R-2, R-3, R-4 AND I-1 REGARDLESS OF OCCUPANT LOAD AT ALL OF THE  
FOLLOWING LOCATIONS:

1. ON THE CEILING OR WALL OUTSIDE OF EACH SEPARATE SLEEPING AREA IN  
THE IMMEDIATE VICINITY OF BEDROOMS.
2. IN EACH ROOM USED FOR SLEEPING PURPOSES

907.5.2 ALARM NOTIFICATION APPLIANCES.  
ALARM NOTIFICATION APPLIANCES SHALL BE PROVIDED AND SHALL BE LISTED FOR THEIR  
PURPOSE.

907.5.2.3.3 GROUP R-2,  
IN GROUP R-2 OCCUPANCIES REQUIRED BY SECTION 907 TO HAVE A FIRE ALARM  
SYSTEM, EACH STORY THAT CONTAINS DWELLING UNITS AND SLEEPING UNITS SHALL BE  
PROVIDED WITH THE CAPABILITY TO SUPPORT VISIBLE ALARM NOTIFICATION APPLIANCES IN  
ACCORDANCE WITH CHAPTER 11. SUCH CAPABILITY SHALL ACCOMMODATE WIRED OR  
WIRELESS EQUIPMENT. THE FUTURE CAPABILITY SHALL INCLUDE ONE OF THE FOLLOWING:

1. THE INTERCONNECTION OF THE BUILDING FIRE ALARM SYSTEM WITH THE UNIT SMOKE  
ALARMS.
2. THE REPLACEMENT OF AUDIBLE APPLIANCES WITH COMBINATION AUDIBLE/VISIBLE  
APPLIANCES.
3. THE FUTURE EXTENSION OF THE EXISTING WIRING FROM THE UNIT SMOKE ALARM  
LOCATIONS TO REQUIRED LOCATIONS FOR VISIBLE APPLIANCES.

ALARM NOTIFICATION APPLIANCES

ALL DWELLING UNITS SHALL BE EQUIPPED WITH THE CAPABILITY TO INCORPORATE AND  
SUPPORT ALARM NOTIFICATION APPLIANCES AS PER THE REQUIREMENTS OF SECTION  
907.9.1.4 FLORIDA BUILDING CODE F.B.C. 7TH EDITION (2020)

2020 FLORIDA BUILDING CODE,  
ACCESSIBILITY, 7th EDITION

303 CHANGES IN LEVEL

303.2 VERTICAL  
CHANGES IN LEVEL OF 1/4 INCH (6.4 MM) HIGH MAXIMUM SHALL BE PERMITTED TO BE  
VERTICAL.

303.3 BEVELED.  
CHANGES IN LEVEL BETWEEN 1/4 INCH (6.4 MM) HIGH MINIMUM AND 1/2 INCH (13  
MM) HIGH MAXIMUM SHALL BE BEVELED WITH A SLOPE NOT STEEPER THAN 1:2.

307 PROTRUDING OBJECTS

307.2 PROTRUSION LIMITS.  
OBJECTS WITH LEADING EDGES MORE THAN 27 INCHES (685 MM) AND NOT MORE THAN  
80 INCHES (2030 MM) ABOVE THE FINISH FLOOR OR GROUND SHALL PROTRUDE 4  
INCHES (100 MM) MAXIMUM HORIZONTALLY INTO THE CIRCULATION PATH.

EXCEPTION: HANDRAILS SHALL BE PERMITTED TO PROTRUDE 4 1/2 INCHES (115  
MM) MAXIMUM.

307.3 POST-MOUNTED OBJECTS.  
FREE-STANDING OBJECTS MOUNTED ON POSTS OR PYLONS SHALL OVERHANG  
CIRCULATION PATHS 12 INCHES (305 MM) MAXIMUM WHEN LOCATED 27 INCHES (685  
MM) MINIMUM AND 80 INCHES (2030 MM) MAXIMUM ABOVE THE FINISH FLOOR OR  
GROUND, WHERE A SIGN OR OTHER OBSTRUCTION IS MOUNTED BETWEEN POSTS OR  
PYLONS AND THE CLEAR DISTANCE BETWEEN THE POSTS OR PYLONS IS GREATER THAN  
12 INCHES (305 MM), THE LOWEST EDGE OF SUCH SIGN OR OBSTRUCTION SHALL BE  
27 INCHES (685 MM) MAXIMUM OR 80 INCHES (2030 MM) MINIMUM ABOVE THE FINISH  
FLOOR OR GROUND.

EXCEPTION: THE SLOPING PORTIONS OF HANDRAILS SERVING STAIRS AND RAMPS  
SHALL NOT BE REQUIRED TO COMPLY WITH 307.3.

307.4 VERTICAL CLEARANCE.  
VERTICAL CLEARANCE SHALL BE 80 INCHES (2030 MM) HIGH MINIMUM. GUARDRAILS OR  
OTHER BARRIERS SHALL BE PROVIDED WHERE THE VERTICAL CLEARANCE IS LESS THAN  
80 INCHES (2030 MM) HIGH. THE LEADING EDGE OF SUCH GUARDRAIL OR BARRIER  
SHALL BE LOCATED 27 INCHES (685 MM) MAXIMUM ABOVE THE FINISH FLOOR OR  
GROUND.

EXCEPTION: DOOR CLOSERS AND DOOR STOPS SHALL BE PERMITTED TO BE 78  
INCHES (1980 MM) MINIMUM ABOVE THE FINISH FLOOR OR GROUND.

307.5 REQUIRED CLEAR WIDTH.  
PROTRUDING OBJECTS SHALL NOT REDUCE THE CLEAR WIDTH REQUIRED FOR  
ACCESSIBLE ROUTES.

BUILDING PLAN NOTES

1. DO NOT SCALE DRAWINGS USE FIGURE DIMENSIONS ONLY. CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS, IN THE EVENT OF A CONFLICT  
NOTIFY ARCHITECT BEFORE PROCEEDING.
2. BUILDING FOOTPRINT SHOWN FOR DIMENSION AND NOTES PURPOSE ONLY, REFER TO SITE PLAN FOR ACTUAL BUILDING ORIENTATION.
3. REFER TO CIVIL DRAWINGS AND ARCHITECTURAL SITE PLAN FOR SIDEWALKS CONTINUATION. EXTERIOR WALKWAYS TO BE SLOPED AWAY FROM THE BUILDING  
ENTRANCES AT 1 TO 20 SLOPE (REFER TO CIVIL GRADING PLANS).
4. SOIL TO BE TREATED FOR TERMITES BEFORE POURING SLABS.GENERAL CONTRACTOR TO PROVIDE TO THE BUILDING DEPARTMENT A CERTIFICATE OF  
COMPLIANCE PREPARED BY A LICENSED PEST CONTROL COMPANY THAT CONTAINS THE FOLLOWING STATEMENT:"THE BUILDING HAS RECEIVED A COMPLETE  
TREATMENT FOR THE PREVENTION OF SUBTERANEAN TERMITES. TREATMENT IS IN ACCORDANCE WITH RULES AND LAWS ESTABLISHED BY THE FLORIDA  
DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES" PER F.B.C. 7TH EDITION (2020) SECTION 1816.1.7
5. STORAGE AREA UNDER STAIRS FOR ELECT. CLOSETS ONLY.
6. REFER TO TABLES 601 & TABLE 602 ON SHEET A0.04 FOR BUILDING FIRE PROTECTION.
7. REFER TO ARCHITECTURAL SITE PLAN FOR ELECTRICAL ROOM, TELEPHONE/CABLE ROOM AND FIRE SPRINKLER CABINET LOCATION AND ORIENTATION.
8. EACH BUILDING SHALL HAVE ITS OWN FIRE ALARM CONTROL PANEL FOR OCCUPANCY NOTIFICATION  
AND MONITORING OF THE FIRE SPRINKLER SYSTEM (SEE FIRE PREVENTION DOCUMENTS).
9. BUILDINGS TO BE EQUIPPED THROUGHOUT WITH AN APPROVED AUTOMATIC SPRINKLER SYSTEM IN  
ACCORDANCE WITH F.B.C. 2020 7TH EDITION, SECTION 903.3.1.2 (SEPARATE PERMIT REQUIRED).
10. REFER TO SITE PLAN & ELECTRICAL DWGS FOR HEARING-IMPAIRED UNIT LOCATIONS.
11. ALL FIRE RATED TENANT SEPARATIONS FROM SLAB, ALL FIRE AND SMOKE BARRIER PENETRATIONS TO BE PROTECTED.
12. PROVIDE PERMANENTLY IDENTIFIED WITH SIGNS OR STENCILING IN A MANNER ACCEPTABLE TO THE AUTHORITY HAVING JURISDICTION IN ACCORDANCE WITH THE  
FLORIDA BUILDING CODE, SECTION 713.6 "FIRE WALLS, FIRE BARRIERS, FIRE PARTITIONS, SMOKE BARRIERS AND SMOKE PARTITIONS OR ANY OTHER WALL  
REQUIRED TO HAVE PROTECTED OPENINGS SHALL BE EFFECTIVELY AND PERMANENTLY IDENTIFIED WITH SIGNS OR STENCILING IN A MANNER ACCEPTABLE TO  
THE AUTHORITY HAVING JURISDICTION. SUCH IDENTIFICATION SHALL BE ABOVE ANY DECORATIVE CEILING AND IN CONCEALED SPACES. SUGGESTED WORDING FOR  
FIRE AND SMOKE BARRIERS: "FIRE AND SMOKE BARRIER - PROTECT ALL OPENINGS."
13. LANDINGS SUBJECT TO WET CONDITIONS SHALL BE CONSTRUCTED TO PREVENT THE ACCUMULATION OF WATER (PER FBCA SEC. 405.10)

BUILDING # 1

- A) NUMBER OF UNITS: 38  
B) UNIT TYPES MIX: (18) UNITS A-(17) UNITS B  
(3) UNITS C 2  
C) BUILDING AREA AT GROUND  
LEVEL - SF. ( BASIC AREA )  
ALLOWED 20,000 S.F  
PROVIDED 14,803 S.F

- D) TOTAL BUILDING AREA:  
1ST FL: 14,803 S.F  
2ND FL: 14,803 S.F  
3RD FL: 14,803 S.F  
TOTAL: 44,409 S.F

- E) BUILDING HEIGHT: 30'-6" (TOP OF ROOF SLAB)

- F) OCCUPANCY TYPE:  
R-2 MULTI-FAMILY DWELLING  
PER FBC 7TH EDITION (2020) SECTION 310

- G) CONSTRUCTION TYPE:  
TYPE II (B)  
(SPRINKLER-NFPA S13R)

- H) NO. OF STORIES: 4 (ALLOWED)  
3 (PROVIDED)

- J) A/C BUILDING AREA:  
1ST FL: 12,364 S.F  
2ND FL: 12,364 S.F  
3RD FL: 12,364 S.F  
TOTAL: 37,092 S.F

NOTE:  
ALLOWABLE HEIGHT AND BUILDING AREAS PER  
TABLE 504.3 & 506.2 FLORIDA BUILDING CODE 7TH EDITION  
(2020).

WALL TYPES:

- CONC. BLOCK W/ STUCCO FINISH EXTERIOR AND  
5/8" GYP. BD ON 2X2 P.T FURRING  
NON RATED MTL. STUD PARTITION

- 1-HOUR RATED MTL PARTITION

- 1-HOUR RATED MTL PARTITION WITH CONC. FILLED  
STEEL COLUMN (PROVIDE MASTIC COATING ON  
EXPOSED -NON PROTECTED STRUCTURAL STEEL  
PLATES & BASE, APPLICATION PER MANUFACTURER  
SPECIFICATIONS).


- DOOR DESIGNATION  
REFER TO DOOR SCHEDULE

- WINDOW DESIGNATION  
REFER TO WINDOW SCHEDULE

- DROP SOFFITS G.W.B. SOFFIT AT 8'-4" (U.O.N) A.F.F.  
WITHIN UNITS AND 8'-4" (U.O.N) A.F.F. BREEZEWAY  
CORRIDOR, METAL FRAME. REFER TO DETAIL 22/A7.03

- F.E. PROVIDE FIRE EXT. 2A 40BC TYPE (FIRE  
EXTINGUISHER TO  
COMPLY W/F.B.C. CHAPTER 36 F.F.P.C. 7.6.3.1 &  
N.F.P.A 10) MAXIMUM TRAVEL DISTANCE TO A FIRE  
EXTINGUISHER - 75 FT FOR ORDINARY HAZARD  
AREAS. FIRE EXTINGUISHERS SHOULD BE MOUNTED  
MINIMUM 4 INCHES AND MAXIMUM 5FT FROM FLOOR,  
IF FIRE EXTINGUISHER IS LESS THAN 40LB IN  
WEIGHT.

- ALL INSULATION MATERIALS TO HAVE A FLAME  
SPREAD INDEX OF NOT MORE THAN 25 AND A  
SMOKE-DEVELOPED INDEX OF NOT MORE THAN  
450. PER FBC 7TH EDITION (2020), SECT 719.2

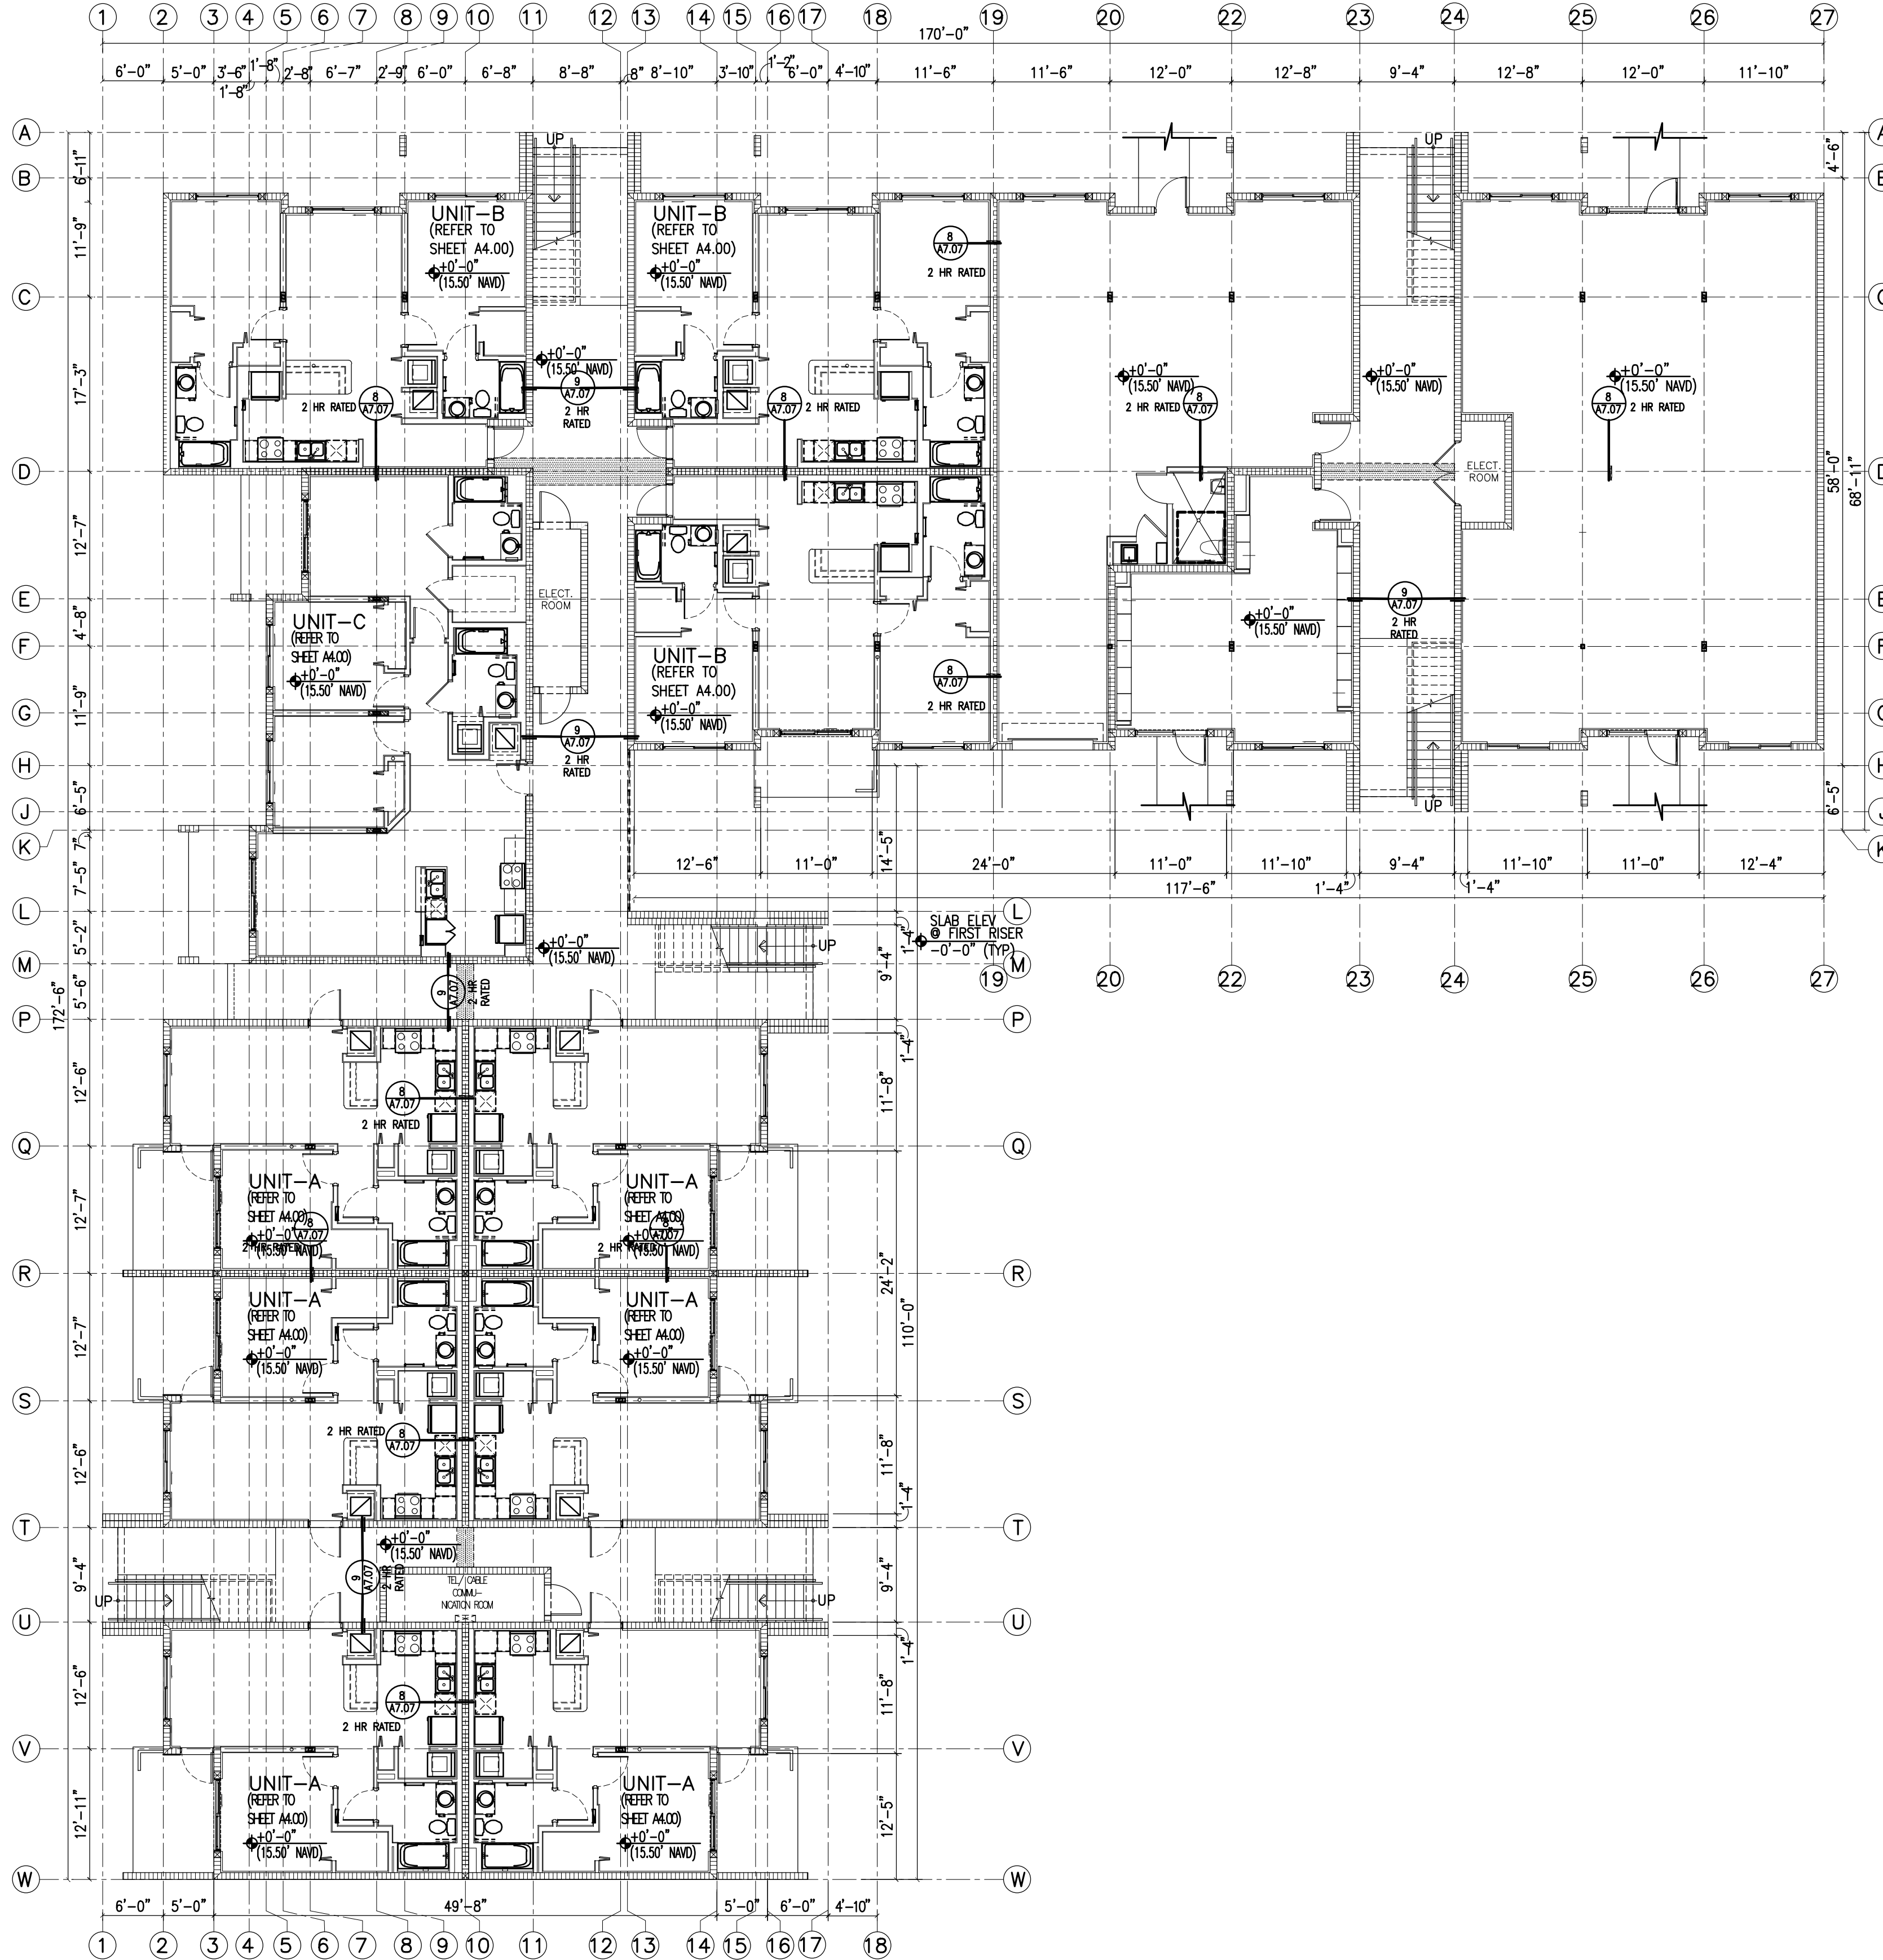

GROUND FLOOR PLAN\_BUILDING #1

SCALE: 3/32" = 1'-0"

REVISIONS:

REV.	REV. ISSUE
1	05/10/2022

2203

GATEWAY LUXURY  
APARTMENTS  
LOCATED AT:  
950 N POWERLINE ROAD,  
POMPANO BEACH FL 33069

BURGOS LANZA & ASSOCIATES  
1249 S ALHAMBRA CIRCLE  
CORAL GABLES, FL 33146  
(786) 554-9035  
AIA 38062698  
WWW.BURGOSLANZA.COM

BURGOS  
LANZA  
ARCHITECTS & PLANNERS  
AA 28001519  
PABLO BURGOS ARCHITECT AND ASSOCIATES  
CARLOS LANZA ARCHITECT AND ASSOCIATES  
COPYRIGHT 2021 BURGOS LANZA & ASSOCIATES  
THE ARCHITECTURAL DESIGN AND DETAIL DRAWINGS ARE THE LEGAL PROPERTY OF BURGOS LANZA ARCHITECTS AND ASSOCIATES  
INSTRUMENTS OF SERVICE NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE EXPRESS WRITTEN CONSENT OF THE SAME

Pablo  
Burgos

Digitally signed by Pablo Burgos  
DN: cn=Pablo Burgos, o=Burgos  
Lanza & Assoc., ou=AR95925,  
email=pburgos@burgoslanza.com,  
c=US  
Date: 2022.05.16 12:23:34 -0400

DATE 11/09/21  
DRAWN CR  
PROJECT No. 2203  
SCALE AS-SHOWN

GROUND FLOOR PLAN

BUILDING #1  
SCALE: 3/32" = 1'-0"

A111

DRC

PZ22-12000008  
6/15/2022