

LEGEND:

- CONNECT ALL EXIT SIGNS AND BATTERY PACKS IN EMERGENCY LIGHT FIXTURES AHEAD OF ANY LIGHTING CONTROL DEVICE FOR CONTINUOUS OPERATION OF THE BATTERY CHARGER.
- MEANS OF EGRESS ILLUMINATION LEVEL, INCLUDING STAIRWELLS, SHALL NOT BE LESS THAN 1 FOOTCANDLE AT THE WALKING SURFACE AS REQUIRED BY FBC.

FIRE ALARM SYMBOL  
LEGEND:

WP HORN/STROBE WALL MOUNTED WEATHER PROOF, AT 80" AFF TO BOTTOM

F PULL STATION AT 48" AFF TO CENTER

SYMBOL KEY

B OCCUPANCY  
2,500 SQUARE FOOTAGE (SQUARE FEET)  
1:100 OCCUPANT LOAD FACTOR  
25 NUMBER OF OCCUPANTS

4.3 STAIR OPENING CLEAR WIDTH  
4.4 MAXIMUM CAPACITY (0.3)  
4.4 ACTUAL CAPACITY

XX DIRECTION OF EGRESS AND OCCUPANT LOAD

WALL TYPES:

CONC. BLOCK W/ STUCCO FINISH EXTERIOR AND 5/8" GYP. BD ON 2X2 P.T FURRING  
NON RATED MTL. STUD PARTITION

1-HOUR RATED MTL PARTITION

1-HOUR RATED MTL PARTITION WITH CONC. FILLED STEEL COLUMN (PROVIDE MASTIC COATING ON EXPOSED -NON PROTECTED STRUCTURAL STEEL PLATES & BASE. APPLICATION PER MANUFACTURER SPECIFICATIONS).


DOOR DESIGNATION  
REFER TO DOOR SCHEDULE

WINDOW DESIGNATION  
REFER TO WINDOW SCHEDULE

DROP SOFFITS G.W.B. SOFFIT AT 8'-4" (U.O.N) A.F.F. WITHIN UNITS AND 8'-4" (U.O.N) A.F.F. BREEZEWAY CORRIDOR, METAL FRAME. REFER TO DETAIL 22/A7.03

F.E. PROVIDE FIRE EXT. 2A 40BC TYPE (FIRE EXTINGUISHER TO COMPLY W/F.B.C. CHAPTER 36 F.F.P.C. 7.6.3.1 & N.F.P.A 10) MAXIMUM TRAVEL DISTANCE TO A FIRE EXTINGUISHER - 75 FT FOR ORDINARY HAZARD AREAS. FIRE EXTINGUISHERS SHOULD BE MOUNTED MINIMUM 4 INCHES AND MAXIMUM 5FT FROM FLOOR, IF FIRE EXTINGUISHER IS LESS THAN 40LB IN WEIGHT.

ALL INSULATION MATERIALS TO HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 450. PER FBC 7th EDITION (2020), SECT 719.2

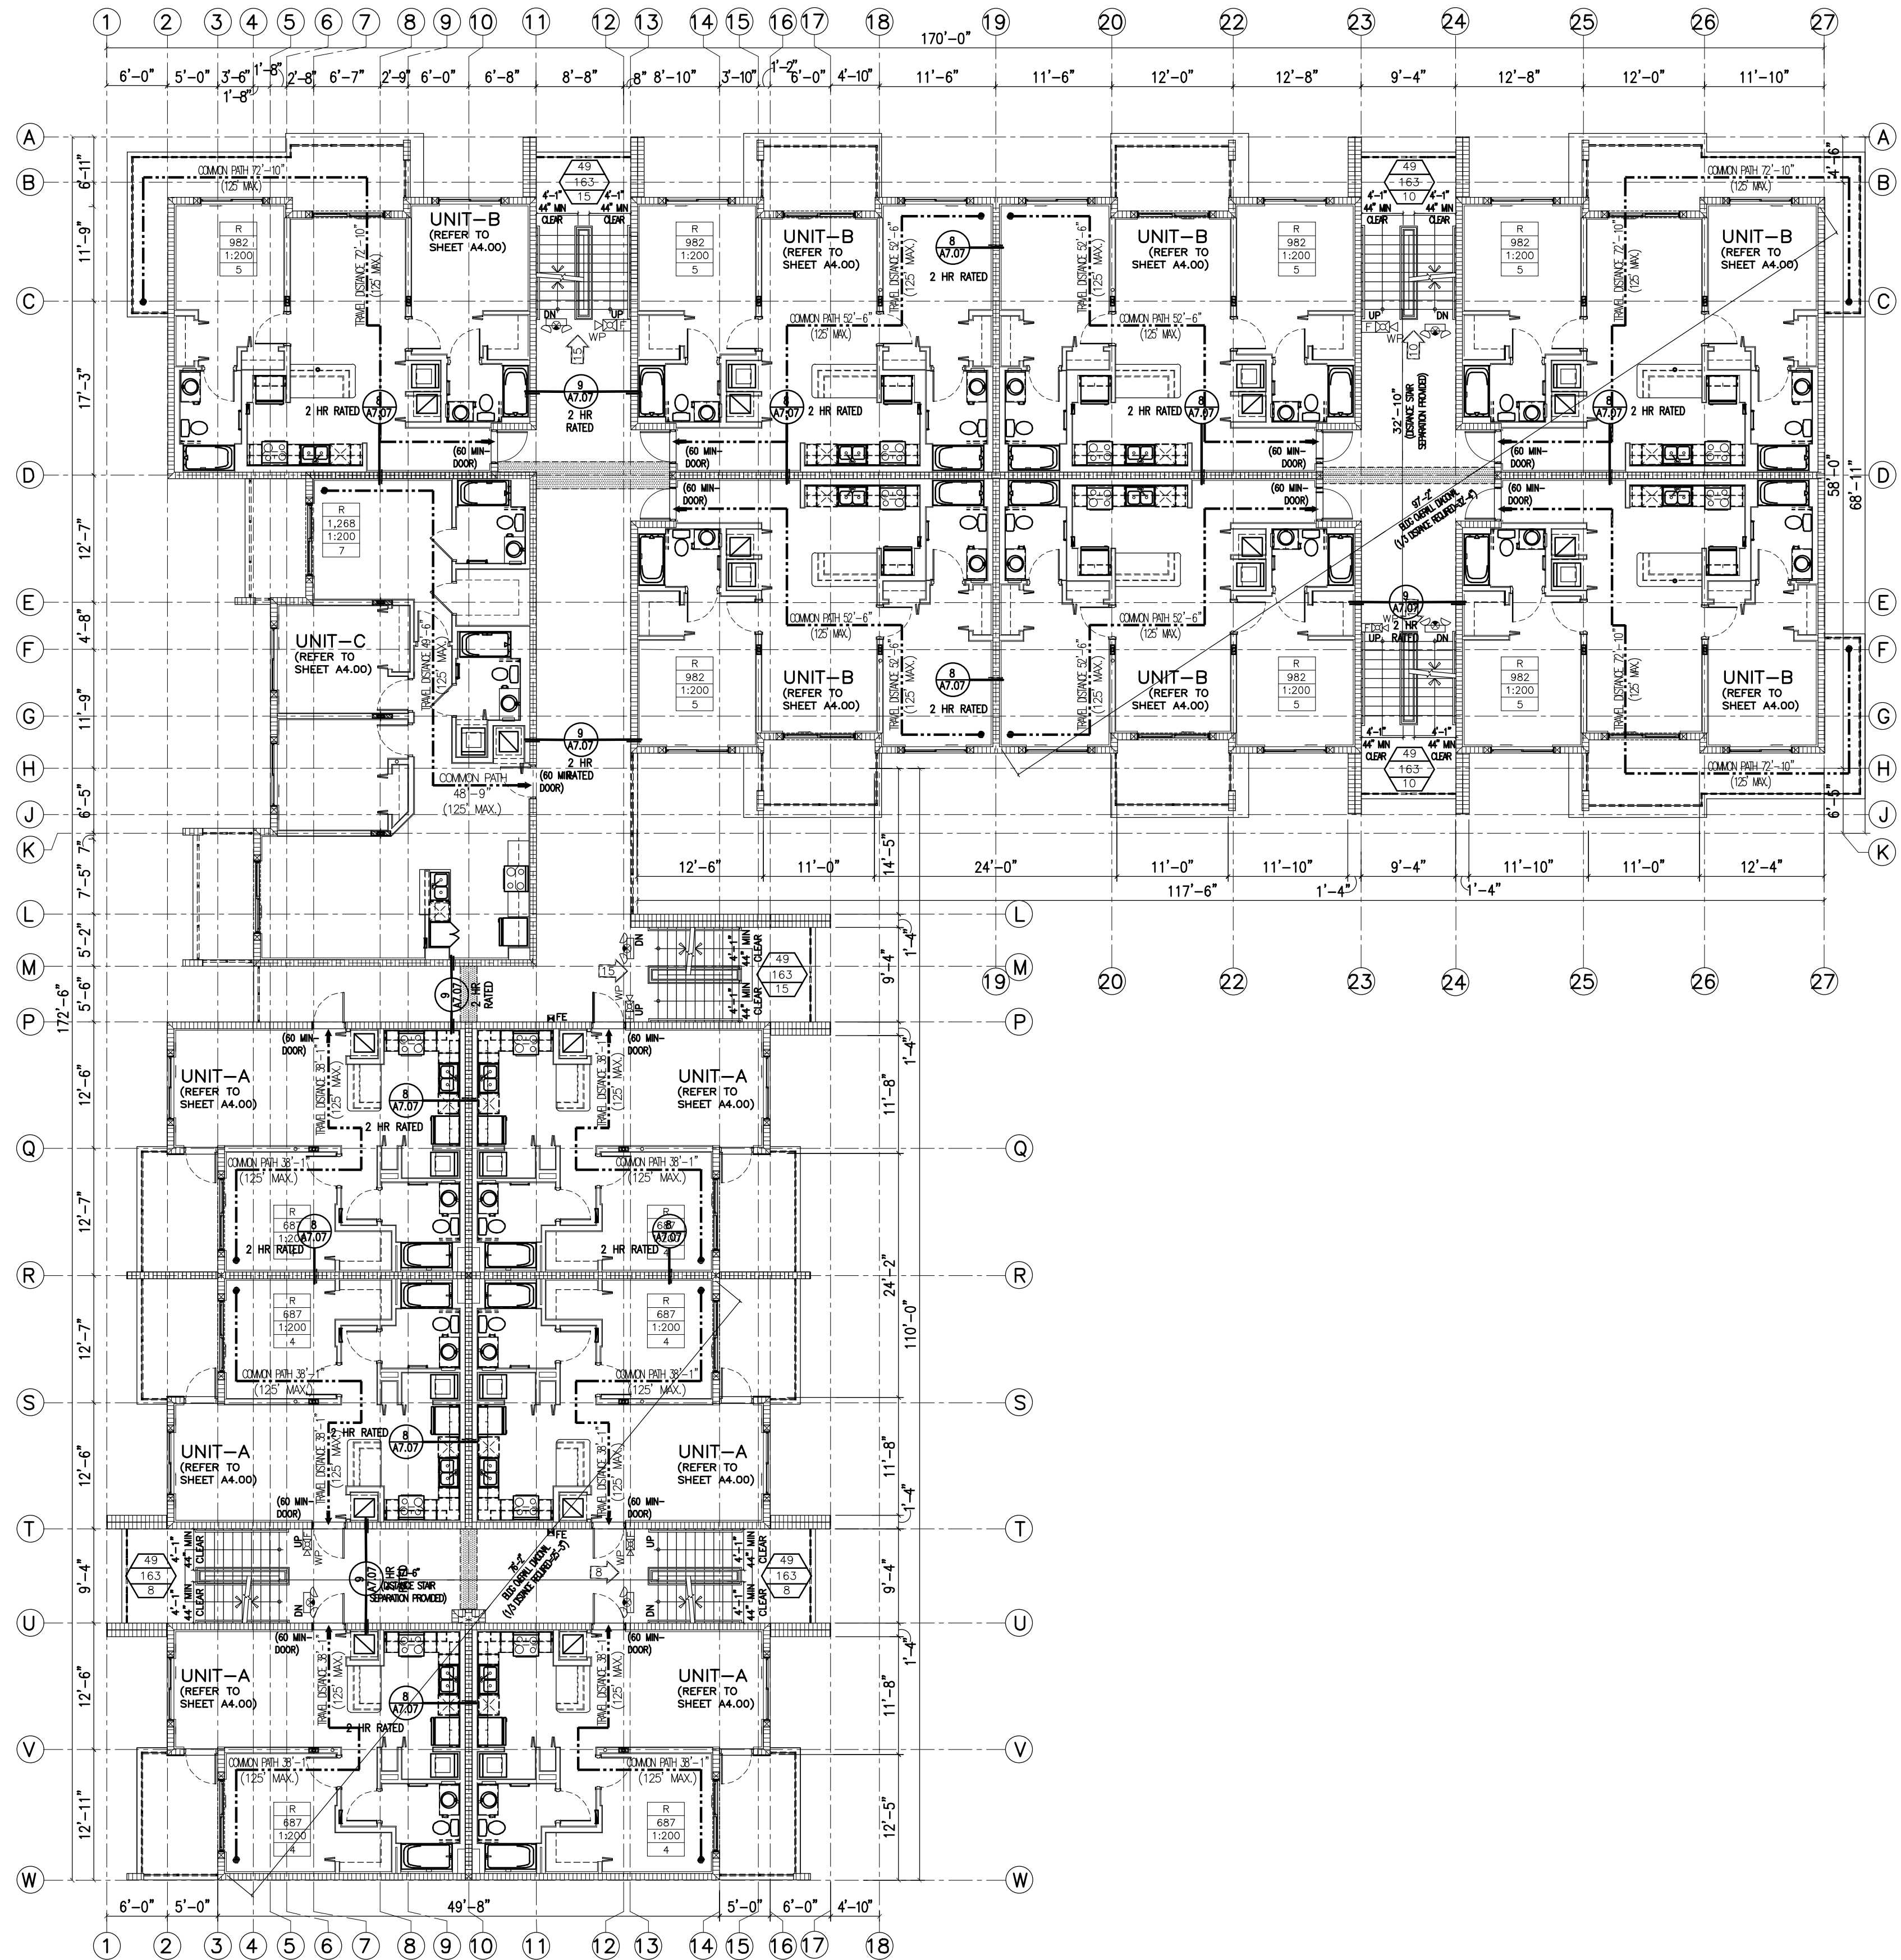

SECOND FLOOR PLAN - LIFE SAFETY - BUILDING #1

SCALE: 3/32" = 1'-0"

REVISIONS:

REV.	REV. ISSUE
1	05/10/2022

2203

GATEWAY LUXURY  
APARTMENTS  
LOCATED AT:  
950 N POWERLINE ROAD,  
POMPANO BEACH FL 33069

BURGOS LANZA & ASSOCIATES  
1248 S ALHAMBRA CIRCLE  
CORAL GABLES, FL 33146  
(786) 554-9036  
AIA 38052596  
WWW.BURGOSLANZA.COM

BURGOS  
LANZA  
ARCHITECTS & PLANNERS  
AIA 26001519

Pablo  
Burgos

Digitally signed by Pablo Burgos  
DN: cn=Pablo Burgos, o=Burgos  
Lanza & Assoc., ou=AR95925,  
email=pburgos@burgoslanza.co  
m, c=US  
Date: 2022.05.11 17:17:26 -04'00'

DATE 11/09/21  
DRAWN CR  
PROJECT No. 2203  
SCALE AS-SHOWN

SECOND FLOOR LIFE

SAFETY PLAN #1

SCALE 1/32" = 1'-0"

1/32" = 1'-0"

DRC

PZ22-12000008

6/15/2022